



NOTE:
BARS MAY BE DISPLACED. NO ADDITIONAL BARS NECESSARY.

HOLE < 150mm
A S/004 DETAIL

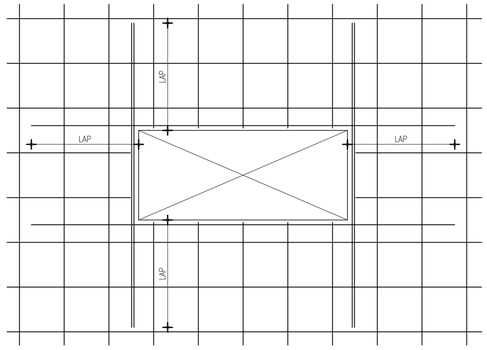


NOTE:
CUT BARS INTERRUPTED BY HOLE PROVIDE TRIMMER BARS SAME DIA, TYPE & NO. AS CUT BARS.

150mm < HOLE < 450mm
B S/004 DETAIL

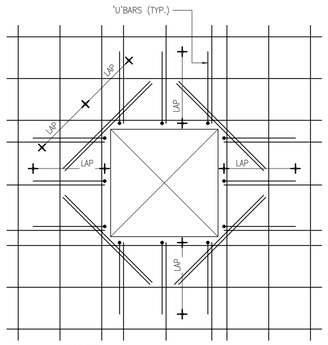


NOTE:
PROVIDE TRIMMER BARS AS DETAIL B. IN ADDITION PROVIDE DIAGONAL TRIMMERS OF SAME DIA, TYPE & NUMBER AS DETAIL B TRIMMERS. PROVIDE ALSO VERTICAL AND HORIZONTAL 'U'-BARS SAME TYPE & DIA. AS THE VERTICAL & HORIZONTAL BARS RESPECTIVELY.

450< HOLE < 900mm
C S/004 DETAIL

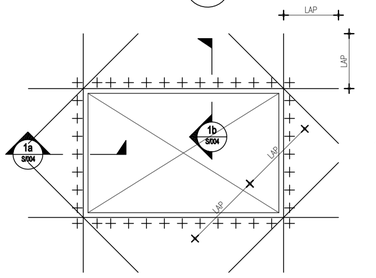

NOTE:
+ DENOTES THE LOCATION OF A T10 LINK.


HOLE >900mm <1200
D S/004 DETAIL



NOTES:
1- TRIMMER BARS ARE OF SAME DIA & TYPE AS:
- VERTICAL BARS FOR VERTICAL TRIMMERS
- HORIZONTAL BARS FOR HORIZONTAL TRIMMERS
- VERTICAL BARS FOR DIAGONAL TRIMMERS
BUT NOT LESS THAN 16mm DIA.

2- LINKS TO CONFORM WITH SPACING OF WALL REINFORCEMENT NOT TO EXCED 200mm.


E S/004 SECTION 1a

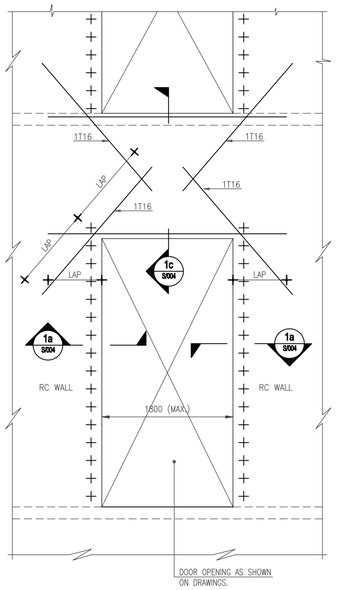

DOOR OPENINGS
(WALL REINFT. NOT SHOWN FOR CLARITY)


H S/004 DETAIL

NOTE:
+ DENOTES THE LOCATION OF A T10 LINK.



*t = WALL THICKNESS


F S/004 SECTION 1c



G S/004 SECTION 1b

NOTES:
1. TOP AND BOTTOM BARS IN SECTION 1c TO HAVE SAME DIAMETER AS MAIN HORIZONTAL BARS IN ADJACENT SHEAR WALLS BUT NOT LESS THAN 20mm.
2. SIDE REINFORCEMENT IN SECTION 1c TO BE PROVIDED ONLY WHEN OVERALL DEPTH OF BEAM IS GREATER THAN OR EQUAL TO 750mm. DIAMETER OF THESE BARS TO BE SAME AS MAIN HORIZONTAL BARS AND NOT MORE THAN 16mm.
3. LINKS IN SECTION 1c TO HAVE THE SAME DIAMETER AND SPACING AS HORIZONTAL BARS IN ADJACENT SHEAR WALLS AND NO MORE THAN 12mm. THE SPACING BETWEEN LINKS NOT TO EXCEED 150mm.

TYPICAL TRIMMING DETAILS OF OPENINGS IN SHEAR WALLS
1 S/004

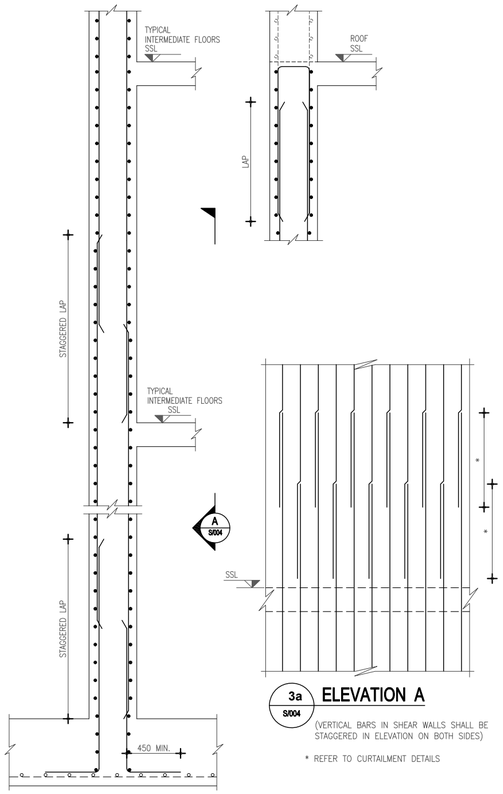


3a S/004 ELEVATION A
(VERTICAL BARS IN SHEAR WALLS SHALL BE STAGGERED IN ELEVATION ON BOTH SIDES)

* REFER TO CURTAILMENT DETAILS


TYPICAL SECTION THROUGH SHEAR WALL

TYPICAL SHEAR WALL DETAILS
3 S/004

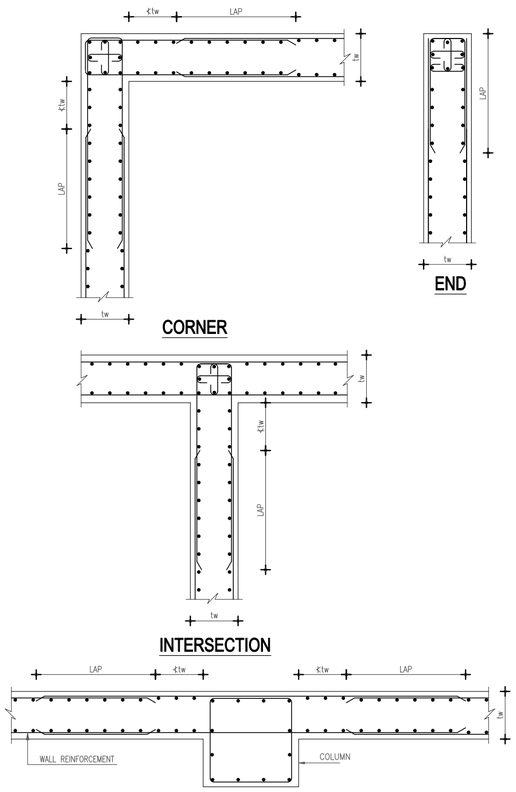

WALL/COLUMN JUNCTION


TYPICAL WALL JUNCTION DETAILS
4 S/004



BARS MAY BE DISPLACED – NO ADDITIONAL REINFORCEMENT NECESSARY.

DETAIL-A S/004


HOLE < 200mm. IN WIDTH AT RIGHT ANGLE TO MAIN SPAN BARS.



CUT BARS INTERRUPTED BY HOLE – PROVIDE REPLACEMENT BARS OF SAME SIZE (MIN. DIA. T12).PROVIDE EQUAL NUMBER OF BARS ON EACH SIDE.

DETAIL-B S/004


200 < HOLE < 500 WIDTH AT RIGHT ANGLE TO MAIN SPAN BARS.

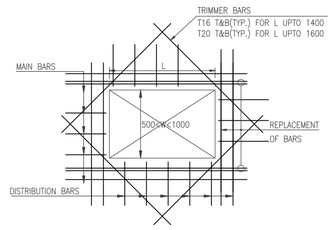


DETAIL-C S/004

500 < HOLE < 1000 WIDTH AT RIGHT ANGLE TO MAIN SPAN BARS.

ALL REPLACEMENT AND DIAGONAL BARS SHOULD EXTEND AN ANCHORAGE LENGTH BEYOND THE EDGE OF THE HOLE.

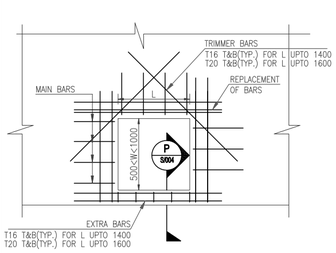


DETAIL-D S/004
OPENING AT SLAB EDGE



SECTION - Q S/004

SECTION-P S/004

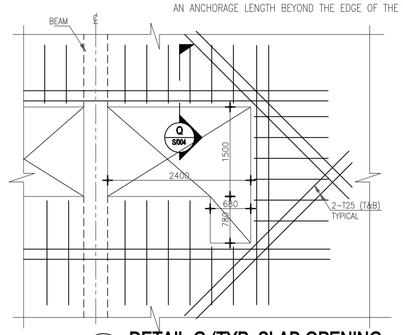

DETAIL-G (TYP. SLAB OPENING DETAILS ON TYP. FLOORS.) S/004

TRIMMING OF HOLES IN SLAB
2 S/004

NOTES :
1. THIS DRAWING MAY NOT BE REPRODUCED BY ANY MEANS WITHOUT PRIOR APPROVAL FROM EMSQUARE
2. DRAWINGS ARE NOT TO BE SCALED,STATED DIMENSIONS ONLY ARE TO BE TAKEN.
3. ANY INCONSISTENCY OR DISCRIPANCY IS TO BE BROUGHT TO THE ATTENTION OF & RESOLVED BY THE ARCHITECT/ENGINEER BEFORE THE WORK IS PUT IN HAND.

DATE	DESCRIPTION	REV.	BY
13.04.2026	FOR AUTHORITY APPROVAL	00	MS

CONSULTANT :
EMSQUARE
ENGINEERING CONSULTANTS
ARCHITECTS-CIVIL ENGINEERS-INTERIORS
P.O. Box 181903, Tel: +971 4 2729009, Fax: +971 4 2729334
Email: emsquare@emirates.net.ae

OWNER :
G F S REAL ESTATE L.L.C

JOB TITLE :
PROPOSED RESIDENTIAL BUILDING (B+G+5+ROOF)

PLOT NO. / PARCEL ID	BLOCK / COMMUNITY
5310319	SAIH SHUAIB 2

DRAWING TITLE : STANDARD DETAILS - SHEET-3

ARCHITECT :	STRUCTURAL ENGR. :	DRAWN :
SHAFI	Eng.Vincent	MUFADDAL
SCALE :	DATE :	CHECKED BY :
NTS	13.04.2026	Eng.Vincent
JOB NO :	DRAWING NO. :	REVISION NO. :
—	S-01_3	

PRINTED BY : :USER-4.-STRUCTURE GFS B+G+5+ROOF R00.DWG -APRIL/13/2026 - 2:46PM)