

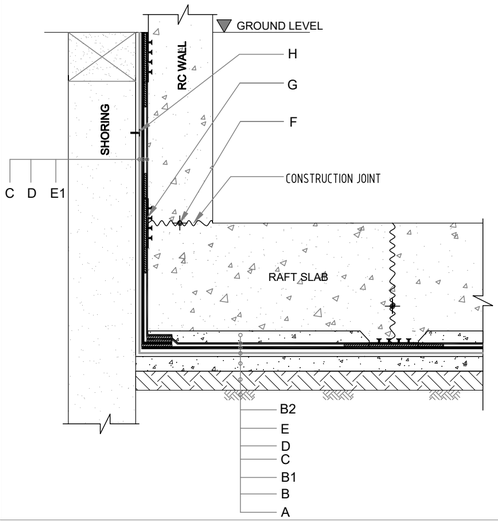


1 BASEMENT WATERPROOFING DETAIL
(STAIR, PUMP ROOM, WATER TANK) SCALE - NTS

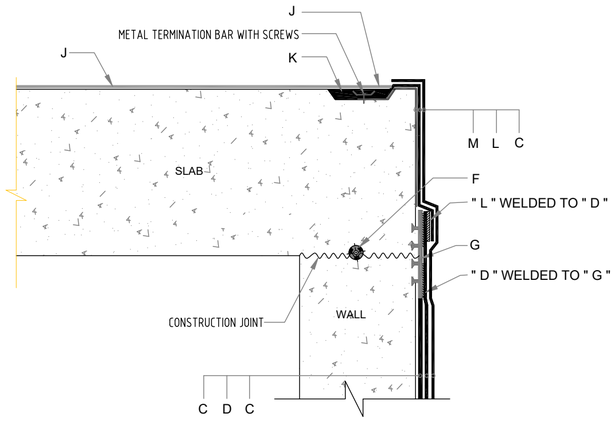


2 BASEMENT/PODIUM WP CONNECTION DETAIL
(PUMP ROOM, WATER TANK) SCALE - NTS

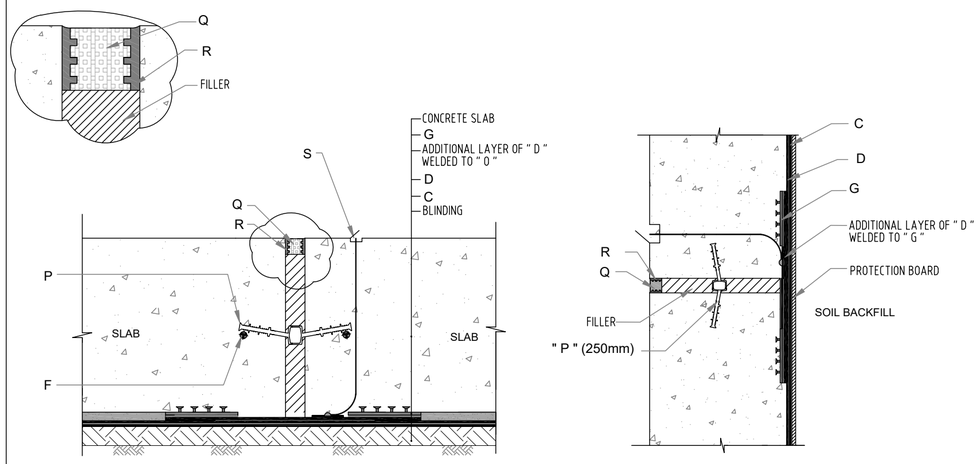


3 EXPANSION JOINT DETAIL -VERTICAL AND HORIZONTAL
SCALE - NTS

NOTES :
1. THIS DRAWING MAY NOT BE REPRODUCED BY ANY MEANS WITHOUT PRIOR APPROVAL FROM EMSQUARE
2. DRAWINGS ARE NOT TO BE SCALED,STATED DIMENSIONS ONLY ARE TO BE TAKEN.
3. ANY INCONSISTENCY OR DISCRIPANCY IS TO BE BROUGHT TO THE ATTENTION OF & RESOLVED BY THE ARCHITECT/ENGINEER BEFORE THE WORK IS PUT IN HAND.

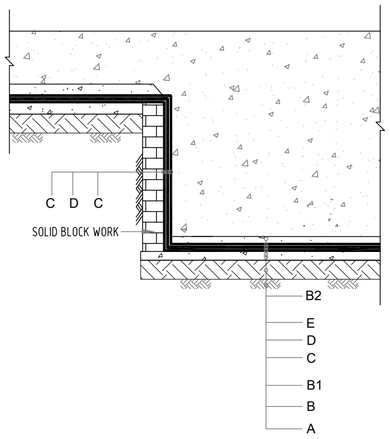


4 TYPICAL PILECAP WATERPROOFING DETAIL
SCALE - NTS

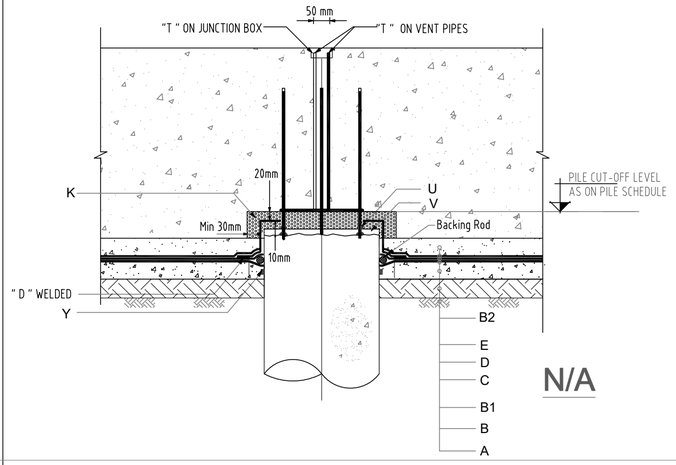


N/A

5 TENSION / COMPRESSION PILE WATERPROOFING DETAIL
SCALE - NTS

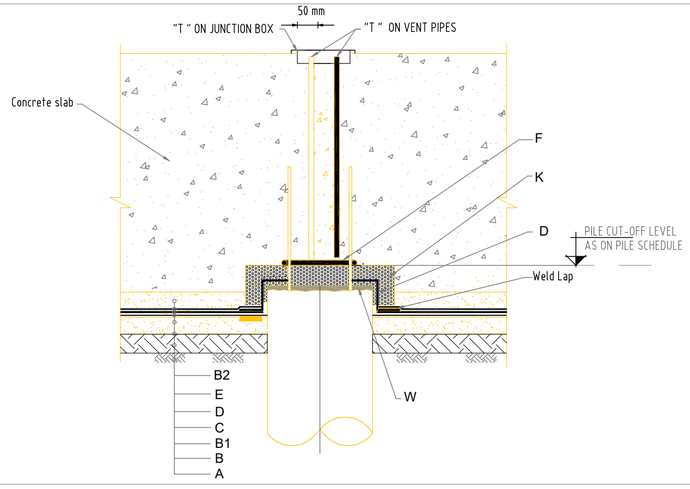


6 COMPRESSION PILE HEAD DETAIL
SCALE - NTS N/A

NOTES:-
1. TYPICAL STANDARD DETAILS SHOWN ARE FOR GUIDELINES,HOWEVER SHALL BE AS PER MANUFACTURES AND SPECIALIST RECOMMENDATION FOR THE NUMBER OF YEARS (20 YERS)OF WARRANTY AS PER AGREEMENT

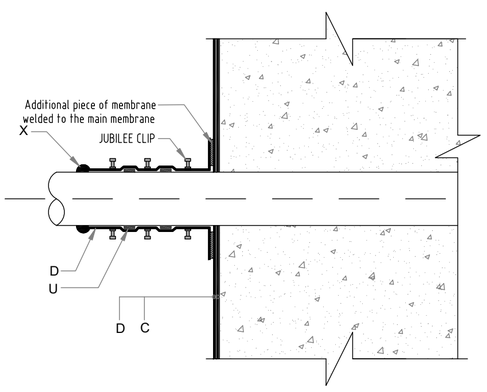


ABOVE WATER LEVEL

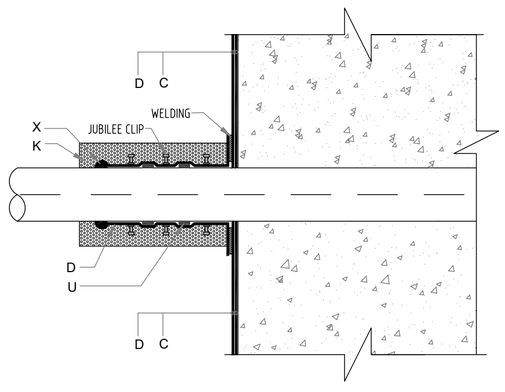

BELOW WATER LEVEL

7 PIPE PENETRATION DETAIL
SCALE - NTS

ALL INTERNAL CONCRETE SURFACES INSIDE THE WATER TANK SHALL BE LINED WITH 4MM THICK GRP LAYER AS PER SPECIFICATIONS

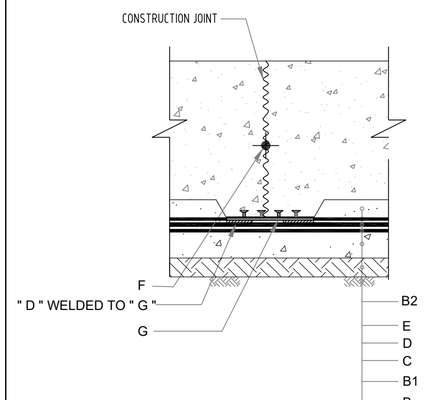

8 CONSTRUCTION JOINT DETAIL (TYP.)
CONSTRUCTION JOINT AS PER SPEC. & APPROVED METHOD STATEMENT (TYP.) SCALE - NTS

LEGEND:

A = COMPACTED BASE SOIL 95% MDD.
B = ROAD BASE LAYER COMPACTED TO 98% MDD. 250 THK (MIN.) AND AS PER SOIL REPORT
B1 = 50mm THICK CONCRETE BLINDING
B2 = 50mm THICK PROTECTION SCREED ON TOP
C = GEOTEXTILE - SNW46 OR EQUIVALENT APPROVED
D = SYNTHETIC PVC MEMBRANE MasterSeal 700BG 4.0 mm (Core, lift pit & pile cap) , 2.0 mm (rest area) OR EQUIVALENT APPROVED
E = POLYETHYLENE SEPARATION LAYER Or MasterSeal 706PZ PVC Membrane Protection & Second Layer, 1.50 mm OR EQUIVALENT APPROVED
E1 = SNW 46 Geotextile Protection Layer Or MasterSeal 706PZ PVC Membrane Protection & Second Layer, 1.50 mm Thick OR EQUIVALENT APPROVED
F = RE-INJECTABLE HOSE MasterSeal 909 OR EQUIVALENT APPROVED
G = WATERSTOP FOR COMPARTMENTALISATION MasterSeal 950 PVC WELDED ON MEMBRANE OR EQUIVALENT APPROVED
H = PVC RONDEL
J = SPRAY APPLIED POLYURETHANE COATING, 2.0 MM THICK MasterSeal M 811 Two Component, OR EQUIVALENT APPROVED
K = HIGH STRENGTH FLOWABLE Epoxy Grout MasterSeal 915 OR EQUIVALENT APPROVED
L = SYNTHETIC MEMBRANE MasterSeal 703RE 2.0 mm OR EQUIVALENT APPROVED
M = ADHESIVE FLEXOCOL V OR EQUIVALENT APPROVED
P = MasterSeal 940 IEJ OR EQUIVALENT APPROVED
Q = MASTERFLEX 1036 OR EQUIVALENT APPROVED
R = MasterBrace ADH 2200 OR EQUIVALENT APPROVED
S = MasterSeal 953 Injection Flange With Hose OR EQUIVALENT APPROVED
T = MasterSeal 909 OR EQUIVALENT APPROVED
U = Swelling Gasket Paste MasterSeal 912 OR EQUIVALENT APPROVED
V = REPROFILING WITH MasterFlow 980 OR EQUIVALENT APPROVED
W = HIGH STRENGTH SHRINKAGE COMPENSATED CEMENTITIOUS MICRO CONCRETE MasterFlow 980 OR EQUIVALENT APPROVED
X = MasterSeal NP 472 OR EQUIVALENT APPROVED
Y = MasterSeal 910 (20x10mm) with MasterSeal 911 Adhesive OR EQUIVALENT APPROVED

REV.	DATE	DESCRIPTION	BY
00	13.04.2026	FOR AUTHORITY APPROVAL	MS

CONSULTANT :
EMSQUARE ENGINEERING CONSULTANTS
ARCHITECTS-CIVIL ENGINEERS-INTERIORS
P.O. Box 181903, Tel: +971 4 2720009, Fax: +971 4 2720334
Email: emsquare@emirates.net.ae

OWNER :
G F S REAL ESTATE L.L.C

JOB TITLE :
PROPOSED RESIDENTIAL BUILDING (B+G+5+ROOF)

PLOT NO. / PARCEL ID	BLOCK / COMMUNITY
5310319	SAIH SHUAIB 2

DRAWING TITLE : STANDARD WATER PROOFING DETAILS

ARCHITECT :	STRUCTURAL ENGR. :	DRAWN :
SHAFI	Eng.Vincent	MUFADDAL
SCALE :	DATE :	CHECKED BY :
NTS	13.04.2026	Eng.Vincent
JOB NO :	DRAWING NO. :	REVISION NO. :
—	S-01_5	

PRINTED BY :USER-4,-STRUCTURE GFS B+G+5+ROOF R00.DWG -APRIL/13/2026 - 2:46PM)