



ADA Curb Ramp New Construction Inspection Form (Cut Through Island)***

Glencoe

North-South Road Name

24952.54

Project No.

Sheet No.

Intersection No.

West union

East-West Road Name

See https://www.oregon.gov/odot/Engineering/Documents_RoadwayEng/ADA_ExhibitA.pdf for more corner styles.
Use Washington County corner numbering system.

Calibration Date 10/8/2024

(mm/dd/yy)

Ramp Style


CT

*The passing value for Gutter Flow Slope (GFS) and Cross Slope 1 (CS1) depends on the Intersection Control Type. CS1 follows the listed rules only on a Cut Through with a through movement. At a Midblock (MB), GFS and CS1 must be \leq Slope of the Road, at Signalized or Uncontrolled (SU), GFS and CS1 must be $\leq 5.0\%$, and at Stop or Yield (SY), GFS and CS1 must be $\leq 2.0\%$. If a Turn Space is required, CS1 must be $\leq 2.0\%$.

**Clear Space area is the width of Ramp Run 1 and extends 4.0 ft into the roadway.

*** Use separate inspection form for each opening of cut-through.

See also Standard Drawings to assess provisions not shown: (inlets, alignment, etc.)

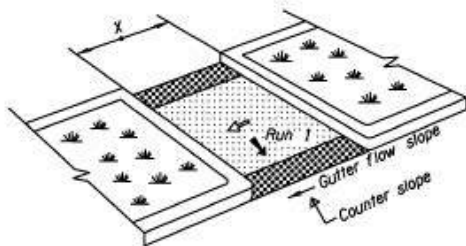

CUT THROUGH (CT)



Pedestrian access route (To measure clear width)

Detectable warning surface



Cross slope



Running slope



Counter slope (5.0% finish grade max.)



Gutter flow slope (as required)

RAMP RUN 1

Pass

Fail

Running Slope 1

2.7 $\leq 8.3\%$ ☒ $> 8.3\%$ ☐

Cross Slope 1

2.2 $\leq *$ ☐ $> *$ ☒

Detectable Warning

Y Y ☒ N ☐

Lip Height

0 $\leq 1/4"$ ☐ $> 1/4"$ ☐

Gutter Flow Slope

2.5 $\leq *$ ☐ $> *$ ☒

Curb Running Slope_(avg)

☐ 1.08 $\leq 8.3\%$ ☒ $> 8.3\%$ ☐


N/A

Counter Slope (+/-) **

2.9 $\leq |5.0\%|$ ☒ $> |5.0\%|$ ☐

4A

Corner Position

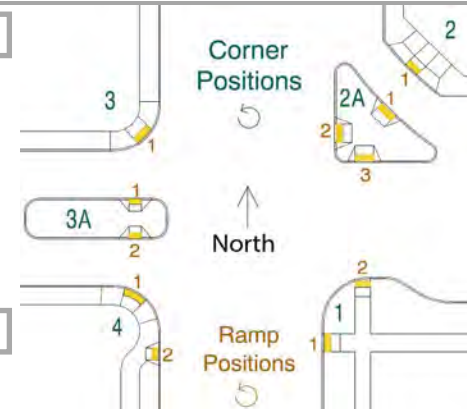

1

Ramp Position

PE Stamp (required for private development)

TURN SPACE ☒

NO TURN SPACE ☐

Pass

Fail

Width X

10.0 $\geq 5.0'$ ☒ $< 5.0'$ ☐

Length Y

10.6 $\geq 5.0'$ ☒ $< 5.0'$ ☐

Slope X

1.6 $\leq 2.0\%$ ☒ $> 2.0\%$ ☐

Slope Y

0.9 $\leq 2.0\%$ ☒ $> 2.0\%$ ☐

MISCELLANEOUS Traversable

Pass

Fail

Flare Slope 1

☒ $\leq 10\%$ ☒ $> 10\%$ ☐

Flare Slope 2

☒ $\leq 10\%$ ☒ $> 10\%$ ☐

Clear Width (feet)

10.0 $\geq 5.0'$ ☐ $< 5.0'$ ☐

Intersection Control Type

SY

Slope of Road

2.5

Cut Through Length ≥ 6 FT (Y/N)

☐

Horizontal Gaps $< 1/2"$ (Y/N)

☐

Comments:

Inspector's Signature

Date (mm/dd/yy)

Darrell Wyant

52638.0

Print name clearly

Certification No.

3J Consulting

Company/Agency

Reset Entire Form

Keep Intersection, Reset Fields

ADA Curb Ramp Images

Attached photos must be in .pdf format in order to be placed

