



ADA Curb Ramp New Construction Inspection Form (Perpendicular)

NW Timeric Dr

North-South Road Name

24952.54

Project No.

Sheet No.

Intersection No.

NW Turel Dr

East-West Road Name

Calibration Date

12/3/2024

(mm/dd/yy)


Ramp Style **PR**

* The passing value for Gutter Flow Slope (GFS) depends on the Intersection Control Type. At a Midblock (MB), GFS must be \leq Slope of the Road, at Signalized or Uncontrolled (SU), GFS must be \leq 5.0%, and at Stop or Yield (SY), GFS must be \leq 2.0%.

* ¹ If Back of Ramp Obstruction is Yes, turn space length Y must be minimum 5.0 ft.

* ² Clear Space area is the width of Ramp Run 1 and extends 4.0 ft into the roadway.

See also Standard Drawings to assess provisions not shown: (inlets, alignment, etc.)

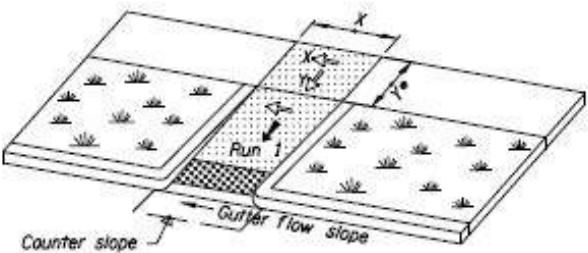

PERPENDICULAR RAMP (PR)


- Pedestrian Access Route (to measure Clear Width)
- Detectable Warning Surface
- Cross Slope (2.0% max.)
- Running Slope (8.3% max.)
- Counter Slope (5.0% max.)
- Turning Space (X & Y) (2.0% max. / 4' x 4' min.)*
- * If constrained at back of walk, min. Y length is 5'.
- Gutter Flow Slope (as directed)

RAMP RUN 1		Pass	Fail
Running Slope 1	7.6 \leq 8.3%	<input checked="" type="checkbox"/>	<input type="checkbox"/>
Length 1	4.4	<input type="checkbox"/>	<input type="checkbox"/>
Cross Slope 1	1.8 \leq 2.0%	<input checked="" type="checkbox"/>	<input type="checkbox"/>
Detectable Warning (Y,N)	Y Y	<input checked="" type="checkbox"/>	<input type="checkbox"/>
Lip Height	0 1/4"	<input checked="" type="checkbox"/>	<input type="checkbox"/>
Gutter Flow Slope	N/A 1.6 \leq *	<input checked="" type="checkbox"/>	<input type="checkbox"/>
Curb Running Slope (avg)	2.4 \leq 8.3%	<input checked="" type="checkbox"/>	<input type="checkbox"/>
Counter Slope (+/-) *2	4.7 \leq 5.0%	<input checked="" type="checkbox"/>	<input type="checkbox"/>

Longest distance from corner to back of curb (see dwg on BT form)	0.0	< 5.0'	<input checked="" type="checkbox"/>	\geq 5.0'	<input type="checkbox"/>
Detectable warning extends full width of ramp throat opening	Y	Y	<input checked="" type="checkbox"/>	N	<input type="checkbox"/>

TURN SPACE	LANDING	NONE	Pass	Fail	
Width X	6.1	\geq 4.0'	<input checked="" type="checkbox"/>	< 4.0'	<input type="checkbox"/>
Length Y	4.9	\geq 4.0'*1	<input checked="" type="checkbox"/>	< 4.0'*1	<input type="checkbox"/>
Back of Ramp Obstruction (Y/N)	N	\geq 5.0'*1	<input checked="" type="checkbox"/>	< 5.0'*1	<input type="checkbox"/>
Slope X	1.3	\leq 2.0%	<input checked="" type="checkbox"/>	> 2.0%	<input type="checkbox"/>
Slope Y	1.2	\leq 2.0%	<input checked="" type="checkbox"/>	> 2.0%	<input type="checkbox"/>

MISCELLANEOUS		Traversable	Pass	Fail	
Flare Slope 1	<input checked="" type="checkbox"/>	\leq 10%	<input checked="" type="checkbox"/>	< 10%	<input type="checkbox"/>
Flare Slope 2	<input checked="" type="checkbox"/>	\leq 10%	<input checked="" type="checkbox"/>	< 10%	<input type="checkbox"/>
Clear Width (feet)	4.9	\geq 4.0'	<input type="checkbox"/>	< 4.0'	<input type="checkbox"/>
Intersection Control Type	SY	Slope of Road	1.2		
Horizontal Gaps		\leq 1/2"	<input checked="" type="checkbox"/>	> 1/2"	<input type="checkbox"/>

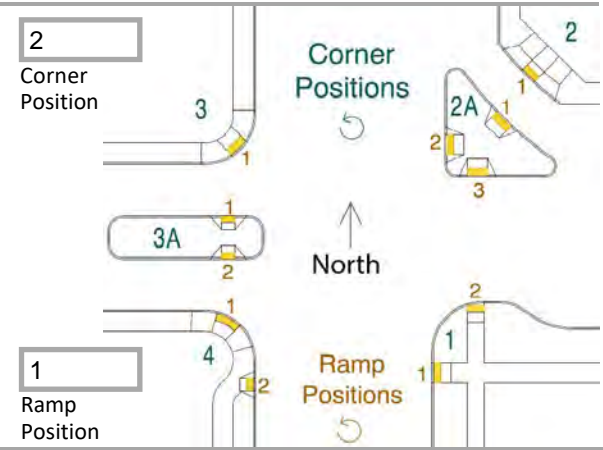

PE Stamp (required for private development)

Comments:

Inspector's Signature

Darrell Wyant

Print name clearly

Date (mm/dd/yyyy)

52638

Certification No.

3J Consulting

Company/Agency

ADA Curb Ramp Images

Attached photos must be in .pdf format in order to be placed

