



ADA Curb Ramp New Construction Inspection Form (Perpendicular)

Nw jackson

24952.54

Nw mays


North-South Road NameProject No. Sheet No. Intersection No. East-West Road Name

Calibration Date8/20/2024(mm/dd/yy)

* The passing value for Gutter Flow Slope (GFS) depends on the Intersection Control Type. At a Midblock (MB), GFS must be ≤ Slope of the Road, at Signalized or Uncontrolled (SU), GFS must be ≤ 5.0%, and at Stop or Yield (SY), GFS must be ≤ 2.0%.

* ¹ If Back of Ramp Obstruction is Yes, turn space length Y must be minimum 5.0 ft.

* ² Clear Space area is the width of Ramp Run 1 and extends 4.0 ft into the roadway.

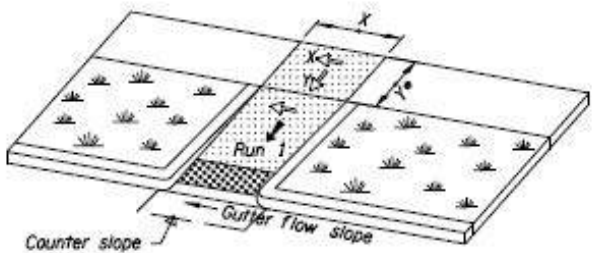

PERPENDICULAR RAMP (PR)

Pedestrian Access Route (to measure Clear Width)

Detectable Warning Surface

Cross Slope (2.0% max.)

Running Slope (8.3% max.)

Counter Slope (5.0% max.)

Turning Space (X & Y) (2.0% max. / 4' x 4' min.)*

* If constrained at back of walk, min. Y length is 5'.

Gutter Flow Slope (as directed)

RAMP RUN 1			Pass	Fail			
Running Slope 1	3.1	≤ 8.3%	<input checked="" type="checkbox"/>	<input type="checkbox"/>			
Length 1	16.0						
Cross Slope 1	1.7	≤ 2.0%	<input checked="" type="checkbox"/>	<input type="checkbox"/>			
Detectable Warning (Y,N)		Y	<input checked="" type="checkbox"/>	<input type="checkbox"/>			
Lip Height		1/4"	<input type="checkbox"/>	<input type="checkbox"/>			
Gutter Flow Slope	N/A 0.5	≤ *	<input type="checkbox"/>	<input type="checkbox"/>			
Curb Running Slope (avg)	6.56	≤ 8.3%	<input checked="" type="checkbox"/>	<input type="checkbox"/>			
Counter Slope (+/-) *2	6.7	≤ 5.0%	<input checked="" type="checkbox"/>	<input type="checkbox"/>			
Longest distance from corner to back of curb (see dwg on BT form)							
			0.25	< 5.0'	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
Detectable warning extends full width of ramp throat opening					Y	<input checked="" type="checkbox"/>	<input type="checkbox"/>
TURN SPACE <input checked="" type="checkbox"/> LANDING <input type="checkbox"/> NONE <input type="checkbox"/>			Pass	Fail			
Width X			4.7	≥ 4.0'	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
Length Y			4.9	≥ 4.0'*1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
Back of Ramp Obstruction (Y/N)				≥ 5.0'*1	<input type="checkbox"/>	<input type="checkbox"/>	
Slope X			1.3	≤ 2.0%	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
Slope Y			0.9	≤ 2.0%	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
MISCELLANEOUS			Traversable	Pass	Fail		
Flare Slope 1			<input checked="" type="checkbox"/>	≤ 10%	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
Flare Slope 2			<input checked="" type="checkbox"/>	≤ 10%	<input checked="" type="checkbox"/>	<input type="checkbox"/>	
Clear Width (feet)			4.7	≥ 4.0'	<input type="checkbox"/>	<input type="checkbox"/>	
Intersection Control Type				Slope of Road	0.1		
Horizontal Gaps				≤ 1/2"	<input checked="" type="checkbox"/>	<input type="checkbox"/>	

Corner Position

Ramp Position

Corner Positions

Ramp Positions

North

PE Stamp (required for private development)

Comments:

Inspector's Signature

Date (mm/dd/yyyy)

Darrell Wyant

52638

Print name clearly

Certification No.

3J Consulting

Company/Agency

ADA Curb Ramp Images

Attached photos must be in .pdf format in order to be placed

