



ADA Curb Ramp New Construction Inspection Form (Parallel)

NW Timeric

North-South Road Name

24952.54

Project No.

Sheet No.

Intersection No.

NW North Ave

East-West Road Name

See https://www.oregon.gov/odot/Engineering/Documents_RoadwayEng/ADA_ExhibitA.pdf for more corner styles.
Use Washington County corner numbering system.

Calibration Date 10/22/2024 (mm/dd/yy)

PL


Ramp Style

*The passing value for Gutter Flow Slope (GFS) depends on the Intersection Control Type. At a Midblock (MB), GFS must be \leq Slope of the Road, at Signalized or Uncontrolled (SU), GFS must be \leq 5.0%, and at Stop or Yield (SY), GFS must be \leq 2.0%.

*1 If Back of Ramp Obstruction is Yes, turn space length Y must be minimum 5.0 ft.

*2 Clear Space area is the width of Ramp Run 1 and extends 4.0 ft into the roadway.

See also Standard Drawings to assess provisions not shown: (inlets, alignment, etc.)

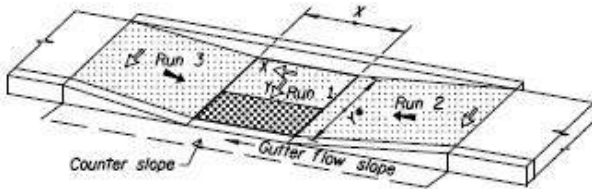

PARALLEL RAMP (PL)

PARALLEL RAMP (PL)

- Pedestrian Access Route (to measure Clear Width)
- Detectable Warning Surface
- Cross Slope (2.0% max.)
- Running Slope (8.3% max.)
- Counter Slope (5.0% max.)
- Turning Space (X & Y) (2.0% max. / 4' x 4' min.)*
* If constrained at back of walk, min. Y length is 5'.
- Gutter Flow Slope (as directed)

RAMP RUN 1

Pass Fail

Running Slope 1

9.7 \leq 2.0% ☐ $>$ 2.0% ☒

Cross Slope 1

4.1 \leq 2.0% ☐ $>$ 2.0% ☒

Detectable Warning

N Y ☐ N ☒

Lip Height

0 \leq 1/4" ☒ $>$ 1/4" ☐

Gutter Flow Slope

5.2 \leq * ☐ $>$ * ☐

Curb Running Slope (avg)

☐ 7.4 \leq 8.3% ☒ $>$ 8.3% ☐

Counter Slope (+/-)*2

4.1 \leq |5.0%| ☐ $>$ |5.0%| ☒

Det. warning full width of ramp

N Y ☐ N ☒

RAMP RUN 2

Pass Fail

Running Slope 2

1.7 \leq 8.3% ☒ $>$ 8.3% ☐

Length 2

5.35

Cross Slope 2

7.2 \leq 2.0% ☐ $>$ 2.0% ☒

RAMP RUN 3

Pass Fail

Running Slope 3

☐ \leq 8.3% ☐ $>$ 8.3% ☒

Length 3

6.2

Cross Slope 3

7.7 \leq 2.0% ☐ $>$ 2.0% ☒

TURN SPACE

Pass Fail

Width X

3.9 \geq 4.0' ☐ $<$ 4.0' ☒

Length Y

5.0 \geq 4.0'*1 ☒ $<$ 4.0'*1 ☐

Back of Ramp Obstruction (Y/N)

N \geq 5.0'*1 ☒ $<$ 5.0'*1 ☐

Slope X (Cross Slope 1)

4.1 \leq 2.0% ☐ $>$ 2.0% ☐

Slope Y (Running Slope 1)

9.7 \leq 2.0% ☐ $>$ 2.0% ☐

MISCELLANEOUS

Pass Fail

Clear Width (feet)

3.9 \geq 4.0' ☐ $<$ 4.0' ☐

Intersection Control Type


SU Slope of Rd. 4.1

Horizontal Gaps

0 \leq 1/2" ☒ $>$ 1/2" ☐

1

Corner Position

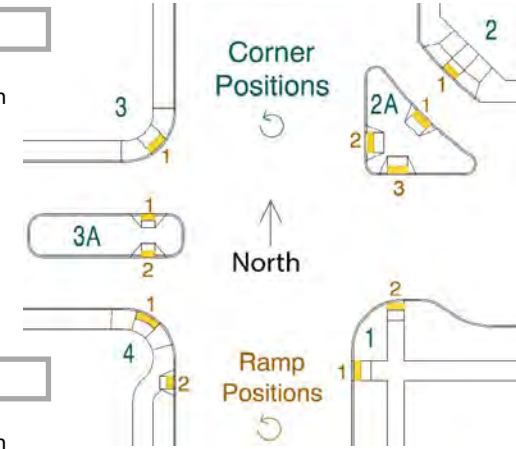

1

Ramp Position

PE Stamp (required for private development)

Comments:

Inspector's Signature

Date (mm/dd/yy)

Darrell Wyant

52638.0

Print name clearly

Certification No.

3J Consulting

Company/Agency

Reset Entire Form

Keep Intersection, Reset Fields

ADA Curb Ramp Images

Attached photos must be in .pdf format in order to be placed

