



ADA Curb Ramp New Construction Inspection Form (Perpendicular)

Nw King

North-South Road Name

23885.56

Project No.

Sheet No.

Intersection No.

Nw 192nd

East-West Road Name

Calibration Date

7/19/2024

(mm/dd/yy)

Ramp Style **PR**

RAMP RUN 1

Pass

Fail

Running Slope 1

5.6

≤ 8.3%

■

>8.3%

□

Length 1

9.5

Cross Slope 1

1.9

≤ 2.0%

■

>2.0%

□

Detectable Warning (Y,N)

Y

■

N

□

Lip Height

1/4"

■

>1/4"

□

Gutter Flow Slope

N/A

0.5

≤ *

■

>*

□

Curb Running Slope (avg)

0.84

≤ 8.3%

■

>8.3%

□

Counter Slope (+/-) *2

3.4

≤ |5.0%|

□

> |5.0%|

■

Longest distance from
corner to back of curb
(see dwg on BT form)

0.45

< 5.0'

■

≥ 5.0'

□

Detectable warning
extends full width of
ramp throat opening

Y

■

N

□

TURN SPACE

LANDING

NONE

■

Pass

Fail

Width X

3.7

≥ 4.0'

■

< 4.0'

□

Length Y

5.15

≥ 4.0'*1

■

< 4.0'*1

□

Back of Ramp Obstruction (Y/N)

≥ 5.0'*1

■

< 5.0'*1

□

Slope X

0.4

≤ 2.0%

■

> 2.0%

□

Slope Y

1.2

≤ 2.0%

■

> 2.0%

□

MISCELLANEOUS Traversable

Pass

Fail

Flare Slope 1

■

□

≤ 10%

■

< 10%

□

Flare Slope 2

■

□

≤ 10%

■

< 10%

□

Clear Width (feet)

3.7

≥ 4.0'

□

< 4.0'

□

Intersection Control Type

SY

Slope of Road

0.6

Horizontal Gaps

□


≤ 1/2"

■

> 1/2"

□

4
Corner
Position

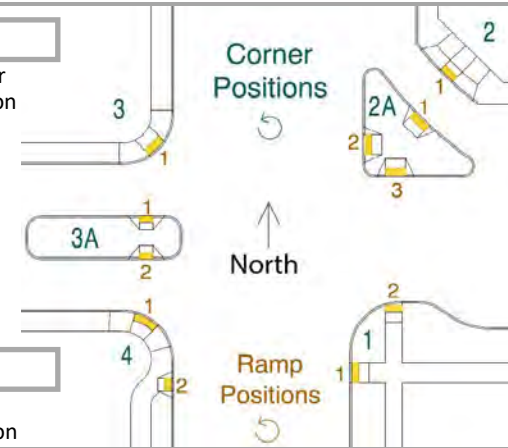

PE Stamp (required for
private development)

Comments:

Inspector's Signature

Date (mm/dd/yyyy)

Darrell Wyant

52638

Print name clearly

Certification No.

3J Consulting

Company/Agency

Reset Entire Form

Keep Intersection, Reset Fields


WashCo ADA 01 (4-2020)

* The passing value for Gutter Flow Slope (GFS) depends on the Intersection Control Type. At a Midblock (MB), GFS must be ≤ Slope of the Road, at Signalized or Uncontrolled (SU), GFS must be ≤ 5.0%, and at Stop or Yield (SY), GFS must be ≤ 2.0%.

* ¹ If Back of Ramp Obstruction is Yes, turn space length Y must be minimum 5.0 ft.

* ² Clear Space area is the width of Ramp Run 1 and extends 4.0 ft into the roadway.

See also Standard Drawings to assess provisions not shown:
(inlets, alignment, etc.)

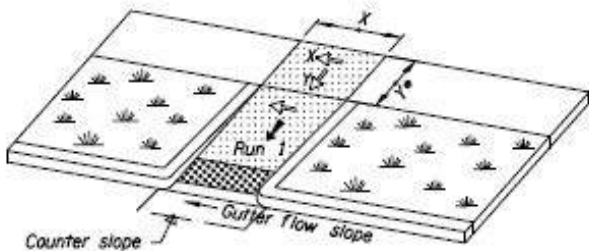

PERPENDICULAR RAMP (PR)

■ Pedestrian Access Route (to measure Clear Width)

■ Detectable Warning Surface

↔ Cross Slope (2.0% max.)

← Running Slope (8.3% max.)

↗ Counter Slope (5.0% max.)

↻ Turning Space (X & Y) (2.0% max. / 4' x 4' min.)*

* If constrained at back of walk, min. Y length is 5'.

→ Gutter Flow Slope (as directed)

ADA Curb Ramp Images

Attached photos must be in .pdf format in order to be placed

