



# ADA Curb Ramp New Construction Inspection Form (Perpendicular)

Nw Kaye way

North-South Road Name

24952.54

Project No.

Sheet No.

Intersection No.

Nw mays st

East-West Road Name

Calibration Date

8/6/2024

(mm/dd/yy)

Ramp Style **PR**

## RAMP RUN 1

Pass

Fail

Running Slope 1

≤ 8.3% ☐ >8.3% ☐

Length 1

19.3

Cross Slope 1

≤ 2.0% ☐ >2.0% ☐

Detectable Warning (Y,N)

Y ☐ N ☐

Lip Height

1/4" ☐ >1/4" ☐

Gutter Flow Slope

2.1 ≤ \* ☐ >\* ☒

Curb Running Slope (avg)

1.12 ≤ 8.3% ☐ >8.3% ☐

Counter Slope (+/-) \*2

5 ≤ |5.0%| ☐ >|5.0%| ☐

Longest distance from corner to back of curb (see dwg on BT form)

0.4 < 5.0' ☒ ≥ 5.0' ☐

Detectable warning extends full width of ramp throat opening

Y ☒ N ☐

TURN SPACE ☒

LANDING ☐

NONE ☐

Pass

Fail

Width X

5.0 ≥ 4.0' ☒ < 4.0' ☐

Length Y

4.9 ≥ 4.0'\*1 ☒ < 4.0'\*1 ☐

Back of Ramp Obstruction (Y/N)

≥ 5.0'\*1 ☐ < 5.0'\*1 ☐

Slope X

1.7 ≤ 2.0% ☒ >2.0% ☐

Slope Y

0.5 ≤ 2.0% ☒ >2.0% ☐

MISCELLANEOUS Traversable

Pass

Fail

Flare Slope 1

≤ 10% ☒ < 10% ☐

Flare Slope 2

≤ 10% ☒ < 10% ☐

Clear Width (feet)

≥ 4.0' ☐ < 4.0' ☐

Intersection Control Type

SY

Slope of Road

1.9

Horizontal Gaps

≤ 1/2" ☐ > 1/2" ☐

2

Corner Position

Corner Positions


North

Ramp Positions

1

Ramp Position

PE Stamp (required for private development)

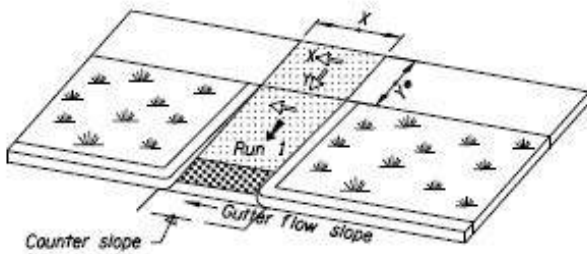

## PERPENDICULAR RAMP (PR)



Pedestrian Access Route (to measure Clear Width)



Detectable Warning Surface



Cross Slope (2.0% max.)



Running Slope (8.3% max.)



Counter Slope (5.0% max.)



Turning Space (X & Y) (2.0% max. / 4' x 4' min.)\*

\* If constrained at back of walk, min. Y length is 5'.



Gutter Flow Slope (as directed)

Comments:

RR1 ICRR

Inspector's Signature

Date (mm/dd/yy)

Darrell Wyant

52638

Print name clearly

Certification No.

3J Consulting

Company/Agency

Reset Entire Form

Keep Intersection, Reset Fields

## ADA Curb Ramp Images

Attached photos must be in .pdf format in order to be placed

