



ADA Curb Ramp New Construction Inspection Form (Perpendicular)

Nw 294th

North-South Road Name

23885.56

Project No.

Sheet No.

Intersection No.

Nw 293rd

East-West Road Name

Calibration Date

7/19/2024

(mm/dd/yy)

Ramp Style **PR**

RAMP RUN 1

Pass

Fail

Running Slope 1

8.6

≤ 8.3%

■

>8.3%

□

Length 1

5.0

Cross Slope 1

≤ 2.0%

■

>2.0%

□

Detectable Warning (Y,N)

Y

■

N

□

Lip Height

1/4"

■

>1/4"

□

Gutter Flow Slope

N/A

1.3

≤ *

■

>*

□

Curb Running Slope (avg)

2.38

≤ 8.3%

■

>8.3%

□

Counter Slope (+/-) *2

6

≤ |5.0%|

□

> |5.0%|

■

Longest distance from corner to back of curb (see dwg on BT form)

< 5.0'

■

≥ 5.0'

□

Detectable warning extends full width of ramp throat opening

Y

■

N

□

TURN SPACE

■

LANDING

□

NONE

□

Pass

Fail

Width X

5.9

≥ 4.0'

■

< 4.0'

□

Length Y

4.95

≥ 4.0'*1

■

< 4.0'*1

□

Back of Ramp Obstruction (Y/N)

≥ 5.0'*1

■

< 5.0'*1

□

Slope X

1.8

≤ 2.0%

■

> 2.0%

□

Slope Y

1.9

≤ 2.0%

■

> 2.0%

□

MISCELLANEOUS Traversable

Pass

Fail

Flare Slope 1

■

□

≤ 10%

■

< 10%

□

Flare Slope 2

■

□

≤ 10%

■

< 10%

□

Clear Width (feet)

4.95

≥ 4.0'

□

< 4.0'

□

Intersection Control Type

SU

Slope of Road

0.7

Horizontal Gaps

□

≤ 1/2"


■

> 1/2"

□

2
Corner
Position

1
Ramp
Position

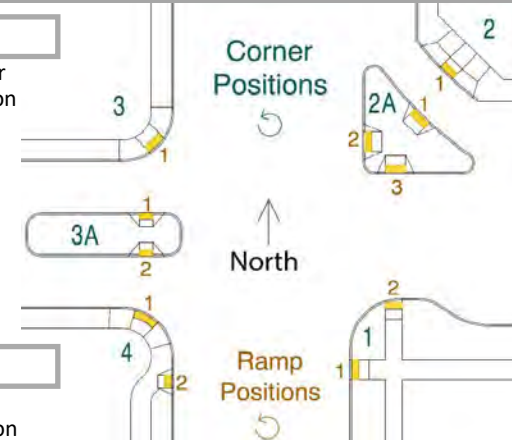

PE Stamp (required for private development)

Comments:

Inspector's Signature

Date (mm/dd/yyyy)

Darrell Wyant

52638

Print name clearly


Certification No.

3J Consulting

Company/Agency

Reset Entire Form

Keep Intersection, Reset Fields

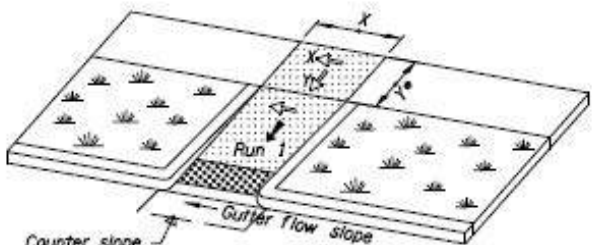

PERPENDICULAR RAMP (PR)

- Pedestrian Access Route (to measure Clear Width)
- Detectable Warning Surface
- Cross Slope (2.0% max.)
- Running Slope (8.3% max.)
- Counter Slope (5.0% max.)
- Turning Space (X & Y) (2.0% max. / 4' x 4' min.)*
- * If constrained at back of walk, min. Y length is 5'.
- Gutter Flow Slope (as directed)

ADA Curb Ramp Images

Attached photos must be in .pdf format in order to be placed

