


G.E. VERNOVA
LM6000 60HZ DLE
CO2 SUPPRESSION SYSTEM
WFE PROJECT # GE-1457

BLOCK	SHEET	DESCRIPTION	REV.	STATUS
COVER SHEET	CS-1457-01	COVER SHEET/DRAWING INDEX	B	ISSUED FOR APPROVAL
FIRE PANEL CABINET	FPC-1457-01	REVISED FIRE PANEL CABINET LAYOUT	C	REVISED LAYOUT
GENERAL ARRANGEMENT	GA-1457-01	CO2 SKID LAYOUT WITH SUNSHIELD AND BACK	C	ISSUED FOR APPROVAL
	GA-1457-02	CO2 SKID ISOMETRIC WITH SUNSHIELD AND BACK	C	ISSUED FOR APPROVAL
	GA-1457-03	FLOW AND INSTRUMENT DIAGRAM	C	ISSUED FOR APPROVAL
	GA-1457-04	FLOW AND INSTRUMENT DIAGRAM	C	ISSUED FOR APPROVAL
	GA-1457-05	ISOMETRIC PIPING LAYOUT	C	ISSUED FOR APPROVAL
	GA-1457-06	BILL OF MATERIALS	C	ISSUED FOR APPROVAL
	GA-1457-07	BILL OF MATERIALS	C	ISSUED FOR APPROVAL
	GA-1457-08	ISOMETRIC PIPING LAYOUT	C	ISSUED FOR APPROVAL
SYSTEM WIRING	SW-1457-01	SYSTEM WIRING NOTES & LEGEND	D	ISSUED FOR APPROVAL
	SW-1457-02	POWER DISTRIBUTION WIRING	D	ISSUED FOR APPROVAL
	SW-1457-03	CONTROLLER WIRING	D	ISSUED FOR APPROVAL
	SW-1457-04	EDIO ELECTRICAL	D	ISSUED FOR APPROVAL
	SW-1457-05	LON LOOP	D	ISSUED FOR APPROVAL
	SW-1457-06	LON LOOP	D	ISSUED FOR APPROVAL
	SW-1457-07	LON LOOP	D	ISSUED FOR APPROVAL
	SW-1457-08	EDIO ELECTRICAL	D	ISSUED FOR APPROVAL
	SW-1457-09	LON LOOP	D	ISSUED FOR APPROVAL
	SW-1457-10	EDIO ELECTRICAL	D	ISSUED FOR APPROVAL
	SW-1457-11	LON LIST	D	ISSUED FOR APPROVAL
	SW-1457-12	LON LIST	D	ISSUED FOR APPROVAL
	SW-1457-13	LON LIST	D	ISSUED FOR APPROVAL
CAUSE&EFFECT	CE-1457-01	CAUSE AND EFFECT MATRIX	B	ISSUED FOR APPROVAL

REVISIONS				THIS DRAWING, DESIGN AND THE DATA CONTAINED THEREIN IS THE PROPERTY OF WILSON FIRE EQUIPMENT AND IS NOT TO BE DISTRIBUTED TO OR USED BY OTHERS WITHOUT THE EXPRESSED WRITTEN CONSENT OF WILSON FIRE EQUIPMENT. SCALE: N.T.S DATE DRAWN: MP 12/04/24 CHECKED: JV 12/04/24 APPROVED: JV 12/04/24	
REV	DESCRIPTION	DATE	BY		
A	ISSUED FOR APPROVAL	12/04/24	MP		
B	ISSUED FOR APPROVAL	01/31/24	MP		

WILSON FIRE EQUIPMENT & SERVICE CO. 7303 EMPIRE CENTRAL DRIVE HOUSTON, TEXAS 77040 (713) 896-4747		
CUSTOMER INFORMATION		
GE VERNOVA		
LM6000 60HZ DLE		
COVER SHEET/DRAWING INDEX FIRE & GAS DETECTION		
CO2 SUPPRESSION SYSTEM WFE PROJECT # GE-1457		

		
SIZE	DRAWING NO.	REV
B	CS-1457-01	B
SHEET 1 OF 1		

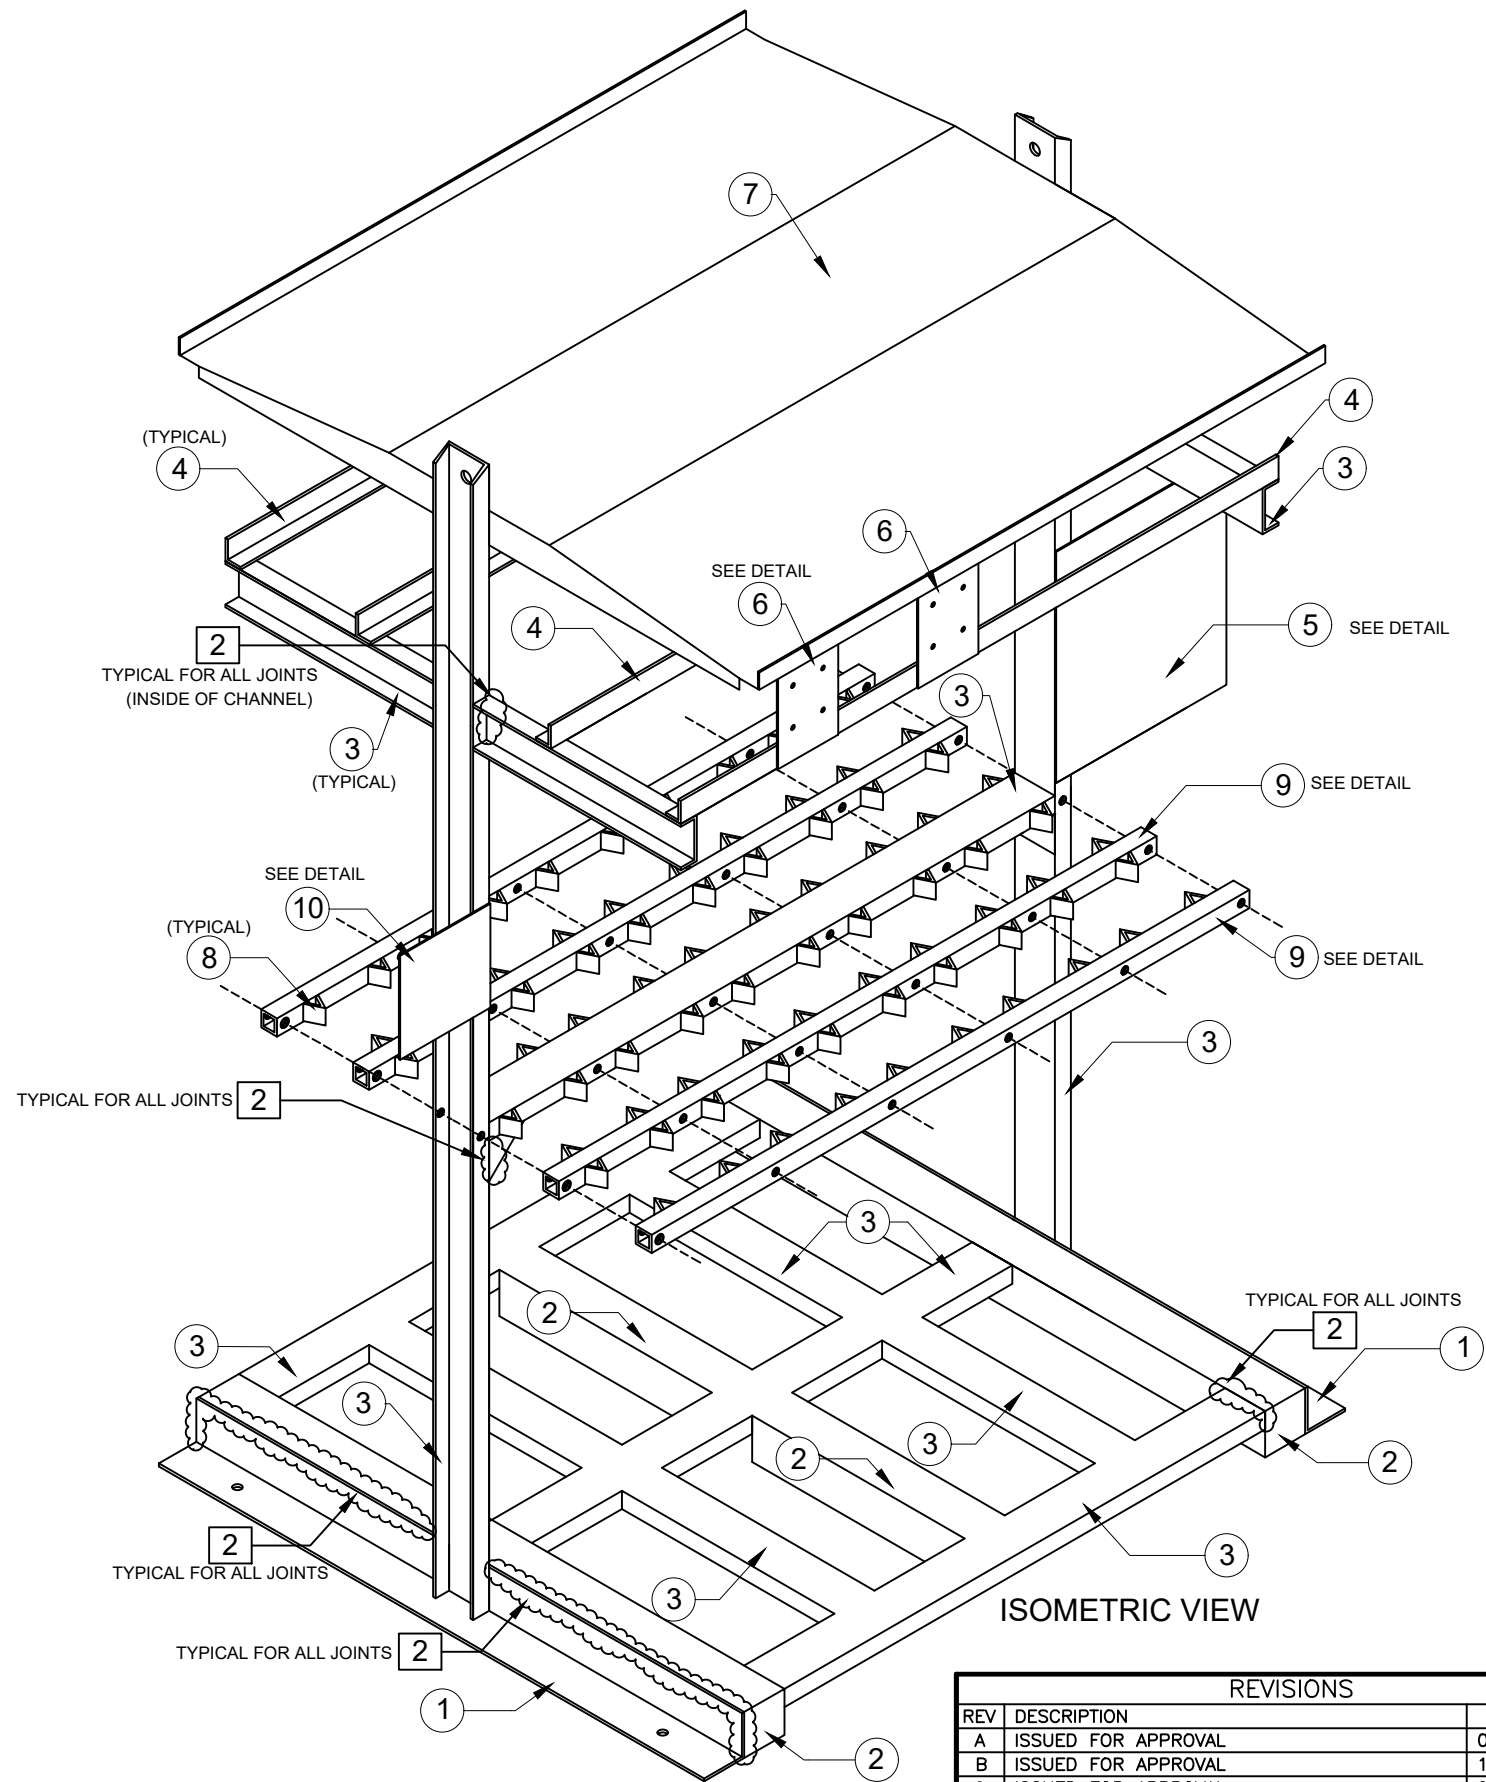


ISOMETRIC VIEW

BILL OF MATERIALS		
ITEM #	DESCRIPTION	NOTES
①	4"X4"X1/4" ANGLE	
②	4"X4"X1/4" TUBING	
③	C4X5.4 CHANNEL	
④	2"X1-1/2"X1/4" ANGLE	
⑤	17"X24" PLATE	
⑥	6"X8" PLATE	SEE DETAIL FOR HOLE PUNCHING
⑦	SUNSHIELD	
⑧	1-1/2"X1-1/2"X1/4" ANGLE	
⑨	1-1/2"X1-1/2"X1/4" TUBING	SEE DETAIL FOR BOTTLE STRAPPING BAR
⑩	9"X9" PLATE	

REVISIONS			
REV	DESCRIPTION	DATE	BY
A	ISSUED FOR APPROVAL	06/13/24	MAP
B	ISSUED FOR APPROVAL	11/01/24	MAP
C	ISSUED FOR APPROVAL	01/31/24	MAP

THIS DRAWING, DESIGN AND THE DATA CONTAINED THEREIN IS THE PROPERTY OF WILSON FIRE EQUIPMENT AND IS NOT TO BE DISTRIBUTED TO OR USED BY OTHERS WITHOUT THE EXPRESSED WRITTEN CONSENT OF WILSON FIRE EQUIPMENT.	
SCALE:	N.T.S. DATE
DRAWN:	MAP 06/13/24
CHECKED/APPROVED:	JV 06/13/24

WILSON FIRE EQUIPMENT & SERVICE CO. 7303 EMPIRE CENTRAL DRIVE HOUSTON, TEXAS 77040 (713) 896-4747		
CUSTOMER INFORMATION		
GE VERNOVA		
CO2 SKID ISOMETRIC WITH SUNSHIELD AND BACK STANDARD		
WFE PROJECT # GE-1457		
		
SIZE	DRAWING NO.	REV
B	GA-1457-02 SHEET 2 OF 8	C

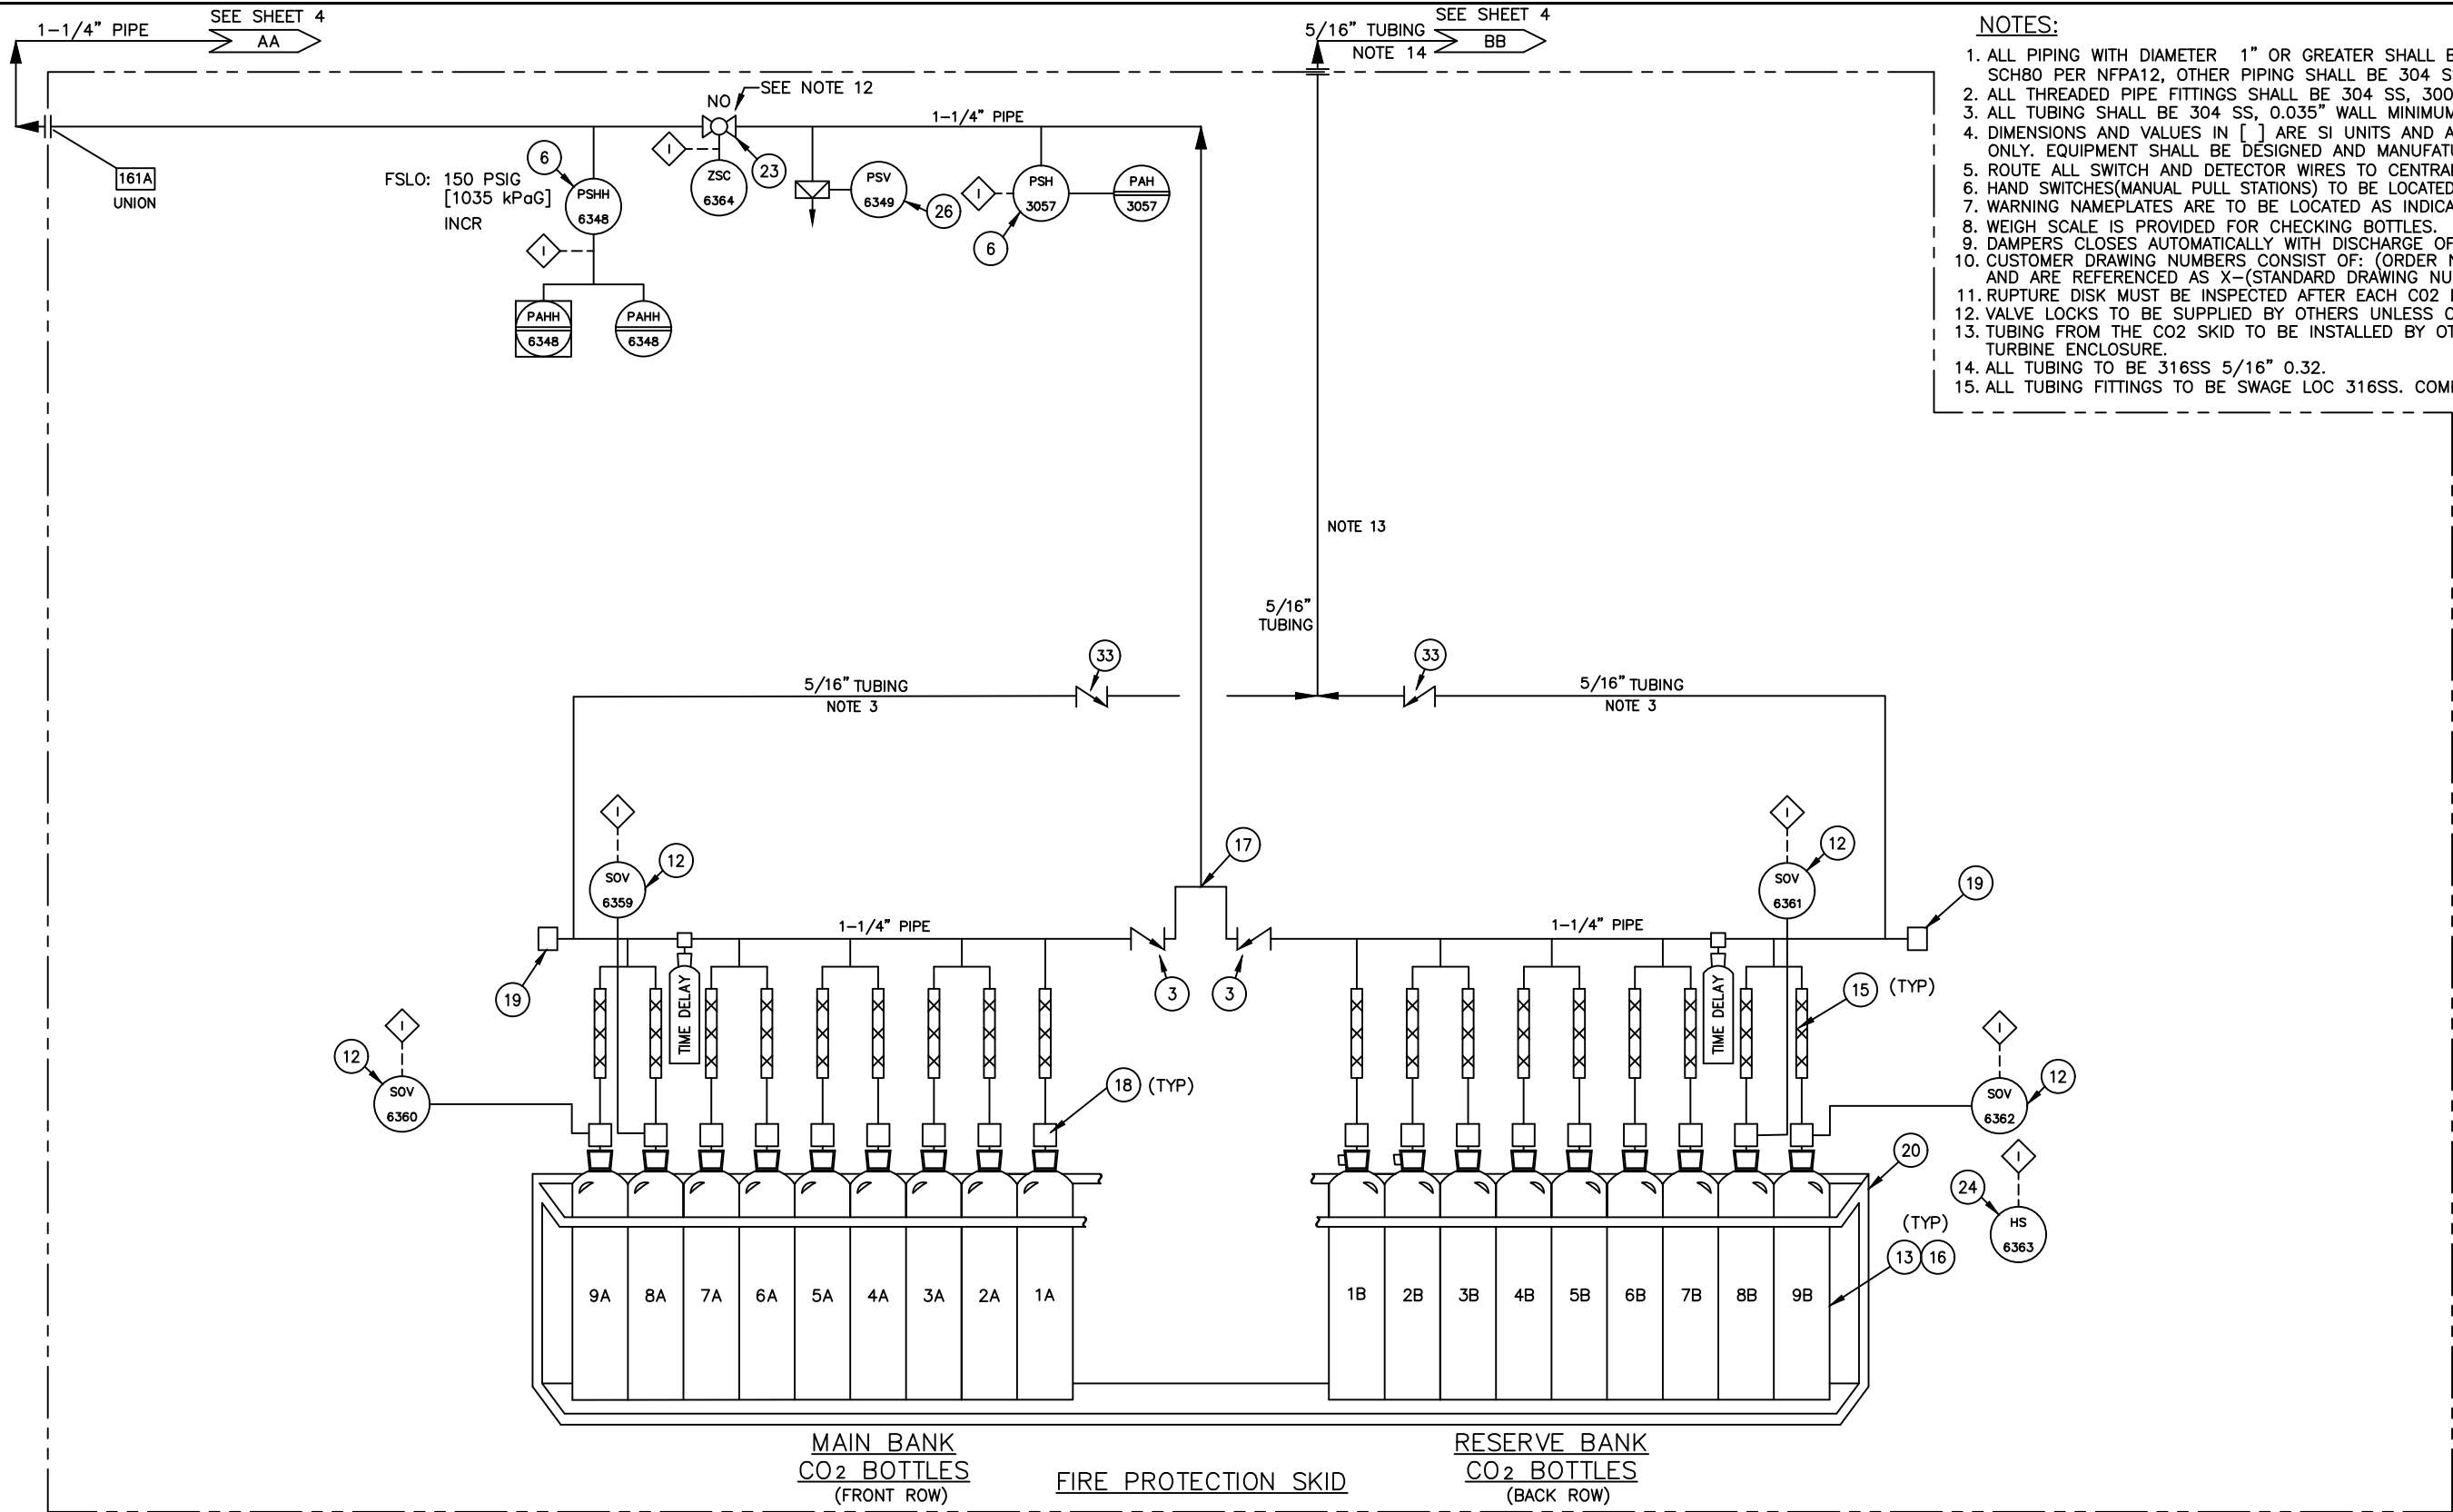

NOTES:

1. ALL PIPING WITH DIAMETER 1" OR GREATER SHALL BE SCH80 PER NFPA12, OTHER SCH80 PER NFPA12, OTHER PIPING SHALL BE 304 SS, SCH40 MIN, ASTM A-312.
2. ALL THREADED PIPE FITTINGS SHALL BE 304 SS, 3000# MINIMUM.
3. ALL TUBING SHALL BE 304 SS, 0.035" WALL MINIMUM, ASTM A-269.
4. DIMENSIONS AND VALUES IN [] ARE SI UNITS AND ARE GIVEN FOR REFERENCE ONLY. EQUIPMENT SHALL BE DESIGNED AND MANUFACTURED USING U.S. CUSTOMARY UNITS.
5. ROUTE ALL SWITCH AND DETECTOR WIRES TO CENTRAL FIRE AND GAS CONSOLE.
6. HAND SWITCHES(MANUAL PULL STATIONS) TO BE LOCATED OUTSIDE MAIN SKID NEXT TO EACH DOOR.
7. WARNING NAMEPLATES ARE TO BE LOCATED AS INDICATED IN THE DESCRIPTION FOR ITEM 22.
8. WEIGH SCALE IS PROVIDED FOR CHECKING BOTTLES.
9. DAMPERS CLOSES AUTOMATICALLY WITH DISCHARGE OF CO2.
10. CUSTOMER DRAWING NUMBERS CONSIST OF: (ORDER NUMBER)-(STANDARD DRAWING NUMBERS) AND ARE REFERENCED AS X-(STANDARD DRAWING NUMBER), WHERE X= ORDER NUMBER.
11. RUPTURE DISK MUST BE INSPECTED AFTER EACH CO2 DISCHARGE AND REPLACED AS NECESSARY.
12. VALVE LOCKS TO BE SUPPLIED BY OTHERS UNLESS OTHERWISE NOTED.
13. TUBING FROM THE CO2 SKID TO BE INSTALLED BY OTHERS AND TO TIE IN THE SIRENS IN THE TURBINE ENCLOSURE.
14. ALL TUBING TO BE 316SS 5/16" 0.32.
15. ALL TUBING FITTINGS TO BE SWAGE LOC 316SS. COMPRESSION

(X) = REFERENCE PARTS ON SHEET 7

LEGEND:


FSLO = FAST STOP LOCKOUT WITHOUT MOTOR
LEL = LOW EXPLOSION LEVEL

REFERENCE DRAWINGS:

REVISIONS				THIS DRAWING, DESIGN AND THE DATA CONTAINED THEREIN IS THE PROPERTY OF WILSON FIRE EQUIPMENT AND IS NOT TO BE DISTRIBUTED TO OR USED BY OTHERS WITHOUT THE EXPRESSED WRITTEN CONSENT OF WILSON FIRE EQUIPMENT.
REV	DESCRIPTION	DATE	BY	
A	ISSUED FOR APPROVAL	06/13/24	MAP	
B	ISSUED FOR APPROVAL	11/01/24	MAP	
C	ISSUED FOR APPROVAL	01/31/24	MAP	
SCALE: AS SHOWN				DATE
DRAWN: MAP				06/13/24
CHECKED: JV				06/13/24
APPROVED: JV				06/13/24

WILSON FIRE EQUIPMENT & SERVICE CO. 7303 EMPIRE CENTRAL DRIVE HOUSTON, TEXAS 77040 (713) 896-4747		
CUSTOMER INFORMATION		
GE VERNOVA		
LM6000 60HZ DLE SHELL FRIENDSWOOD		
FLOW AND INSTRUMENT DIAGRAM CO2 FIRE PROTECTION SKID WFE PROJECT # SHELL-1457		

		
SIZE	DRAWING NO.	REV
B	GA-1457-03 SHEET 3 OF 8	C

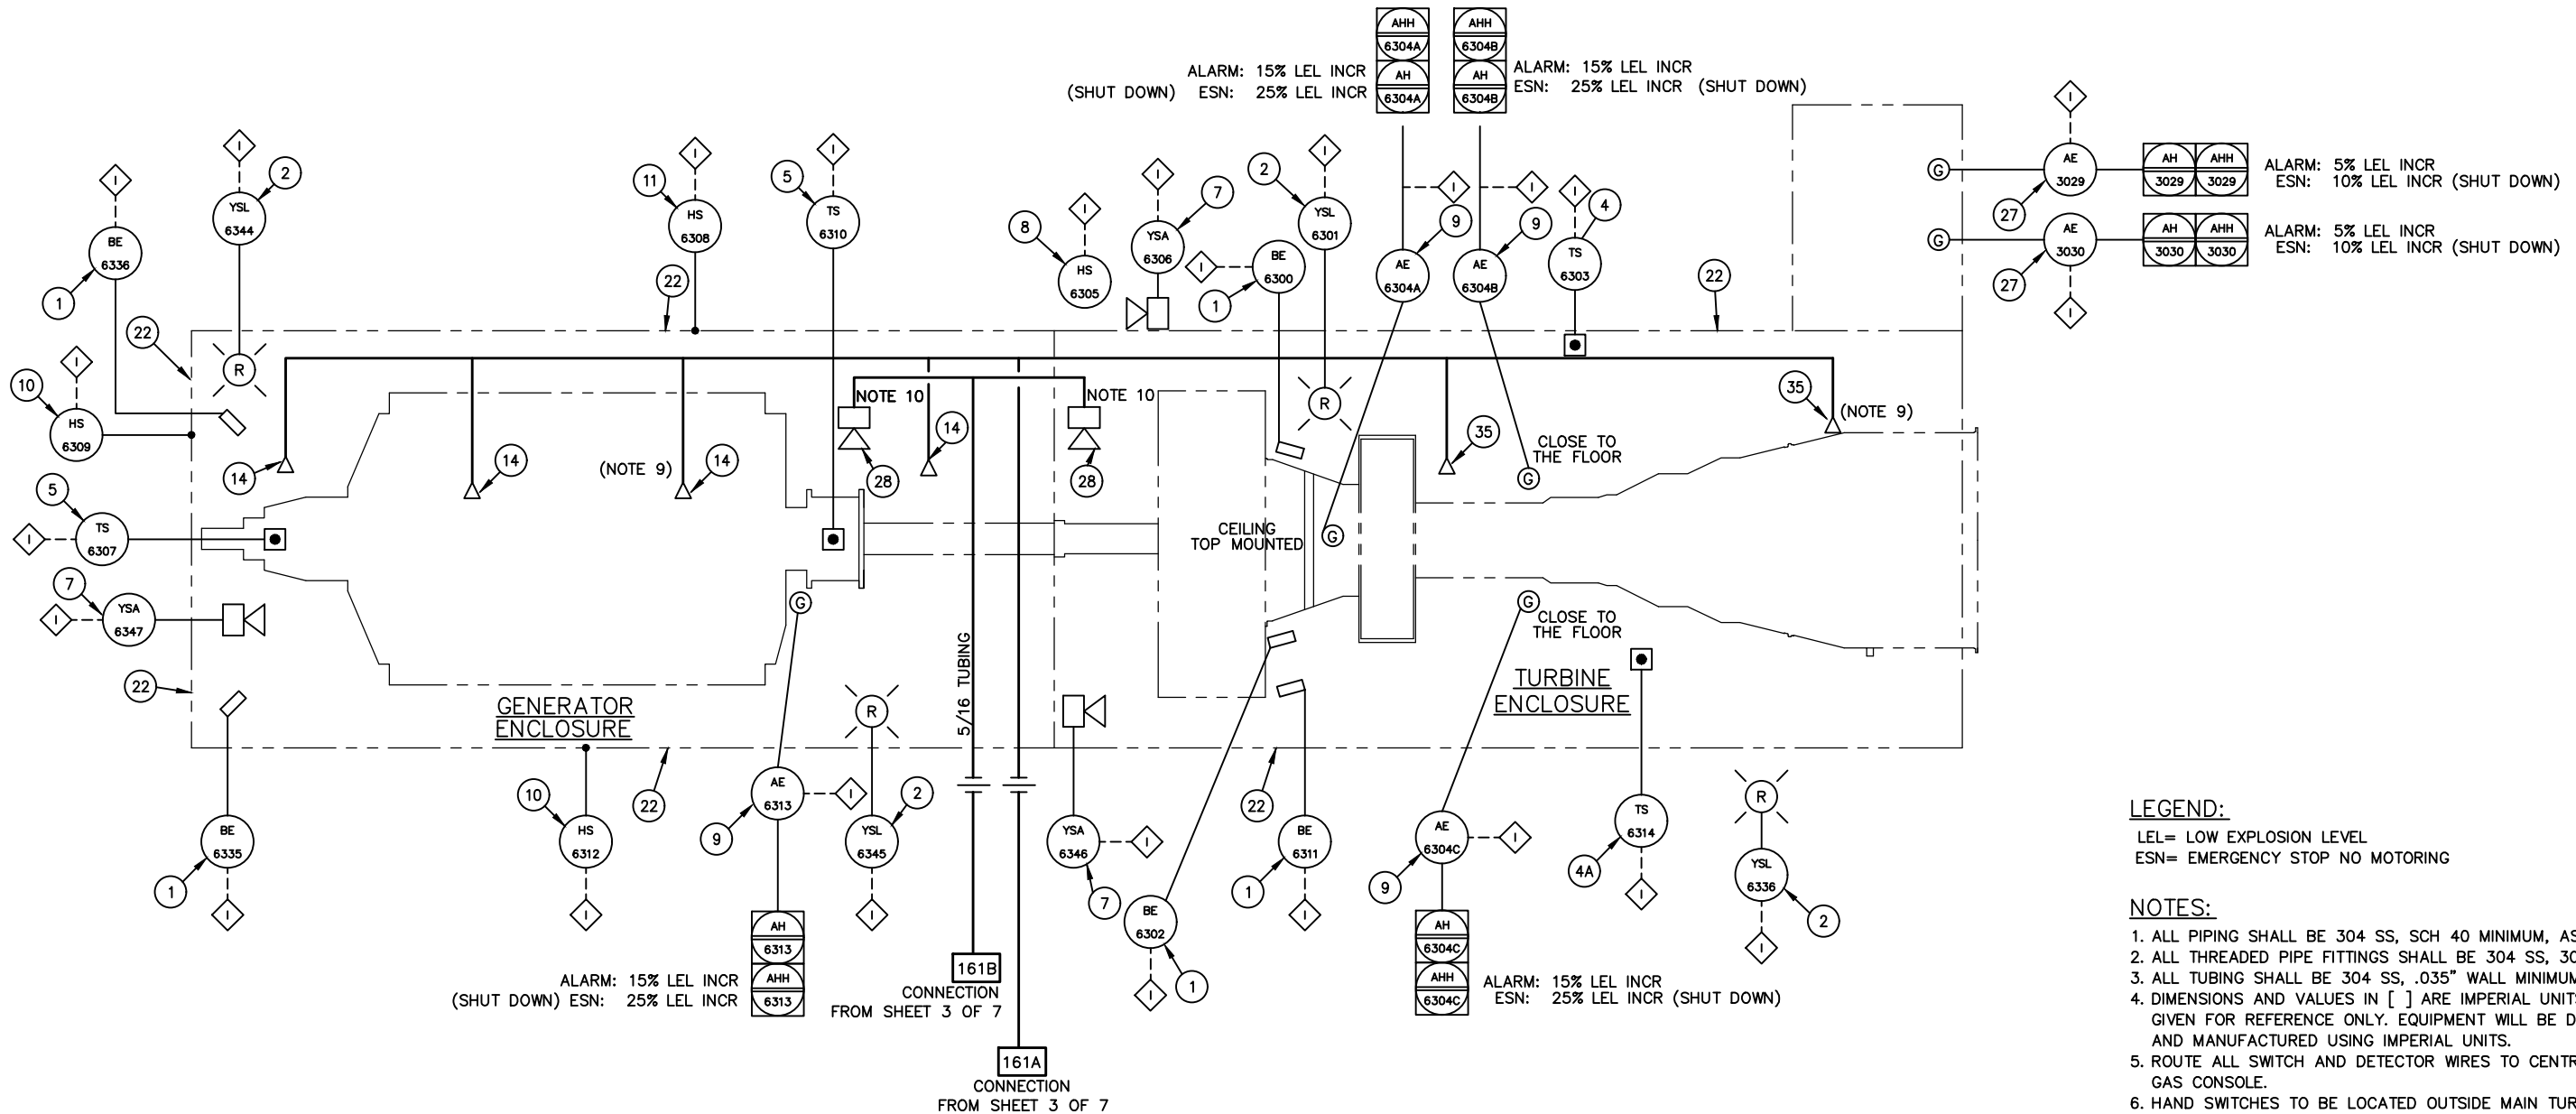

LEGEND:

LEL= LOW EXPLOSION LEVEL
ESN= EMERGENCY STOP NO MOTORING

NOTES:


- 1. ALL PIPING SHALL BE 304 SS, SCH 40 MINIMUM, ASTM A-312.
- 2. ALL THREADED PIPE FITTINGS SHALL BE 304 SS, 3000# MINIMUM.
- 3. ALL TUBING SHALL BE 304 SS, .035" WALL MINIMUM, ASTM A-269.
- 4. DIMENSIONS AND VALUES IN [] ARE IMPERIAL UNITS. ENGLISH ARE GIVEN FOR REFERENCE ONLY. EQUIPMENT WILL BE DESIGNED AND MANUFACTURED USING IMPERIAL UNITS.
- 5. ROUTE ALL SWITCH AND DETECTOR WIRES TO CENTRAL FIRE AND GAS CONSOLE.
- 6. HAND SWITCHES TO BE LOCATED OUTSIDE MAIN TURBINE NEXT TO MOST FREQUENTLY USED DOORS.
- 7. WARNING NAMEPLATES ARE TO BE LOCATED AS INDICATED IN THE DESCRIPTION FOR ITEM 22.
- 8. WEIGH SCALE IS PROVIDED FOR CHECKING BOTTLES.
- 9. DAMPERS CLOSE AUTOMATICALLY WITH DISCHARGE OF CO2. ROUTE 1/4" DIA LINE TO KIDDE PRESSURE RELEASE MECHANISMS ON FIRE DAMPERS.
- 10. AN ASTERISK (*) INDICATES INTERFACE CONNECTION HARDWARE BY GEPLP.
- 11. RUPTURE DISK MUST BE INSPECTED AFTER EACH CO2 DISCHARGE AND REPLACED AS NECESSARY.

(X) = REFERENCE NUMBERS ON GA SHEET 7
(I) = REPRESENTS EQUIPMENT INTERFACING WITH GEPLP

REVISIONS				THIS DRAWING, DESIGN AND THE DATA CONTAINED THEREIN IS THE PROPERTY OF WILSON FIRE EQUIPMENT AND IS NOT TO BE DISTRIBUTED TO OR USED BY OTHERS WITHOUT THE EXPRESSED WRITTEN CONSENT OF WILSON FIRE EQUIPMENT.	
REV	DESCRIPTION	DATE	BY		
A	ISSUED FOR APPROVAL	06/13/24	MAP		
B	ISSUED FOR APPROVAL	11/01/24	MAP		
C	ISSUED FOR APPROVAL	01/31/25	MAP		
				SCALE:	N.T.S
				DRAWN:	MAP 06/13/24
				CHECKED:	JV 06/13/24
				APPROVED:	JV 06/13/24

WILSON FIRE EQUIPMENT & SERVICE CO. 7303 EMPIRE CENTRAL DRIVE HOUSTON, TEXAS 77040 (713) 896-4747		
CUSTOMER INFORMATION		
GE VERNOVA		
LM6000 60HZ DLE SHELL FRIENDSWOOD		
FLOW AND INSTRUMENT DIAGRAM CO2 FIRE PROTECTION SYSTEM WFE PROJECT # GE-1457		

SIZE	DRAWING NO.	REV
B	GA-1457-04	C
SHEET 4 OF 8		

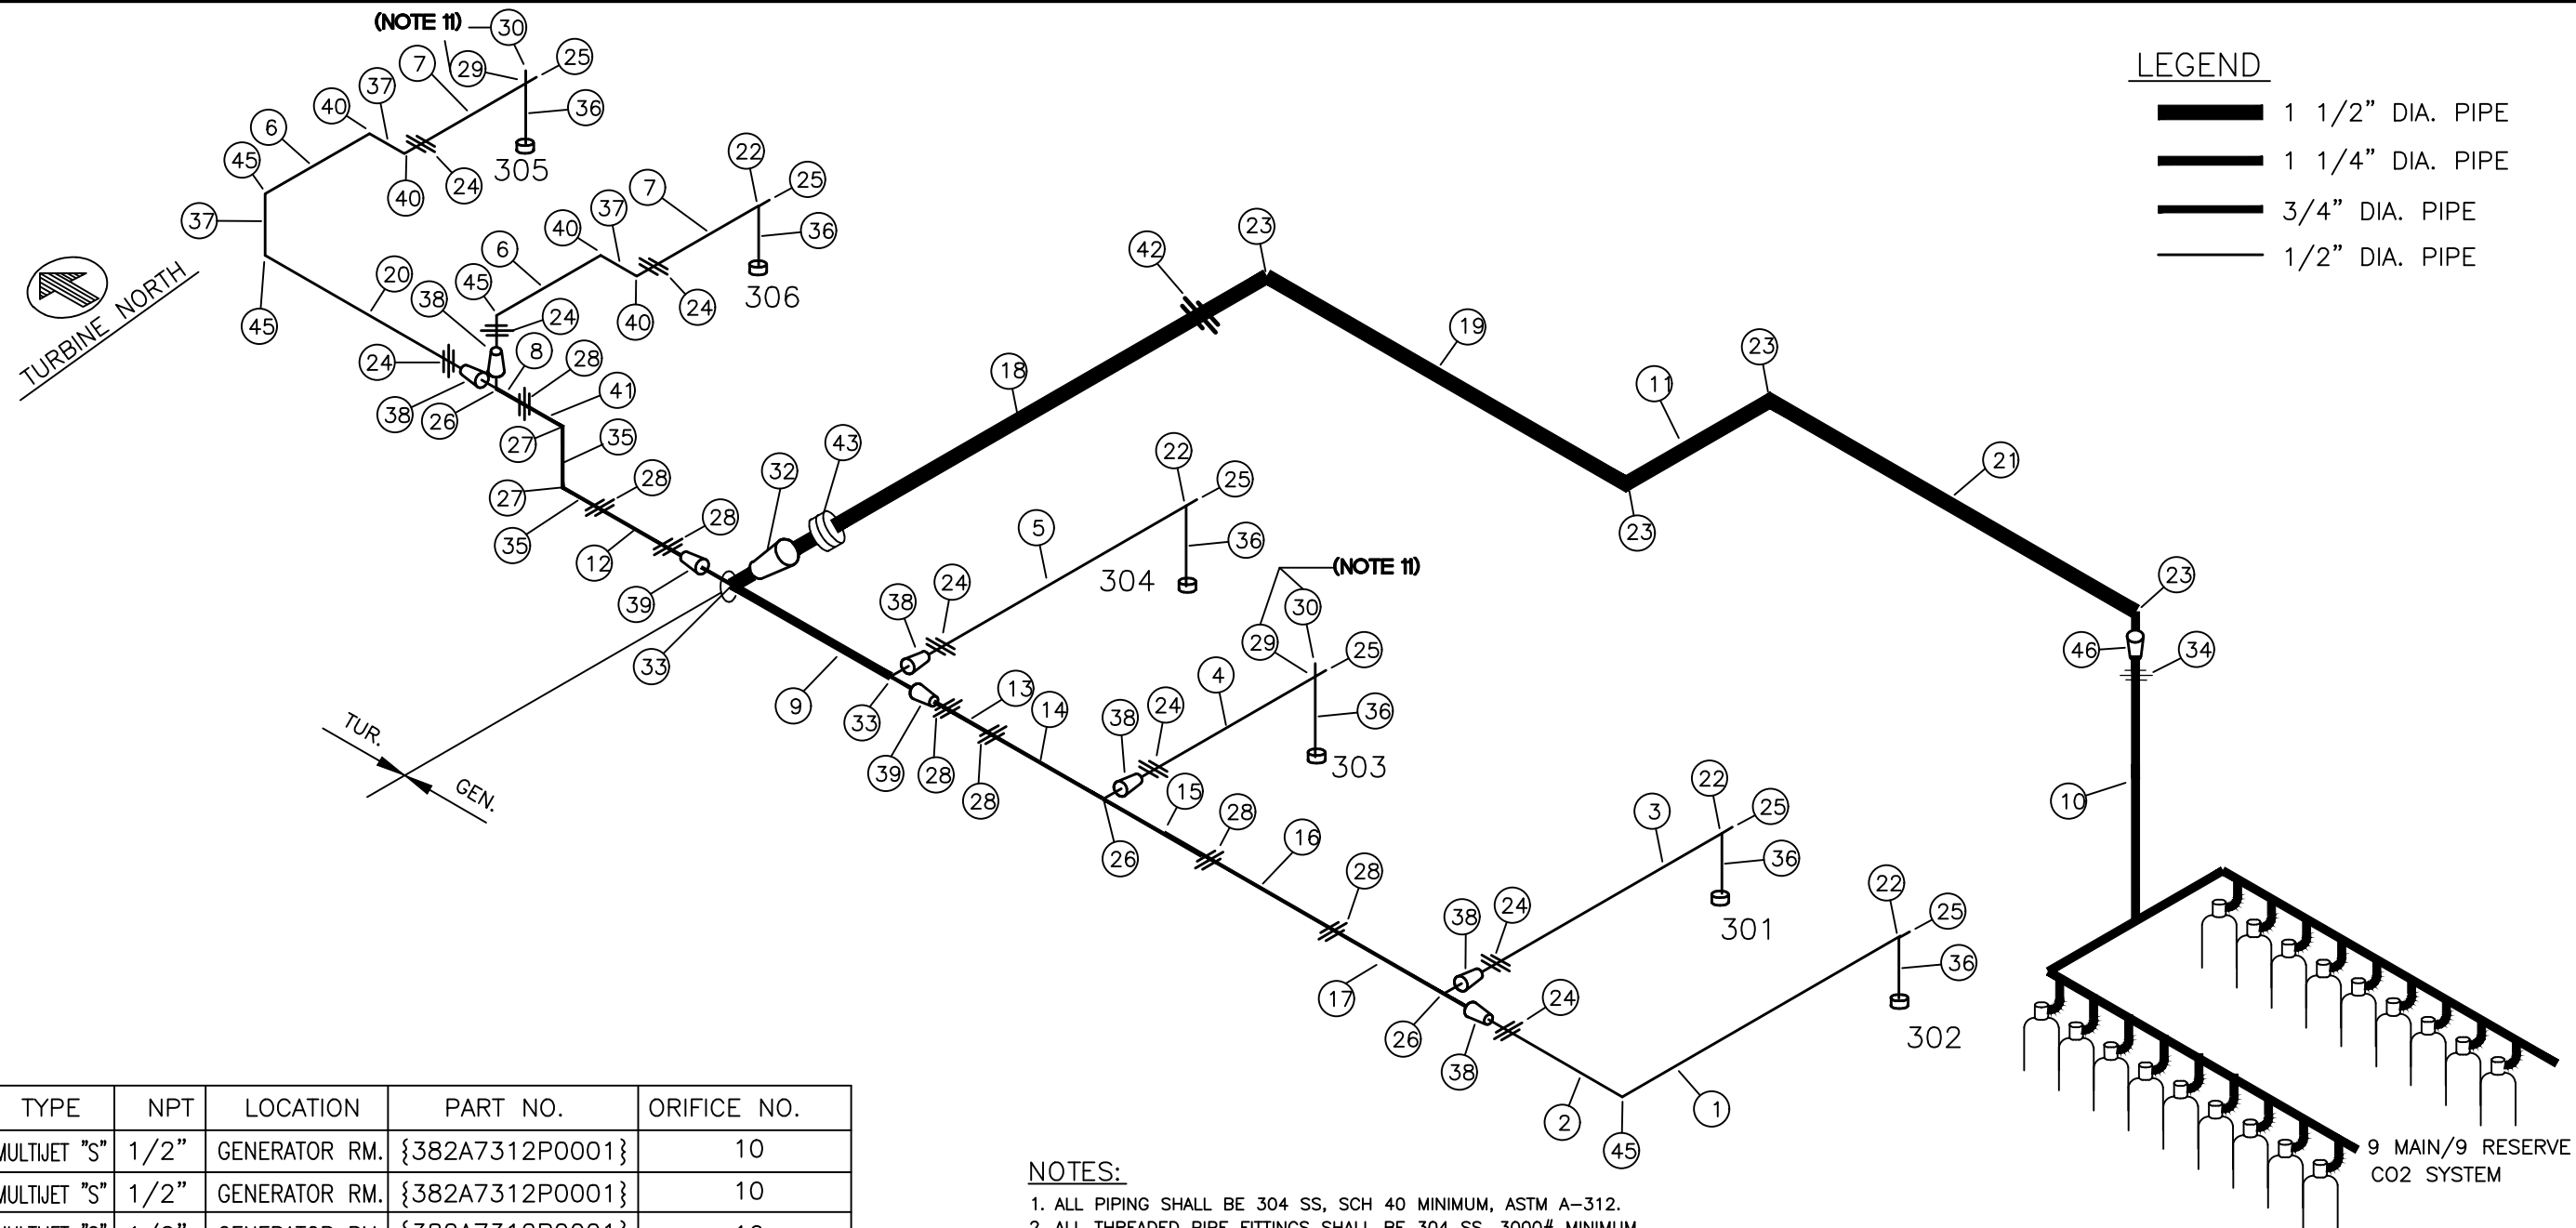

NOZZLE	TYPE	NPT	LOCATION	PART NO.	ORIFICE NO.
301	MULTIJET "S"	1/2"	GENERATOR RM.	{382A7312P0001}	10
302	MULTIJET "S"	1/2"	GENERATOR RM.	{382A7312P0001}	10
303	MULTIJET "S"	1/2"	GENERATOR RM.	{382A7312P0001}	10
304	MULTIJET "S"	1/2"	GENERATOR RM.	{382A7312P0001}	10
305	MULTIJET "S"	1/2"	TURBINE RM.	{382A7312P0001}	10
306	MULTIJET "S"	1/2"	TURBINE RM.	{382A7312P0001}	10

- NOTES:
1. ALL PIPING SHALL BE 304 SS, SCH 40 MINIMUM, ASTM A-312.
 2. ALL THREADED PIPE FITTINGS SHALL BE 304 SS, 3000# MINIMUM.
 3. ALL TUBING SHALL BE 304 SS, .035" WALL MINIMUM, ASTM A-269.
 4. DIMENSIONS AND VALUES IN [] ARE SI UNITS AND ARE GIVEN FOR REFERENCE ONLY. EQUIPMENT WILL BE DESIGNED AND MANUFACTURED USING ENGLISH UNITS ONLY. DIMENSIONS ARE IN INCHES.
 5. PIPING IS INSTALLED BY WILSON FIRE INSIDE THE UNIT.
 6. ALL PIPE THAT IS 1" OR LARGER IS SCH.80.
 7. ALL PIPE THAT IS 3/4" OR SMALLER IS SCH.40.
 8. THIS DRAWING IS FOR NOZZLE LOCATIONS. PIPE LAYOUT MAY NOT ADHERE TO ACTUAL PIPING DESIGN.
 9. ALL EXTERIOR PIPING TO BE INSTALLED BY CONTRACTOR.
 10. ALL EXTERIOR PIPING TO BE PROVIDED BY WILSON FIRE EQUIPMENT.
 11. ROUTE 1/4" DIA TUBING LINE TO KIDDE PRESSURE RELEASE MECHANISM ON FIRE DAMPER (TYPICAL BY 4 EACH DAMPERS).

(X) = REFERENCE PARTS ON SHEET 6

REVISIONS				THIS DRAWING, DESIGN AND THE DATA CONTAINED THEREIN IS THE PROPERTY OF WILSON FIRE EQUIPMENT AND IS NOT TO BE DISTRIBUTED TO OR USED BY OTHERS WITHOUT THE EXPRESSED WRITTEN CONSENT OF WILSON FIRE EQUIPMENT.	
REV	DESCRIPTION	DATE	BY		
A	ISSUED FOR APPROVAL	06/13/24	MAP		
B	ISSUED FOR APPROVAL	11/01/24	MAP		
C	ISSUED FOR APPROVAL	01/31/25	MAP		
				SCALE:	N.T.S. DATE
				DRAWN:	MAP 06/13/24
				CHECKED:	JV 06/13/24
				APPROVED:	JV 06/13/24

WILSON FIRE EQUIPMENT & SERVICE CO.	
7303 EMPIRE CENTRAL DRIVE HOUSTON, TEXAS 77040 (713) 896-4747	
CUSTOMER INFORMATION	
GE VERNOVA	
LM6000 60HZ DLE SHELL FRIENDSWOOD	
ISOMETRIC PIPING LAYOUT MAIN/RESERVE DISCHARGE PIPING WFE PROJECT # GE-1457	

WFE		
SIZE	DRAWING NO.	REV
B	GA-1457-05 SHEET 5 OF 8	C

ITEM NO.	QTY	PIPE	SCH 40	SS 304L
1	1	1/2" x 6'-2"	X	X
2	1	1/2" x 2'-7-5/8"	X	X
3	1	1/2" x 5'-10"	X	X
4	1	1/2" x 0'-6"	X	X
5	1	1/2" x 6'-0"	X	X
6	2	1/2" x 2'-3"	X	X
7	2	1/2" x 3'-2"	X	X
8	1	3/4" x 2'-0"	X	X
9	1	1" x 0'-4"	X	X
10	1	1 1/4" x 6'-0"	X	X
11	1	1 1/2" x 5'-0"	X	X
12	1	3/4" x 2'-1"	X	X
ITEM NO.	QTY	PIPE	SCH 80	SS 304L
13	1	3/4" X 2'-7 1/2"	X	X
14	1	3/4" X 2'-8 3/4"	X	X
15	1	3/4" x 2'-4 3/4"	X	X
16	1	3/4" x 5'-7"	X	X
17	1	3/4" x 6'-0"	X	X
18	1	1 1/2" x 12'-11"	X	X
19	1	1 1/2" x 10'-0"	X	X
20	1	1/2" x 6'-0"	X	X
21	1	1 1/2" x 10'-0"	X	X

ITEM NO.	QTY	FITTINGS	SS	3000#
22	4	1/2" TEES	X	X
23	4	1 1/2" ELBOW	X	X
24	8	1/2" UNION	X	X
25	6	1/2" X 2" NIPPLE W/ CAP	X	X
26	3	3/4" TEE	X	X
27	2	3/4" ELBOW	X	X
28	7	3/4" UNION	X	X
29	2	1/2" CROSS	X	X
30	2	1/2" x 1/4" BUSHING	X	X
31	1	1 1/2" TEE	X	X
32	1	1 1/2" x 1" SWAGE	X	X
33	1	1" TEE	X	X
34	1	1 1/4" UNION	X	X
35	2	3/4" X 4" NIPPLE	SCH 40	SS 304L
36	6	1/2" x 3" NIPPLE	SCH 40	SS 304L
37	3	3/4" x 4" NIPPLE	X	X
38	4	3/4" X 1/2" SWAGE	X	X
39	1	1" x 3/4" SWAGE	X	X
40	4	1/2" X 45° ELBOW	X	X
41	1	3/4" X 2" NIPPLE	SCH 40	SS 304L
42	1	1 1/2" UNION	X	X
43	1	1 1/2"COUPLING	X	X
45	4	1/2" ELBOW	X	X
46	1	1 1/2" X 1 1/4" SWAGE	X	X

(X) = REFERENCE PARTS ON SHEET 5

REVISIONS				THIS DRAWING, DESIGN AND THE DATA CONTAINED THEREIN IS THE PROPERTY OF WILSON FIRE EQUIPMENT AND IS NOT TO BE DISTRIBUTED TO OR USED BY OTHERS WITHOUT THE EXPRESSED WRITTEN CONSENT OF WILSON FIRE EQUIPMENT.	
REV	DESCRIPTION	DATE	BY		
A	ISSUED FOR APPROVAL	06/13/24	MAP		
B	ISSUED FOR APPROVAL	11/01/24	MAP		
C	ISSUED FOR APPROVAL	01/31/24	MAP		
				SCALE:	NONE DATE
				DRAWN:	MAP 06/13/24
				CHECKED:	JV 06/13/24
				APPROVED:	JV 06/13/24

WILSON FIRE EQUIPMENT & SERVICE CO. 7303 EMPIRE CENTRAL DRIVE HOUSTON, TEXAS 77040 (713) 896-4747		
CUSTOMER INFORMATION		
GE VERNOVA		
LM6000 60HZ DLE SHELL FRIENDSWOOD		
BILL OF MATERIALS MAIN/RESERVE DISCHARGE FIELD PIPING WFE PROJECT # GE-1457		

		
SIZE	DRAWING NO.	REV
B	GA-1457-06 SHEET 6 OF 8	C

ITEM NO.	TAG NO.	DEVICE	MFG/PART NO.	QTY.	DESCRIPTION	ITEM NO.	TAG NO.	DEVICE	MFG/PART NO.	QTY.	DESCRIPTION	ITEM NO.	TAG NO.	DEVICE	MFR/PART NO.	QTY	DESCRIPTION
①	BE-6300 BE-6302 BE-6311 BE-6335 BE-6336	OPTICAL FLAME DETECTOR	DETTRONICS {382A6242P0002}	5	IR FLAME DETECTOR, 90 DEGREE VIEW CONE, FORM C CONTACTS, 24 VDC, CERTS: ATEX/FM, CSA	②②	N/A	CO2 WARNING NAMEPLATE SET (ENGLISH)	MERCURY {216A4505P0001}	1	ONE (1) WARNING NAMEPLATES FOR THE OUTSIDE SURFACE OF EACH ENCLOSURE DOOR, AS FOLLOWS: "WARNING, CARBON DIOXIDE GAS CAN CAUSE INJURY OR DEATH. WHEN ALARM OPERATES OR AFTER DISCHARGE, DO NOT ENTER, UNTIL VENTILATED". "DO NOT ENTER, WHILE UNIT IS OPERATING, INHIBIT FIRE PROTECTION SYSTEM BEFORE ENTRY". "NOTICE: RETAIN DOOR WITH HOLDER WHEN OPEN." ONE (1) WARNING NAMEPLATE FOR THE INSIDE SURFACE OF EACH ENCLOSURE DOOR, AS FOLLOWS: "WARNING, CARBON DIOXIDE GAS CAN CAUSE INJURY OR DEATH. WHEN ALARM OPERATES VACATE IMMEDIATELY". ONE (1) WARNING NAMEPLATES ADJACENT TO CO2 BOTTLES AND AT MANUAL RELEASE STATIONS, PER NFPA, AS FOLLOWS: "WARNING, CARBON DIOXIDE GAS CAN CAUSE INJURY OR DEATH, ACTUATION OF THIS DEVICE WILL CAUSE CARBON DIOXIDE TO DISCHARGE, BEFORE ACTUATING BE SURE PERSONNEL ARE CLEAR OF THE AREA". ONE (1) "CAUTION, PRESSURIZED COMPARTMENT, STAND CLEAR OF DOOR WHEN OPENING." TWO (2) "CAUTION, COMPARTMENT UNDER NEGATIVE PRESSURE. STAND CLEAR OF DOOR WHEN CLOSING TOTAL 22 NAMEPLATES PER SET (FOUR NAMEPLATES FOR EACH OF SIX ENCLOSURE DOORS, ONE NAMEPLATE ADJACENT TO CO2 BOTTLES AND ONE NAMEPLATE AT EACH MANUAL RELEASE STATION).	②⑧	N/A	PNEUMATIC SIREN	KIDDE {377A2236P0002}	2	PNEUMATIC SIREN UL CERTIFIED
②	YSL-6301 YSL-6336 YSL-6344 YSL-6345	BEACON LIGHT	MEDC {382A3136P0001}	5	RED LIGHT STROBE, EXPLOSION PROOF, CERTS: ATEX/UL W/10K							③①	N/A	NITROGEN CYLINDER	KIDDE {393A1526P0001}	2	NITROGEN CYLINDER
③	N/A	1" CHECK VALVE	WILSON {398A4796P0001}	2	1" CHECK VALVES UL LISTED.			SIGN 1 QUANTITY (6) (LAMINATED) (10" x 21")				③②	N/A	BRACKETS	KIDDE {377A1189P0002}	2	BRACKETS FOR CYLINDER
④	TS-6303	THERMAL SPOT DETECTOR (TURBINE ROOM)	MEDC {382A4000P0001}	1	THERMAL SWITCH, FORM A, 24 VDC, 232°C [450 °F] PLUS RATE OF RISE, EXPLOSION PROOF, CERTS: UL							③③	N/A	CHECK VALVE	KIDDE 264985	2	1/4" CHECK VALVE
④A	TS-6314	THERMAL SPOT DETECTOR (TURBINE ROOM)	MEDC {390A6118P0001}	1	THERMAL SWITCH, FORM A, 24 VDC, 232°C [450 °F] PLUS RATE OF RISE, EXPLOSION PROOF, WITH 10K RESISTOR. CERTS: UL							③④	N/A	WEIGH SCALE	KIDDE 982505	1	CO2 CYLINDER WEIGH SCALE
⑤	TS-6307 TS-6310	THERMAL SPOT DETECTOR (GENERATOR ROOM)	MEDC {382A3999P0001}	2	THERMAL SWITCH, FORM A, 24 VDC, 107°C [225 °F] PLUS RATE OF RISE, EXPLOSION PROOF, CERTS: UL 10K			SIGN 2 QUANTITY (6) (ALU) (10" x 7")				③⑤	305 306	NOZZLE (TURBINE ROOM)	KIDDE {382A7312P0001}	2	MULTIJET "S" 1/2" NPT, CS CADMIUM PLATED, ORIFICE # 10
⑥	PSHH-6348 PSH-3057	(DRY LINE) DISCHARGE PRESSURE SWITCH	UNITED ELECTRIC {398A4800P0001}	2	PRESSURE SWITCH, TWO FORM A, 24 VDC, EXPLOSION PROOF DESIGNED FOR CO2 SERVICE. UL												
⑦	YSA-6306 YSA-6346 YSA-6347	FIRE/GAS ALARM HORN	MEDC {386A3126P0002}	3	HORN, 24 VDC, 100-110 dB AT 10 FEET, EXPLOSION PROOF. CERTS: ATEX/UL 10K												
⑧	HS-6305	HORN SILENCE SWITCH	ABTECH {382A5412P0001}	1	KEYED STATION, FORM B MAINTAINED, 24 VDC UL. WITH 10K RESISTOR.												
⑨	AE-6304A AE-6304B AE-6304C AE-6313	DETECTOR, COMBUSTIBLE GAS	DETTRONICS {390A3459P0001}	4	DETECTOR, COMBUSTIBLE GAS (METHANE) ANALOG, EXPLOSION PROOF 500 Ohm, METRIC, CERTS: ATEX/FM, CSA UD10 MODEL.			SIGN 3 QUANTITY (4) (LAMINATED) (10" x 7")									
⑩	HS-6309 HS-6312	MANUAL RELEASE STATION	MEDC {390A3393P0001}	2	FIRE ALARM PULL STATION, MANUAL, 24 VDC, TWO FORM A, OUTDOOR, DESIGNED FOR CO2 SERVICE, EXPLOSION PROOF. CERTS: UL												
⑪	HS-6308	MANUAL RELEASE STATION	MEDC {390A3394P0001}	1	FIRE ALARM PULL STATION, MANUAL, 24 VDC, TWO FORM A, OUTDOOR, DESIGNED FOR CO2 SERVICE, EXPLOSION PROOF, WITH 10K RESISTOR. CERTS: UL			SIGN 4 QUANTITY (4) (LAMINATED) (10" x 7")									
⑫	SOV-6359 SOV-6360 SOV-6361 SOV-6362 SOV-6365 SOV-6366	AUTO/MANUAL RELEASE SOLENOID VALVE	KIDDE {377A1196P0001}	6	ELECTRIC CONTROL HEAD W/MANUAL RELEASE, 2 EACH MAIN AND RESERVE, EXPLOSION PROOF. CERTS: UL			SIGN 5 QUANTITY (2) (LAMINATED) (10" x 7")									
⑬	N/A	FIRE SUPPRESSANT	CO2	1600	CO2, FOR FILLING ITEM 16, 100 LBS EACH CYLINDER, 800 LBS MAIN BANK, 800 LBS RESERVE BANK, 1600 LBS TOTAL	②③	ZSC-6364	SERVICE BALL VALVE/ POSITION SWITCH	STONEL/FLOWTEK {398A4798P0001}	1	BALL VALVE, 1" NPT, SS BODY & TRIM, GRAPHITE SEALS, FIRE SAFE, LOCKABLE HANDLES, ACCUTRAK NEMA-7 SWITCH, 24 VDC/1000 OHMS. FM.						
⑭	301 302 303 304	NOZZLE (GENERATOR ROOM)	KIDDE {382A7312P0001}	4	MULTIJET "S", 1/2" NPT, CS, CADMIUM PLATED, ORIFICE #10	②④	HS-6363	CO2 PURGE SWITCH	ABTECH {382A6402P0001}	1	CO2 PURGE SWITCH WITH LATCHING RELAY ASSEMBLY UL.						
⑮	N/A	FLEXIBLE HOSE	KIDDE {377A2245P0001}	16	FLEX HOSE, 3/4",REINFORCED RUBBER WITH INTERNAL DOUBLE WIRE BRAID, STEEL AND CADMIUM-PLATED STAINLESS STEEL FITTINGS	②⑤	161A	CO2 SKID CONNECTION	N/A	1	CO2 SKID CONNECTION TO MAIN PIPING 1" UNION						
⑯	N/A	CO2 CYLINDERS	KIDDE {377A1188P0001}	16	CO2 CYLINDER 100# DOT	②⑥	PSV-6349	SAFETY OUTLET VALVE ASSEMBLY	KIDDE 803242	2	RUPTURE DISK ASSEMBLY RATED AT 16547-19305 kPaG [2400-2800 PSIG] RUPTURE DISK UL						
⑰	N/A	MANIFOLD	WILSON WFE 30416SS	1	MAIN MANIFOLD AND FITTINGS, 304 SS, 1", 3000 LBS. FITTINGS	②⑦	AE-3029 AE-3030	IR GAS DETECTOR	DETTRONICS {216A3299P0002}	2	IR GAS DETECTOR, 24 V, CLASS 1 DIV 2, EXPLOSION PROOF, ASSEMBLY WITH BRACKET AND RAIN SHIELD, CERTS: ATEX/FM/CSA						
⑱	N/A	DISCHARGE HEAD	KIDDE {377A2233P0001}	16	PLAIN NUT DISCHARGE HEAD, BODY:BRASS, O-RINGS:RUBBER, STOP CHECK: BRASS UL												
⑲	N/A	DISCHARGE INDICATOR	KIDDE 967082	2	POP-UP INDICATOR IN MANIFOLD, 3/4" NPT, BRASS BODY UL												
⑳	N/A	CYLINDER RACK	WILSON {386A3351P0001}	1	CYLINDER FRAMING FOR TWENTY FOUR 100 LB CO2 BOTTLES, INCLUDES MOUNTS FOR ITEM 30												
㉑			LEFT BLANK														


NOTE:
NUMBERS IN { } BRACES ARE GEPLP ASSIGNED PART NUMBERS.
REFERENCE SHEET 3 AND 4 FOR EQUIPMENT LOCATION

ⓧ = REFERENCE NUMBERS ON SHEET 1, 2, 3, 4

REVISIONS				THIS DRAWING, DESIGN AND THE DATA CONTAINED THEREIN IS THE PROPERTY OF WILSON FIRE EQUIPMENT AND IS NOT TO BE DISTRIBUTED TO OR USED BY OTHERS WITHOUT THE EXPRESSED WRITTEN CONSENT OF WILSON FIRE EQUIPMENT.	
REV	DESCRIPTION	DATE	BY		
A	ISSUED FOR APPROVAL	06/13/24	MAP		
B	ISSUED FOR APPROVAL	11/01/24	MAP		
C	ISSUED FOR APPROVAL	01/31/24	MAP		
				SCALE:	AS SHOWN
				DRAWN:	MAP 06/13/24
				CHECKED:	JV 06/13/24
				APPROVED:	JV 06/13/24

WILSON FIRE EQUIPMENT & SERVICE CO. 7303 EMPIRE CENTRAL DRIVE HOUSTON, TEXAS 77040 (713) 896-4747	
CUSTOMER INFORMATION	
GE VERNOVA	
LM6000 60HZ DLE SHELL FRIENDSWOOD	
BILL OF MATERIAL CO2 EQUIPMENT & DEVICES WFE PROJECT # GE-1457	

		
SIZE	DRAWING NO.	REV
B	GA-1457-07 SHEET 7 OF 8	C

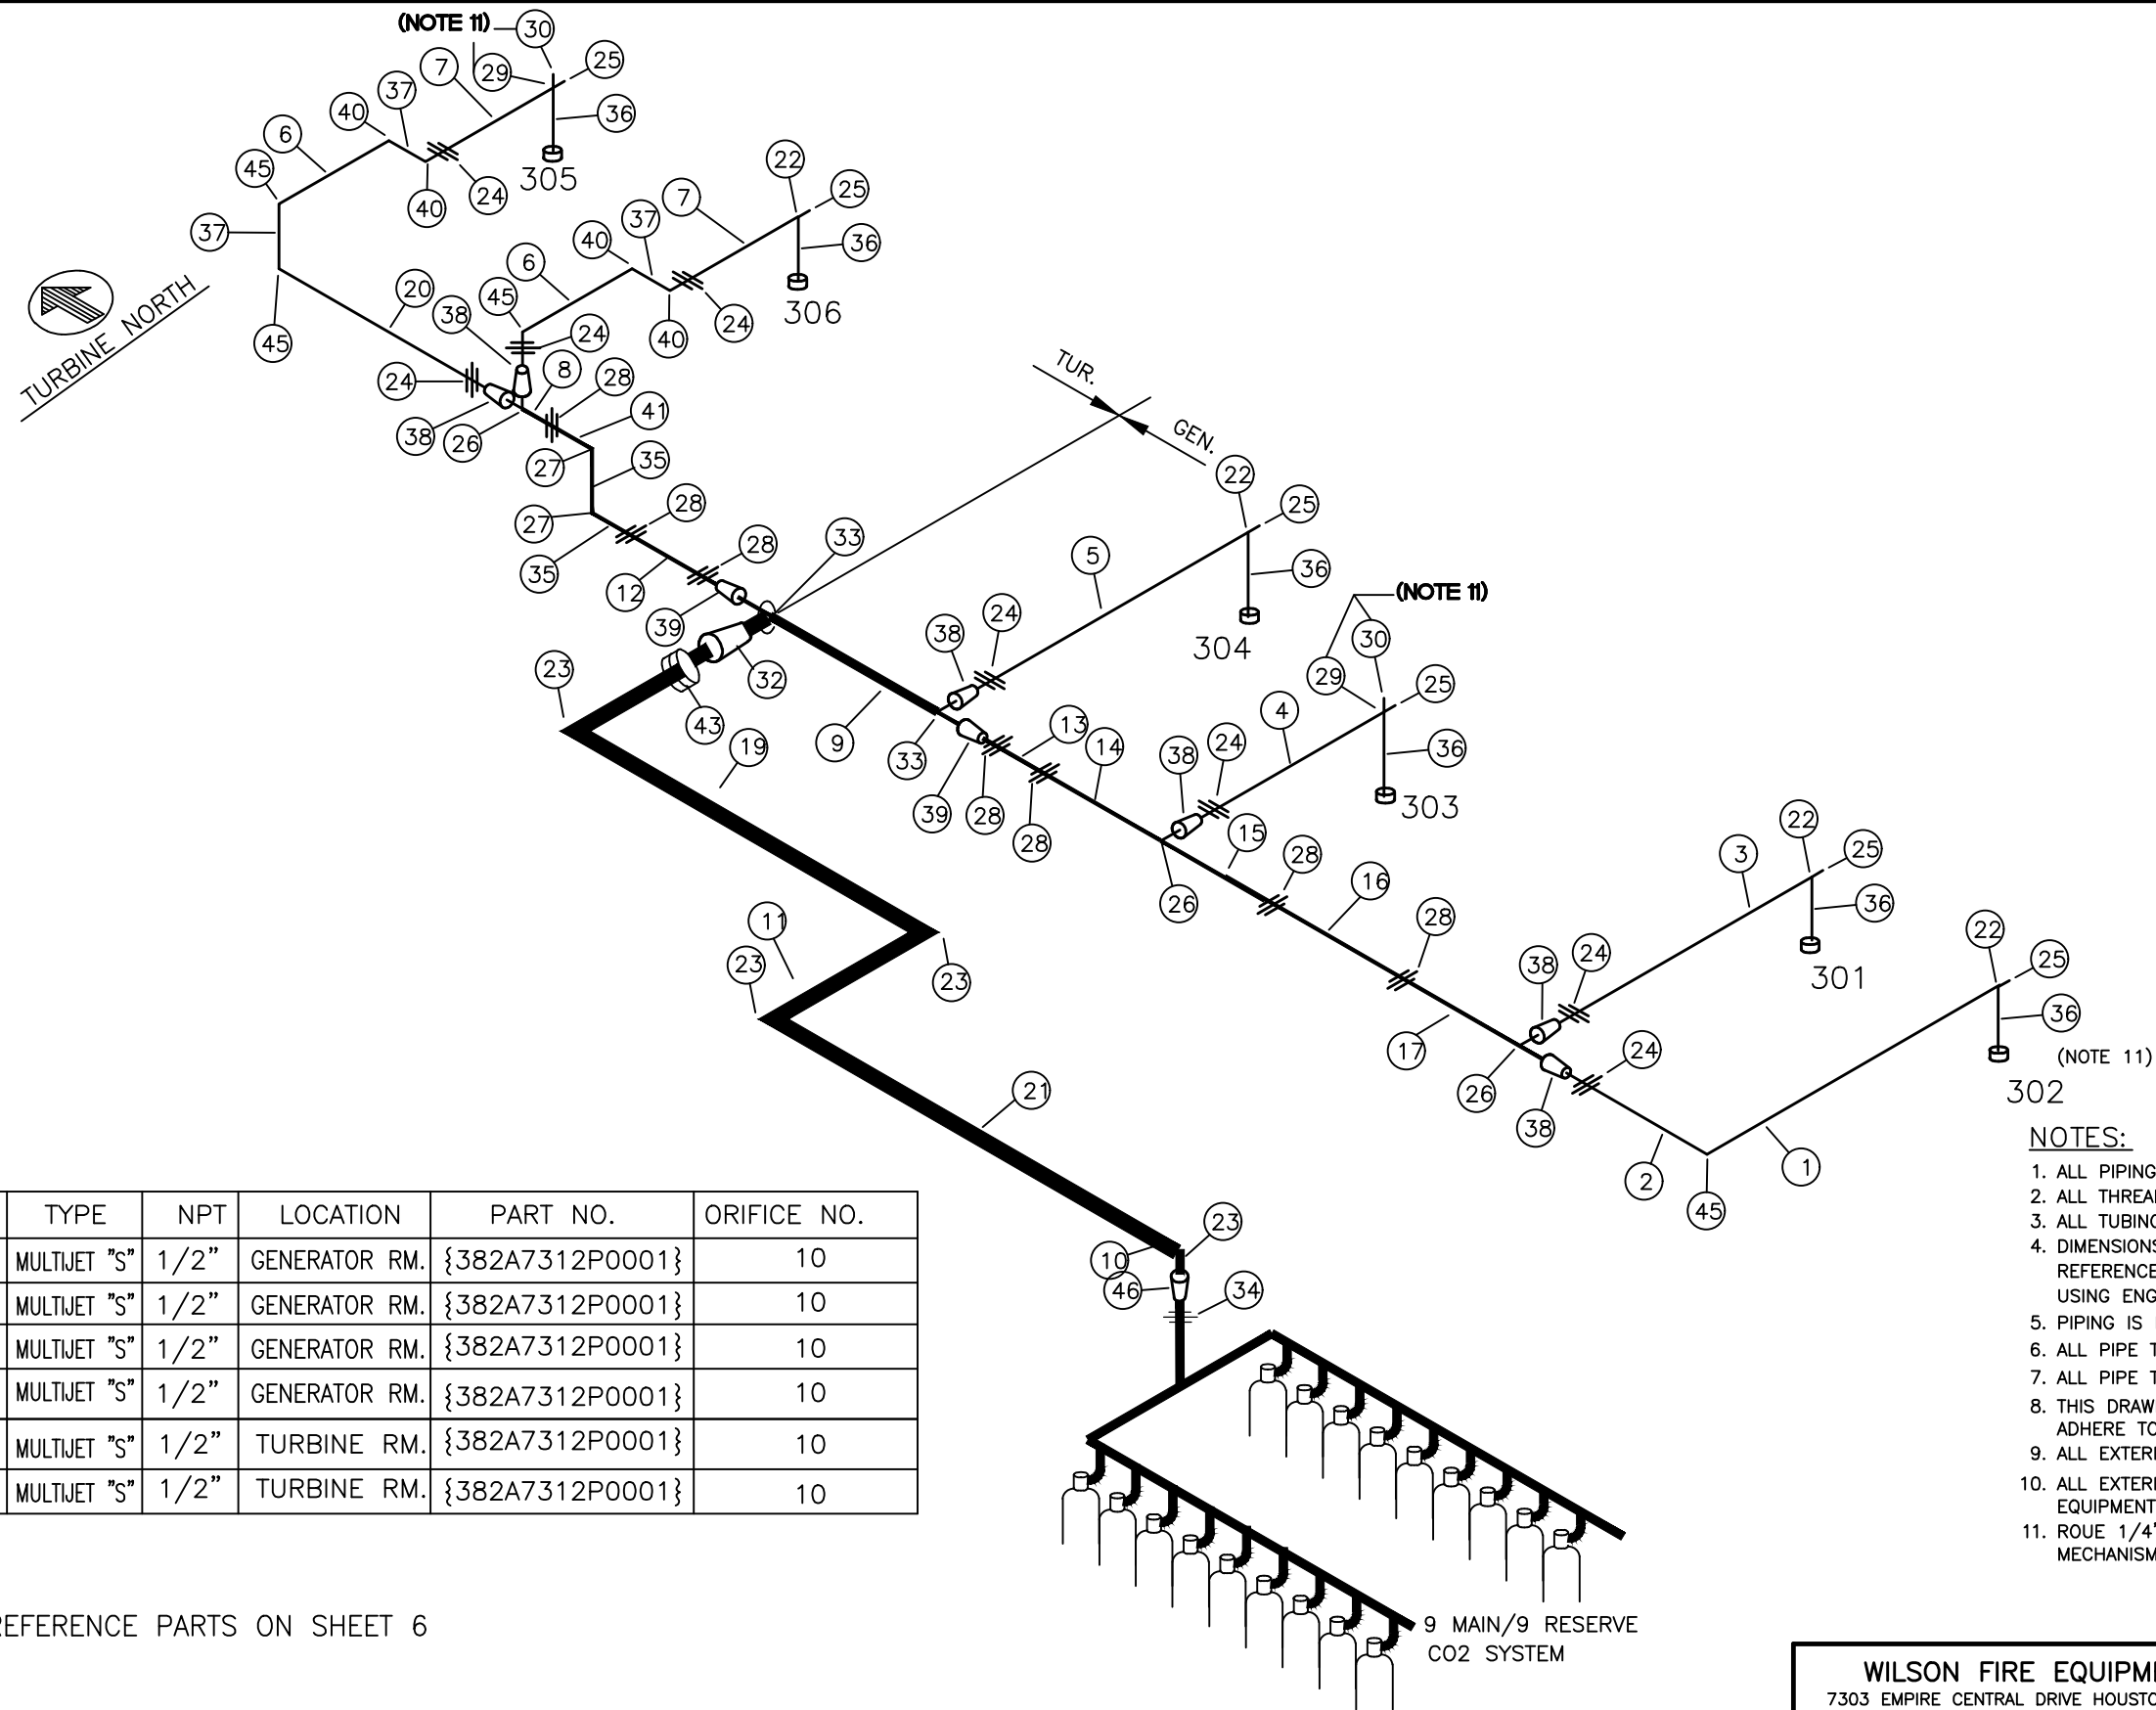

LEGEND	
	1 1/2" DIA. PIPE
	1 1/4" DIA. PIPE
	3/4" DIA. PIPE
	1/2" DIA. PIPE

NOZZLE	TYPE	NPT	LOCATION	PART NO.	ORIFICE NO.
301	MULTIJET "S"	1/2"	GENERATOR RM.	{382A7312P0001}	10
302	MULTIJET "S"	1/2"	GENERATOR RM.	{382A7312P0001}	10
303	MULTIJET "S"	1/2"	GENERATOR RM.	{382A7312P0001}	10
304	MULTIJET "S"	1/2"	GENERATOR RM.	{382A7312P0001}	10
305	MULTIJET "S"	1/2"	TURBINE RM.	{382A7312P0001}	10
306	MULTIJET "S"	1/2"	TURBINE RM.	{382A7312P0001}	10

- NOTES:
1. ALL PIPING SHALL BE 304 SS, SCH 40 MINIMUM, ASTM A-312.
 2. ALL THREADED PIPE FITTINGS SHALL BE 304 SS, 3000# MINIMUM.
 3. ALL TUBING SHALL BE 304 SS, .035" WALL MINIMUM, ASTM A-269.
 4. DIMENSIONS AND VALUES IN [] ARE SI UNITS AND ARE GIVEN FOR REFERENCE ONLY. EQUIPMENT WILL BE DESIGNED AND MANUFACTURED USING ENGLISH UNITS ONLY. DIMENSIONS ARE IN INCHES.
 5. PIPING IS INSTALLED BY WILSON FIRE INSIDE THE UNIT.
 6. ALL PIPE THAT IS 1" OR LARGER IS SCH.80.
 7. ALL PIPE THAT IS 3/4" OR SMALLER IS SCH.40.
 8. THIS DRAWING IS FOR NOZZLE LOCATIONS. PIPE LAYOUT MAY NOT ADHERE TO ACTUAL PIPING DESIGN.
 9. ALL EXTERIOR PIPING TO BE INSTALLED BY CONTRACTOR.
 10. ALL EXTERIOR PIPING TO BE PROVIDED BY WILSON FIRE EQUIPMENT.
 11. ROUE 1/4" DIA TUBING LINE TO KIDDE PRESSURE RELEASE MECHANISM ON FIRE DAMPER (TYPICAL BY 4 EACH DAMPERS).

(X) = REFERENCE PARTS ON SHEET 6

REVISIONS				THIS DRAWING, DESIGN AND THE DATA CONTAINED THEREIN IS THE PROPERTY OF WILSON FIRE EQUIPMENT AND IS NOT TO BE DISTRIBUTED TO OR USED BY OTHERS WITHOUT THE EXPRESSED WRITTEN CONSENT OF WILSON FIRE EQUIPMENT.	
REV	DESCRIPTION	DATE	BY		
A	ISSUED FOR APPROVAL	06/13/24	MAP		
B	ISSUED FOR APPROVAL	11/01/24	MAP		
C	ISSUED FOR APPROVAL	01/31/25	MAP		
				SCALE:	N.T.S. DATE
				DRAWN:	MAP 06/13/24
				CHECKED:	JV 06/13/24
				APPROVED:	JV 06/13/24

WILSON FIRE EQUIPMENT & SERVICE CO.	
7303 EMPIRE CENTRAL DRIVE HOUSTON, TEXAS 77040 (713) 896-4747	
CUSTOMER INFORMATION	
GE VERNOVA	
LM6000 60HZ DLE SHELL FRIENDSWOOD	
ISOMETRIC PIPING LAYOUT MAIN/RESERVE DISCHARGE PIPING WFE PROJECT # GE-1457	

SIZE	DRAWING NO.	REV
B	GA-1457-08 SHEET 8 OF 8	C

NOTES:

1. ALL FIRE & GAS SYSTEM WIRING TO BE SEGREGATED AS DESCRIBED IN NOTE 7.
2. ALL THE WIRES TO BE LABELED AT EACH TERMINATION WITH SLEEVE TYPE WIRE MARKERS.
3. * + NUMBER = JUMPER BAR IN CENTER OF TERMINAL BLOCK COMMON TO LIKE NUMBERS.
4. TERMINATION SUFFIXED WITH AN "S" INDICATES A PASS-THRU BAR AT THAT TERMINAL FOR SHIELD CONNECTION, UNLESS OTHERWISE INDICATED.
5. ALL GND AND PE (PROTECTIVE EARTH) WIRES TO BE GRN/YEL 14AWG TYPE TFE STRANDED OR EQUAL.
6. HORN TONE MUST BE SET TO CUSTOMER SPEC. DIP SWITCHES FOUND INSIDE OF HORN COVER.
7. IDENTIFIES CONDUCTORS THAT SHALL BE ROUTED WITH SEGREGATION FROM ALL OTHER CONDUCTORS CONFORMS TO IEC STANDARD EN60204-1. SEGREGATION SHALL BE MAINTAINED WITH BARRIER, OR >2 INCHES[51 MM] WITHOUT BARRIER WHERE POSSIBLE.
8. TWO (2) CONDUCTOR SHIELDED/ARMORED LON CABLE TO BE 16AWG, STRANDED, 600 V,23 pF/ft, GE#382A7300P0001 (THERMO ELECTRIC NO. KTEX/ALTEXQSTW6-16F-BXSSPTRAY) WHERE INDICATED.
9. TWO (2) CONDUCTOR SHIELDED/ARMORED CABLE TO BE 12AWG, STRANDED, 600 V, GE#399A1278P0007 (THERMO ELECTRIC NO. K/ALTEXQSTW-12F-2AGCUTRAY) OR EQUAL WHERE INDICATED.
10. TWO (2) CONDUCTOR SHIELDED/ARMORED CABLE TO BE 14AWG, STRANDED, 600 V, GE#399A1278P0004 (THERMO ELECTRIC NO. K/ALTEXQSTW-14F-2AGCUTRAY) OR EQUAL WHERE INDICATED.
11. THREE (3) CONDUCTOR SHIELDED/ARMORED CABLE TO BE 16AWG, STRANDED, 600 V, GE#399A1278P0002 (THERMO ELECTRIC NO. K/ALTEXQSTW-16F-3AGCUTRAY) OR EQUAL WHERE INDICATED.
12. TWO (2) CONDUCTOR SHIELDED LON CABLE TO BE 16AWG, 8.8 PF/FT, STRANDED, 150 V, BELDEN NO. 8719 OR EQUAL, WHERE INDICATED.
13. ALL ARMORED CABLE UTILIZED WITHIN THE JUNCTION BOX OR TURBINE CONTROL PANEL SHALL HAVE SS ARMOR REMOVED.
14. ALL SHIELDS MUST BE INSULATED.

LEGEND:


CHG#3___ CHARGER, FIRE & GAS BATTERY
DCIO_____ DC I/O MODULE
DSW24F___ FUSED DISCONNECT SWITCH, 24 VDC FIRE & GAS POWER
FBAT_____ BATTERY, FIRE & GAS PROTECTION POWER
FBFPP___ FUSE BLOCK, FIRE & GAS POWER
FPP_____ PANEL, FIRE & GAS PROTECTION
JB18A___ BOX, JUNCTION (GENERATOR SKID)
JB19A___ BOX, JUNCTION (TURBINE SKID)
JB20_____ BOX, JUNCTION (CO2 SKID)
LDP_____ PANEL, LIGHTING & DISTRIBUTION
MCC_____ MOTOR CONTROL CENTER
SW24F___ DISCONNECT SWITCH, 24 VDC FIRE & GAS POWER
TB#_____ TERMINAL BLOCK
TCP_____ TURBINE CONTROL PANEL
FPCP_____ FIRE & GAS PROTECTION CONTROL PANEL

LEGEND:


SEE 7320647-000005-504005

NOTES:

1. CUSTOMER DRAWING NUMBERS CONSIST OF: (ORDER NUMBER)-(STANDARD DRAWING NUMBER), AND ARE REFERENCED AS X-(STANDARD DRAWING NUMBER), WHERE X = ORDER NUMBER.
2. ALL DEVICES SHOWN DE-ENERGIZED (SHELF STATE).
3. X / XX / XX REPRESENTS " CAN NETWORK/NODE/CHANNEL" ADDRESS OR "CHASSIS/BOARD/CHANNEL ADDRESS. EXAMPLE 2/03/04



3. NX XX REPRESENTS NODE NUMBER IN DISTRIBUTION I/O NETWORK.



4. IDENTIFIES CONDUCTORS THAT SHALL BE ROUTED WITH SEGREGATION FROM ALL OTHER CONDUCTORS CONFORMS TO IEC STANDARD EN60204-1. SEGREGATION SHALL BE MAINTAINED WITH BARRIER, OR >2 INCHES[51 MM] WITHOUT BARRIER WHERE POSSIBLE.


REFERENCE DRAWINGS:

7320647-000005 ELECTRICAL SYMBOLS, ABBREVIATIONS, AND REF DATA
7320647-504044 SCHEMATIC DIAGRAM, MOTOR CONTROL CENTER
7320647-504768 SCHEMATIC DIAGRAM, CRITICAL SHUTDOWN PATH
7320647-504934 SYSTEM SCHEMATIC, COMMUNICATION

WIRE GAUGE CONVERSION TABLE
(AMERICAN WIRE GAUGE-METRIC)

US Standard AWG	NEAREST AVAILABLE CROSS-SECTION mm ²
22	0.5
18	0.75
16	1.5
14	2.5
12	4.0
10	6.0
8	10.0
6	16.0
4	25.0
2	35.0


				WILSON FIRE EQUIPMENT & SERVICE CO. 7303 EMPIRE CENTRAL DRIVE HOUSTON, TEXAS 77040 (713) 896-4747					
REVISIONS				THIS DRAWING, DESIGN AND THE DATA CONTAINED THEREIN IS THE PROPERTY OF WILSON FIRE EQUIPMENT AND IS NOT TO BE DISTRIBUTED TO OR USED BY OTHERS WITHOUT THE EXPRESSED WRITTEN CONSENT OF WILSON FIRE EQUIPMENT.		CUSTOMER INFORMATION			
REV	DESCRIPTION	DATE	BY						
A	ISSUED FOR APPROVAL	09/12/24	CM						
B	ISSUED FOR APPROVAL	11/01/24	CM						
C	ISSUED FOR APPROVAL	12/02/24	MAP						
D	ISSUED FOR APPROVAL	01/31/25	MAP			GE VERNOVA			
						LM6000 60HZ DLE			
						NOTES AND LEGENDS			
						SYSTEM WIRING			
						CO2 FIRE PROTECTION SYSTEM			
						WFE PROJECT # GE-1457			
				SCALE: AS SHOWN		DATE		SIZE	
				DRAWN: CM		09/12/24		DRAWING NO.	
				CHECKED: JV		09/12/24		REV	
				APPROVED: JV		09/12/24		B	
								SW-1457-01	
								SHEET 1 OF 13	
								D	

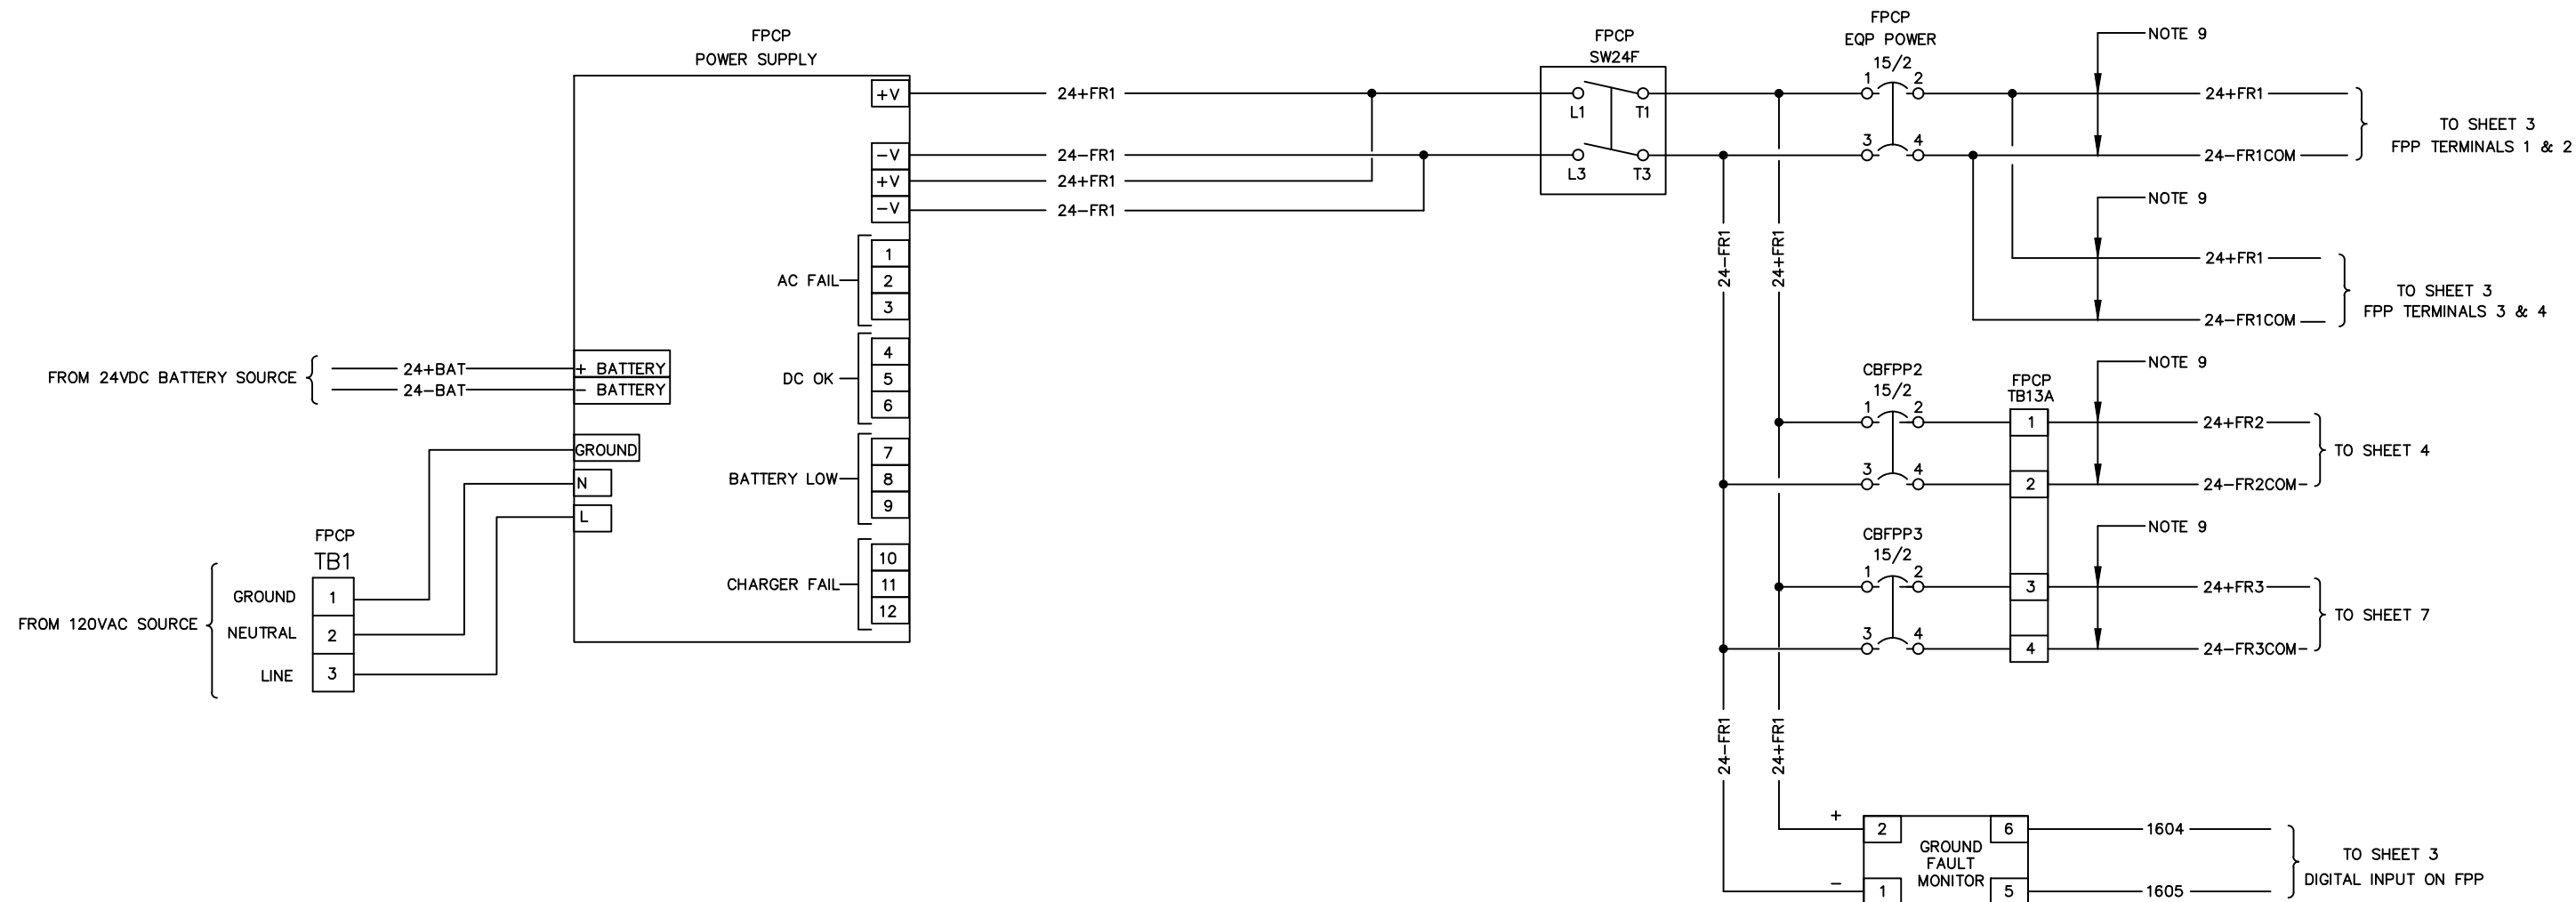

REVISIONS					THIS DRAWING, DESIGN AND THE DATA CONTAINED THEREIN IS THE PROPERTY OF WILSON FIRE EQUIPMENT AND IS NOT TO BE DISTRIBUTED TO OR USED BY OTHERS WITHOUT THE EXPRESSED WRITTEN CONSENT OF WILSON FIRE EQUIPMENT.	
REV	DESCRIPTION	DATE	BY			
A	ISSUED FOR APPROVAL	09/12/24	CM			
B	ISSUED FOR APPROVAL	11/01/24	CM			
C	ISSUED FOR APPROVAL	12/02/24	MAP			
D	ISSUED FOR APPROVAL	01/31/25	MAP			
					SCALE:	AS SHOWN
					DRAWN:	CM 09/12/24
					CHECKED:	JV 09/12/24
					APPROVED:	JV 09/12/24

WILSON FIRE EQUIPMENT & SERVICE CO. 7303 EMPIRE CENTRAL DRIVE HOUSTON, TEXAS 77040 (713) 896-4747		
CUSTOMER INFORMATION		
GE VERNOVA		
LM6000 60HZ DLE		
POWER DISTRIBUTION WIRING CO2 FIRE PROTECTION SYSTEM WFE PROJECT # GE-1457		

		
SIZE	DRAWING NO.	REV
B	SW-1457-02 SHEET 2 OF 13	D

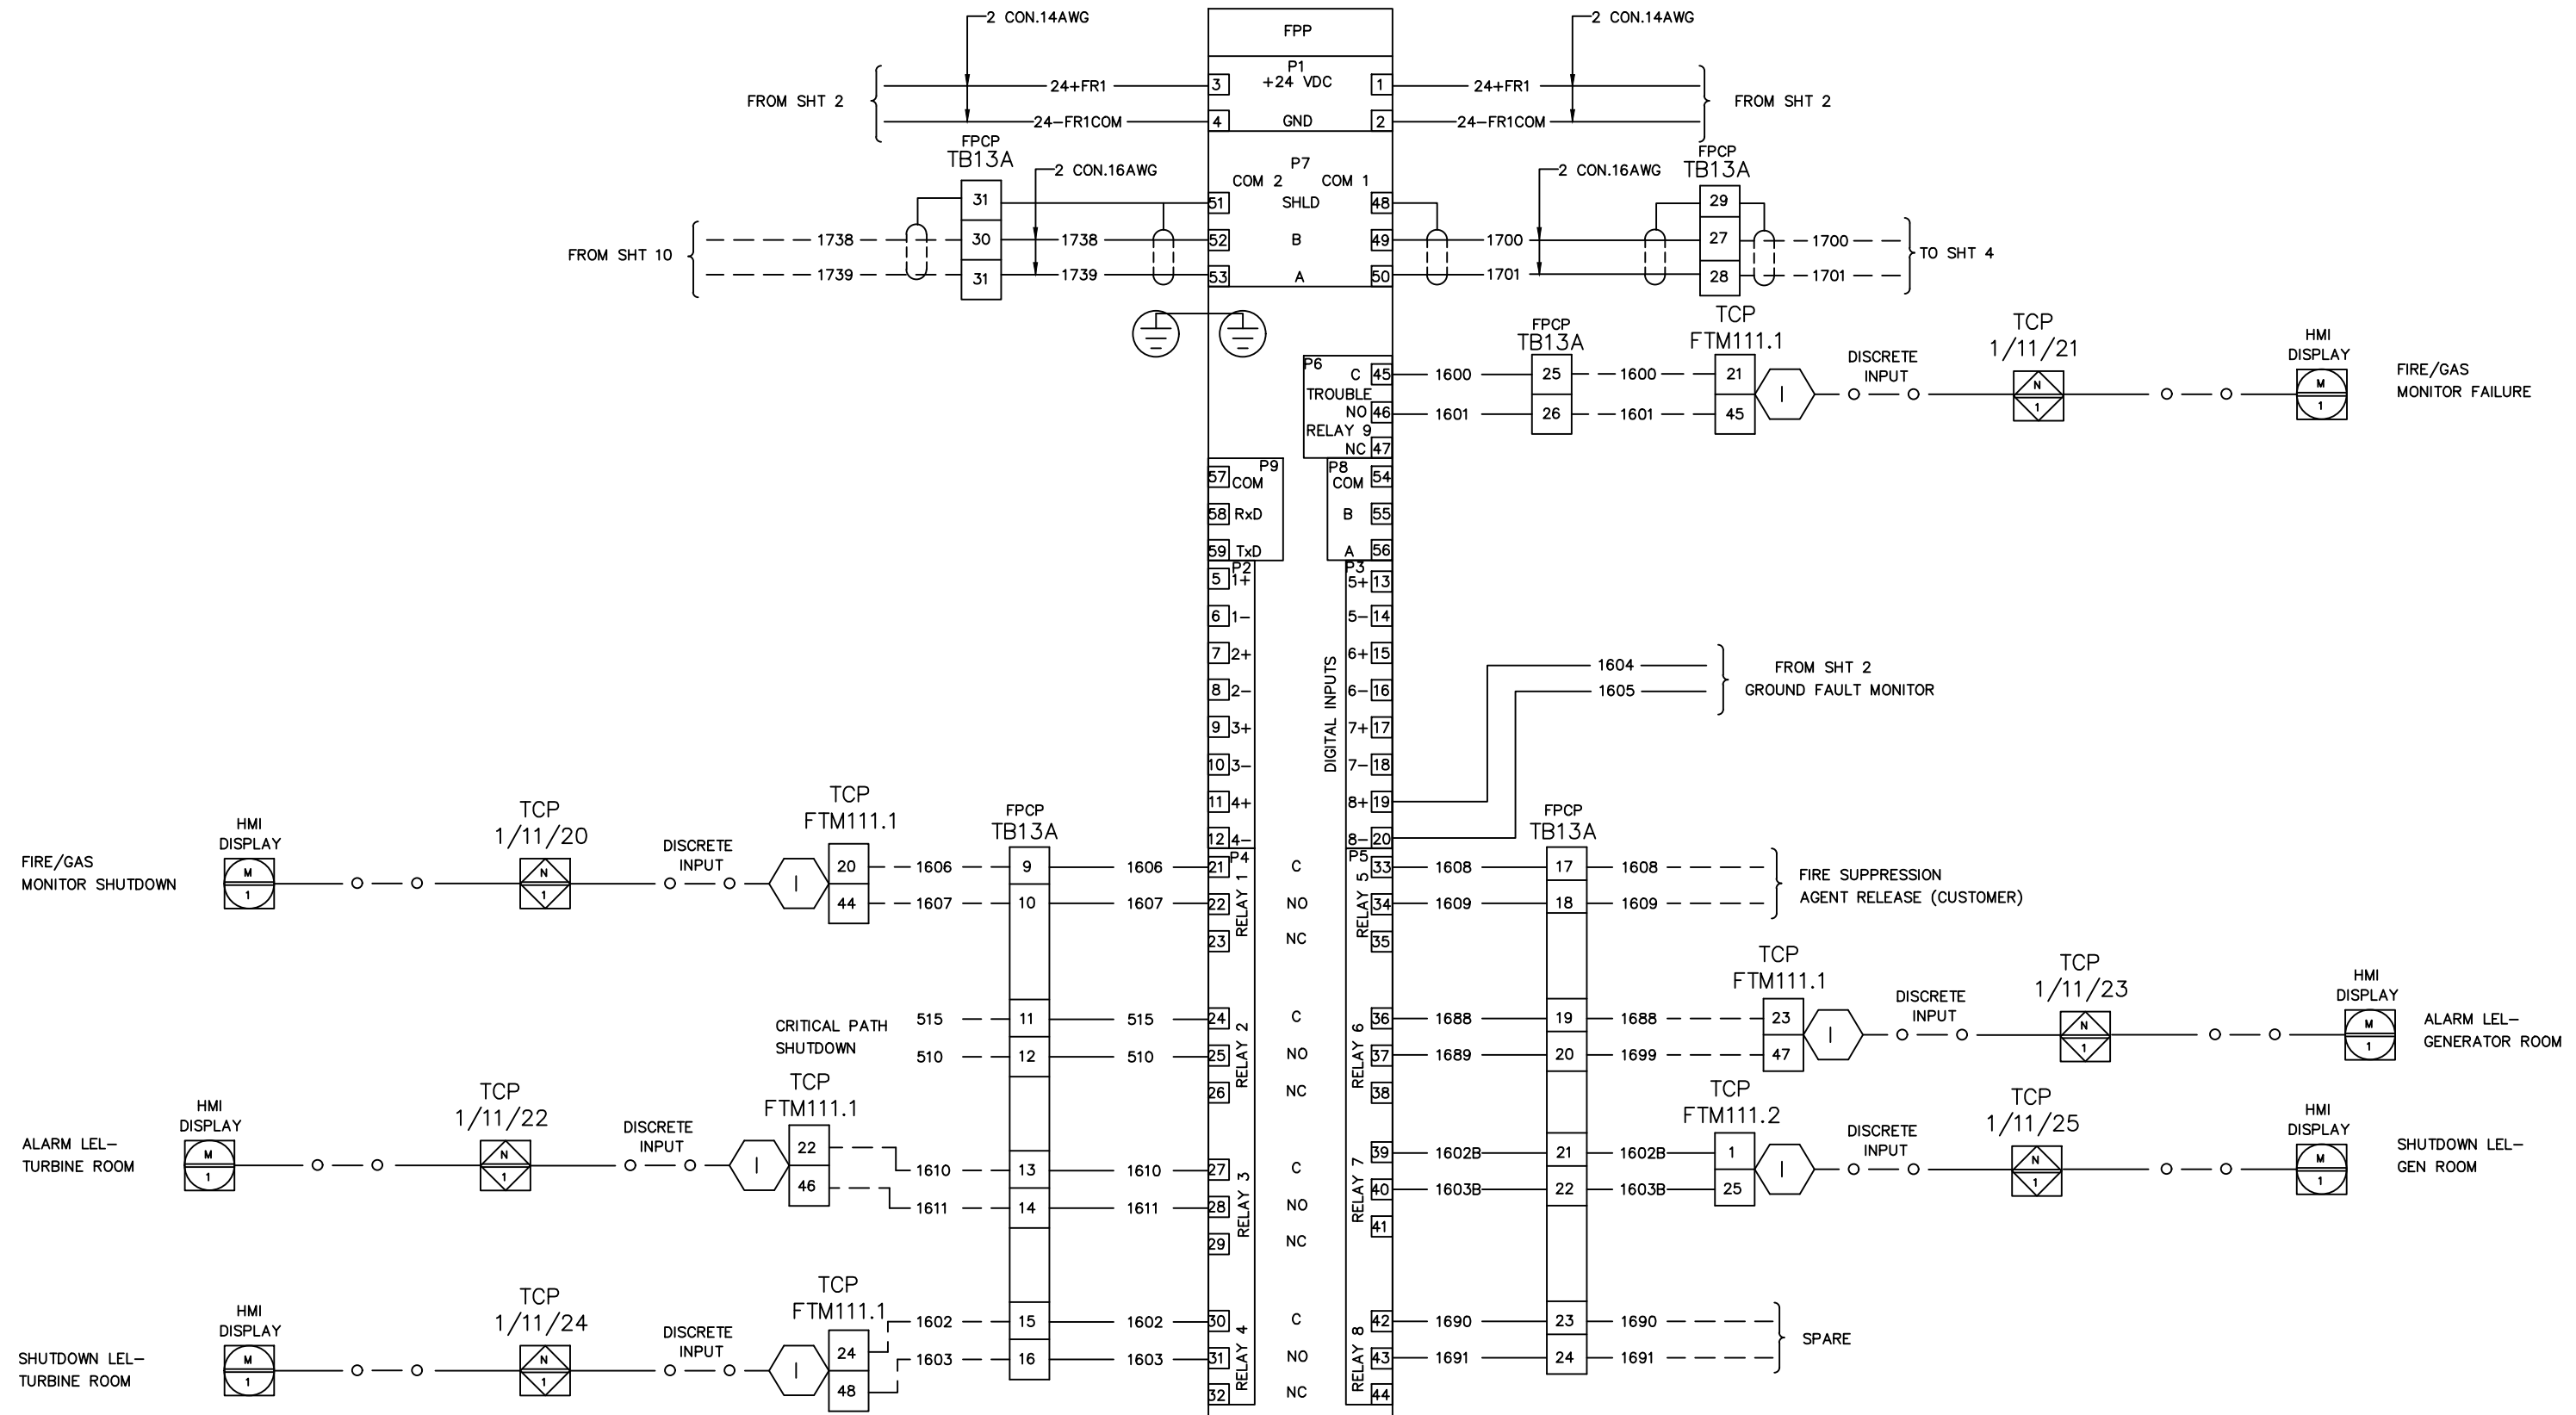

REVISIONS			
REV	DESCRIPTION	DATE	BY
A	ISSUED FOR APPROVAL	09/12/24	CM
B	ISSUED FOR APPROVAL	11/01/24	CM
C	ISSUED FOR APPROVAL	12/02/24	MAP
D	ISSUED FOR APPROVAL	01/31/25	MAP

THIS DRAWING, DESIGN AND THE DATA CONTAINED THEREIN IS THE PROPERTY OF WILSON FIRE EQUIPMENT AND IS NOT TO BE DISTRIBUTED TO OR USED BY OTHERS WITHOUT THE EXPRESSED WRITTEN CONSENT OF WILSON FIRE EQUIPMENT.

SCALE:	AS SHOWN	DATE
DRAWN:	CM	09/12/24
CHECKED:	JV	09/12/24
APPROVED:	JV	09/12/24

WILSON FIRE EQUIPMENT & SERVICE CO.
7303 EMPIRE CENTRAL DRIVE HOUSTON, TEXAS 77040 (713) 896-4747

CUSTOMER INFORMATION


GE VERNOVA

LM6000 60HZ DLE

SYSTEM WIRING – CONTROL PANEL
CO2 FIRE PROTECTION SYSTEM
WFE PROJECT # GE-1457



SIZE	DRAWING NO.	REV
B	SW-1457-03 SHEET 3 OF 13	D

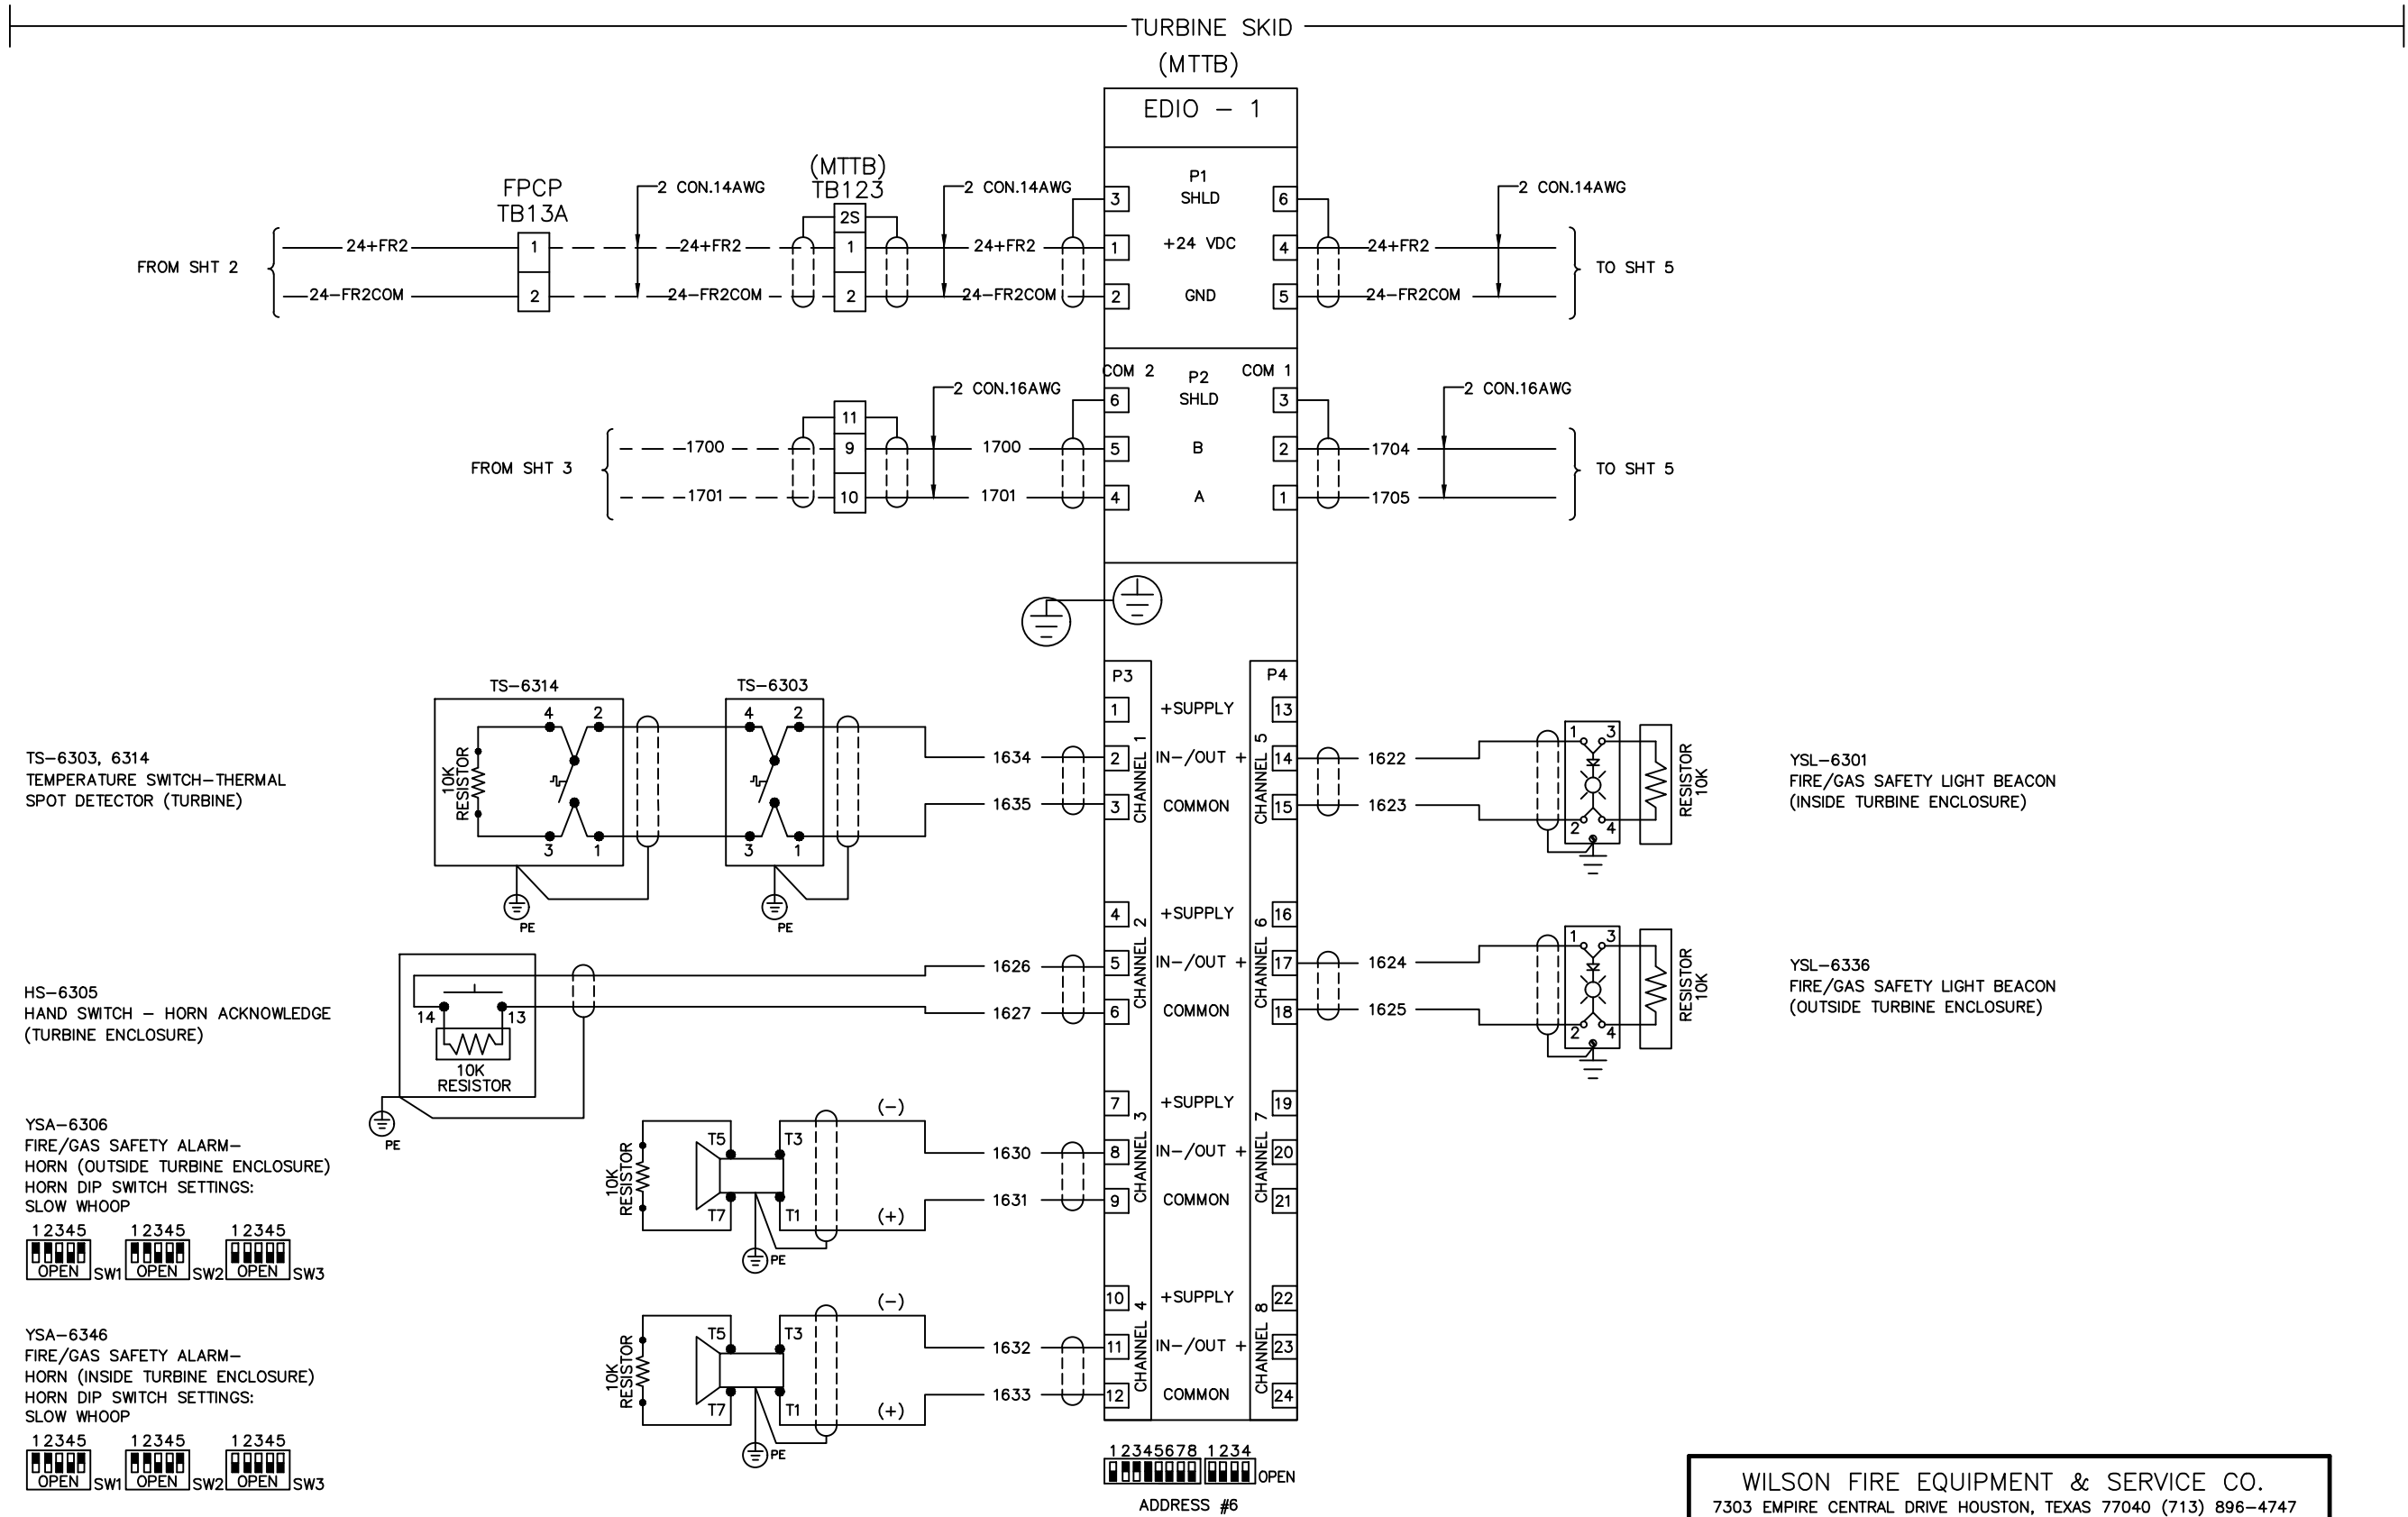

REVISIONS			
REV	DESCRIPTION	DATE	BY
A	ISSUED FOR APPROVAL	09/12/24	CM
B	ISSUED FOR APPROVAL	11/01/24	CM
C	ISSUED FOR APPROVAL	12/02/24	MAP
D	ISSUED FOR APPROVAL	01/31/25	MAP

THIS DRAWING, DESIGN AND THE DATA CONTAINED THEREIN IS THE PROPERTY OF WILSON FIRE EQUIPMENT AND IS NOT TO BE DISTRIBUTED TO OR USED BY OTHERS WITHOUT THE EXPRESSED WRITTEN CONSENT OF WILSON FIRE EQUIPMENT.

SCALE: AS SHOWN DATE


DRAWN: CM 09/12/24

CHECKED: JV 09/12/24

APPROVED: JV 09/12/24

WILSON FIRE EQUIPMENT & SERVICE CO. 7303 EMPIRE CENTRAL DRIVE HOUSTON, TEXAS 77040 (713) 896-4747		
CUSTOMER INFORMATION		
GE VERNOVA		
LM6000 60HZ DLE		
INSTRUMENT LOOP DIAGRAM CO2 FIRE PROTECTION SYSTEM WFE PROJECT # GE-1457		

		
SIZE	DRAWING NO.	REV
B	SW-1457-04 SHEET 4 OF 13	D

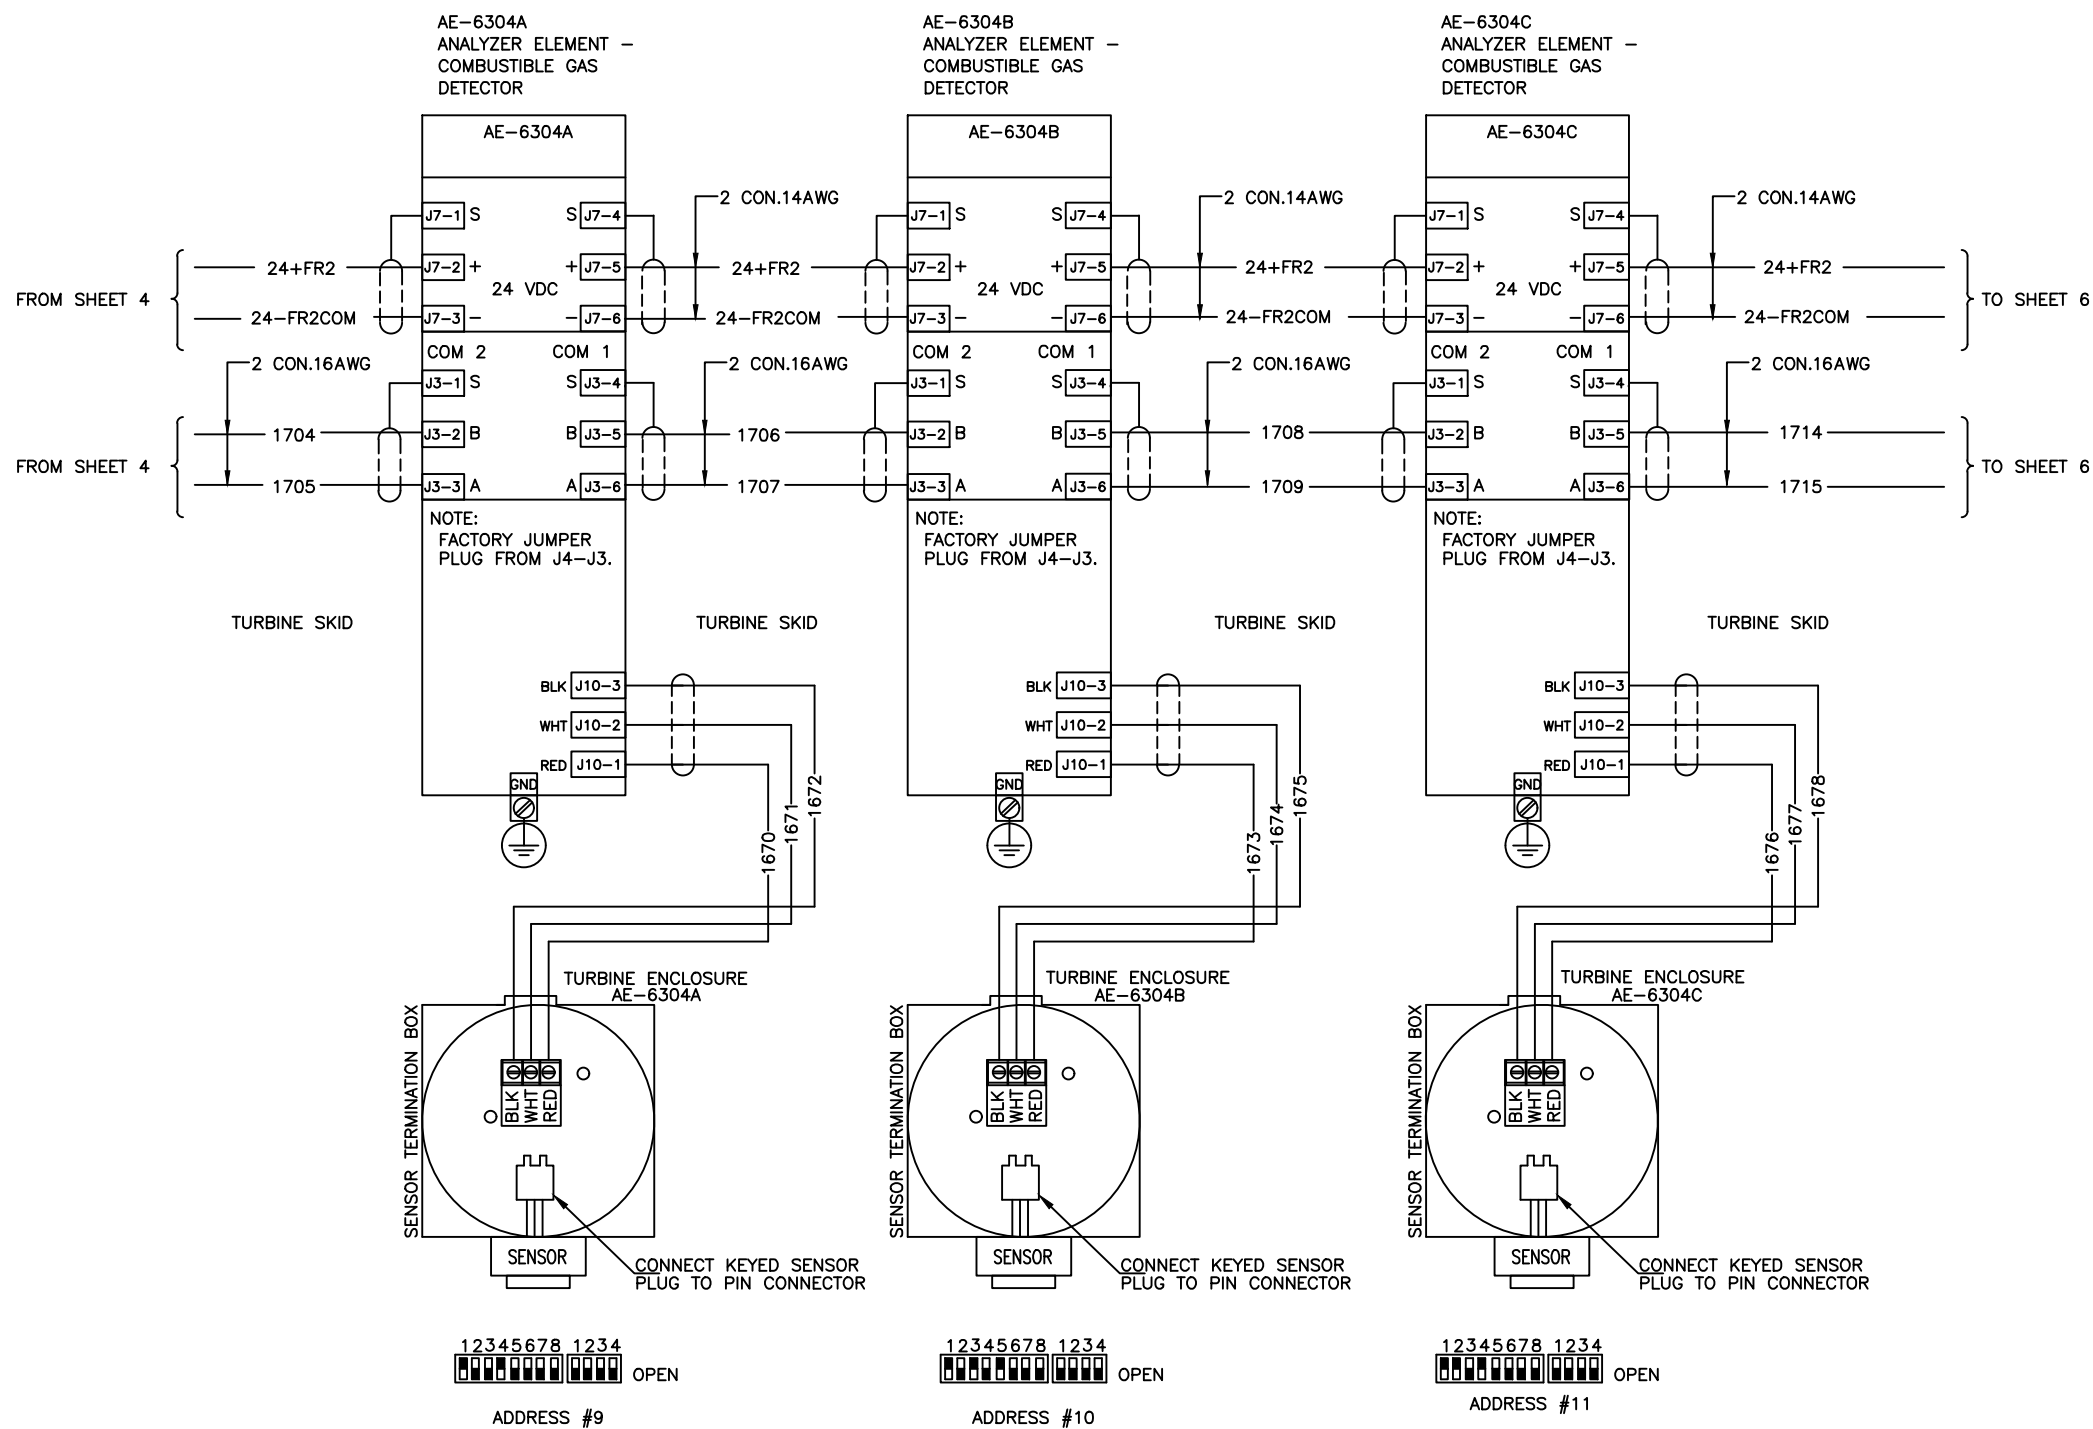

REVISIONS

REV	DESCRIPTION	DATE	BY
A	ISSUED FOR APPROVAL	09/12/24	CM
B	ISSUED FOR APPROVAL	09/12/24	CM
C	ISSUED FOR APPROVAL	12/02/24	MAP
D	ISSUED FOR APPROVAL	01/31/25	MAP

THIS DRAWING, DESIGN AND THE DATA CONTAINED THEREIN IS THE PROPERTY OF WILSON FIRE EQUIPMENT AND IS NOT TO BE DISTRIBUTED TO OR USED BY OTHERS WITHOUT THE EXPRESSED WRITTEN CONSENT OF WILSON FIRE EQUIPMENT.

SCALE: AS SHOWN DATE
DRAWN: CM 09/12/24
CHECKED: JV 09/12/24
APPROVED: JV 09/12/24

WILSON FIRE EQUIPMENT & SERVICE CO.
7303 EMPIRE CENTRAL DRIVE HOUSTON, TEXAS 77040 (713) 896-4747

CUSTOMER INFORMATION

GE VERNOVA


LM6000 60HZ DLE

INSTRUMENT LOOP DIAGRAM
CO2 FIRE PROTECTION SYSTEM
WFE PROJECT # GE-1457



SIZE	DRAWING NO.	REV
B	SW-1457-05 SHEET 5 OF 13	D

TURBINE SKID

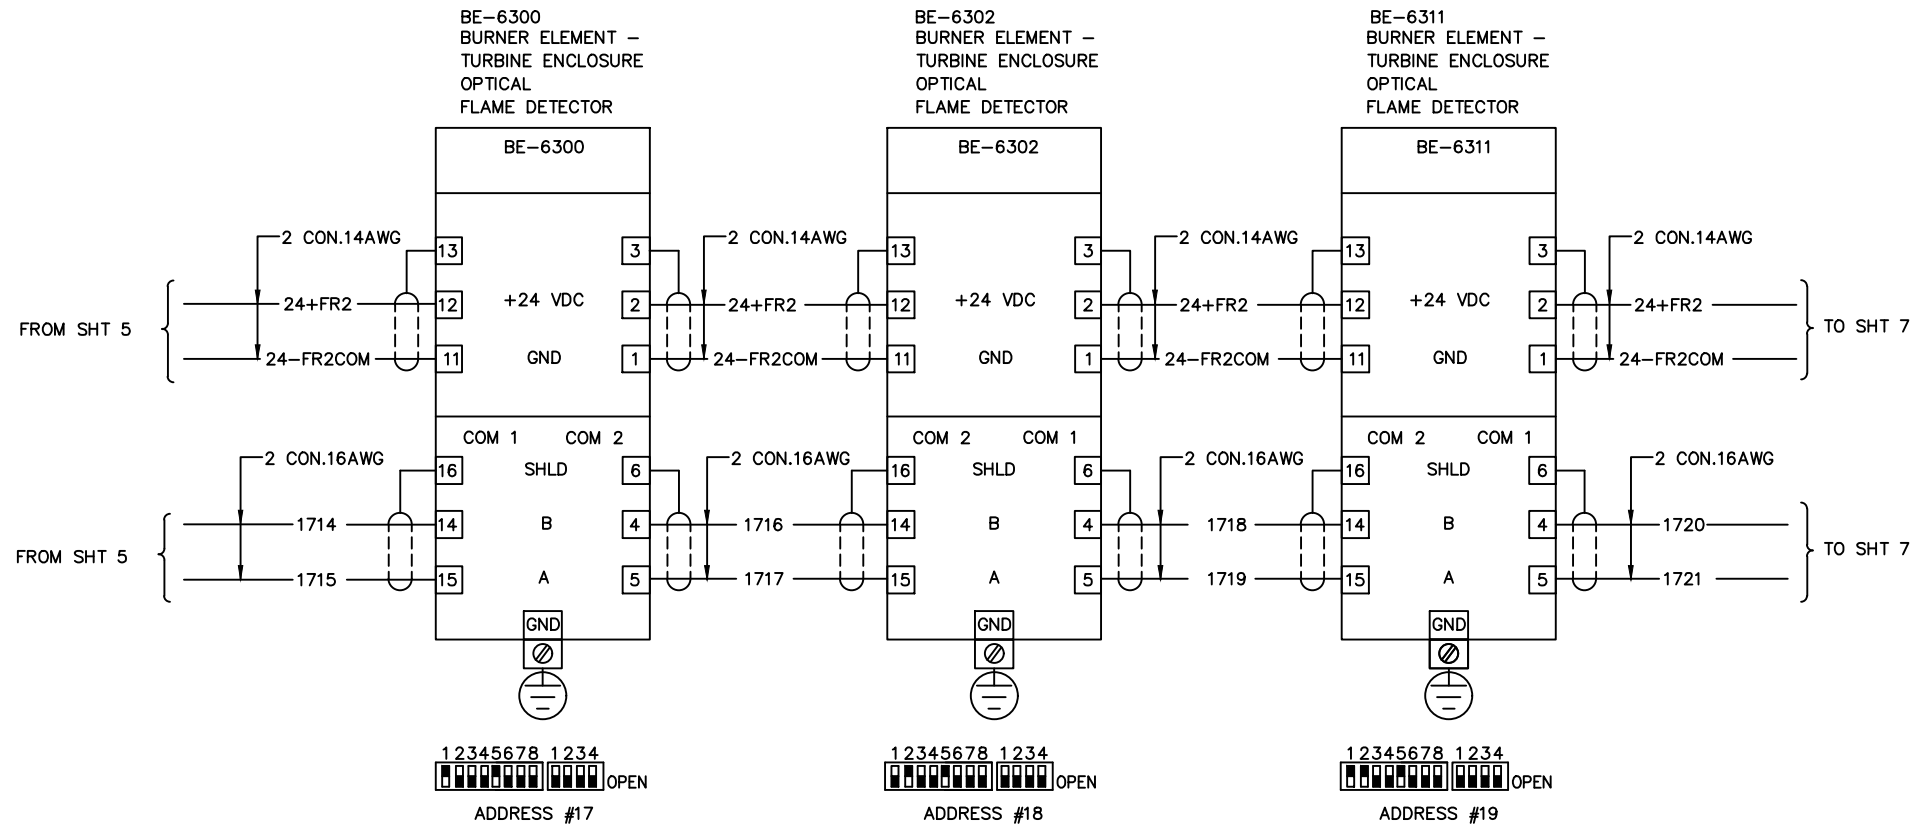


REVISIONS				THIS DRAWING, DESIGN AND THE DATA CONTAINED THEREIN IS THE PROPERTY OF WILSON FIRE EQUIPMENT AND IS NOT TO BE DISTRIBUTED TO OR USED BY OTHERS WITHOUT THE EXPRESSED WRITTEN CONSENT OF WILSON FIRE EQUIPMENT.	
REV	DESCRIPTION	DATE	BY		
A	ISSUED FOR APPROVAL	09/12/24	CM		
B	ISSUED FOR APPROVAL	11/01/24	CM		
C	ISSUED FOR APPROVAL	12/02/24	MAP		
D	ISSUED FOR APPROVAL	01/31/25	MAP		
				SCALE:	AS SHOWN
				DRAWN:	CM 09/12/24
				CHECKED:	JV 09/12/24
				APPROVED:	JV 09/12/24

WILSON FIRE EQUIPMENT & SERVICE CO. 7303 EMPIRE CENTRAL DRIVE HOUSTON, TEXAS 77040 (713) 896-4747		
CUSTOMER INFORMATION		
GE VERNOVA		
LM6000 60HZ DLE		
INSTRUMENT LOOP DIAGRAM CO2 FIRE PROTECTION SYSTEM WFE PROJECT # GE-1457		

		
SIZE	DRAWING NO.	REV
B	SW-1457-06 SHEET 6 OF 13	D

NOTES:
SEE SW-01

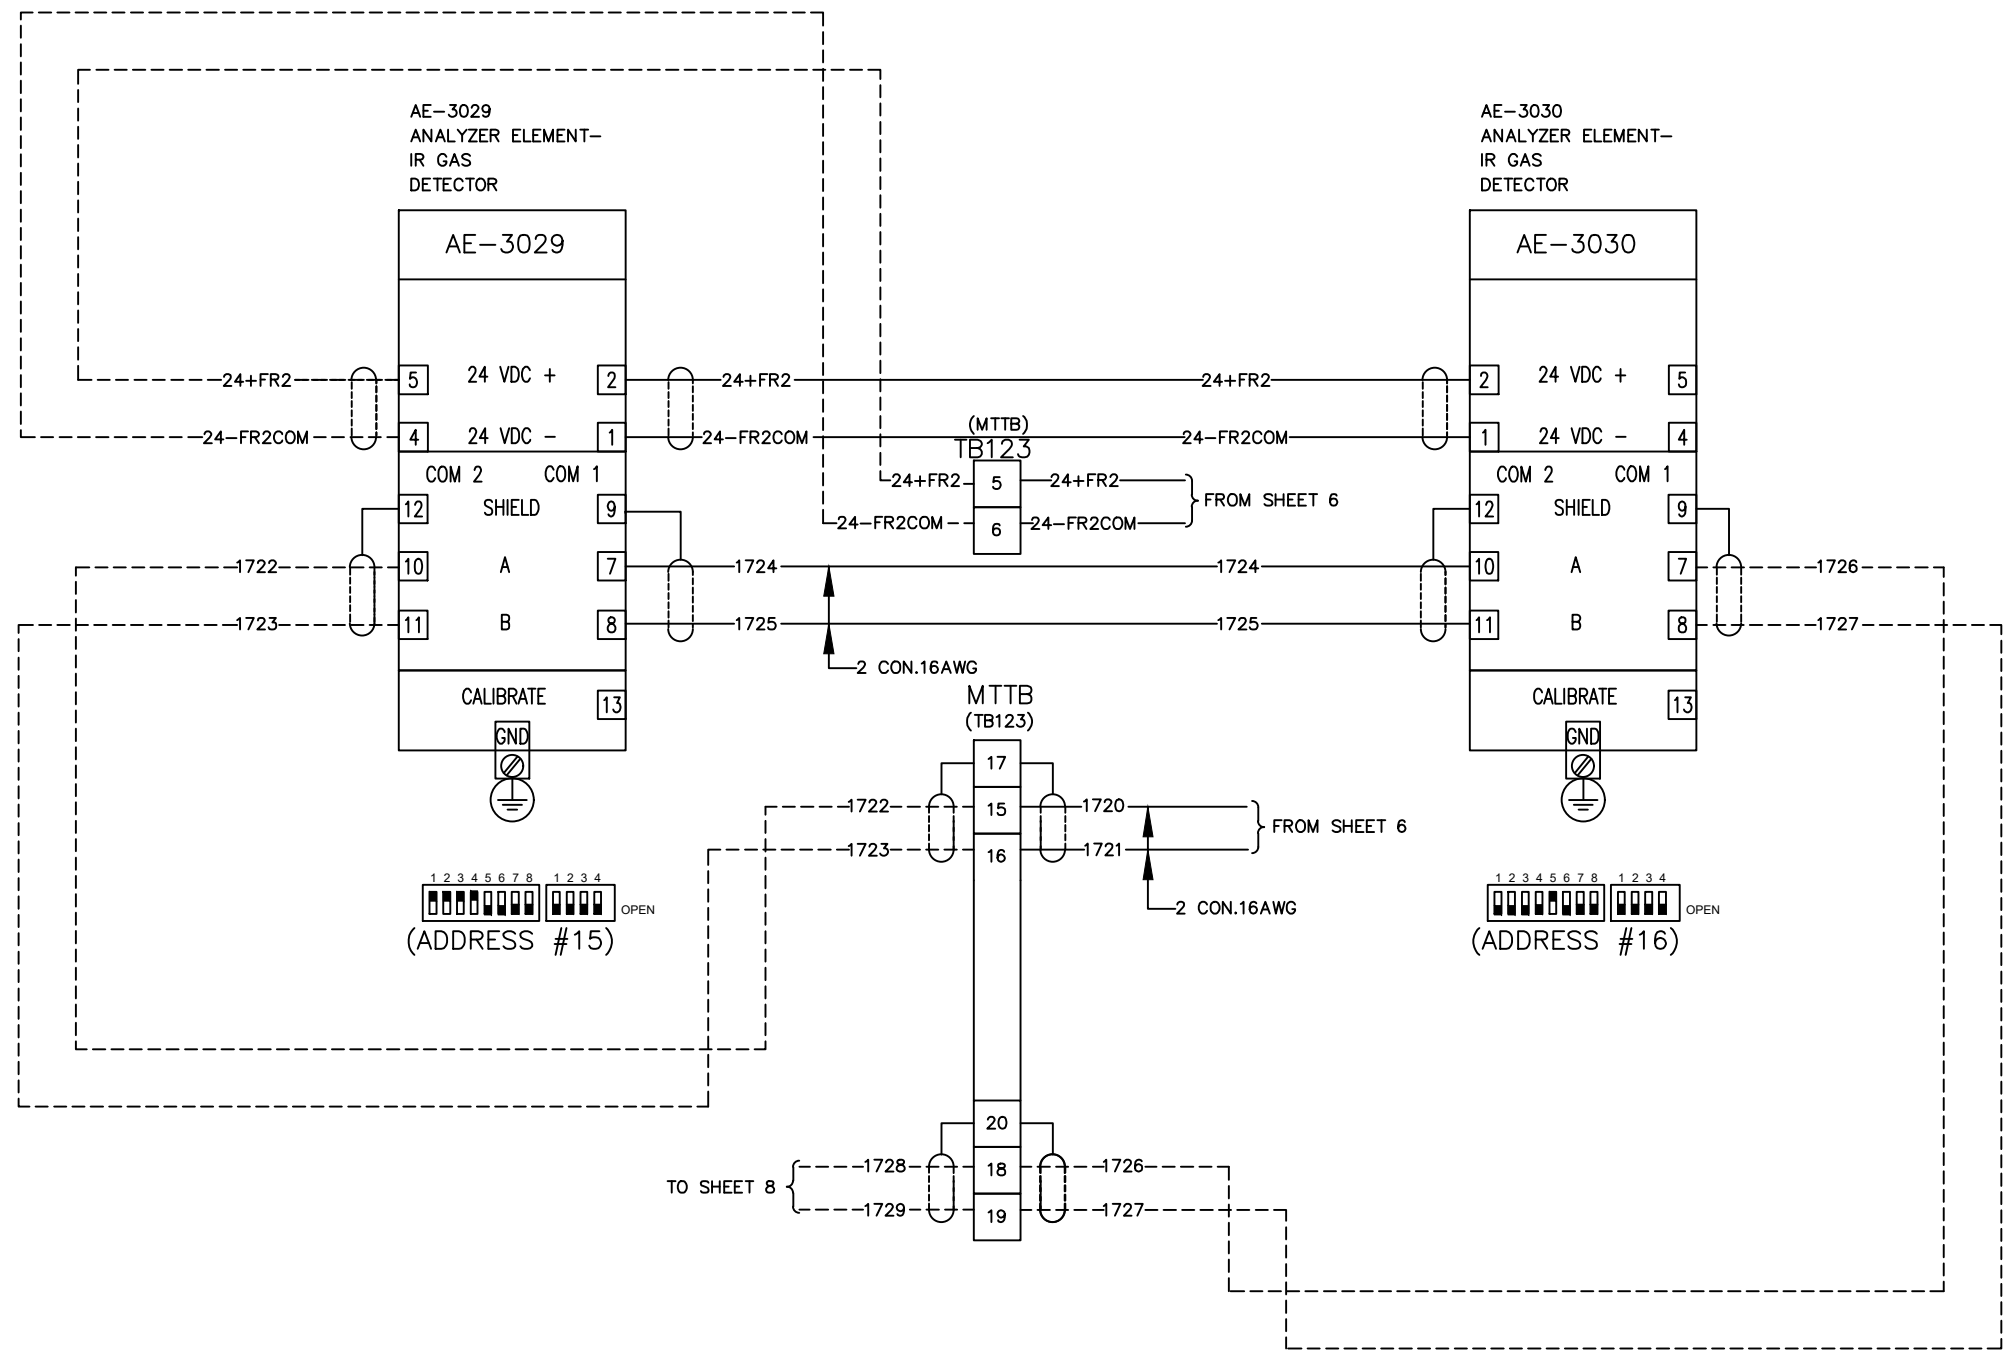


REVISIONS			
REV	DESCRIPTION	DATE	BY
A	ISSUED FOR APPROVAL	09/12/24	CM
B	ISSUED FOR APPROVAL	11/01/24	CM
C	ISSUED FOR APPROVAL	12/02/24	MAP
D	ISSUED FOR APPROVAL	01/31/25	MAP

THIS DRAWING, DESIGN AND THE DATA CONTAINED THEREIN IS THE PROPERTY OF WILSON FIRE EQUIPMENT AND IS NOT TO BE DISTRIBUTED TO OR USED BY OTHERS WITHOUT THE EXPRESSED WRITTEN CONSENT OF WILSON FIRE EQUIPMENT.

SCALE:	AS SHOWN	DATE
DRAWN:	CM	09/12/24
CHECKED:	JV	09/12/24
APPROVED:	JV	09/12/24

WILSON FIRE EQUIPMENT & SERVICE CO. 7303 EMPIRE CENTRAL DRIVE HOUSTON, TEXAS 77040 (713) 896-4747		
CUSTOMER INFORMATION		
GE VERNOVA		
LM6000 60HZ DLE		
INSTRUMENT LOOP DIAGRAM CO2 SUPPRESSION SYSTEM WFE PROJECT # GE-1457		

		
SIZE	DRAWING NO.	REV
B	SW-1457-07 SHEET 7 OF 13	D

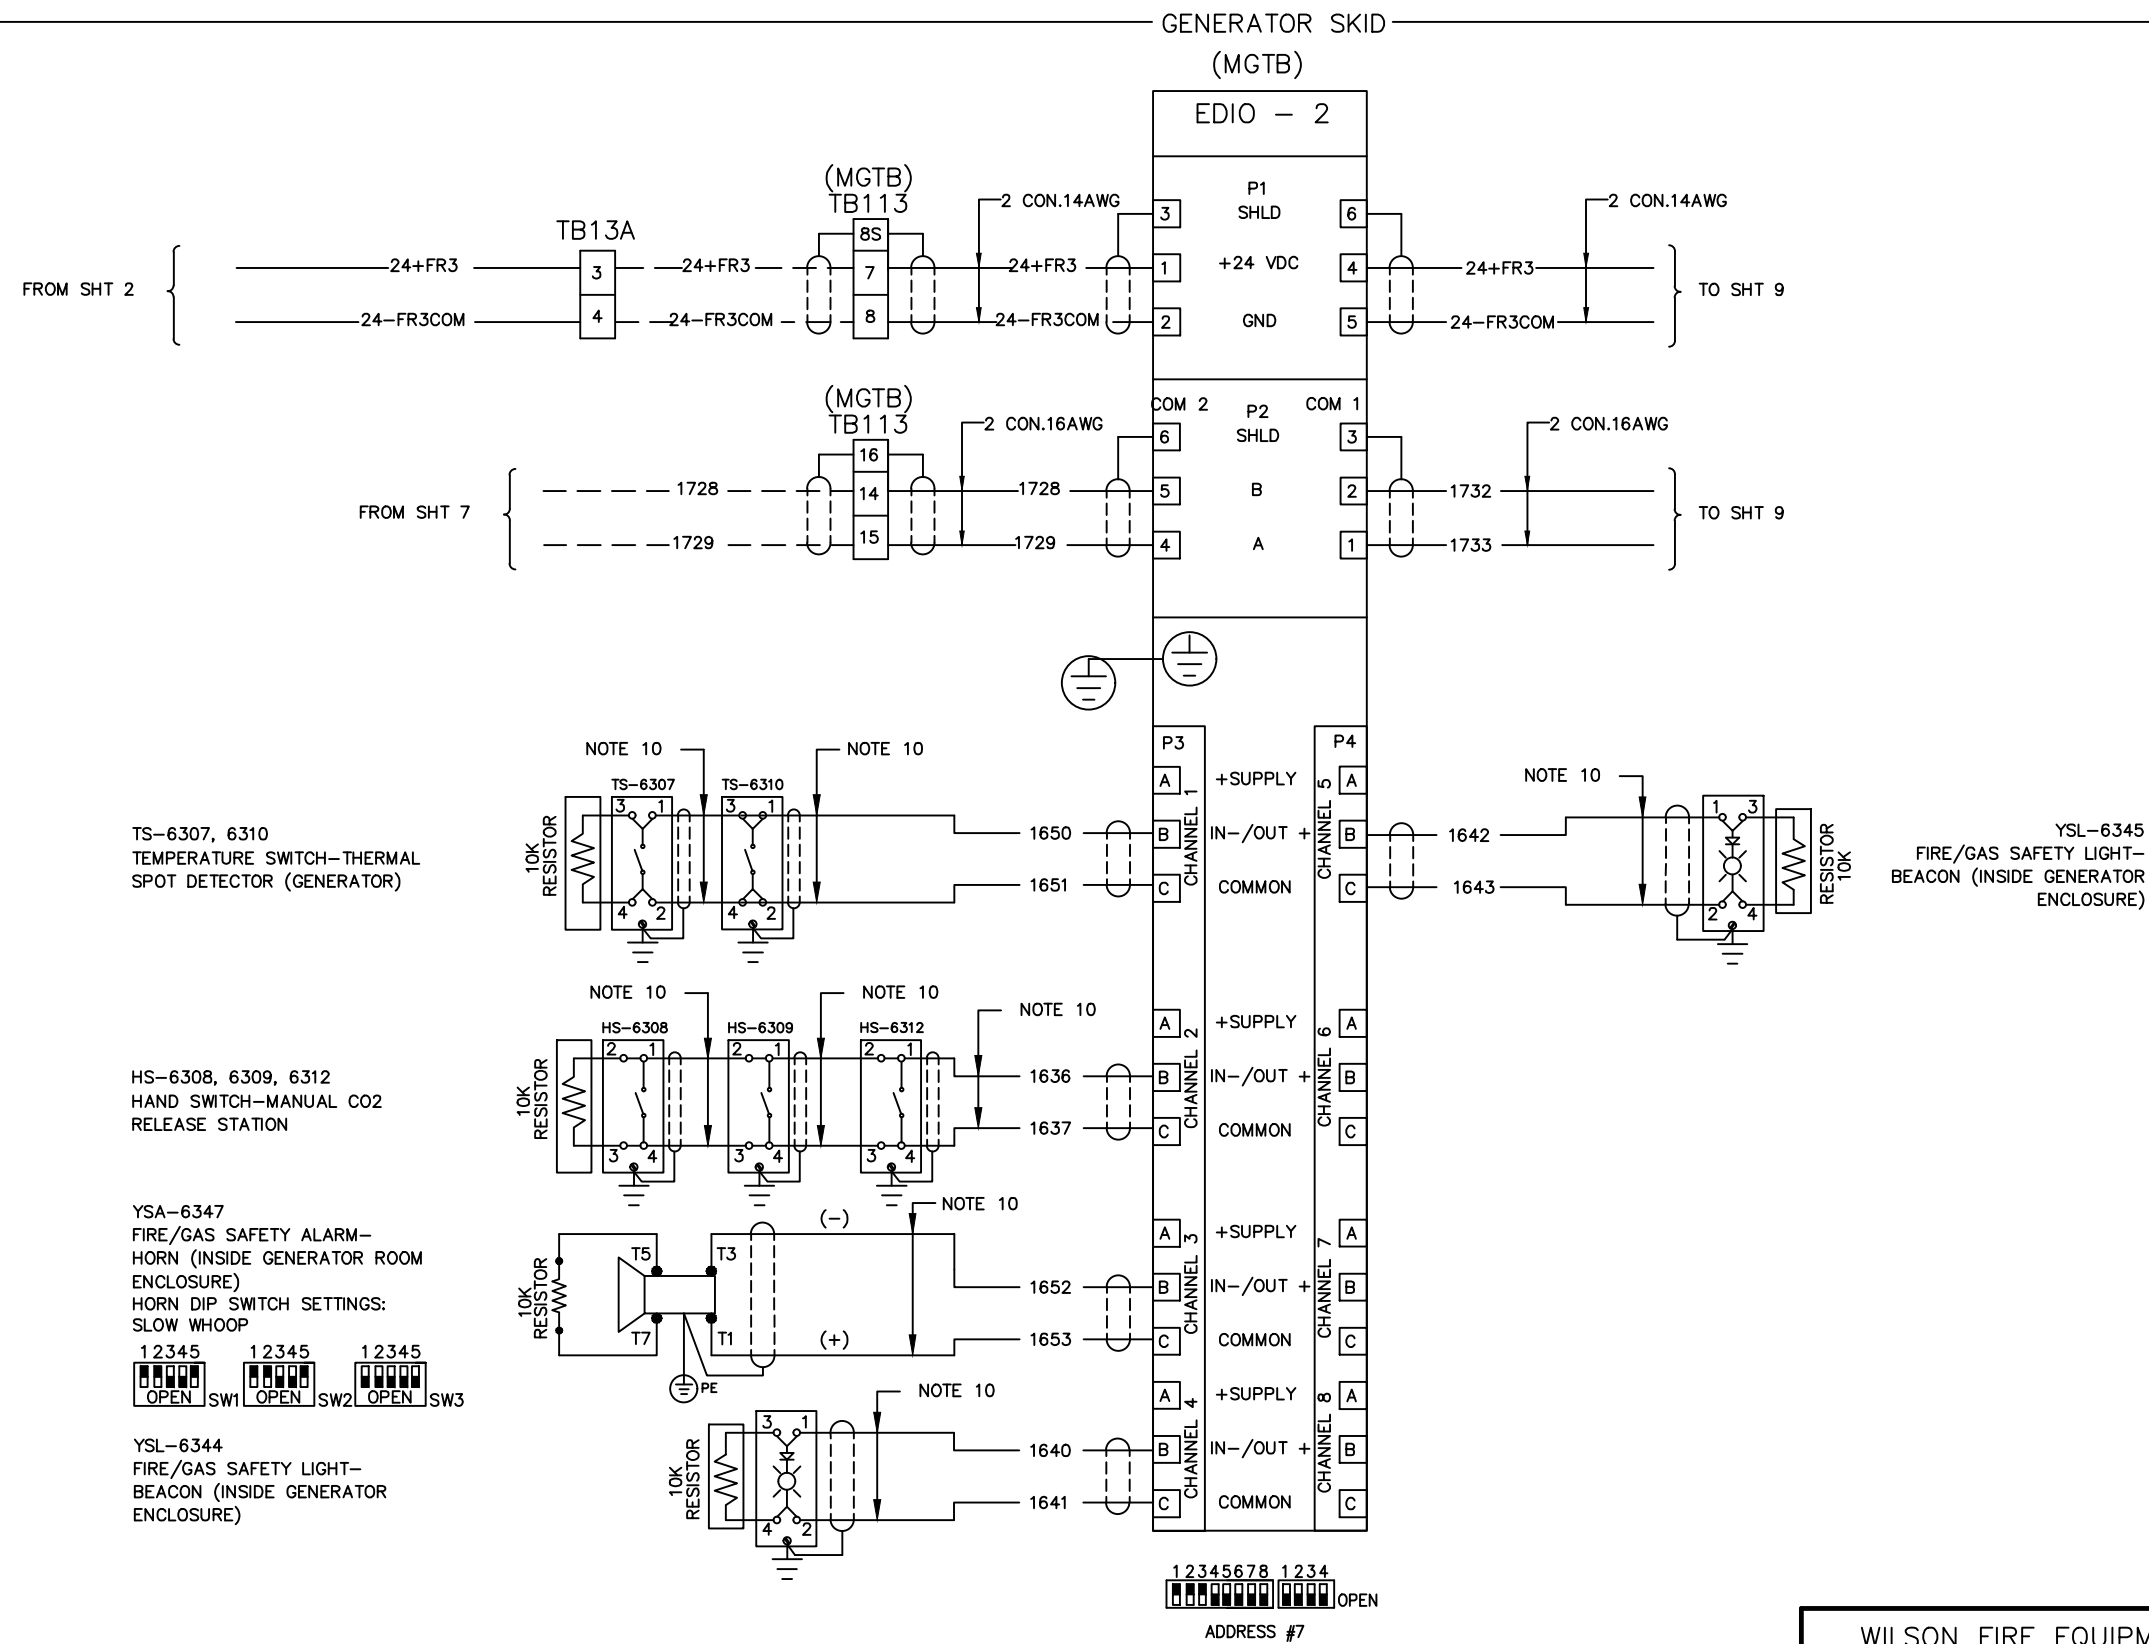

REVISIONS				
REV	DESCRIPTION	DATE	BY	
A	ISSUED FOR APPROVAL	09/12/24	CM	
B	ISSUED FOR APPROVAL	11/01/24	CM	
C	ISSUED FOR APPROVAL	12/02/24	MAP	
D	ISSUED FOR APPROVAL	01/31/25	MAP	

THIS DRAWING, DESIGN AND THE DATA CONTAINED THEREIN IS THE PROPERTY OF WILSON FIRE EQUIPMENT AND IS NOT TO BE DISTRIBUTED TO OR USED BY OTHERS WITHOUT THE EXPRESSED WRITTEN CONSENT OF WILSON FIRE EQUIPMENT.

SCALE: AS SHOWN DATE

DRAWN: CM 09/12/24


CHECKED: JV 09/12/24

APPROVED: JV 09/12/24

WILSON FIRE EQUIPMENT & SERVICE CO. 7303 EMPIRE CENTRAL DRIVE HOUSTON, TEXAS 77040 (713) 896-4747		
CUSTOMER INFORMATION		
GE VERNOVA		
LM6000 60HZ DLE		
INSTRUMENT LOOP DIAGRAM CO2 FIRE PROTECTION SYSTEM WFE PROJECT # GE-1457		


		
SIZE	DRAWING NO.	REV
B	SW-1457-08 SHEET 8 OF 13	D


_____ GENERATOR SKID _____

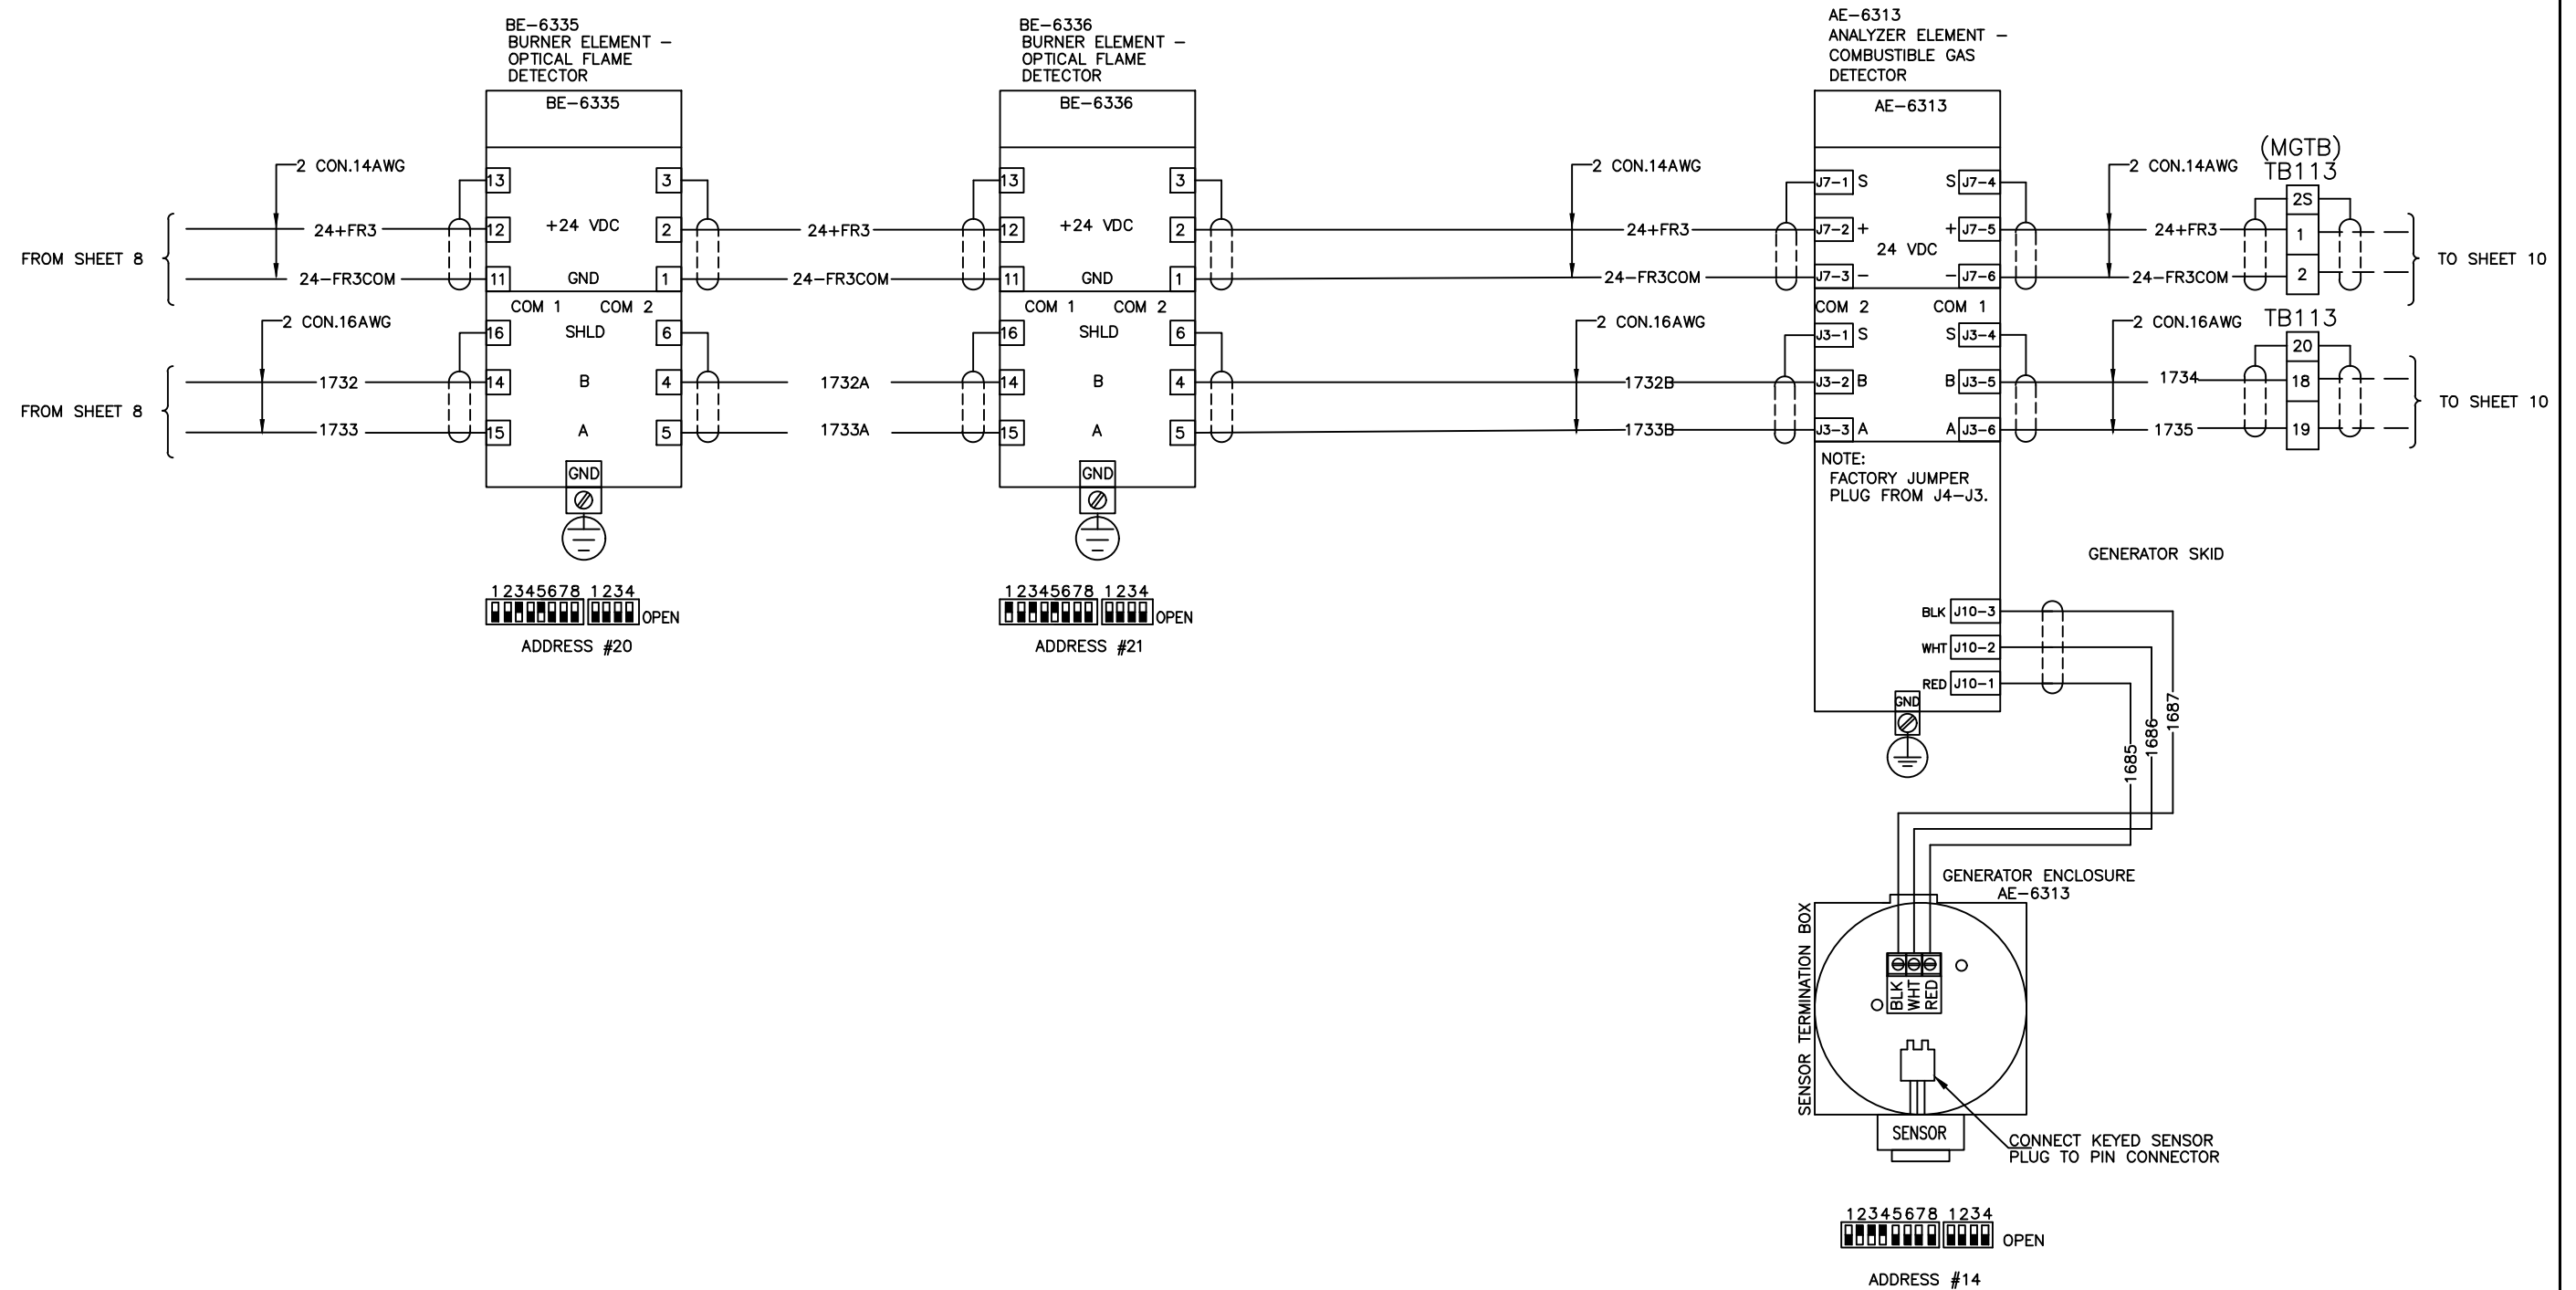

REVISIONS				THIS DRAWING, DESIGN AND THE DATA CONTAINED THEREIN IS THE PROPERTY OF WILSON FIRE EQUIPMENT AND IS NOT TO BE DISTRIBUTED TO OR USED BY OTHERS WITHOUT THE EXPRESSED WRITTEN CONSENT OF WILSON FIRE EQUIPMENT.	
REV	DESCRIPTION	DATE	BY		
A	ISSUED FOR APPROVAL	09/12/24	CM		
B	ISSUED FOR APPROVAL	11/01/24	CM		
C	ISSUED FOR APPROVAL	12/02/24	MAP		
D	ISSUED FOR APPROVAL	01/31/25	MAP		
				SCALE: AS SHOWN	DATE
				DRAWN: CM	09/12/24
				CHECKED: JV	09/12/24
				APPROVED: JV	09/12/24

WILSON FIRE EQUIPMENT & SERVICE CO. 7303 EMPIRE CENTRAL DRIVE HOUSTON, TEXAS 77040 (713) 896-4747
CUSTOMER INFORMATION
GE VERNOVA
LM6000 60HZ DLE
INSTRUMENT LOOP DIAGRAM CO2 FIRE PROTECTION SYSTEM WFE PROJECT # GE-1457

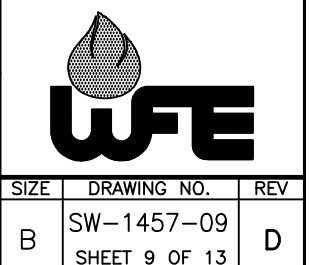

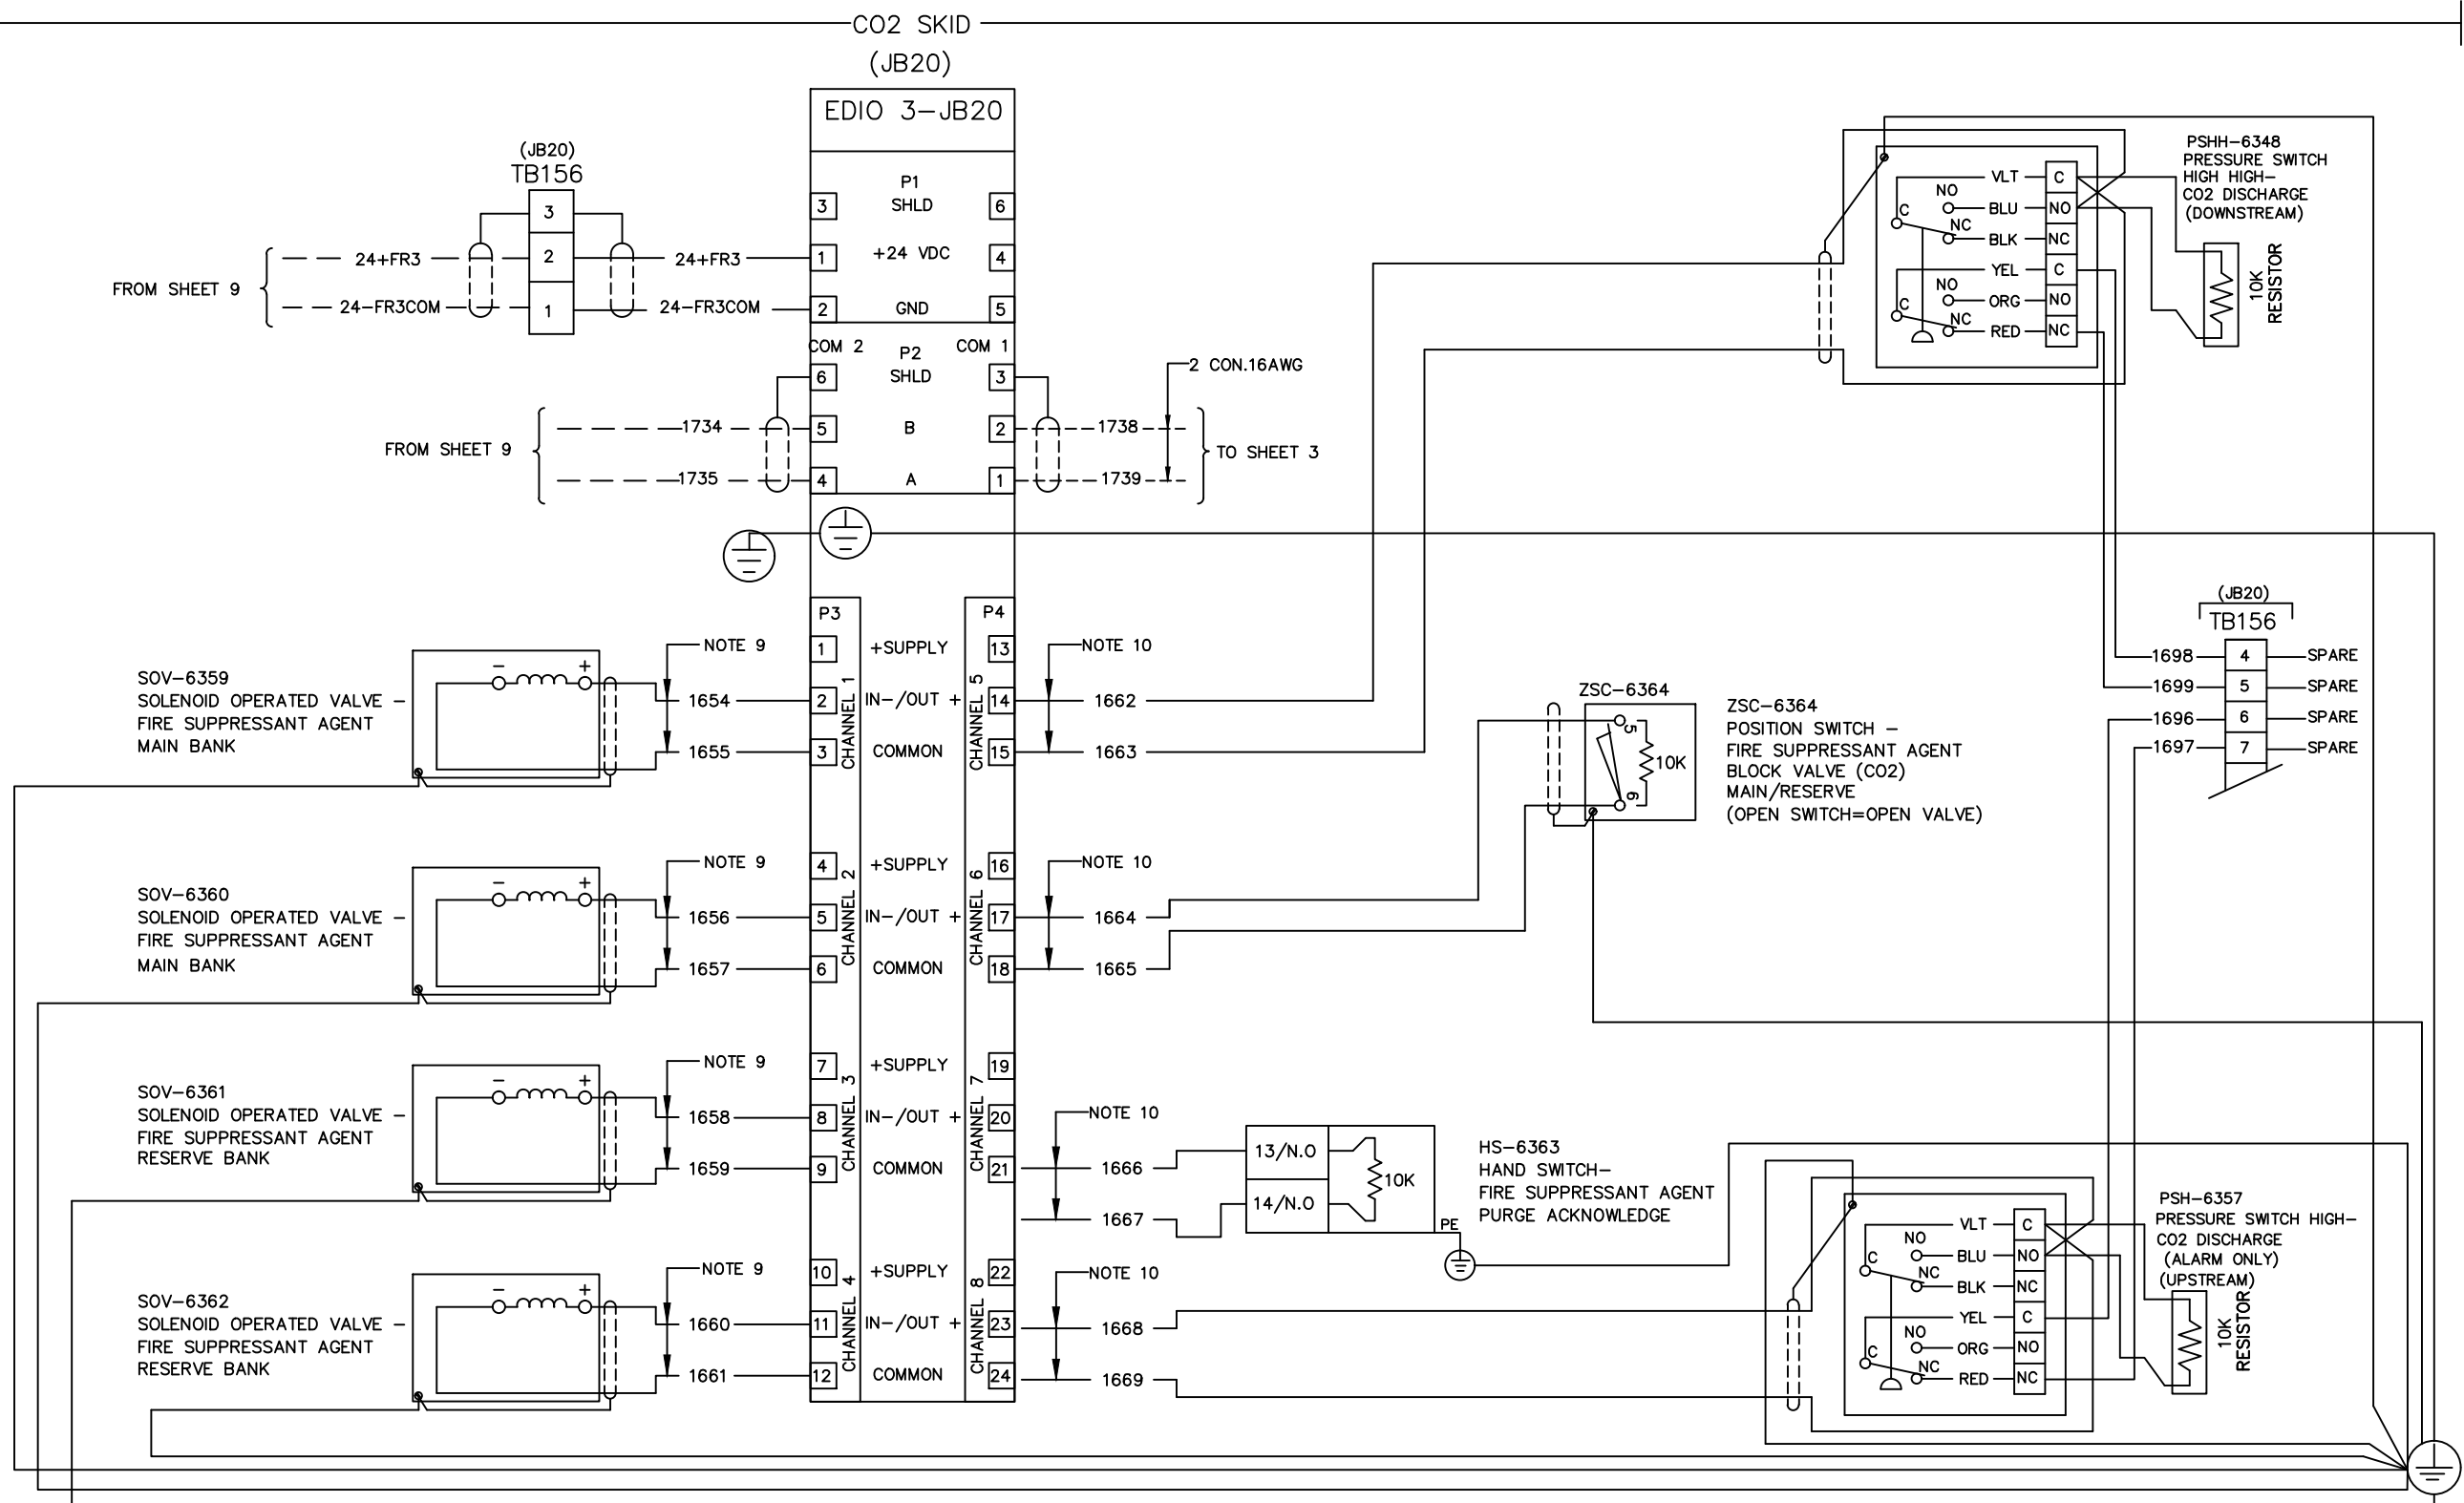

12345678 1234
ADDRESS # 8

REVISIONS				
REV	DESCRIPTION	DATE	BY	
A	ISSUED FOR APPROVAL	09/12/24	CM	
B	ISSUED FOR APPROVAL	11/01/24	CM	
C	ISSUED FOR APPROVAL	12/02/24	MAP	
D	ISSUED FOR APPROVAL	01/31/25	MAP	
THIS DRAWING, DESIGN AND THE DATA CONTAINED THEREIN IS THE PROPERTY OF WILSON FIRE EQUIPMENT AND IS NOT TO BE DISTRIBUTED TO OR USED BY OTHERS WITHOUT THE EXPRESSED WRITTEN CONSENT OF WILSON FIRE EQUIPMENT.				
SCALE:		AS SHOWN	DATE	
DRAWN:		CM	09/12/24	
CHECKED:		JV	09/12/24	
APPROVED:		JV	09/12/24	

WILSON FIRE EQUIPMENT & SERVICE CO. 7303 EMPIRE CENTRAL DRIVE HOUSTON, TEXAS 77040 (713) 896-4747	
CUSTOMER INFORMATION	
GE VERNOVA	
LM6000 60HZ DLE	
INSTRUMENT LOOP DIAGRAM CO2 FIRE PROTECTION SYSTEM WFE PROJECT # GE-1457	

		
SIZE	DRAWING NO.	REV
B	SW-1457-10 SHEET 10 OF 13	D

NODE ADD	DEVICE TYPE	TAG NAME	DESCRIPTION	NODE CONFIGURATION SETTINGS													
9	UDIO	AE-6304A	AE-6304A ANALYZER ELEMENT COMBUSTIBLE GAS DETECTOR	UDIO TYPE: EXPLOSIVE	HIGH ALARM: 25	LOW ALARM: 15	CAL LEVEL: 50	GAS MODE: GAS DETECTOR		12345678 00000000 1234 0000 #9 OPEN					DEADBAND 5		
10	UDIO	AE-6304B	AE-6304B ANALYZER ELEMENT COMBUSTIBLE GAS DETECTOR	UDIO TYPE: EXPLOSIVE	HIGH ALARM: 25	LOW ALARM: 15	CAL LEVEL: 50	GAS MODE: GAS DETECTOR		12345678 00000000 1234 0000 #10 OPEN					DEADBAND 5		
11	UDIO	AE-6304C	AE-6304C ANALYZER ELEMENT COMBUSTIBLE GAS DETECTOR	UDIO TYPE: EXPLOSIVE	HIGH ALARM: 25	LOW ALARM: 15	CAL LEVEL: 50	GAS MODE: GAS DETECTOR		12345678 00000000 1234 0000 #11 OPEN					DEADBAND 5		
14	UDIO	AE-6313	AE-6313 ANALYZER ELEMENT COMBUSTIBLE GAS DETECTOR	UDIO TYPE: EXPLOSIVE	HIGH ALARM: 25	LOW ALARM: 15	CAL LEVEL: 50	GAS MODE: GAS DETECTOR		12345678 00000000 1234 0000 #14 OPEN					DEADBAND 5		
15	ECLIPSE	AE-3029	AE-3029 ANALYZER ELEMENT – COMBUSTIBLE GAS DETECTOR	GAS TYPE: METHANE	CAL GAS TYPE: SAME	CAL METHOD: STD	UNITS: %LEL	HIGH ALARM: 10	LOW ALARM: 5	12345678 00000000 1234 0000 #15 OPEN	CAL LEVEL: 50	LOW ALARM: NON- LATCHING:	HIGH ALARM: LATCHING	DEADBAND 5			
16	ECLIPSE	AE-3030	AE-3030 ANALYZER ELEMENT – COMBUSTIBLE GAS DETECTOR	GAS TYPE: METHANE	CAL GAS TYPE: SAME	CAL METHOD: STD	UNITS: %LEL	HIGH ALARM: 10	LOW ALARM: 5	12345678 00000000 1234 0000 #16 OPEN	CAL LEVEL: 50	LOW ALARM: NON- LATCHING:	HIGH ALARM: LATCHING	DEADBAND 5			
17	X9800 IR	BE-6300	BE-6300 BURNER ELEMENT TURBINE ENCLOSURE OPTICAL FLAME DETECTOR	NON- LATCHING:	TIME DELAY: 0	Oi MODE: AUTO	HEATER: ENABLED	IR SENS: MEDIUM		12345678 00000000 1234 0000 #17 OPEN	PROCESSING MODE (IR): TDSA	IR Oi TEST FREQ: 1	FAILED IR Oi TEST FOR FAULT: 1	DEADBAND 5			
18	X9800 IR	BE-6302	BE-6302 BURNER ELEMENT TURBINE ENCLOSURE OPTICAL FLAME DETECTOR	NON- LATCHING:	TIME DELAY: 0	Oi MODE: AUTO	HEATER: ENABLED	IR SENS: MEDIUM		12345678 00000000 1234 0000 #18 OPEN	PROCESSING MODE (IR): TDSA	IR Oi TEST FREQ: 1	FAILED IR Oi TEST FOR FAULT: 1	DEADBAND 5			
19	X9800 IR	BE-6311	BE-6311 BURNER ELEMENT TURBINE ENCLOSURE OPTICAL FLAME DETECTOR	NON- LATCHING:	TIME DELAY: 0	Oi MODE: AUTO	HEATER: ENABLED	IR SENS: MEDIUM		12345678 00000000 1234 0000 #19 OPEN	PROCESSING MODE (IR): TDSA	IR Oi TEST FREQ: 1	FAILED IR Oi TEST FOR FAULT: 1	DEADBAND 5			
20	X9800 IR	BE-6335	BE-6335 BURNER ELEMENT OPTICAL FLAME DETECTOR	NON- LATCHING:	TIME DELAY: 0	Oi MODE: AUTO	HEATER: ENABLED	IR SENS: MEDIUM		12345678 00000000 1234 0000 #20 OPEN	PROCESSING MODE (IR): TDSA	IR Oi TEST FREQ: 1	FAILED IR Oi TEST FOR FAULT: 1	DEADBAND 5			
21	X9800 IR	BE-6335	BE-6336 BURNER ELEMENT OPTICAL FLAME DETECTOR	NON- LATCHING:	TIME DELAY: 0	Oi MODE: AUTO	HEATER: ENABLED	IR SENS: MEDIUM		12345678 00000000 1234 0000 #21 OPEN	PROCESSING MODE (IR): TDSA	IR Oi TEST FREQ: 1	FAILED IR Oi TEST FOR FAULT: 1	DEADBAND 5			

REVISIONS				THIS DRAWING, DESIGN AND THE DATA CONTAINED THEREIN IS THE PROPERTY OF WILSON FIRE EQUIPMENT AND IS NOT TO BE DISTRIBUTED TO OR USED BY OTHERS WITHOUT THE EXPRESSED WRITTEN CONSENT OF WILSON FIRE EQUIPMENT.	
REV	DESCRIPTION	DATE	BY		
A	ISSUED FOR APPROVAL	09/12/24	CM		
B	ISSUED FOR APPROVAL	11/01/24	CM		
C	ISSUED FOR APPROVAL	12/02/24	MAP		
D	ISSUED FOR APPROVAL	01/31/25	MAP		
				SCALE:	AS SHOWN
				DRAWN:	CM 09/12/24
				CHECKED:	JV 09/12/24
				APPROVED:	JV 09/12/24

WILSON FIRE EQUIPMENT & SERVICE CO. 7303 EMPIRE CENTRAL DRIVE HOUSTON, TEXAS 77040 (713) 896-4747		
CUSTOMER INFORMATION		
GE VERNOVA		
LM6000 60HZ DLE SHELL FRIENDSWOOD		
LON LIST CO2 FIRE PROTECTION SYSTEM WFE PROJECT # GE-1457		

		
SIZE	DRAWING NO.	REV
B	SW-1457-13	D
SHEET 13 OF 13		

