

---

# SAVINGS REPORT FOR LABORATORY: OTTO MASS BUILDING 119 ROOM 230

Equipmind of Glencross Brunet Inc

[calem@equipmind.com](mailto:calem@equipmind.com)

---

## Abstract

*This is a report made for you for this particular lab should you want a more in depth analysis of the results we gathered for your laboratory. In particular, the method by which we generated your results is presented.*

## 1 Glossary of Terms


*Fumehood* HyveDev is the name for the automation team outside of Solar Decathlon.

## 2 Introduction


## 3 Method

## 4 Data


## 5 Conclusion

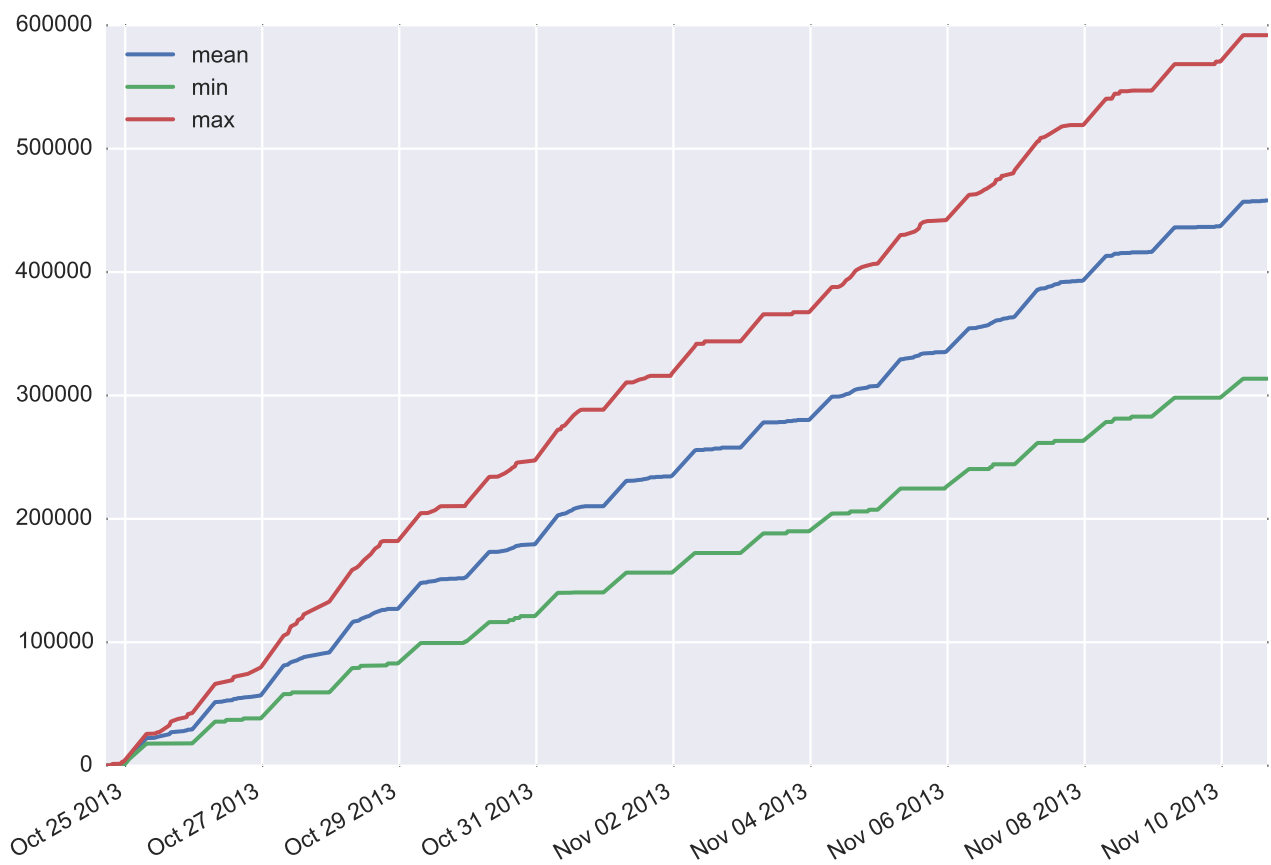

**Figure 1:** A summary of the cumulative savings of a laboratory across the different parameters tested.

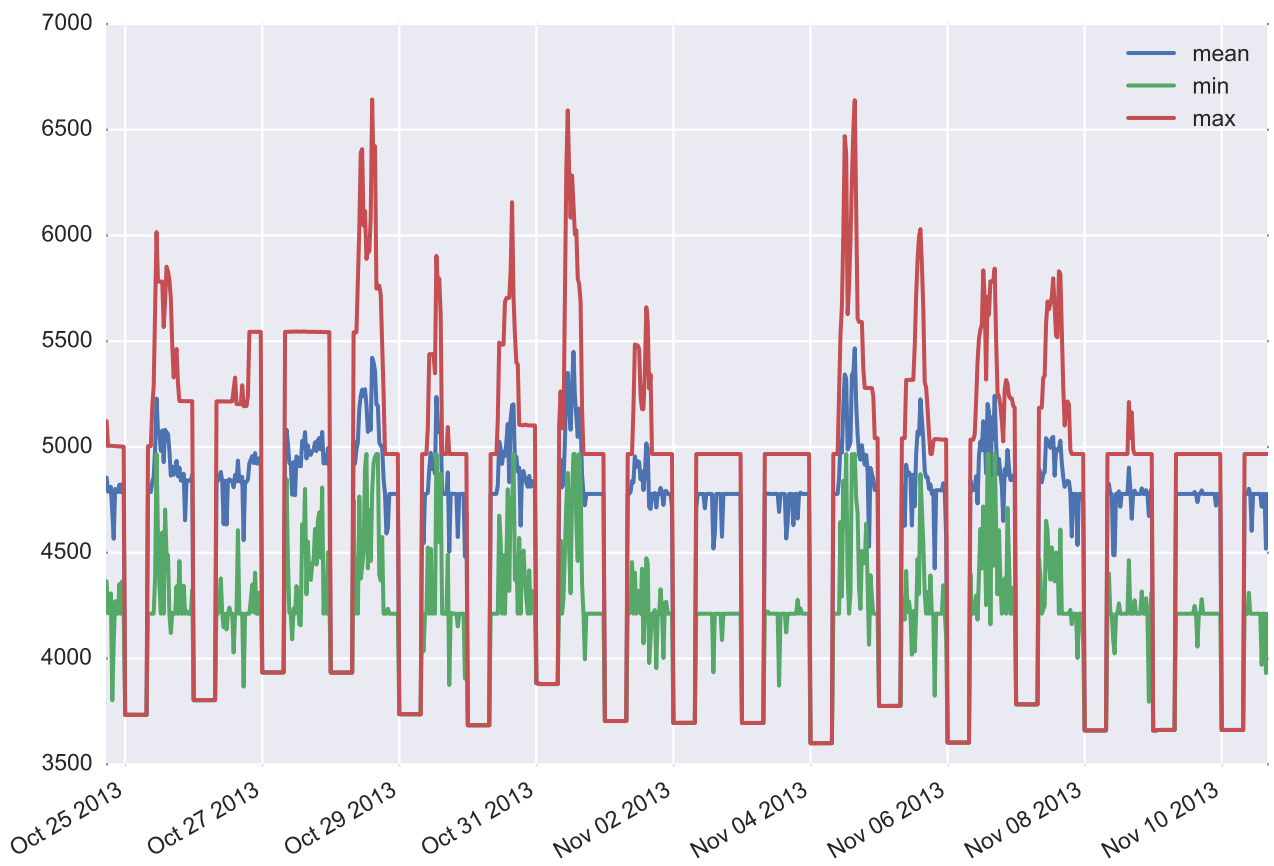

**Figure 2:** A summary of the summation of all fumehood and laboratory evacuation over time across the different parameters evaluated. Significant dips in evacuation are typically night time.

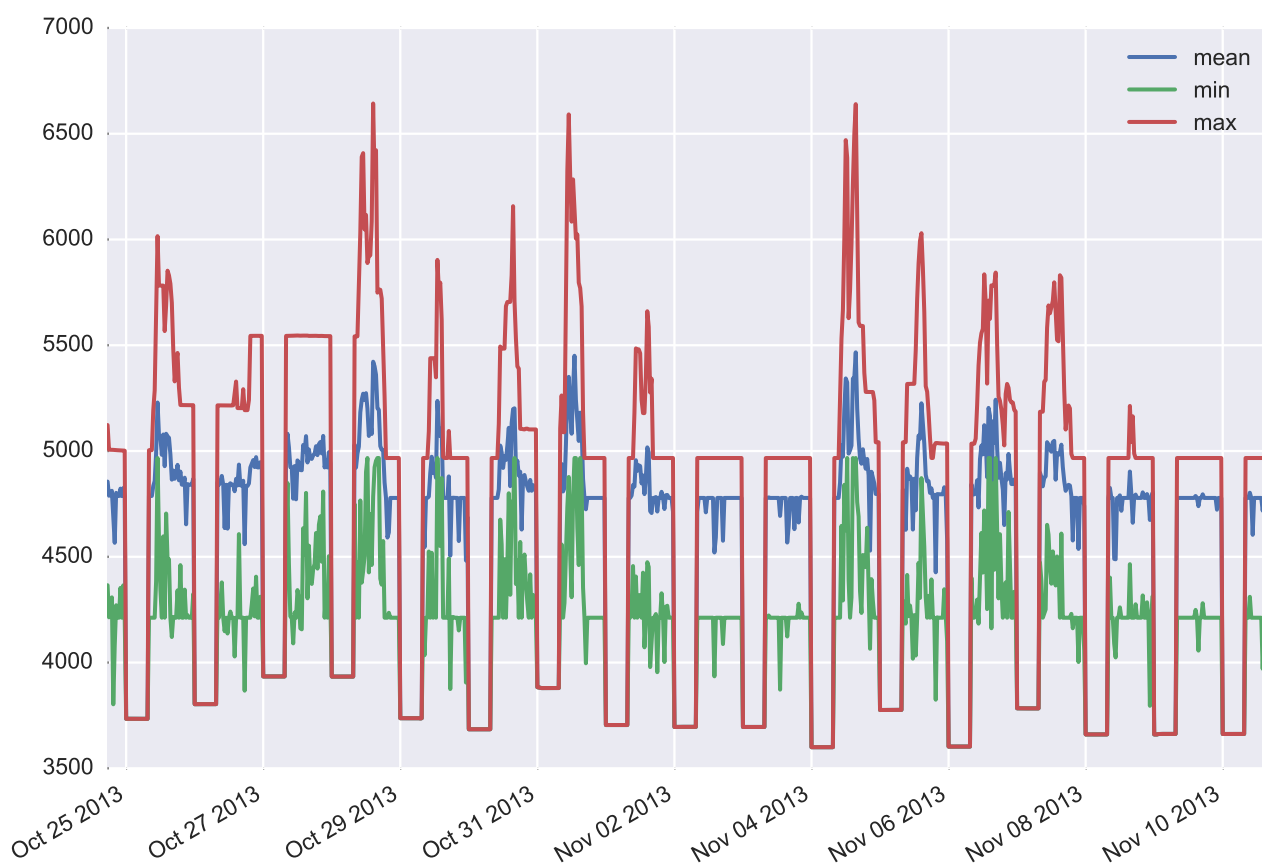

**Figure 3:** A summary of the summation of all fumehood and laboratory evacuation over time across the different parameters evaluated. Significant dips in evacuation are typically night time.