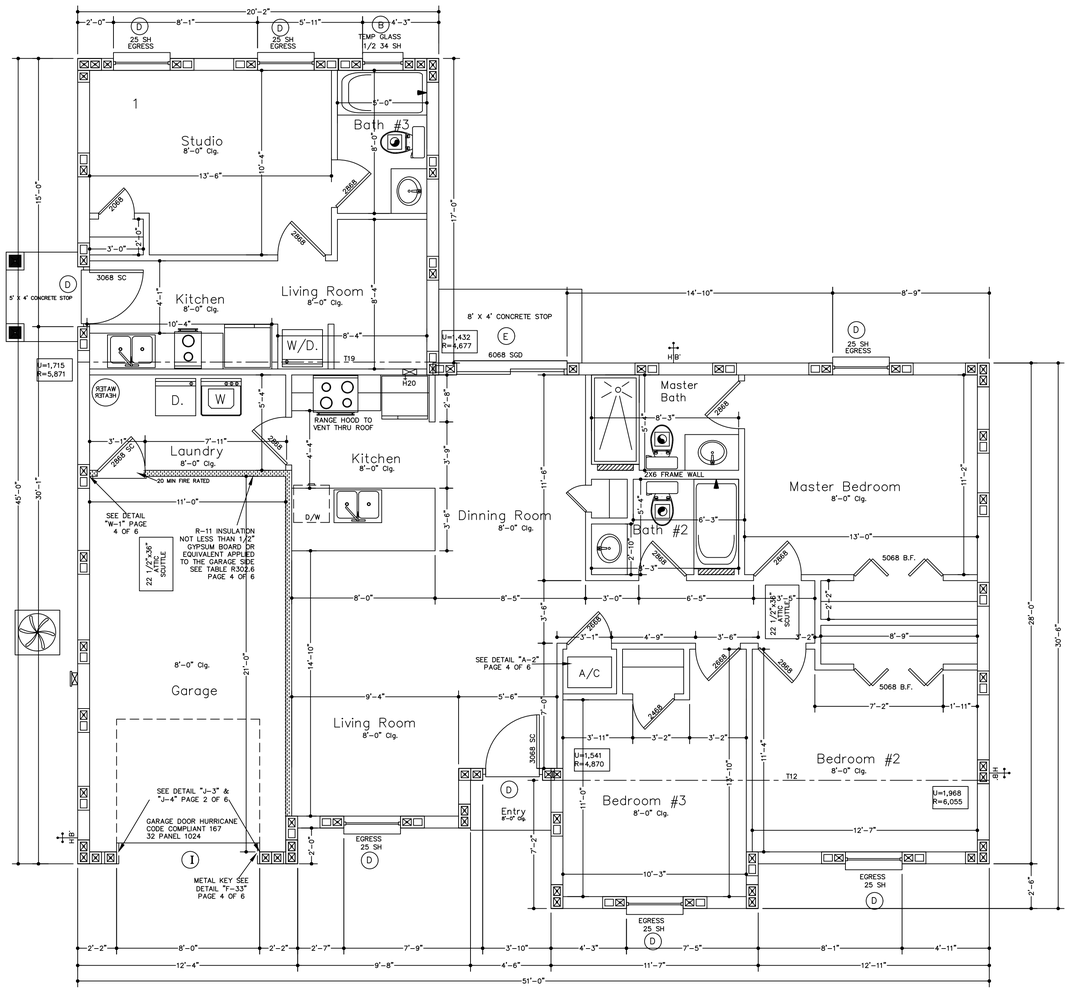


Floor Plan

SQUARE FOOTAGES

LIVING	1,490	SQ. FT.
ENTRY	13	SQ. FT.
GARAGE	263	SQ. FT.
TOTAL	1,766	SQ. FT.

GENERAL NOTES

1. MIN. OF 1/2" DRYWALL ON ATTACHED GARAGE/CARPORT CEILING AND WALLS SEPARATING LIVING AREA FROM GARAGE/CARPORT AREA. ALL DOORS IN ATTACHED GARAGE/CARPORT AREA ENTERING THE LIVING AREA TO BE 20 MINUTE FIRE RATED & MUST BE INSULATED.
2. WHERE APPLYING A WATER-BASED TEXTURE MATERIAL ON CEILING, THE MINIMUM GYPSUM BOARD THICKNESS SHALL BE INCREASED FROM 1/2" TO 5/8" FOR 24 INCH ON CENTER FRAMING OR 1/2" SAG-RESISTANT GYPSUM CEILING BOARD SHALL BE USED.
3. ALL APPLIANCES IN GARAGES TO BE RAISED 24" MIN. FOR PROTECTION UNLESS OTHERWISE NOTED.
4. WHERE APPLIANCES, EQUIPMENT AND INSULATION ARE SUBJECT TO WATER DAMAGE WHEN AUXILIARY DRAIN PANS FILL, THAT PORTION OF THE APPLIANCE, EQUIPMENT AND INSULATION SHALL BE INSTALLED ABOVE THE RIM OF THE PAN, SUPPORT THE APPLIANCE OR EQUIPMENT SHALL BE WATER RESISTANT AND APPROVED.
5. MAXIMUM DRYER DUCT LENGTH AS PER MANUFACTURER'S SPECS OR WHERE NO MANUFACTURE'S SPECS ARE PROVIDED 35'-0". WERE FITTINGS ARE USED EXHAUST DUCT LENGTH REDUCED IN ACCORDANCE WITH TABLE M1502.4.5.1 (4" RADIUS MITERED 45-DEGREE ELBOW 2'-6"; 90-DEGREE 5'-0"; 6" RADIUS MITERED 45-DEGREE ELBOW 1'-0"; 90 DEGREE 1'-9') OWNER/BUILDER TO PROVIDE. WHERE DRYER EXHAUST DUCT POWER VENTILATORS ARE USED, THEY ARE TO BE INSTALLED AS PER MANUFACTURER'S SPECS AND CONFORM TO UL 705. THE MAXIMUM ALLOWABLE LENGTH WHEN USING A POWER VENTILATOR SHALL BE IN ACCORDANCE WITH MANUFACTURER'S INSTRUCTIONS FOR THE DUCT POWER VENTILATOR. WHERE THE EXHAUST DUCT LENGTH EXCEEDS 35'0:. THE LENGTH OF THE DUCT SHALL BE IDENTIFIED ON A PERMANENT LABEL OR TAG AND BE LOCATED WITHIN 6'0" OF THE EXHAUST DUCT CONNECTION.
6. MECHANICAL CONTRACTOR TO PROVIDE WHOLE HOUSE MECHANICAL VENTILATION SYSTEM SPECS WHEN REQUIRED IN ACCORDANCE WITH SECTIONS R303.4 & M1507.3 IN THE EIGHT EDITION F.B.C.R (2023)
7. MECHANICAL: REFRIGERANT PIPING AND TUBING TO SHALL BE SECURELY FASTENER TO A PERMANENT SUPPORT WITHIN 6'0" OF THE CONDENSING UNIT.
8. VERTICAL OR HORIZONTAL ACCESS DOOR FROM CONDITIONED SPACED TO UNCONDITIONED SPACED SUCH AS ATTICS OR CRAWL SPACED. WHERE LOOSE-FILL INSULATION IS INSTALLED, A WOOD FRAMED OR EQUIVALENT BAFFLE, RETAINER OR DAM SHALL BE INSTALLED TO PREVENT LOOSE FILL INSULATION FROM SPILLING INTO LIVING SPACE, FROM HIGHER TO LOWER SECTION OF THE ATTIC, AND FROM ATTIC COVERING CONDITIONED SPACES TO UNCONDITIONED SPACES. THE BAFFLE OR RETAINER SHALL BE PROVIDE PERMANENT MEANS OF MAINTAINING THE INSTALLED R-VALUE OF THE LOOSE-FILL INSULATION.

WALL LEGEND

- WOOD FRAME WALL
- INSULATED WOOD WALL
- BEARING WOOD FRAME WALL
- 8'-0" HIGH BLOCK WALL

LEGEND

- SHOWER HEAD & WALL MOUNT TUB SPOUT
- SHOWER HEAD ONLY
- HOSE BIB

© COPY RIGHT
KIMSA CONSTRUCTION LLC
ALL RIGHTS RESERVED

JOB # 2025-713

DATE:

DRAWING BY:
KIMSA CONSTRUCTION LLC

EMAIL:
KIMSACONSTRUCTIONCORP@GMAIL.COM

PHONE:
352-581-9844
973-508-7387

ADDRESS:
780 SE 64TH TERRACE OCALA
FL 34472

DESIGN MODEL FOR:

MODEL NAME:
"UTAH/ ANEXO MODEL"

PARCEL #:

DRAWING BY: A.C

SCALE: 1/4"=1'-0"

REVIEW NOTES:

ENGINEERING NOTES:

1. DESIGN WIND LOAD= 130MPH (Vult)
2. ASSUMED SOIL BEARING= 2000psf
3. DESIGN LIVE LOADS:
   ROOF= 20psf
   FLOOR= 40psf
4. DESIGN DEAD LOADS:
   ROOF= 17psf
   FLOOR= 15psf
   ALL OTHER ACTUAL WEIGHTS OF MATERIALS

DESIGN CRITERIA:

- FLORIDA BUILDING CODE RESIDENTIAL 8TH. EDITION(2023)
- ASCE 7-22
- 130 mph WIND SPEED (Vult) 101 MPH (Vasd)
- WIND EXPOSURE "C"
- WIND IMPORTANCE FACTOR: 1
- RISK CATEGORY II
- BUILDING CLASSIFICATION "R-3" TYPE V-B
- ALL OPENINGS IN EXTERIOR WALLS TO RESIST P.S.F. REQUIREMENTS PER TABLE R301.2(2)
- ENCLOSED INTERNAL PRESSURE COEFFICIENT= +/-0.18
- PARTIALLY ENCLOSED INTERNAL PRESSURE COEFFICIENT= +/-0.55
- ICC 600-20 STD. FOR RESIDENTIAL CONSTRUCTION IN HIGH-WIND AREAS