

Overflow DN400

Inlet DN225

Outlet DN150

Drainage DN80

Flat Inverted bottom panel

TANK-AXONOMETRIC

Note:
Overflow shall be twice the area of inlet to avoid overfilling.

TANK COMPONENTS

No.	Description	Material	Qty.	Remarks
1	Water tank	G.R.P.	1	
2	Manhole Cover	G.R.P.	1	S/S Hinges & Locks
3	Internal Ladder	G.R.P.	1	Height : 4m
4	External Ladder	SS/A4	1	Height : 4m
5	Air vent	PVC	2	Light & Insect Proof 4" Cowl Type
6	Inlet	U.P.V.C	10	DN225
7	Outlet	U.P.V.C	2	DN150
8	Drainage	U.P.V.C	2	DN80
9	Overflow	U.P.V.C	2	DN400
10	Water Level Gage	GRP/ ACRYLIC	1	Height : 4m

- GENERAL CAUTIONS
- NOTES:
- Allow a minimum space of 50 cm all around the tank's foundation.
 - Maximum allowable deviation in concrete foundation = +/- 2mm.
 - For sizes of items 6, 7, 8, 9 & 10, please refer to catalogue.
 - Overflow shall be twice the area of inlet to avoid overfilling.
 - Overflow shall flow freely to the ground.
 - All pipes, fittings and other accessories shall be self supported.
 - Tank to be electrically grounded in case of internal tie rod reinforcement.

Solico Panel Type Water Tank

Tank size:	7x2x4m HIGH		
Capacity:	56 m ³	14,793 USG	12,318 ImpG
Bolts / Nuts:	S/S(A4) Internally & GI Externally		
Insulation:	Non Insulated		

Order No.:

Project Name:
PROJECT IN AUSTRALIA

Contractor:
ATM TANK

Consultant:
-


Reference No.:26SE399	Scale: NTS	Page No.
-----------------------	------------	----------

Done By:SHANIF	Approved By: JB
----------------	-----------------

Revisions			
No.	Date	Description	Rev By
0	18Aug'26	NEW	-



P.O. Box:61426, Jebel Ali Ind. Area 2
Dubai - UAE.
Tel: (971-4) 8804441 Fax: (971-4) 8801018
e-mail: fiberglass@solicouae.com

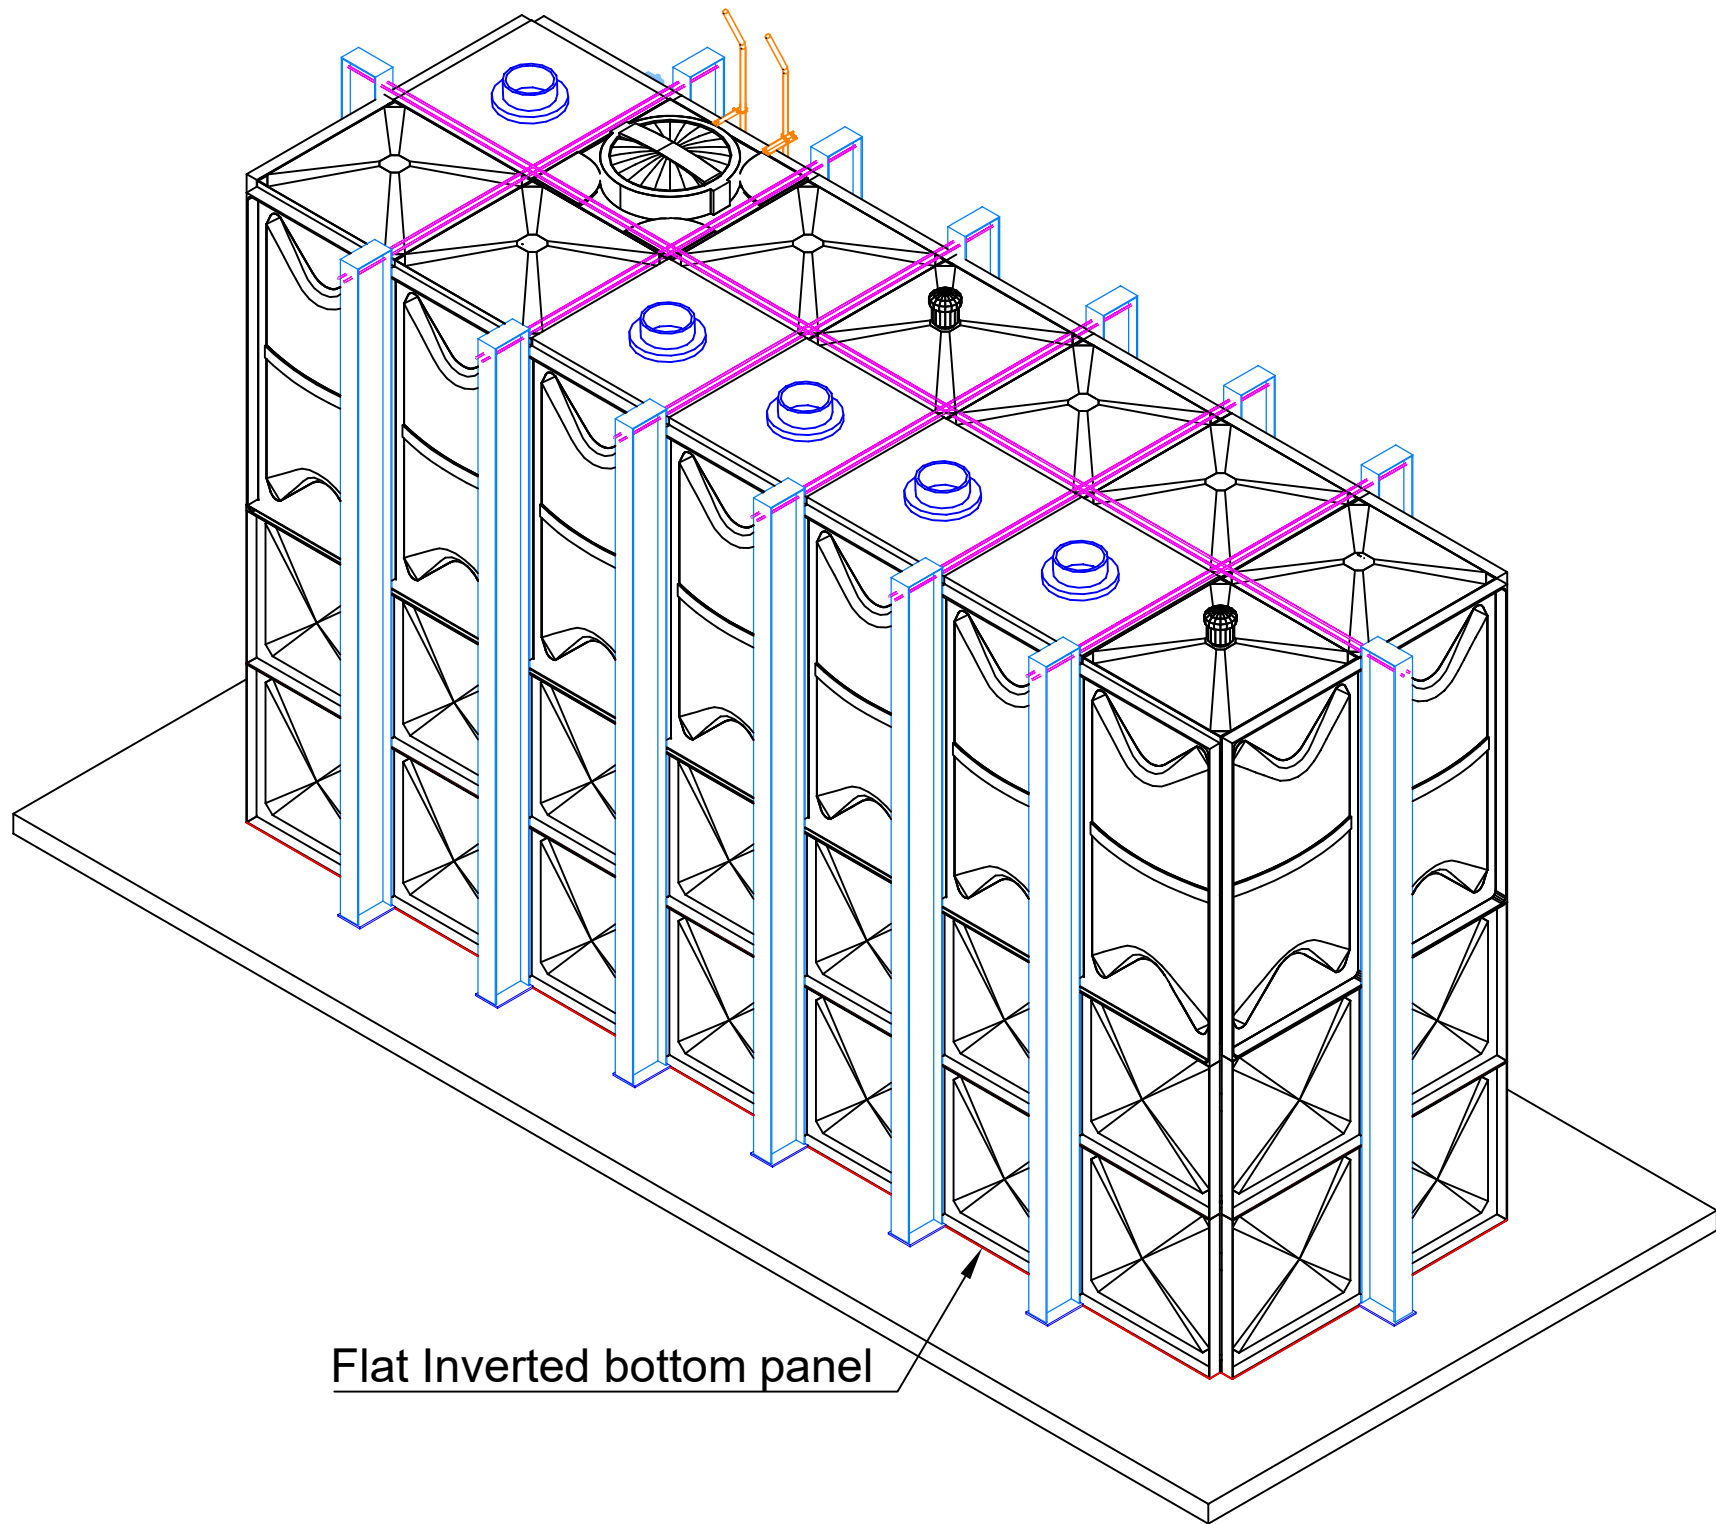

TANK-AXONOMETRIC

TANK COMPONENTS				
No.	Description	Material	Qty.	Remarks
1	Water tank	G.R.P.	1	
2	Manhole Cover	G.R.P.	1	S/S Hinges & Locks
3	Internal Ladder	G.R.P.	1	Height : 4m
4	External Ladder	SS/A4	1	Height : 4m
5	Air vent	PVC	2	Light & Insect Proof 4" Cowl Type
6	Inlet	U.P.V.C	10	DN225
7	Outlet	U.P.V.C	2	DN150
8	Drainage	U.P.V.C	2	DN80
9	Overflow	U.P.V.C	2	DN400
10	Water Level Gage	GRP/ ACRYLIC	1	Height : 4m

- GENERAL CAUTIONS
- NOTES:

1.

Allow a minimum space of 50 cm all around the tank's foundation.

2.

Maximum allowable deviation in concrete foundation = +/- 2mm.

3.

For sizes of items 6, 7, 8, 9 & 10, please refer to catalogue.

4.

Overflow shall be twice the area of inlet to avoid overfilling.

5.

Overflow shall flow freely to the ground.

6.

All pipes, fittings and other accessories shall be self supported.

7.

Tank to be electrically grounded in case of internal tie rod reinforcement.

Solico Panel Type Water Tank				
Tank size:	7x2x4m HIGH			
Capacity:	56 m ³	14,793 USG	12,318 ImpG	
Bolts / Nuts:	S/S(A4) Internally & GI Externally			
Insulation:	Non Insulated			

Order No.:

Project Name:

PROJECT IN AUSTRALIA

Contractor:

ATM TANK

Consultant:


-

Reference No.:26SE399		Scale: NTS	Page No.
Done By:SHANIF		Approved By: JB	
Revisions			
No.	Date	Description	Rev By
0	18Aug'26	NEW	-

SOLICO TANKS

P.O. Box:61426, Jebel Ali Ind. Area 2
Dubai - UAE.
Tel: (971-4) 8804441 Fax: (971-4) 8801018
e-mail: fiberglass@solicouae.com

Copyright Solico Fiber Glass Factory (L.L.C.)

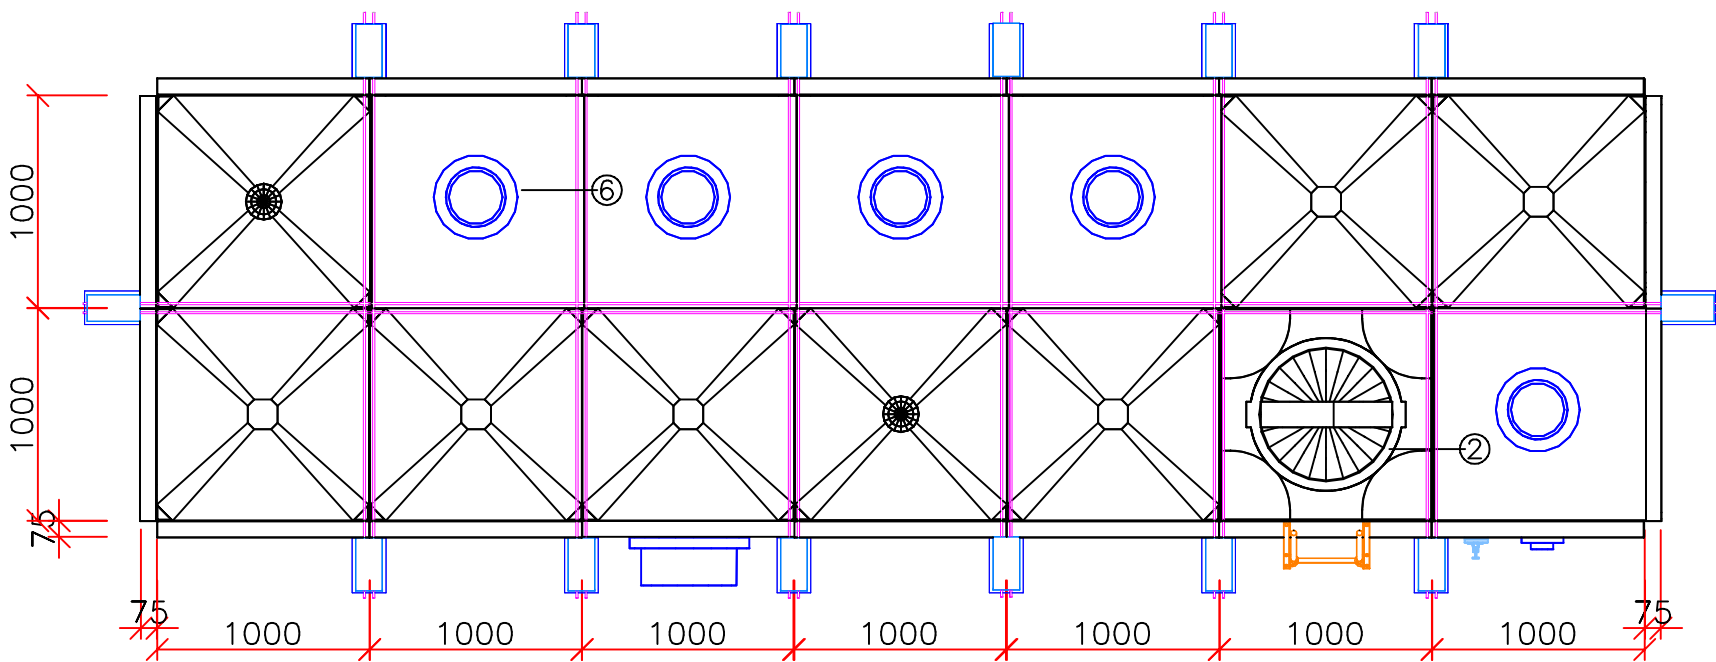

TANK-PLAN

TANK COMPONENTS				
No.	Description	Material	Qty	Remarks
1	Water tank	G.R.P.	1	
2	Manhole Cover	G.R.P.	1	S/S Hinges & Locks
3	Internal Ladder	G.R.P.	1	Height : 4m
4	External Ladder	SS/A4	1	Height : 4m
5	Air vent	PVC	2	Light & Insect Proof 4" Cowl Type
6	Inlet	U.P.V.C	10	DN225
7	Outlet	U.P.V.C	2	DN150
8	Drainage	U.P.V.C	2	DN80
9	Overflow	U.P.V.C	2	DN400
10	Water Level Gage	GRP/ ACRYLIC	1	Height : 4m

- GENERAL CAUTIONS**
- NOTES:
- Allow a minimum space of 50 cm all around the tank's foundation.
 - Maximum allowable deviation in concrete foundation = +/- 2mm.
 - For sizes of items 6, 7, 8, 9 & 10, please refer to catalogue.
 - Overflow shall be twice the area of inlet to avoid overfilling.
 - Overflow shall flow freely to the ground.
 - All pipes, fittings and other accessories shall be self supported.
 - Tank to be electrically grounded in case of internal tie rod reinforcement.

Solico Panel Type Water Tank				
Tank size:	7x2x4m HIGH			
Capacity:	56 m ³	14,793 USG	12,318 ImpG	
Bolts / Nuts:	S/S(A4) Internally & GI Externally			
Insulation:	Non Insulated			

Order No.:

Project Name:

PROJECT IN AUSTRALIA

Contractor:

ATM TANK

Consultant:


-

Reference No.:26SE399		Scale: NTS	Page No.
Done By:SHANIF		Approved By: JB	
Revisions			
No.	Date	Description	Rev By
0	18Aug'26	NEW	-



P.O. Box:61426, Jebel Ali Ind. Area 2
Dubai - UAE.
Tel: (971-4) 8804441 Fax: (971-4) 8801018
e-mail: fiberglass@solicouae.com

Copyright Solico Fiber Glass Factory (L.L.C.)

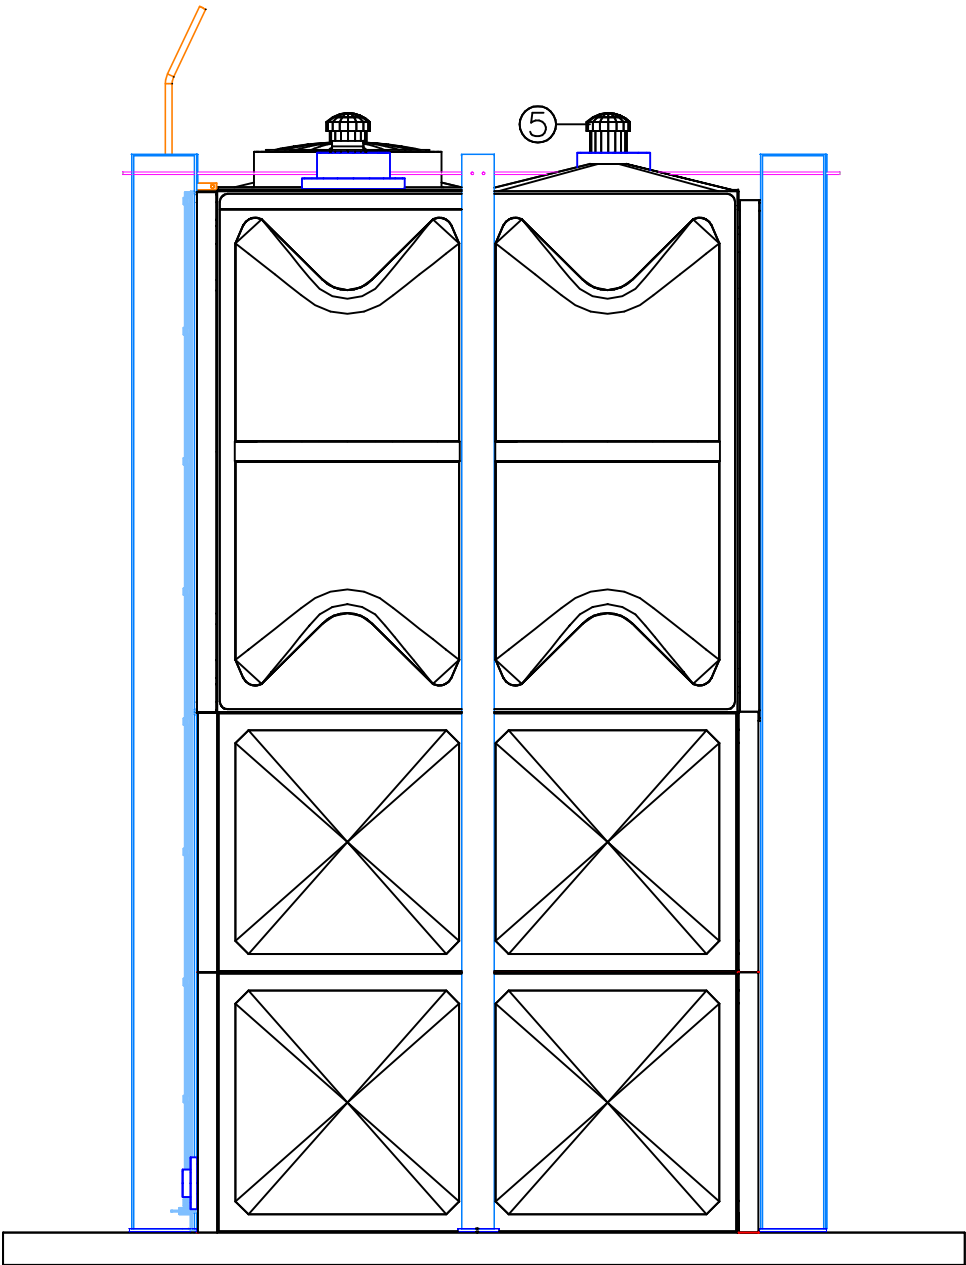

TANK-RIGHT ELEVATION

TANK COMPONENTS				
No.	Description	Material	Qty.	Remarks
1	Water tank	G.R.P.	1	
2	Manhole Cover	G.R.P.	1	S/S Hinges & Locks
3	Internal Ladder	G.R.P.	1	Height : 4m
4	External Ladder	SS/A4	1	Height : 4m
5	Air vent	PVC	2	Light & Insect Proof 4" Cowl Type
6	Inlet	U.P.V.C	10	DN225
7	Outlet	U.P.V.C	2	DN150
8	Drainage	U.P.V.C	2	DN80
9	Overflow	U.P.V.C	2	DN400
10	Water Level Gage	GRP/ ACRYLIC	1	Height : 4m

- GENERAL CAUTIONS
- NOTES:

1.

Allow a minimum space of 50 cm all around the tank's foundation.

2.

Maximum allowable deviation in concrete foundation = +/- 2mm.

3.

For sizes of items 6, 7, 8, 9 & 10, please refer to catalogue.

4.

Overflow shall be twice the area of inlet to avoid overfilling.

5.

Overflow shall flow freely to the ground.

6.

All pipes, fittings and other accessories shall be self supported.

7.

Tank to be electrically grounded in case of internal tie rod reinforcement.

Solico Panel Type Water Tank

Tank size:	7x2x4m HIGH		
Capacity:	56m ³	14,793USG	12,318ImpG
Bolts / Nuts:	S/S(A4) Internally & GI Externally		
Insulation:	Non Insulated		

Order No.:

Project Name:

PROJECT IN AUSTRALIA

Contractor:

ATM TANK

Consultant:

-

Reference No.:26SE399	Scale: NTS	Page No.
Done By:SHANIF	Approved By: JB	


Revisions			
No.	Date	Description	Rev By
0	18Aug'26	NEW	-

SOLICO TANKS

P.O. Box:61426, Jebel Ali Ind. Area 2
Dubai - UAE.

Tel: (971-4) 8804441 Fax: (971-4) 8801018
e-mail: fiberglass@solicouae.com

Copyright Solico Fiber Glass Factory (L.L.C.)

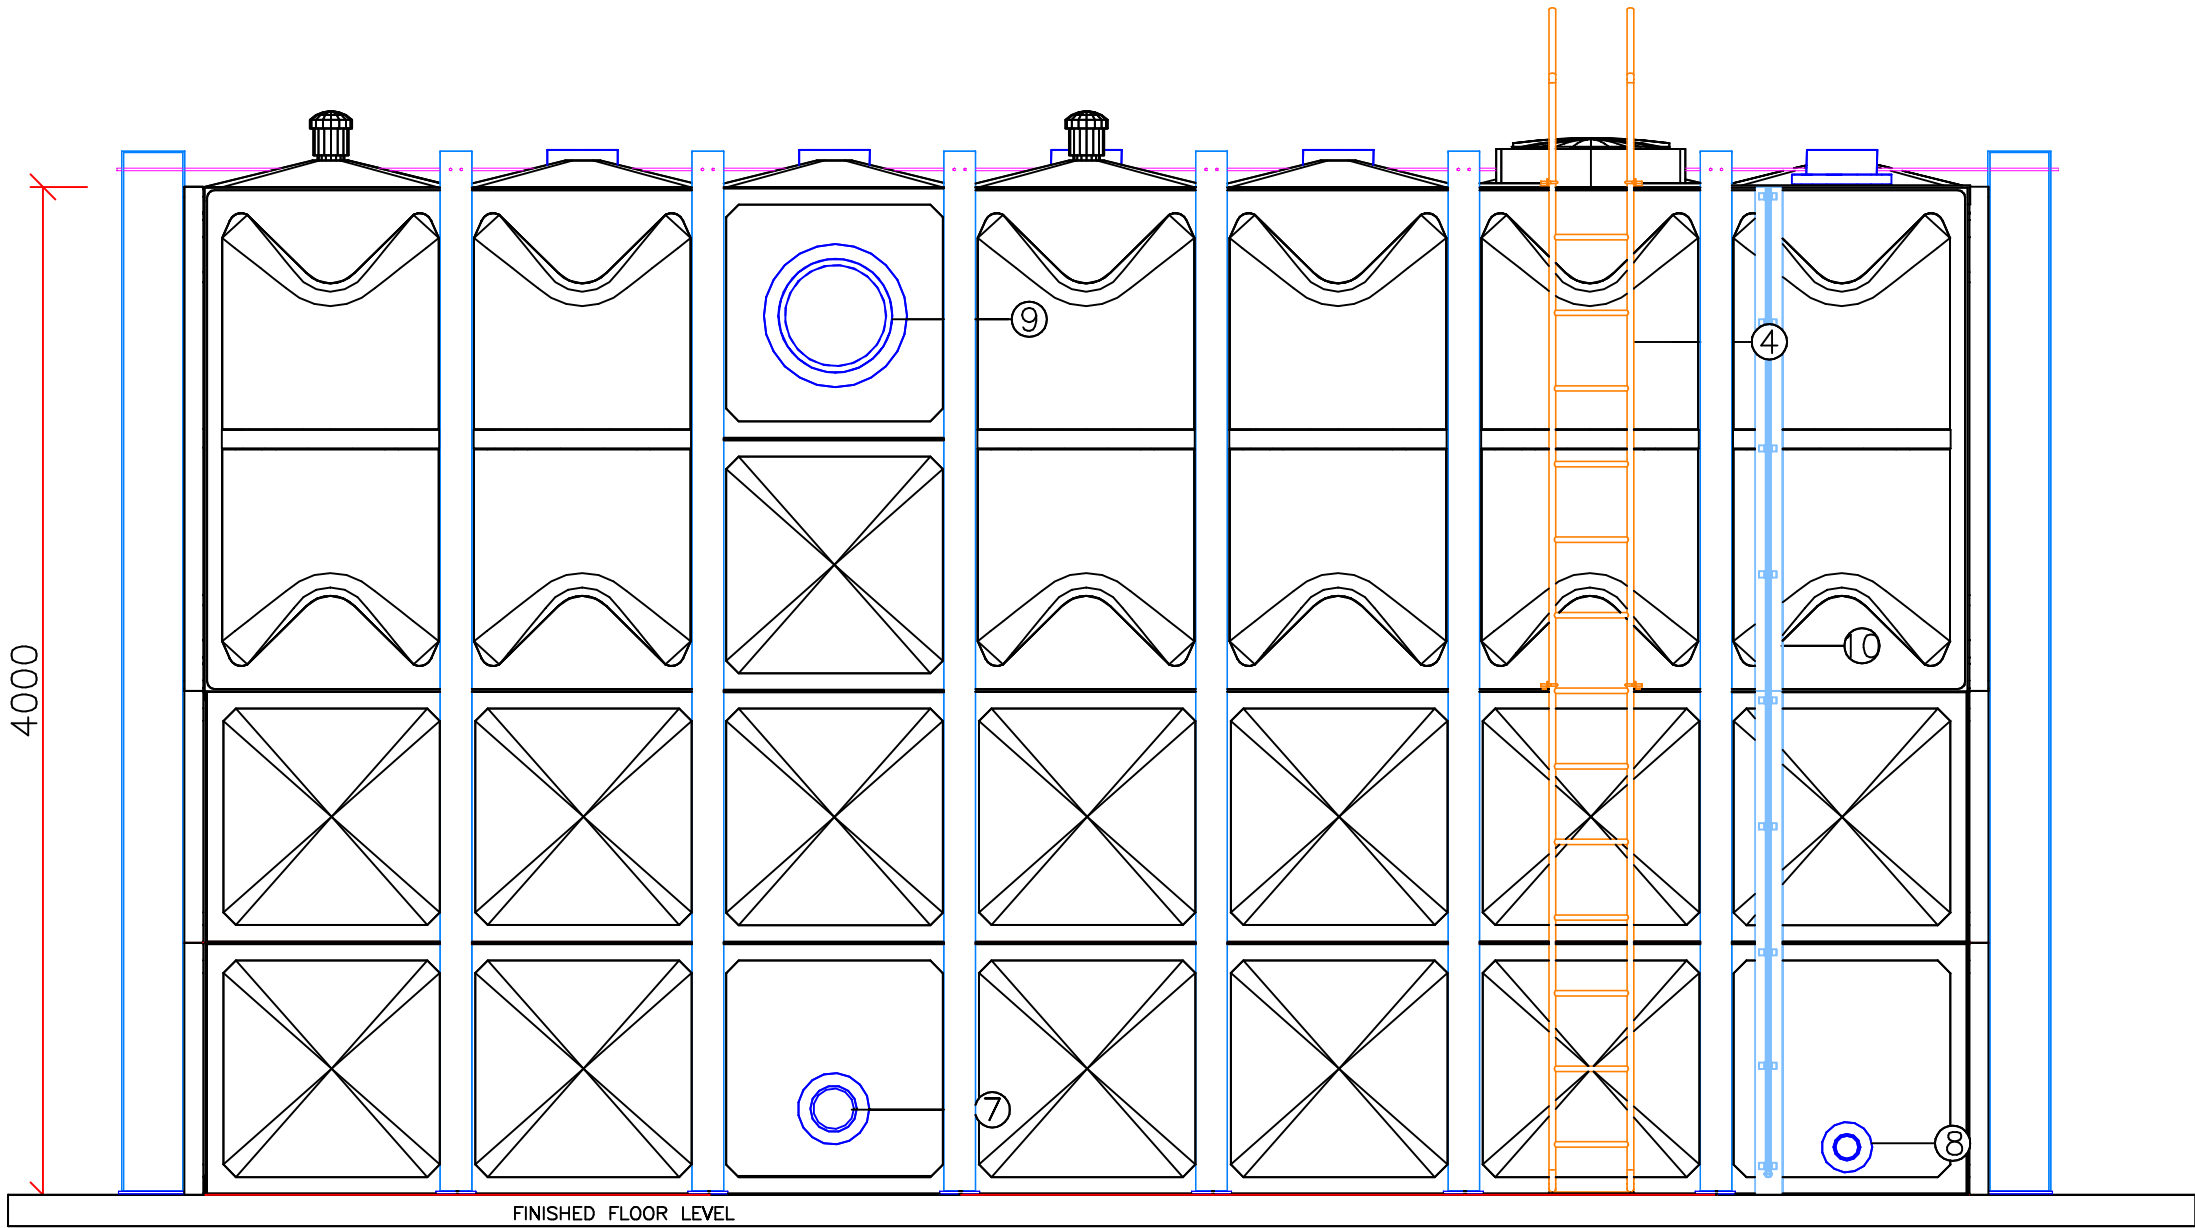

FRONT ELEVATION

TANK COMPONENTS				
No.	Description	Material	Qty	Remarks
1	Water tank	G.R.P.	1	
2	Manhole Cover	G.R.P.	1	S/S Hinges & Locks
3	Internal Ladder	G.R.P.	1	Height : 4m
4	External Ladder	SS/A4	1	Height : 4m
5	Air vent	PVC	2	Light & Insect Proof 4" Cowl Type
6	Inlet	U.P.V.C	10	DN225
7	Outlet	U.P.V.C	2	DN150
8	Drainage	U.P.V.C	2	DN80
9	Overflow	U.P.V.C	2	DN400
10	Water Level Gage	GRP/ ACRYLIC	1	Height : 4m

- NOTES:
- GENERAL CAUTIONS

1.

Allow a minimum space of 50 cm all around the tank's foundation.

2.

Maximum allowable deviation in concrete foundation = +/- 2mm.

3.

For sizes of items 6, 7, 8, 9 & 10, please refer to catalogue.

4.

Overflow shall be twice the area of inlet to avoid overfilling.

5.

Overflow shall flow freely to the ground.

6.

All pipes, fittings and other accessories shall be self supported.

7.

Tank to be electrically grounded in case of internal tie rod reinforcement.

Solico Panel Type Water Tank

Tank size:	7x2x4m HIGH		
Capacity:	56 m ³	14,793 USG	12,318 ImpG
Bolts / Nuts:	S/S(A4) Internally & GI Externally		
Insulation:	Non Insulated		

Order No.:

Project Name:

PROJECT IN AUSTRALIA

Contractor:

ATM TANK

Consultant:

-

Reference No.:26SE399		Scale: NTS	Page No.
Done By:SHANIF		Approved By: JB	
Revisions			
No.	Date	Description	Rev By
0	18Aug'26	NEW	-

SOLICO TANKS

P.O. Box:61426, Jebel Ali Ind. Area 2
Dubai - UAE.

Tel: (971-4) 8804441 Fax: (971-4) 8801018
e-mail: fiberglass@solicouae.com

Copyright Solico Fiber Glass Factory (L.L.C.)