

Overflow DN400

Inlet DN225

Outlet DN150

Drainage DN80

Flat Inverted bottom panel

TANK-AXONOMETRIC

Note:  
Overflow shall be twice the area of inlet to avoid overfilling.

TANK COMPONENTS

| No. | Description      | Material     | Qty | Remarks                           |
|-----|------------------|--------------|-----|-----------------------------------|
| 1   | Water tank       | G.R.P.       | 1   |                                   |
| 2   | Manhole Cover    | G.R.P.       | 1   | S/S Hinges & Locks                |
| 3   | Internal Ladder  | G.R.P.       | 1   | Height : 4m                       |
| 4   | External Ladder  | SS/A4        | 1   | Height : 4m                       |
| 5   | Air vent         | PVC          | 2   | Light & Insect Proof 4" Cowl Type |
| 6   | Inlet            | U.P.V.C      | 10  | DN225                             |
| 7   | Outlet           | U.P.V.C      | 2   | DN150                             |
| 8   | Drainage         | U.P.V.C      | 2   | DN80                              |
| 9   | Overflow         | U.P.V.C      | 2   | DN400                             |
| 10  | Water Level Gage | GRP/ ACRYLIC | 1   | Height : 4m                       |
|     |                  |              |     |                                   |
|     |                  |              |     |                                   |
|     |                  |              |     |                                   |

- GENERAL CAUTIONS
- NOTES:
- Allow a minimum space of 50 cm all around the tank's foundation.
  - Maximum allowable deviation in concrete foundation = +/- 2mm.
  - For sizes of items 6, 7, 8, 9 & 10, please refer to catalogue.
  - Overflow shall be twice the area of inlet to avoid overfilling.
  - Overflow shall flow freely to the ground.
  - All pipes, fittings and other accessories shall be self supported.
  - Tank to be electrically grounded in case of internal tie rod reinforcement.

ATM Tanks Panel Type Water Tank

|               |                                    |            |             |
|---------------|------------------------------------|------------|-------------|
| Tank size:    | 7x2x4m HIGH                        |            |             |
| Capacity:     | 56 m <sup>3</sup>                  | 14,793 USG | 12,318 ImpG |
| Bolts / Nuts: | S/S(A4) Internally & GI Externally |            |             |
| Insulation:   | Non Insulated                      |            |             |

Order No.:

Project Name:  
PROJECT IN AUSTRALIA

Contractor:  
ATM TANKS

Consultant:  
-


|                       |                 |          |
|-----------------------|-----------------|----------|
| Reference No.:26SE399 | Scale: NTS      | Page No. |
| Done By:SHANIF        | Approved By: JB |          |

| Revisions |          |             |        |
|-----------|----------|-------------|--------|
| No.       | Date     | Description | Rev By |
| 0         | 18Aug'26 | NEW         | -      |
|           |          |             |        |
|           |          |             |        |
|           |          |             |        |
|           |          |             |        |



52/1014 Currumbin Creek Road,  
Currumbin Waters QLD 4223  
1800 422 444  
info@atmtanks.com.au  
atmtanks.com.au

Copyright ATM Tanks Group

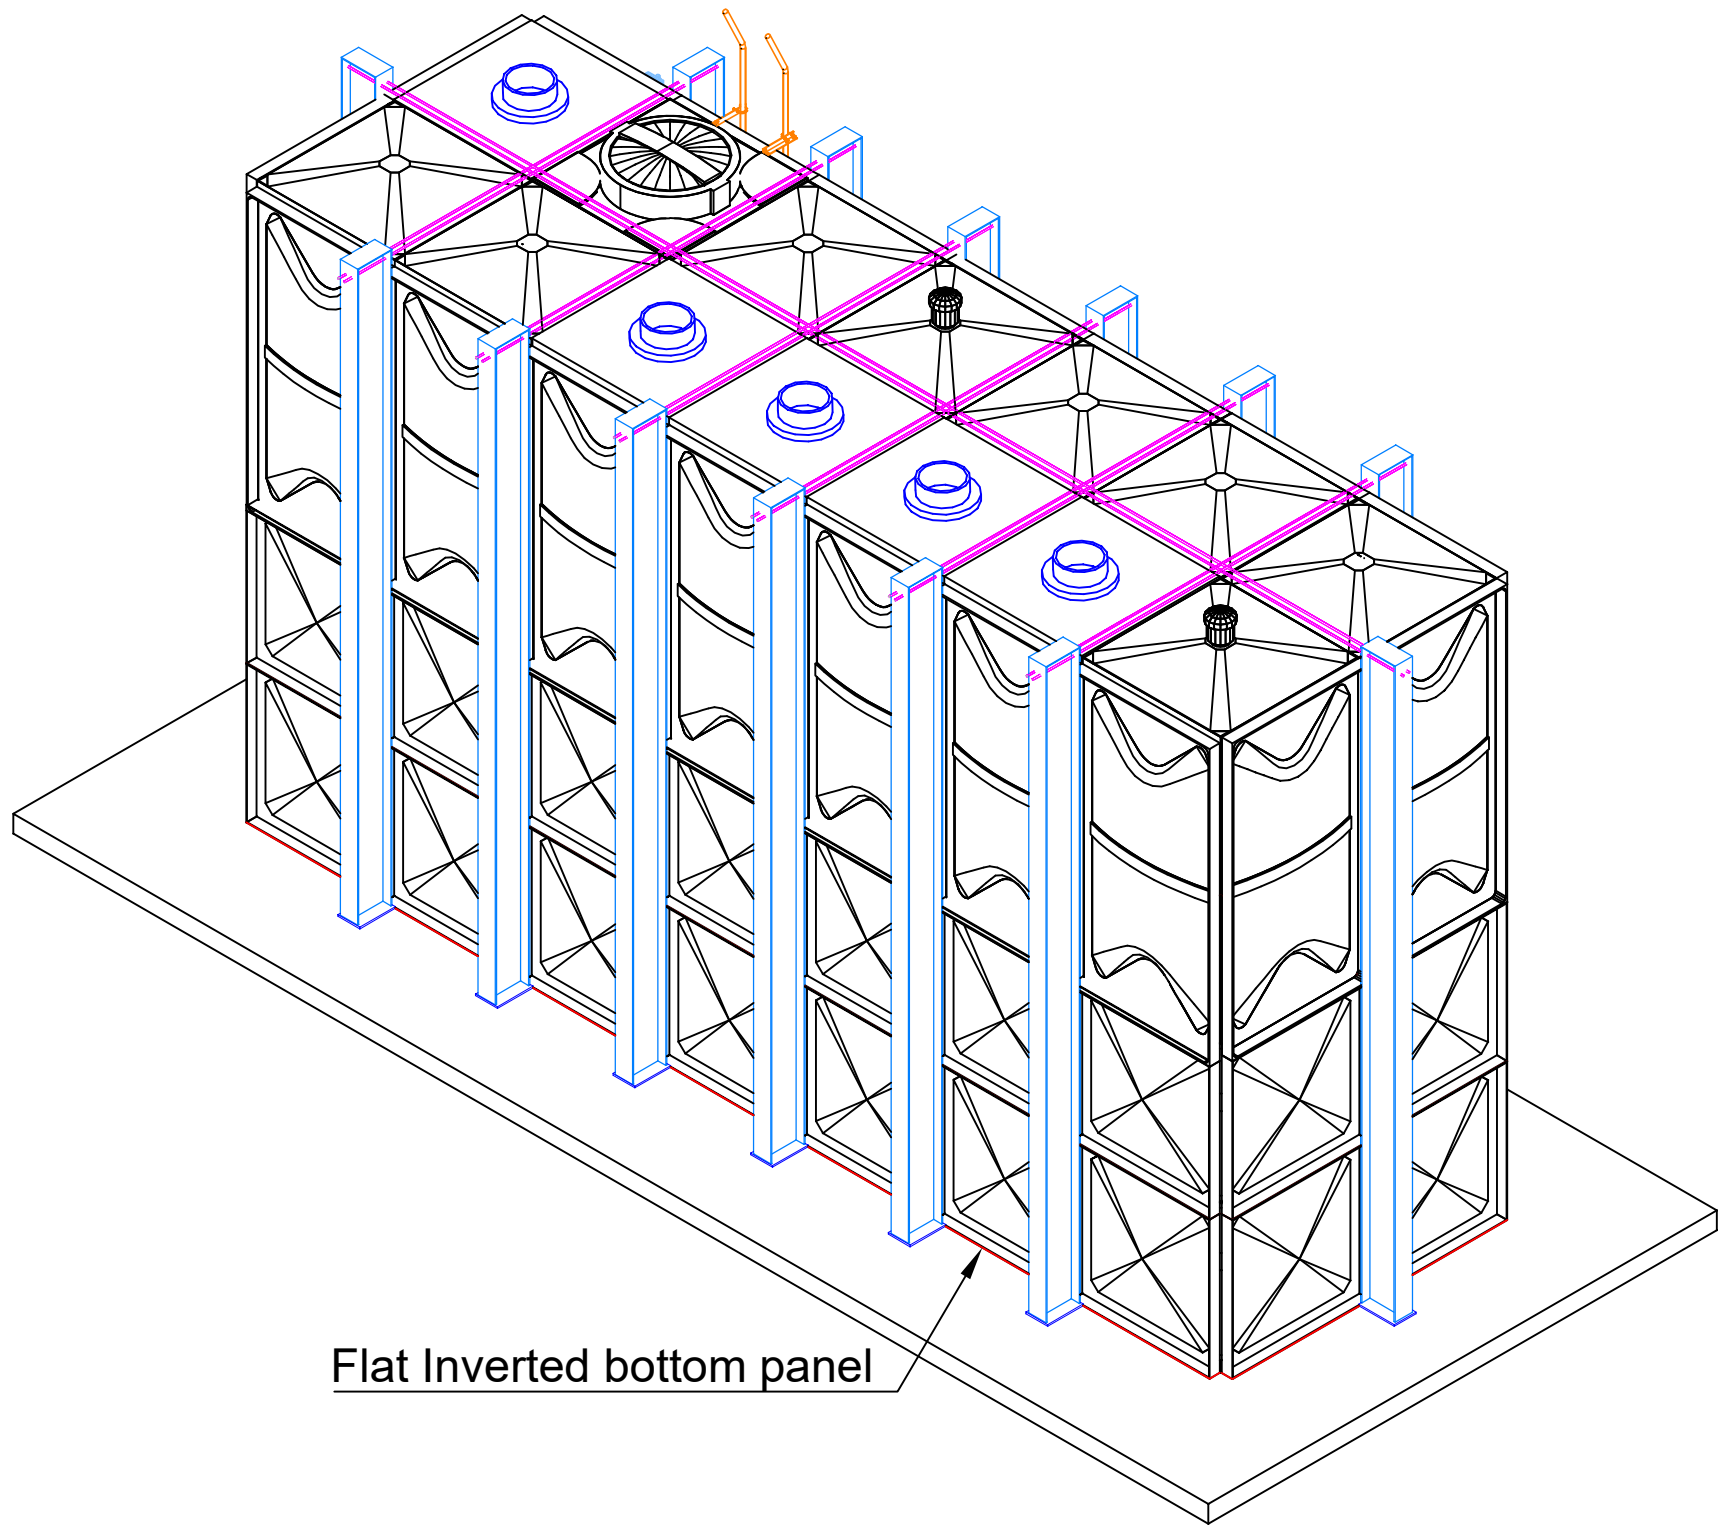

TANK-AXONOMETRIC

| TANK COMPONENTS |                  |              |     |                                   |
|-----------------|------------------|--------------|-----|-----------------------------------|
| No.             | Description      | Material     | Qty | Remarks                           |
| 1               | Water tank       | G.R.P.       | 1   |                                   |
| 2               | Manhole Cover    | G.R.P.       | 1   | S/S Hinges & Locks                |
| 3               | Internal Ladder  | G.R.P.       | 1   | Height : 4m                       |
| 4               | External Ladder  | SS/A4        | 1   | Height : 4m                       |
| 5               | Air vent         | PVC          | 2   | Light & Insect Proof 4" Cowl Type |
| 6               | Inlet            | U.P.V.C      | 10  | DN225                             |
| 7               | Outlet           | U.P.V.C      | 2   | DN150                             |
| 8               | Drainage         | U.P.V.C      | 2   | DN80                              |
| 9               | Overflow         | U.P.V.C      | 2   | DN400                             |
| 10              | Water Level Gage | GRP/ ACRYLIC | 1   | Height : 4m                       |
|                 |                  |              |     |                                   |
|                 |                  |              |     |                                   |
|                 |                  |              |     |                                   |

- GENERAL CAUTIONS
- NOTES:

1.

Allow a minimum space of 50 cm all around the tank's foundation.

2.

Maximum allowable deviation in concrete foundation = +/- 2mm.

3.

For sizes of items 6, 7, 8, 9 & 10, please refer to catalogue.

4.

Overflow shall be twice the area of inlet to avoid overfilling.

5.

Overflow shall flow freely to the ground.

6.

All pipes, fittings and other accessories shall be self supported.

7.

Tank to be electrically grounded in case of internal tie rod reinforcement.

| ATM Tanks Panel Type Water Tank |                                    |            |             |  |
|---------------------------------|------------------------------------|------------|-------------|--|
| Tank size:                      | 7x2x4m HIGH                        |            |             |  |
| Capacity:                       | 56 m <sup>3</sup>                  | 14,793 USG | 12,318 ImpG |  |
| Bolts / Nuts:                   | S/S(A4) Internally & GI Externally |            |             |  |
| Insulation:                     | Non Insulated                      |            |             |  |

Order No.:

Project Name:

PROJECT IN AUSTRALIA

Contractor:

ATM TANKS

Consultant:

-


|                       |                 |          |
|-----------------------|-----------------|----------|
| Reference No.:26SE399 | Scale: NTS      | Page No. |
| Done By:SHANIF        | Approved By: JB |          |

| Revisions |          |             |        |
|-----------|----------|-------------|--------|
| No.       | Date     | Description | Rev By |
| 0         | 18Aug'26 | NEW         | -      |
|           |          |             |        |
|           |          |             |        |
|           |          |             |        |
|           |          |             |        |
|           |          |             |        |



52/1014 Currumbin Creek Road,  
Currumbin Waters QLD 4223  
1800 422 444  
info@atmtanks.com.au  
atmtanks.com.au

Copyright ATM Tanks Group

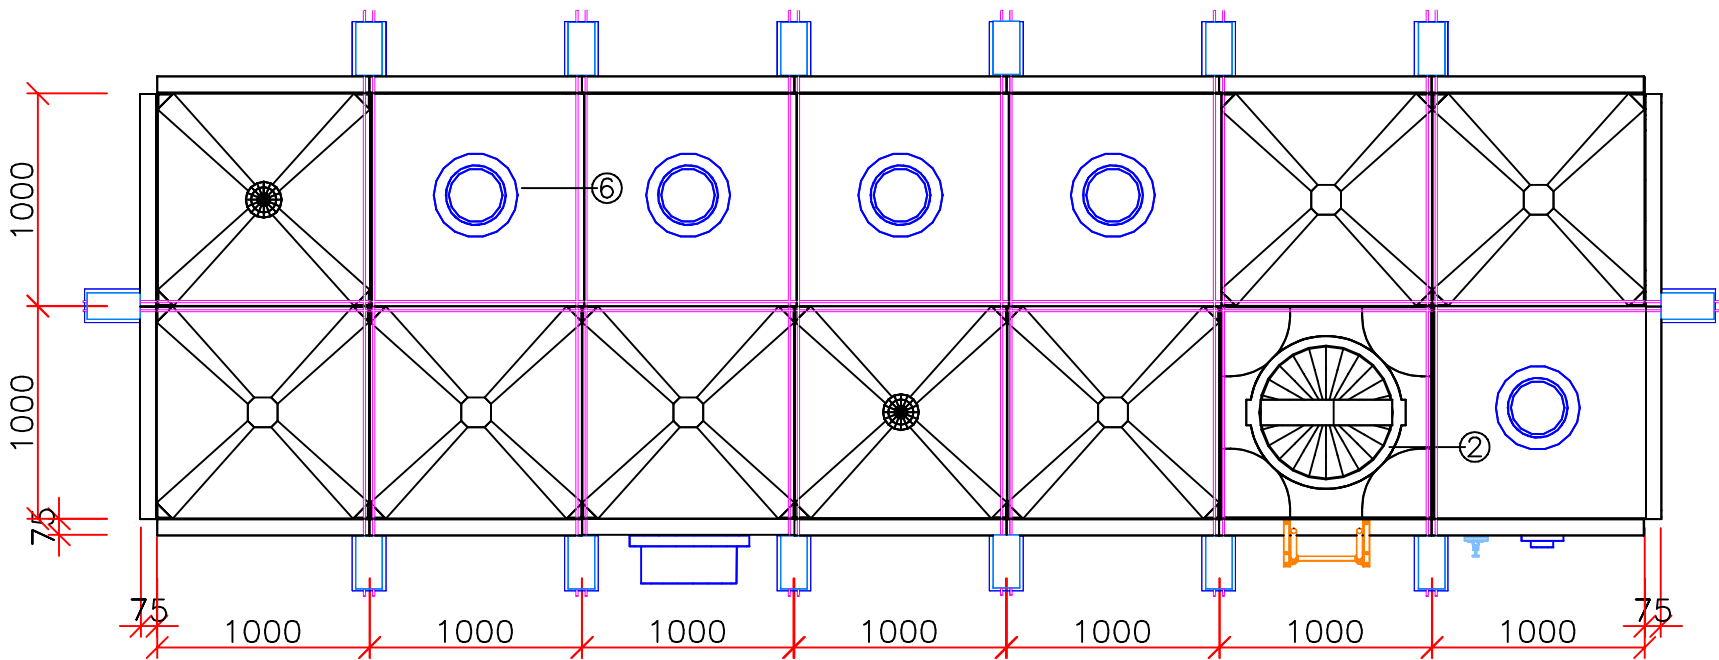

TANK-PLAN

| TANK COMPONENTS |                  |              |     |                                   |
|-----------------|------------------|--------------|-----|-----------------------------------|
| No.             | Description      | Material     | Qty | Remarks                           |
| 1               | Water tank       | G.R.P.       | 1   |                                   |
| 2               | Manhole Cover    | G.R.P.       | 1   | S/S Hinges & Locks                |
| 3               | Internal Ladder  | G.R.P.       | 1   | Height : 4m                       |
| 4               | External Ladder  | SS/A4        | 1   | Height : 4m                       |
| 5               | Air vent         | PVC          | 2   | Light & Insect Proof 4" Cowl Type |
| 6               | Inlet            | U.P.V.C      | 10  | DN225                             |
| 7               | Outlet           | U.P.V.C      | 2   | DN150                             |
| 8               | Drainage         | U.P.V.C      | 2   | DN80                              |
| 9               | Overflow         | U.P.V.C      | 2   | DN400                             |
| 10              | Water Level Gage | GRP/ ACRYLIC | 1   | Height : 4m                       |
|                 |                  |              |     |                                   |
|                 |                  |              |     |                                   |
|                 |                  |              |     |                                   |

- GENERAL CAUTIONS
- NOTES:

1.

Allow a minimum space of 50 cm all around the tank's foundation.

2.

Maximum allowable deviation in concrete foundation = +/- 2mm.

3.

For sizes of items 6, 7, 8, 9 & 10, please refer to catalogue.

4.

Overflow shall be twice the area of inlet to avoid overfilling.

5.

Overflow shall flow freely to the ground.

6.

All pipes, fittings and other accessories shall be self supported.

7.

Tank to be electrically grounded in case of internal tie rod reinforcement.

| ATM Tanks Panel Type Water Tank |                                    |            |             |  |
|---------------------------------|------------------------------------|------------|-------------|--|
| Tank size:                      | 7x2x4m HIGH                        |            |             |  |
| Capacity:                       | 56 m <sup>3</sup>                  | 14,793 USG | 12,318 ImpG |  |
| Bolts / Nuts:                   | S/S(A4) Internally & GI Externally |            |             |  |
| Insulation:                     | Non Insulated                      |            |             |  |

Order No.:

Project Name:

PROJECT IN AUSTRALIA

Contractor:

ATM TANKS

Consultant:

-


|                       |                 |          |
|-----------------------|-----------------|----------|
| Reference No.:26SE399 | Scale: NTS      | Page No. |
| Done By:SHANIF        | Approved By: JB |          |

| Revisions |          |             |        |
|-----------|----------|-------------|--------|
| No.       | Date     | Description | Rev By |
| 0         | 18Aug'26 | NEW         | -      |
|           |          |             |        |
|           |          |             |        |
|           |          |             |        |
|           |          |             |        |
|           |          |             |        |

ATM

52/1014 Currumbin Creek Road,  
Currumbin Waters QLD 4223  
1800 422 444  
info@atmtanks.com.au  
atmtanks.com.au

Copyright ATM Tanks Group

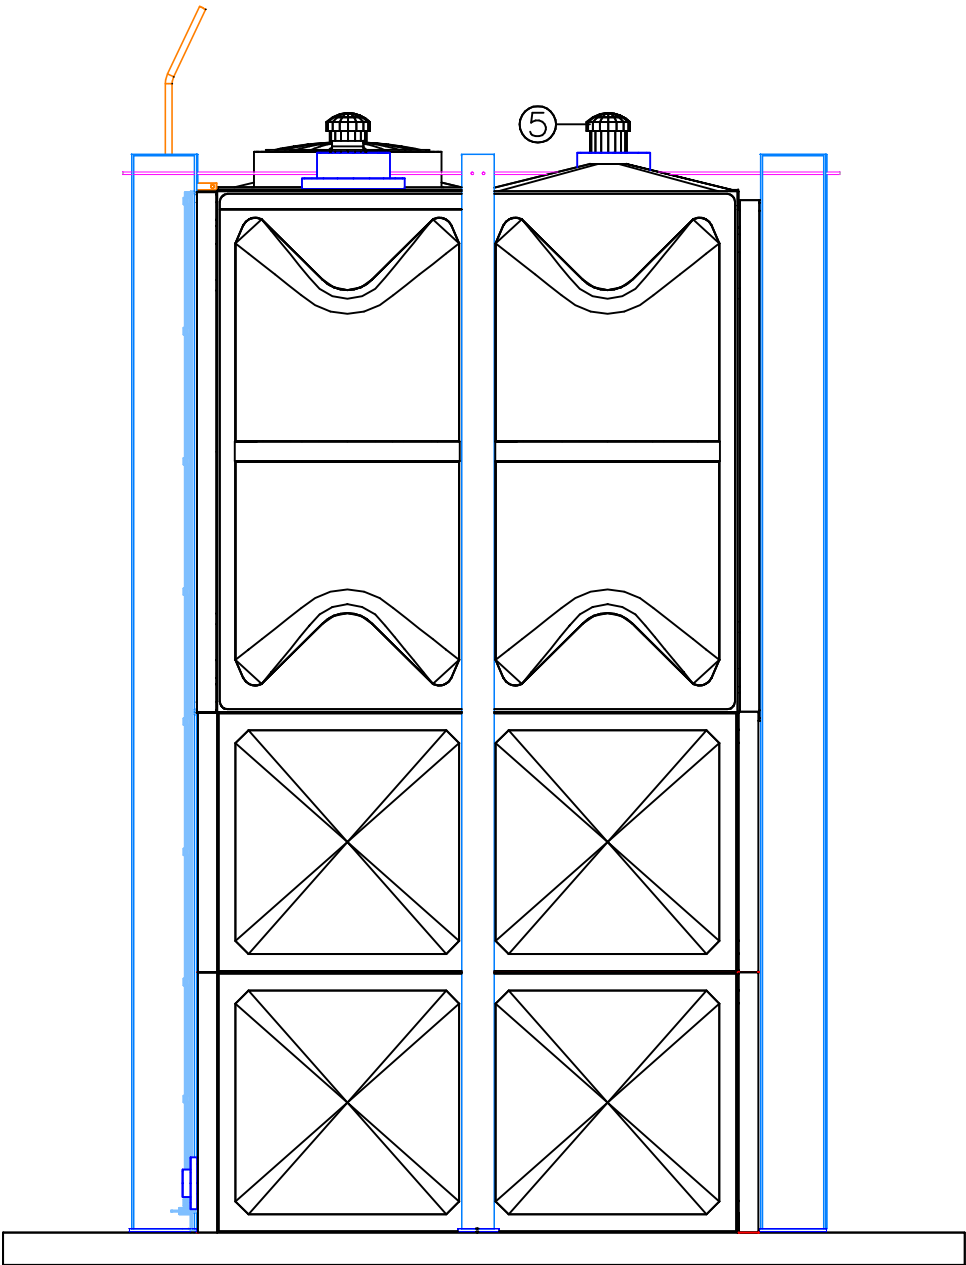

TANK-RIGHT ELEVATION

| TANK COMPONENTS |                  |              |     |                                   |
|-----------------|------------------|--------------|-----|-----------------------------------|
| No.             | Description      | Material     | Qty | Remarks                           |
| 1               | Water tank       | G.R.P.       | 1   |                                   |
| 2               | Manhole Cover    | G.R.P.       | 1   | S/S Hinges & Locks                |
| 3               | Internal Ladder  | G.R.P.       | 1   | Height : 4m                       |
| 4               | External Ladder  | SS/A4        | 1   | Height : 4m                       |
| 5               | Air vent         | PVC          | 2   | Light & Insect Proof 4" Cowl Type |
| 6               | Inlet            | U.P.V.C      | 10  | DN225                             |
| 7               | Outlet           | U.P.V.C      | 2   | DN150                             |
| 8               | Drainage         | U.P.V.C      | 2   | DN80                              |
| 9               | Overflow         | U.P.V.C      | 2   | DN400                             |
| 10              | Water Level Gage | GRP/ ACRYLIC | 1   | Height : 4m                       |
|                 |                  |              |     |                                   |
|                 |                  |              |     |                                   |
|                 |                  |              |     |                                   |

- GENERAL CAUTIONS
- NOTES:

1.

Allow a minimum space of 50 cm all around the tank's foundation.

2.

Maximum allowable deviation in concrete foundation = +/- 2mm.

3.

For sizes of items 6, 7, 8, 9 & 10, please refer to catalogue.

4.

Overflow shall be twice the area of inlet to avoid overfilling.

5.

Overflow shall flow freely to the ground.

6.

All pipes, fittings and other accessories shall be self supported.

7.

Tank to be electrically grounded in case of internal tie rod reinforcement.

|                                 |                                    |            |             |
|---------------------------------|------------------------------------|------------|-------------|
| ATM Tanks Panel Type Water Tank |                                    |            |             |
| Tank size:                      | 7x2x4m HIGH                        |            |             |
| Capacity:                       | 56 m <sup>3</sup>                  | 14,793 USG | 12,318 ImpG |
| Bolts / Nuts:                   | S/S(A4) Internally & GI Externally |            |             |
| Insulation:                     | Non Insulated                      |            |             |

Order No.:

Project Name:

PROJECT IN AUSTRALIA

Contractor:

ATM TANKS

Consultant:


-

|                       |                 |          |
|-----------------------|-----------------|----------|
| Reference No.:26SE399 | Scale: NTS      | Page No. |
| Done By:SHANIF        | Approved By: JB |          |

| Revisions |          |             |        |
|-----------|----------|-------------|--------|
| No.       | Date     | Description | Rev By |
| 0         | 18Aug'26 | NEW         | -      |
|           |          |             |        |
|           |          |             |        |
|           |          |             |        |
|           |          |             |        |
|           |          |             |        |

ATM

52/1014 Currumbin Creek Road,  
Currumbin Waters QLD 4223  
1800 422 444  
info@atmtanks.com.au  
atmtanks.com.au

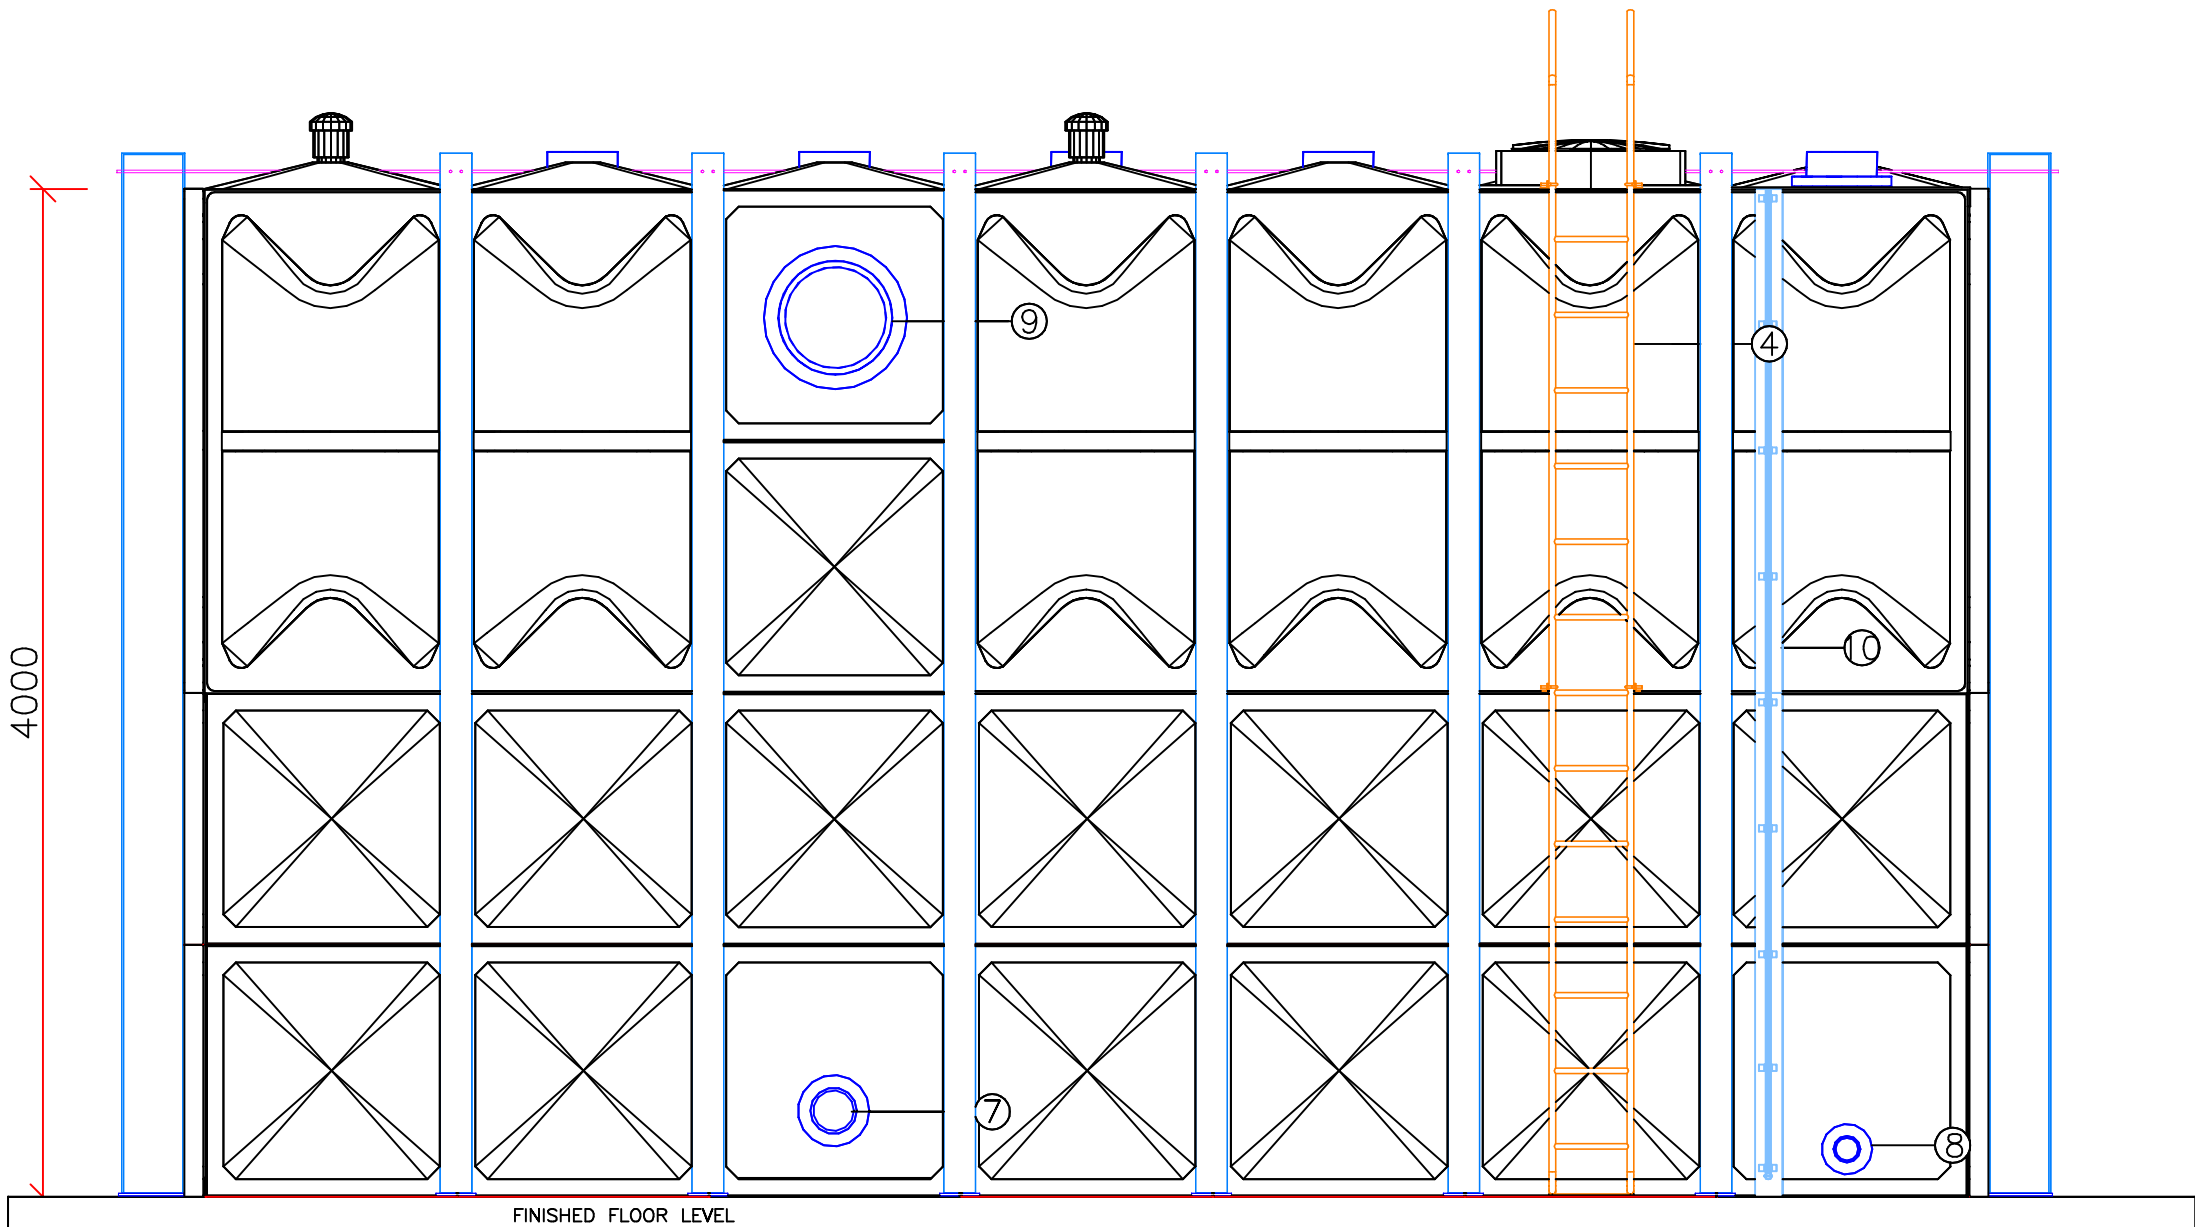

FRONT ELEVATION

| TANK COMPONENTS |                  |              |     |                                   |
|-----------------|------------------|--------------|-----|-----------------------------------|
| No.             | Description      | Material     | Qty | Remarks                           |
| 1               | Water tank       | G.R.P.       | 1   |                                   |
| 2               | Manhole Cover    | G.R.P.       | 1   | S/S Hinges & Locks                |
| 3               | Internal Ladder  | G.R.P.       | 1   | Height : 4m                       |
| 4               | External Ladder  | SS/A4        | 1   | Height : 4m                       |
| 5               | Air vent         | PVC          | 2   | Light & Insect Proof 4" Cowl Type |
| 6               | Inlet            | U.P.V.C      | 10  | DN225                             |
| 7               | Outlet           | U.P.V.C      | 2   | DN150                             |
| 8               | Drainage         | U.P.V.C      | 2   | DN80                              |
| 9               | Overflow         | U.P.V.C      | 2   | DN400                             |
| 10              | Water Level Gage | GRP/ ACRYLIC | 1   | Height : 4m                       |
|                 |                  |              |     |                                   |
|                 |                  |              |     |                                   |
|                 |                  |              |     |                                   |

- NOTES:
1.

Allow a minimum space of 50 cm all around the tank's foundation.
2.

Maximum allowable deviation in concrete foundation = +/- 2mm.
3.

For sizes of items 6, 7, 8, 9 & 10, please refer to catalogue.
4.

Overflow shall be twice the area of inlet to avoid overfilling.
5.

Overflow shall flow freely to the ground.
6.

All pipes, fittings and other accessories shall be self supported.
7.

Tank to be electrically grounded in case of internal tie rod reinforcement.

GENERAL CAUTIONS

ATM Tanks Panel Type Water Tank

Tank size:

7x2x4m HIGH

Capacity:

56m<sup>3</sup>

14,793USG

12,318ImpG

Bolts / Nuts:

S/S(A4) Internally & GI Externally

Insulation:

Non Insulated

Order No.:

Project Name:

PROJECT IN AUSTRALIA

Contractor:

ATM TANKS

Consultant:

-

|                       |          |                 |          |
|-----------------------|----------|-----------------|----------|
| Reference No.:26SE399 |          | Scale: NTS      | Page No. |
| Done By:SHANIF        |          | Approved By: JB |          |
| Revisions             |          |                 |          |
| No.                   | Date     | Description     | Rev By   |
| 0                     | 18Aug'26 | NEW             | -        |
|                       |          |                 |          |
|                       |          |                 |          |
|                       |          |                 |          |
|                       |          |                 |          |



52/1014 Currumbin Creek Road,  
Currumbin Waters QLD 4223  
1800 422 444  
info@atmtanks.com.au  
atmtanks.com.au

Copyright ATM Tanks Group