


Overflow DN400

Inlet DN225

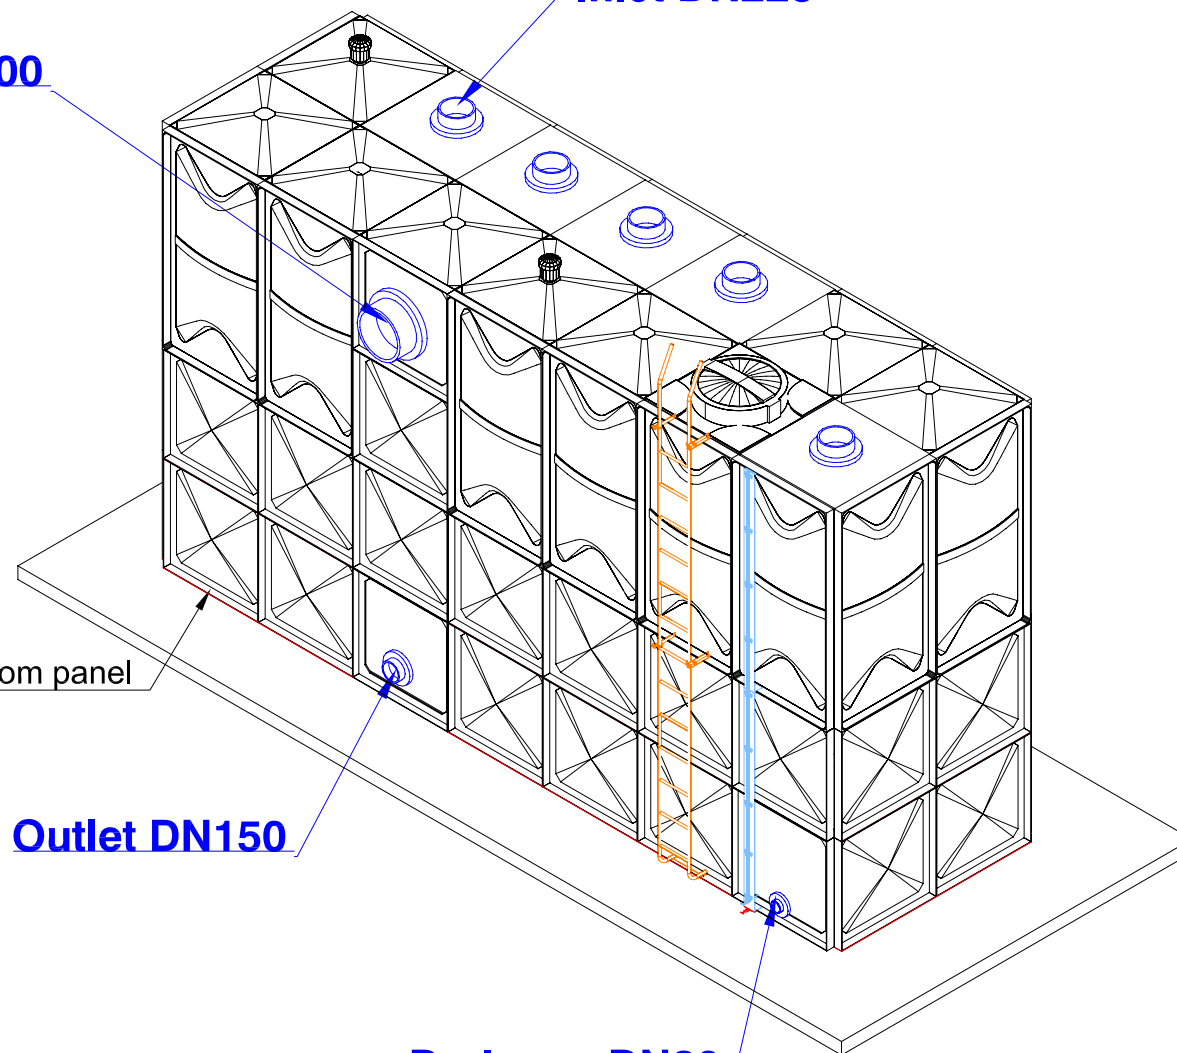

Flat Inverted bottom panel

Outlet DN150

Drainage DN80

TANK-AXONOMETRIC

Note:

Overflow shall be twice the area of inlet to avoid overfilling.

TANK COMPONENTS

No.	Description	Material	Qty	Remarks
1	Water tank	G.R.P.	1	
2	Manhole Cover	G.R.P.	1	S/S Hinges & Locks
3	Internal Ladder	G.R.P.	1	Height : 4m
4	External Ladder	SS/A4	1	Height : 4m
5	Air vent	PVC	2	Light & Insect Proof 4" Cowl Type
6	Inlet	U.P.V.C	10	DN225
7	Outlet	U.P.V.C	2	DN150
8	Drainage	U.P.V.C	2	DN80
9	Overflow	U.P.V.C	2	DN400
10	Water Level Gage	GRP/ACRYLIC	1	Height : 4m

GENERAL CAUTIONS

NOTES:

1. Allow a minimum space of 50 cm all around the tank's foundation.
2. Maximum allowable deviation in concrete foundation = +/- 2mm.
3. For sizes of items 6, 7, 8, 9 & 10, please refer to catalogue.
4. Overflow shall be twice the area of inlet to avoid overfilling.
5. Overflow shall flow freely to the ground.
6. All pipes, fittings and other accessories shall be self supported.
7. Tank to be electrically grounded in case of internal tie rod reinforcement.

Solico Panel Type Water Tank

Tank size:	7x2x4m HIGH		
Capacity:	56 m ³	14,793 USG	12,318 ImpG
Bolts / Nuts:	S/S(A4) Internally & GI Externally		
Insulation:	Non Insulated		

Order No.:

Project Name:

PROJECT IN AUSTRALIA

Contractor:

ATM TANK

Consultant:

-

Reference No.:26SE399	Scale: NTS	Page No.
-----------------------	------------	----------

Done By:SHANIF	Approved By: JB
----------------	-----------------

Revisions


No.	Date	Description	Rev By
0	18Aug'26	NEW	-
1	19Aug'26	Revised as per comment	Mus

SOLICO TANKS

P.O. Box:61426, Jebel Ali Ind. Area 2
Dubai - UAE.

Tel: (971-4) 8804441 Fax: (971-4) 8801018
e-mail: fiberglass@solicouae.com

Copyright Solico Fiber Glass Factory (L.L.C.)

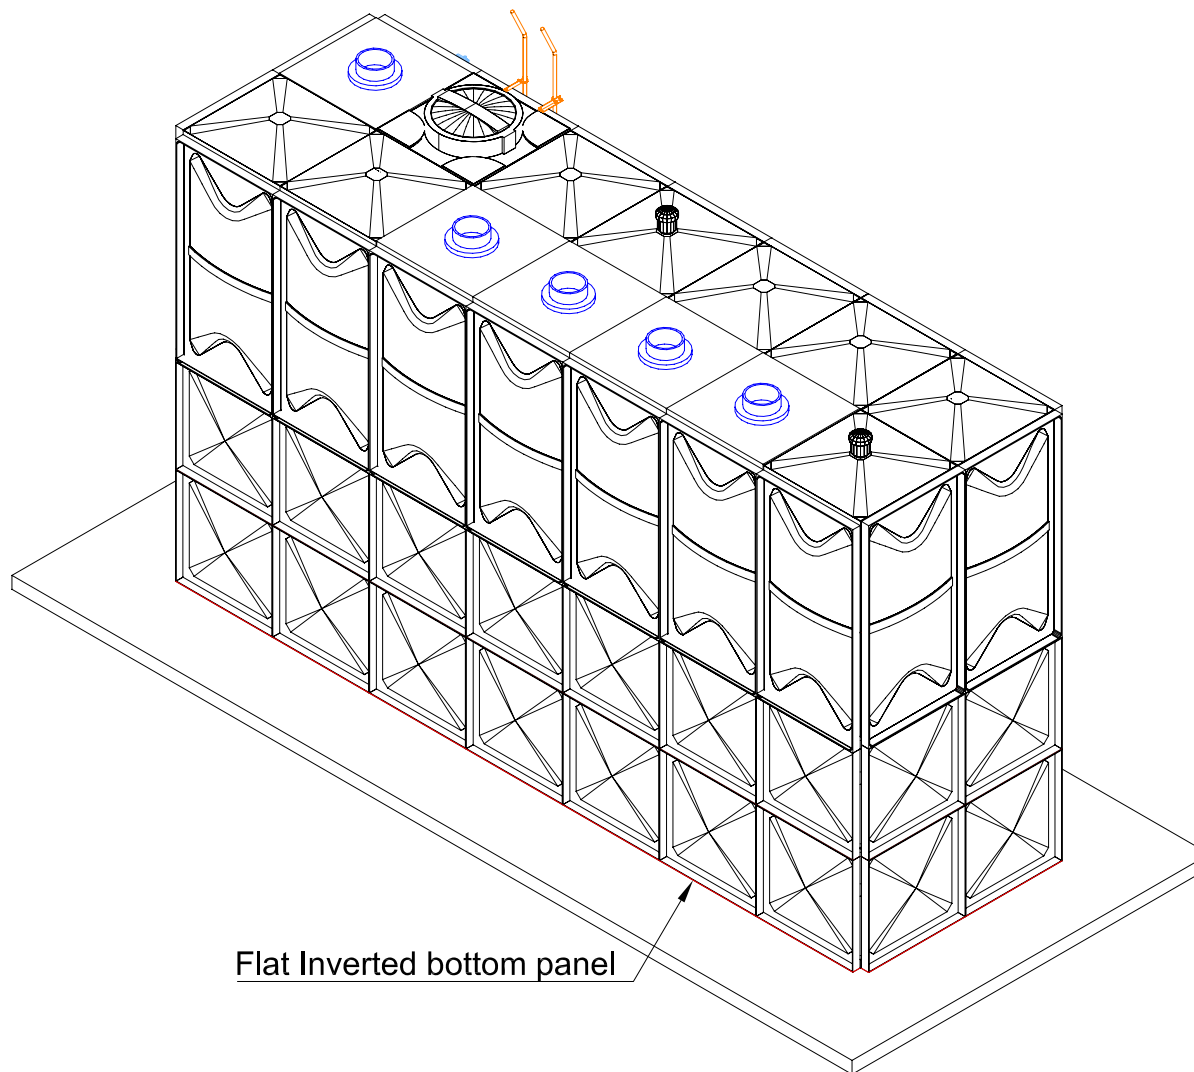

Flat Inverted bottom panel

TANK-AXONOMETRIC

TANK COMPONENTS

No.	Description	Material	Qty	Remarks
1	Water tank	G.R.P.	1	
2	Manhole Cover	G.R.P.	1	S/S Hinges & Locks
3	Internal Ladder	G.R.P.	1	Height : 4m
4	External Ladder	SS/A4	1	Height : 4m
5	Air vent	PVC	2	Light & Insect Proof 4" Cowl Type
6	Inlet	U.P.V.C	10	DN225
7	Outlet	U.P.V.C	2	DN150
8	Drainage	U.P.V.C	2	DN80
9	Overflow	U.P.V.C	2	DN400
10	Water Level Gage	GRP/ACRYLIC	1	Height : 4m

GENERAL CAUTIONS

NOTES:

1. Allow a minimum space of 50 cm all around the tank's foundation.
2. Maximum allowable deviation in concrete foundation = +/- 2mm.
3. For sizes of items 6, 7, 8, 9 & 10, please refer to catalogue.
4. Overflow shall be twice the area of inlet to avoid overfilling.
5. Overflow shall flow freely to the ground.
6. All pipes, fittings and other accessories shall be self supported.
7. Tank to be electrically grounded in case of internal tie rod reinforcement.

Solico Panel Type Water Tank

Tank size:	7x2x4m HIGH		
Capacity:	56 m ³	14,793 USG	12,318 ImpG
Bolts / Nuts:	S/S(A4) Internally & GI Externally		
Insulation:	Non Insulated		

Order No.:

Project Name:

PROJECT IN AUSTRALIA

Contractor:

ATM TANK

Consultant:

-

Reference No.: 26SE399	Scale: NTS	Page No.
-------------------------------	------------	----------

Done By:SHANIF	Approved By: JB
----------------	-----------------

Revisions


No.	Date	Description	Rev By
0	18Aug'26	NEW	-
1	19Aug'26	Revised as per comment	Mus

SOLICO TANKS

P.O. Box:61426, Jebel Ali Ind. Area 2
Dubai - UAE.

Tel: (971-4) 8804441 Fax: (971-4) 8801018
e-mail: fiberglass@solicouae.com

Copyright Solico Fiber Glass Factory (L.L.C.)

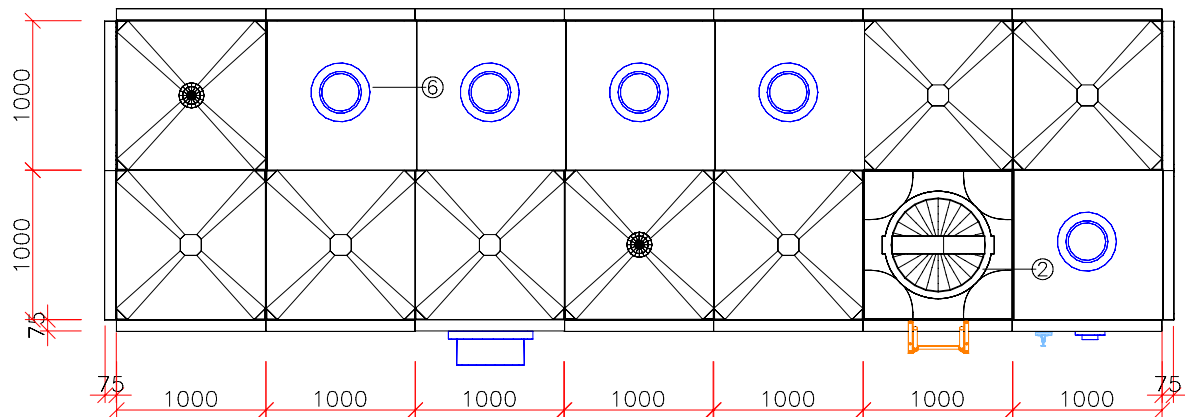

TANK-PLAN

TANK COMPONENTS

No.	Description	Material	Qty	Remarks
1	Water tank	G.R.P.	1	
2	Manhole Cover	G.R.P.	1	S/S Hinges & Locks
3	Internal Ladder	G.R.P.	1	Height : 4m
4	External Ladder	SS/A4	1	Height : 4m
5	Air vent	PVC	2	Light & Insect Proof 4" Cowl Type
6	Inlet	U.P.V.C	10	DN225
7	Outlet	U.P.V.C	2	DN150
8	Drainage	U.P.V.C	2	DN80
9	Overflow	U.P.V.C	2	DN400
10	Water Level Gage	GRP/ACRYLIC	1	Height : 4m

GENERAL CAUTIONS

- NOTES:
1. Allow a minimum space of 50 cm all around the tank's foundation.
 2. Maximum allowable deviation in concrete foundation = +/- 2mm.
 3. For sizes of items 6, 7, 8, 9 & 10, please refer to catalogue.
 4. Overflow shall be twice the area of inlet to avoid overfilling.
 5. Overflow shall flow freely to the ground.
 6. All pipes, fittings and other accessories shall be self supported.
 7. Tank to be electrically grounded in case of internal tie rod reinforcement.

Solico Panel Type Water Tank

Tank size:	7x2x4m HIGH		
Capacity:	56 m ³	14,793 USG	12,318 ImpG
Bolts / Nuts:	S/S(A4) Internally & GI Externally		
Insulation:	Non Insulated		

Order No.:

Project Name:

PROJECT IN AUSTRALIA

Contractor:

ATM TANK

Consultant:

-

Reference No.: 26SE399	Scale: NTS	Page No.
Done By:SHANIF	Approved By: JB	

Revisions

No.	Date	Description	Rev By
0	18Aug'26	NEW	-
1	19Aug'26	Revised as per comment	Mus




P.O. Box:61426, Jebel Ali Ind. Area 2
Dubai - UAE.

Tel: (971-4) 8804441 Fax: (971-4) 8801018
e-mail: fiberglass@solicouae.com

Copyright Solico Fiber Glass Factory (L.L.C.)

TANK-RIGHT ELEVATION

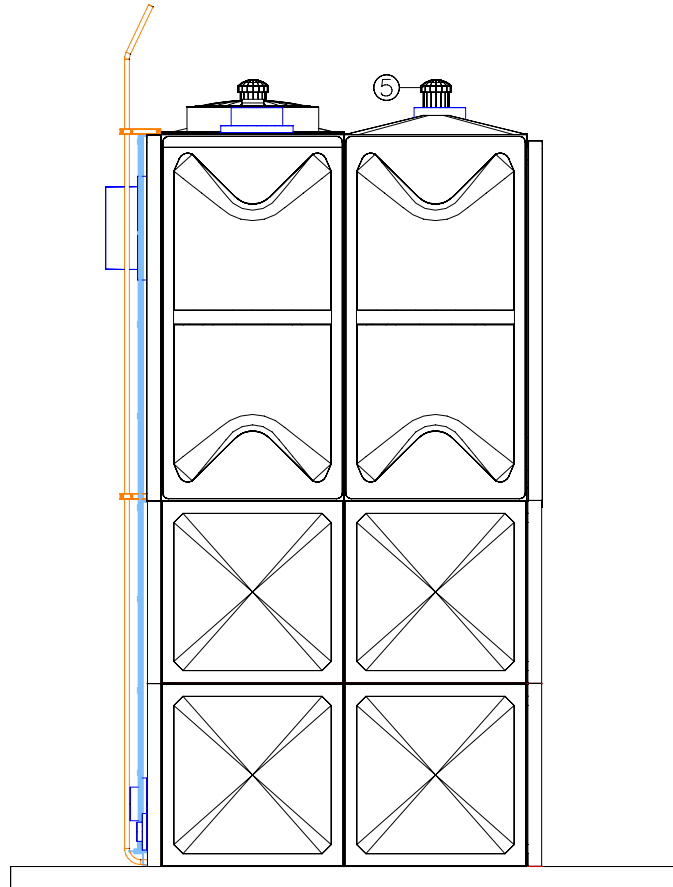

TANK COMPONENTS

No.	Description	Material	Qty.	Remarks
1	Water tank	G.R.P.	1	
2	Manhole Cover	G.R.P.	1	S/S Hinges & Locks
3	Internal Ladder	G.R.P.	1	Height : 4m
4	External Ladder	SS/A4	1	Height : 4m
5	Air vent	PVC	2	Light & Insect Proof 4" Cowl Type
6	Inlet	U.P.V.C	10	DN225
7	Outlet	U.P.V.C	2	DN150
8	Drainage	U.P.V.C	2	DN80
9	Overflow	U.P.V.C	2	DN400
10	Water Level Gage	GRP/ACRYLIC	1	Height : 4m

GENERAL CAUTIONS

NOTES:

1. Allow a minimum space of 50 cm all around the tank's foundation.
2. Maximum allowable deviation in concrete foundation = +/- 2mm.
3. For sizes of items 6, 7, 8, 9 & 10, please refer to catalogue.
4. Overflow shall be twice the area of inlet to avoid overfilling.
5. Overflow shall flow freely to the ground.
6. All pipes, fittings and other accessories shall be self supported.
7. Tank to be electrically grounded in case of internal tie rod reinforcement.

Solico Panel Type Water Tank

Tank size:	7x2x4m HIGH		
Capacity:	56 m ³	14,793 USG	12,318 ImpG
Bolts / Nuts:	S/S(A4) Internally & GI Externally		
Insulation:	Non Insulated		

Order No.:

Project Name:

PROJECT IN AUSTRALIA

Contractor:

ATM TANK

Consultant:

-

Reference No.: 26SE399	Scale: NTS	Page No.
-------------------------------	------------	----------

Done By:SHANIF	Approved By: JB
----------------	-----------------

Revisions


No.	Date	Description	Rev By
0	18Aug26	NEW	-
1	19Aug26	Revised as per comment	Mus



P.O. Box:61426, Jebel Ali Ind. Area 2
Dubai - UAE.

Tel: (971-4) 8804441 Fax: (971-4) 8801018
e-mail: fiberglass@solicouae.com

Copyright Solico Fiber Glass Factory (L.L.C.)

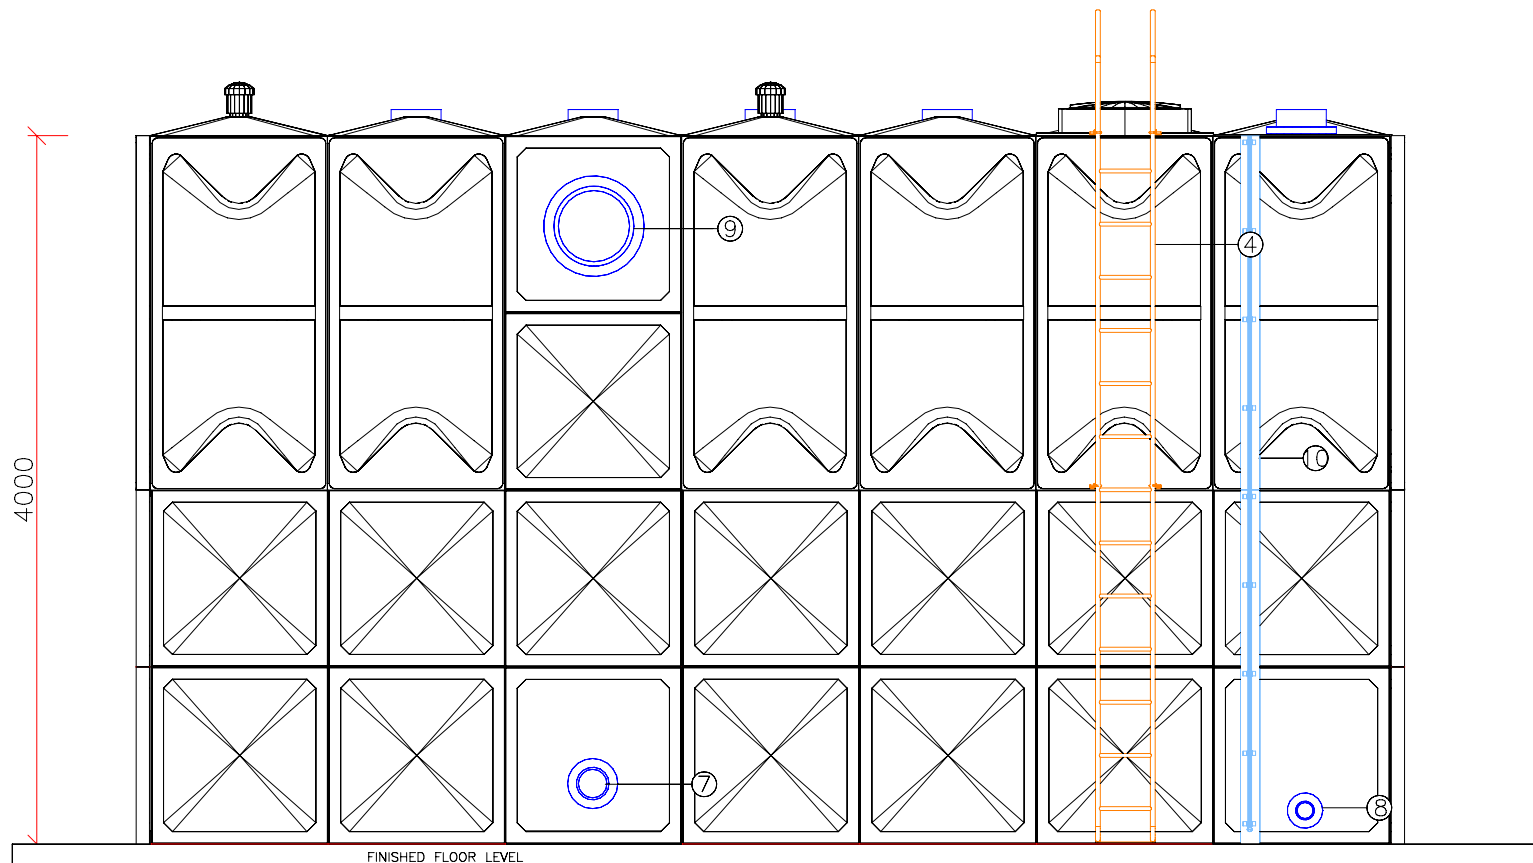

FRONT ELEVATION

TANK COMPONENTS

No.	Description	Material	Qty.	Remarks
1	Water tank	G.R.P.	1	
2	Manhole Cover	G.R.P.	1	S/S Hinges & Locks
3	Internal Ladder	G.R.P.	1	Height : 4m
4	External Ladder	SS/A4	1	Height : 4m
5	Air vent	PVC	2	Light & Insect Proof 4" Cow Type
6	Inlet	U.P.V.C	10	DN225
7	Outlet	U.P.V.C	2	DN150
8	Drainage	U.P.V.C	2	DN80
9	Overflow	U.P.V.C	2	DN400
10	Water Level Gage	GRP/ACRYLIC	1	Height : 4m

GENERAL CAUTIONS

NOTES:

1. Allow a minimum space of 50 cm all around the tank's foundation.
2. Maximum allowable deviation in concrete foundation = +/- 2mm.
3. For sizes of items 6, 7, 8, 9 & 10, please refer to catalogue.
4. Overflow shall be twice the area of inlet to avoid overfilling.
5. Overflow shall flow freely to the ground.
6. All pipes, fittings and other accessories shall be self supported.
7. Tank to be electrically grounded in case of internal tie rod reinforcement.

Solico Panel Type Water Tank

Tank size:	7x2x4m HIGH		
Capacity:	56 m ³	14,793 USG	12,318 ImpG
Bolts / Nuts:	S/S(A4) Internally & GI Externally		
Insulation:	Non Insulated		

Order No.:

Project Name:

PROJECT IN AUSTRALIA

Contractor:

ATM TANK

Consultant:

-

Reference No.: 26SE399	Scale: NTS	Page No.
Done By:SHANIF	Approved By: JB	

Revisions

No.	Date	Description	Rev By
0	18Aug'26	NEW	-
1	19Aug'26	Revised as per comment	Mus



P.O. Box:61426, Jebel Ali Ind. Area 2
Dubai - UAE.
Tel: (971-4) 8804441 Fax: (971-4) 8801018
e-mail: fiberglass@solicouae.com

Copyright Solico Fiber Glass Factory (L.L.C.)