


Resolved and SGS transport near the surface

Same final-hour average · native flux faces · physical fluxes remain unscaled

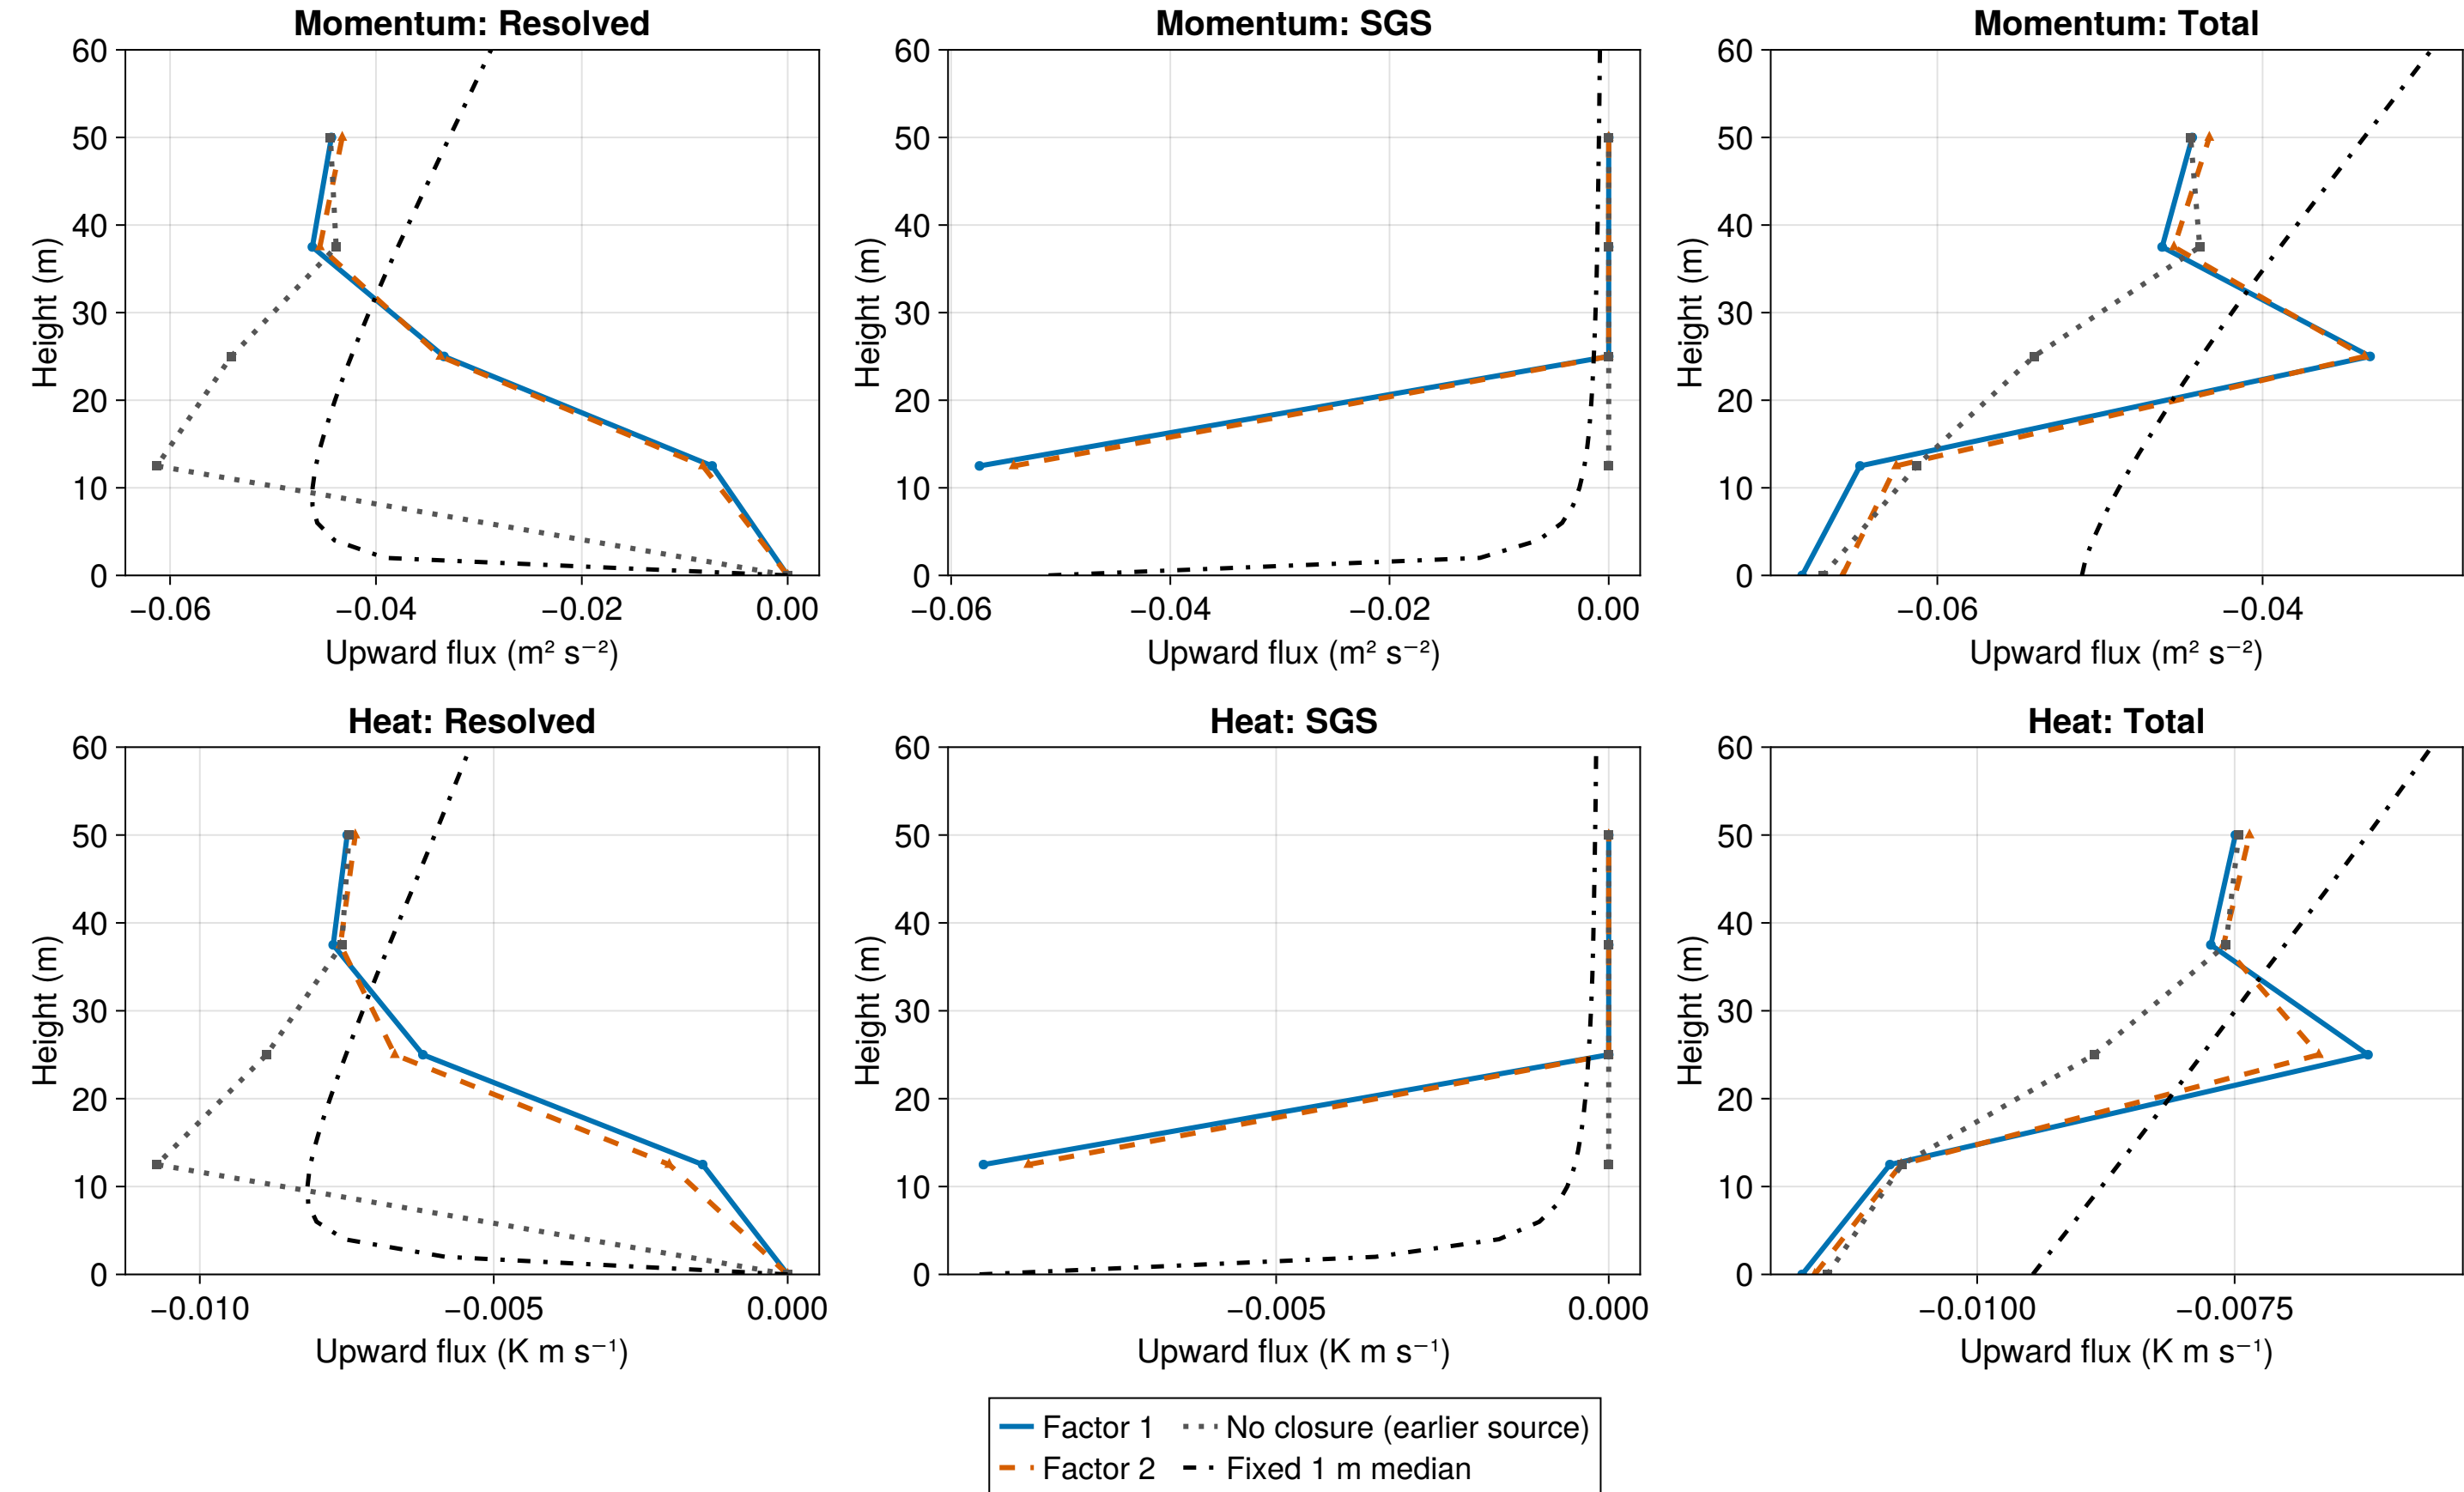

Interior total = resolved + SGS. At the wall, total includes the prescribed flux; artificial SGS wall zeros are omitted.
Each panel includes the fixed 1 m median wherever that reference quantity is available.