


What the factor changes: coefficients and local switch-off

One supported face at 12.5 m · factors 1 and 3 · factor 1 switch-off fractions unavailable

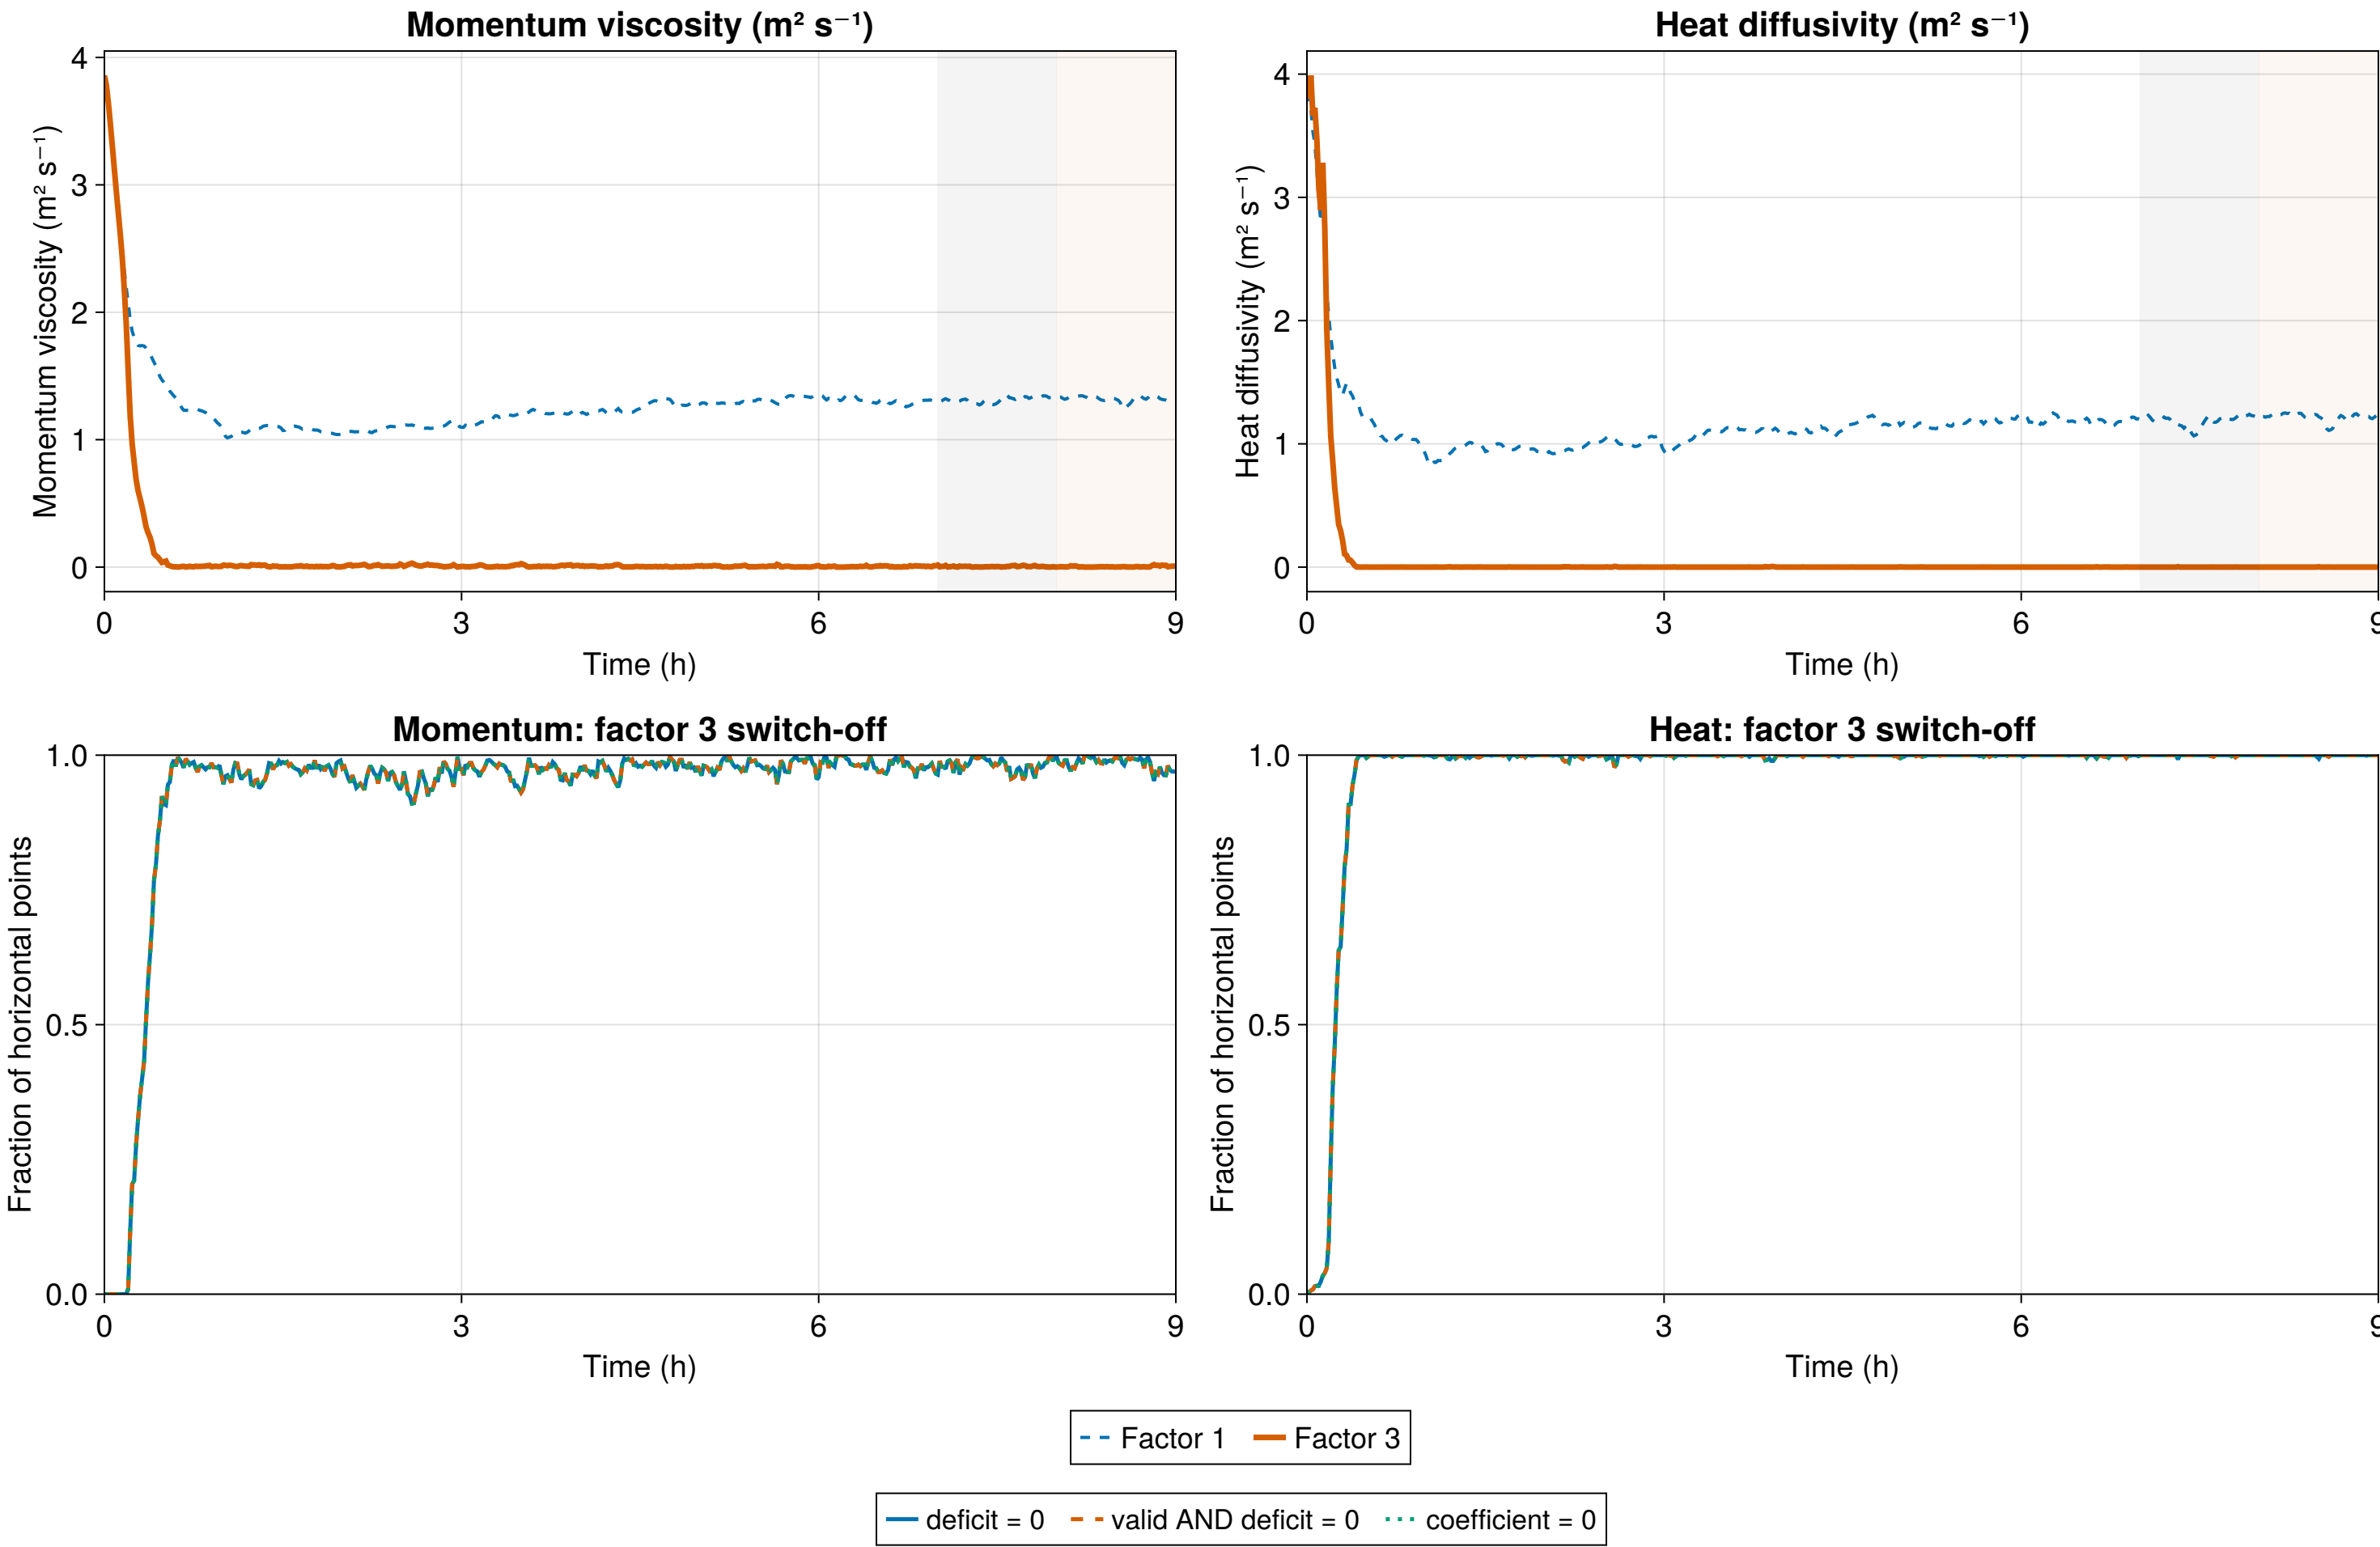

All fraction denominators include every horizontal point. Exact overlap is meaningful; quantitative values are in the report.
Active/guard validity is separate from positive mixing. These six fractions were not saved for factor 1.