


What the factor changes: coefficients and local switch-off

One supported face at 12.5 m · coefficients from all three factors · switch-off fractions saved only for factor 10

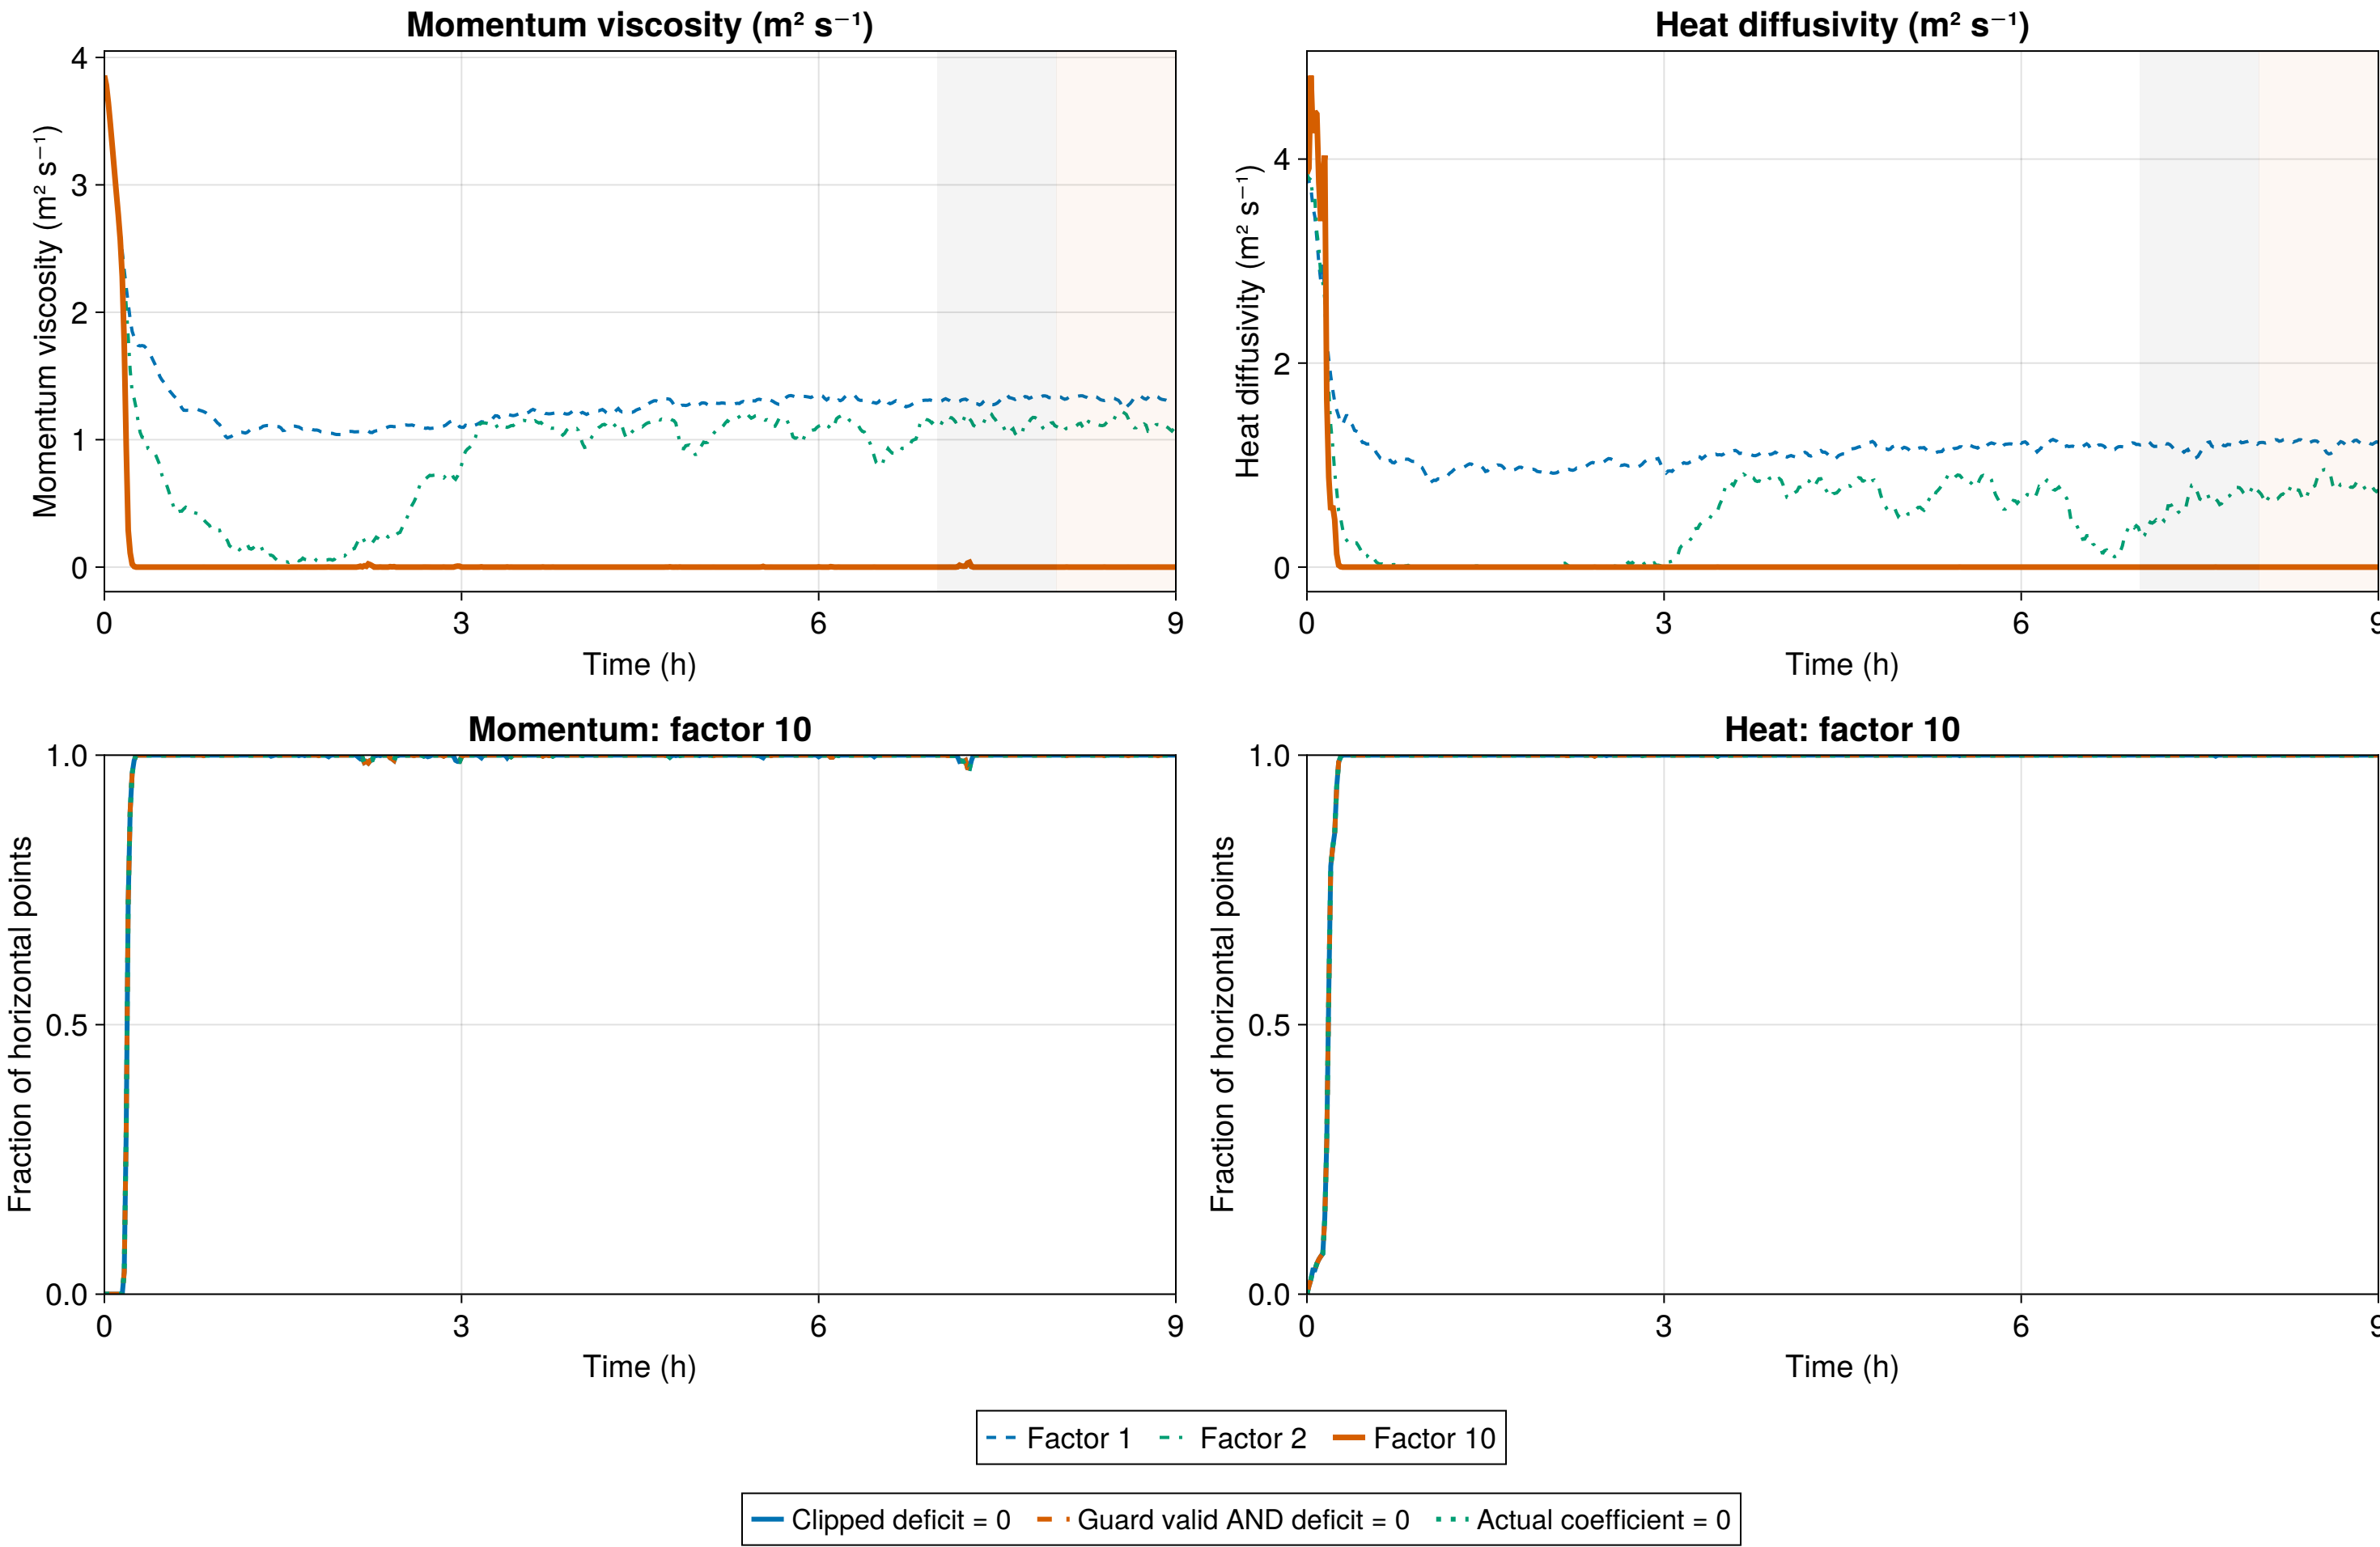

All fraction denominators include every horizontal point. Exact overlap is meaningful; quantitative values are in the report.
Active/guard validity is separate from positive mixing. These six fractions were not saved for factors 1 and 2.