



Independent external validation of the transcriptomic pCR model

Model locked on PREDIX and applied unchanged; features standardised within each cohort under two independent schemes


I-SPY2 — POOLED model (all PREDIX patients, both arms)
n=44, 26 pCR events

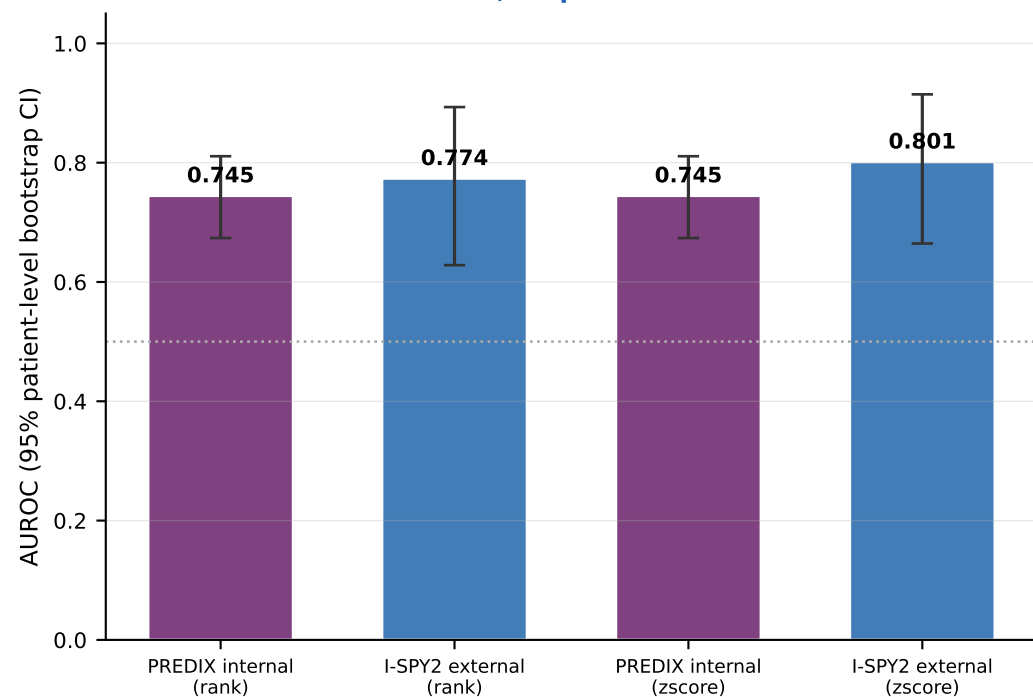

NCT02326974 — POOLED model (all PREDIX patients, both arms)
n=129, 64 pCR events

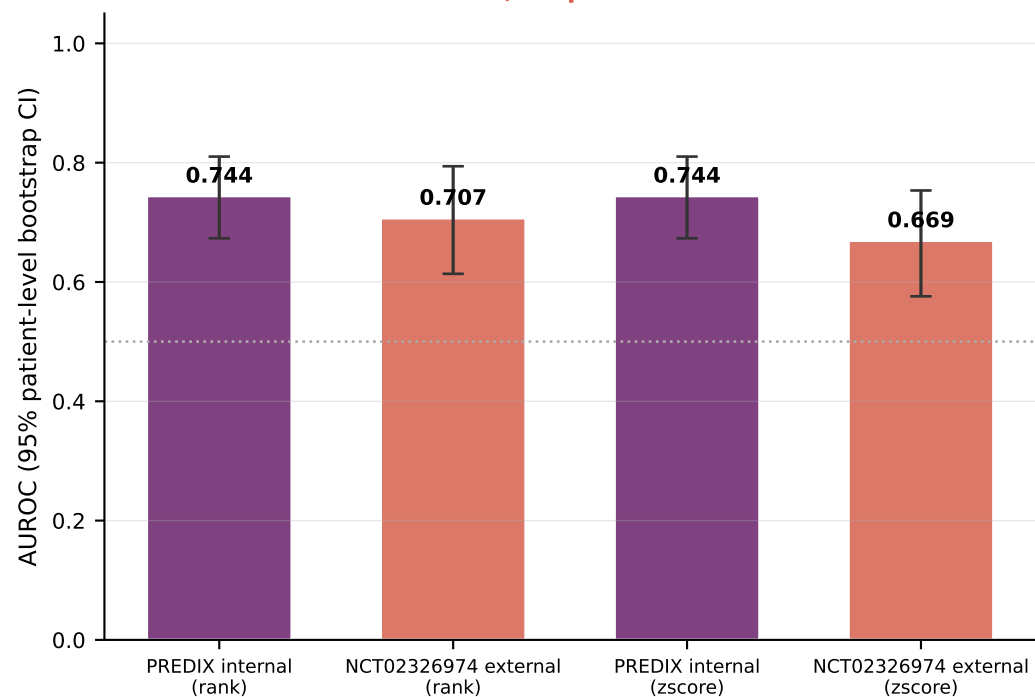

I-SPY2 — external calibration

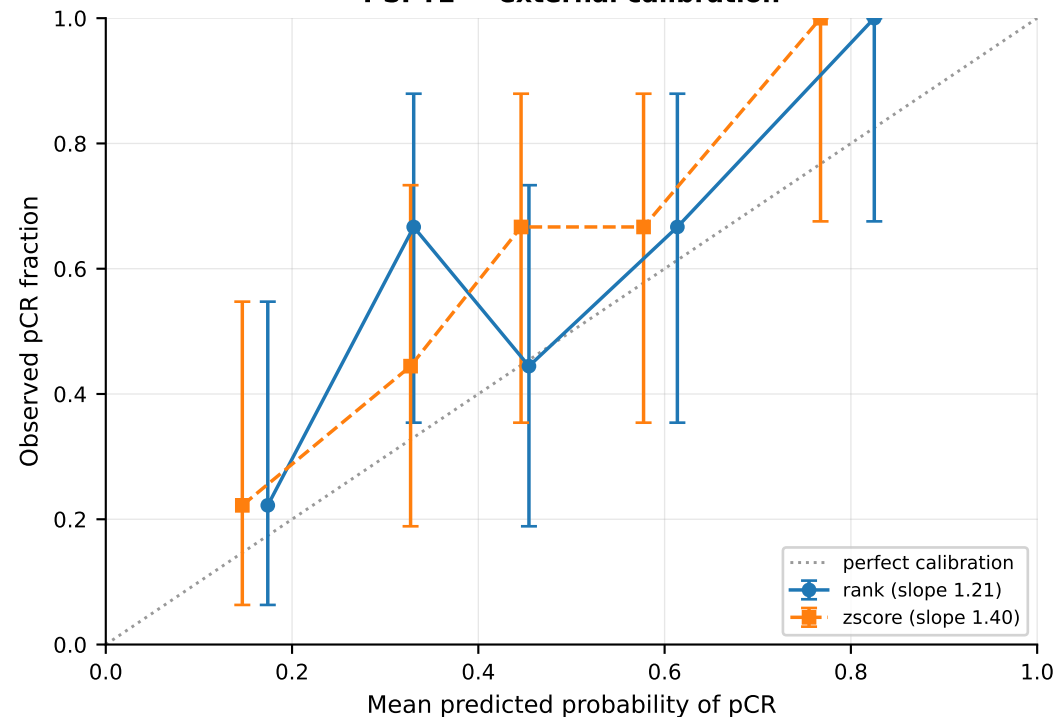

NCT02326974 — external calibration

