


Metformin HCl Dissolution Profile

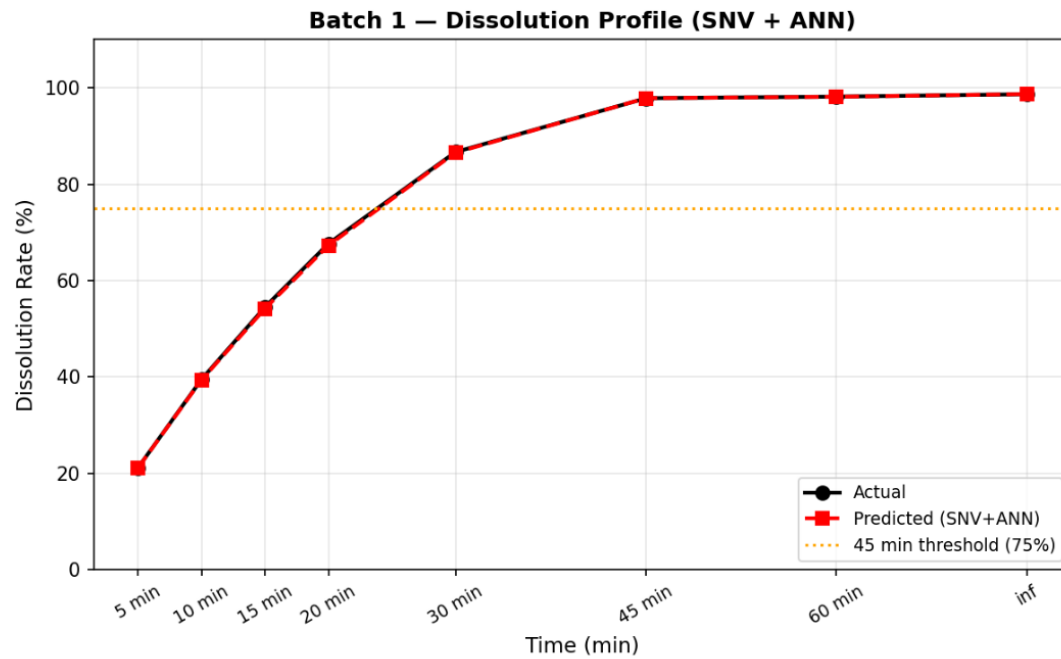

Time	% Dissolution	Remark
5 min	21.1409	OK
10 min	39.3721	OK
15 min	54.1889	OK
20 min	67.2938	OK
30 min	86.5438	OK
45 min	97.8501	OK
60 min	98.1412	OK
inf	98.6938	OK

Approved by:

Position:

Date:

Comment: