


Metformin HCl Dissolution Profile

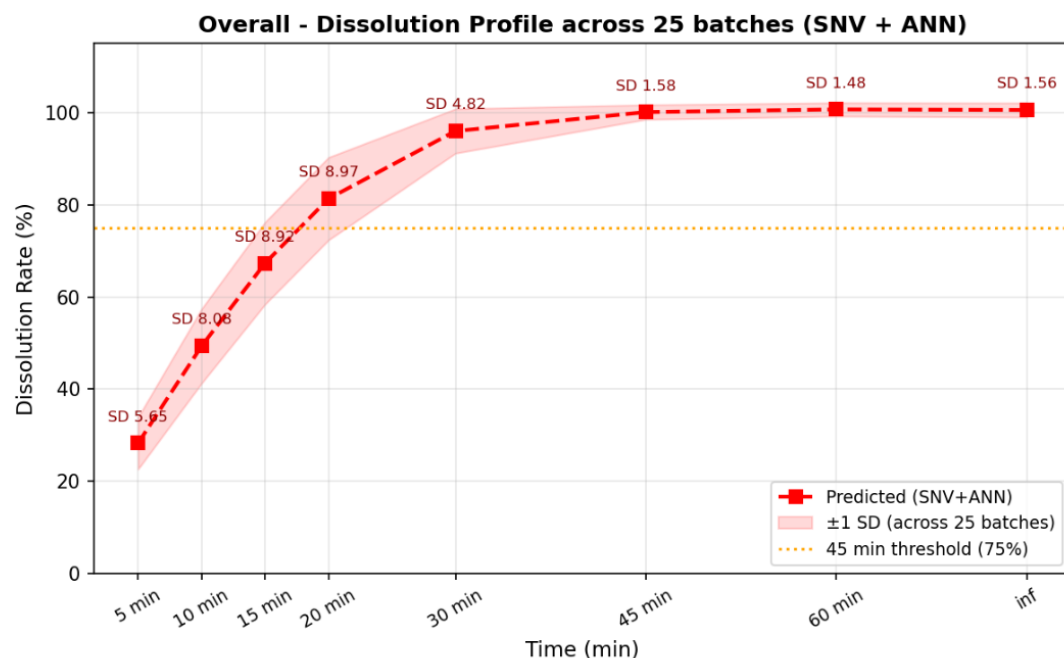

Time	% Dissolution	SD	Remark
5 min	28.3055	5.6471	OK
10 min	49.3738	8.076	OK
15 min	67.3565	8.9191	OK
20 min	81.354	8.9726	OK
30 min	96.0353	4.815	OK
45 min	100.1471	1.5824	OK
60 min	100.7219	1.4754	OK
inf	100.5954	1.5597	OK

Approved by:

Position:

Date:

Comment: