


Demand Response (*DR1*) Summary

Ran on *ICF Test Employees* on *2016-04-05* between *17:00 - 19:50*


Average Duty Cycle

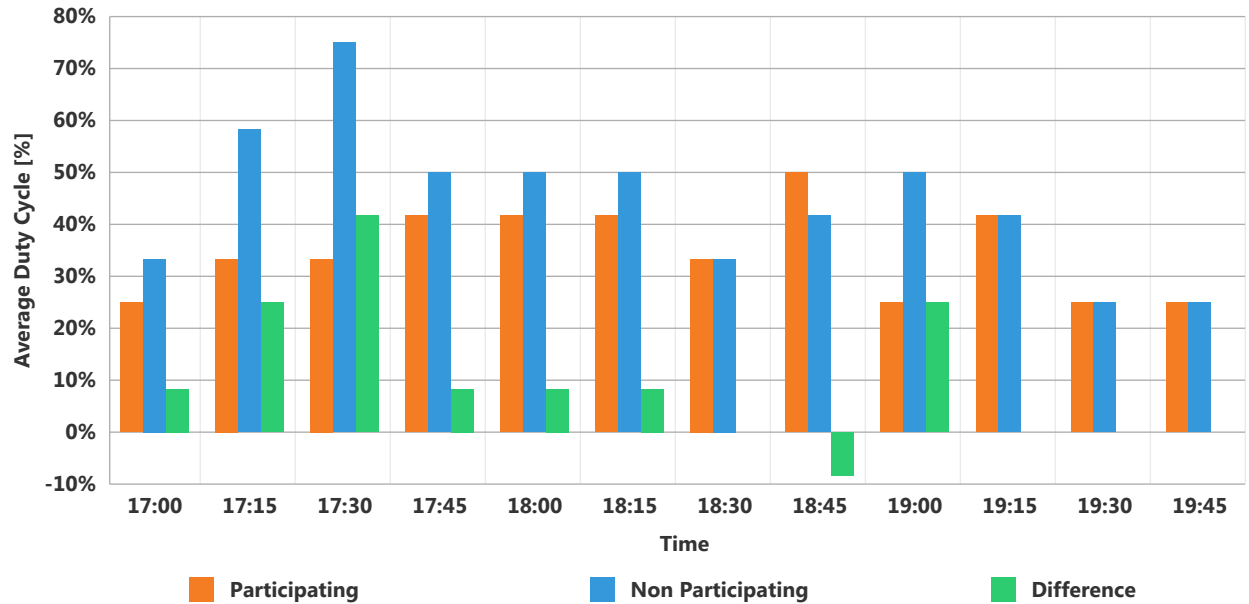

Average Load (kW)


Max kW Saved during DR: *1.68 kW*

Average kW over DR: *0.33 kW*

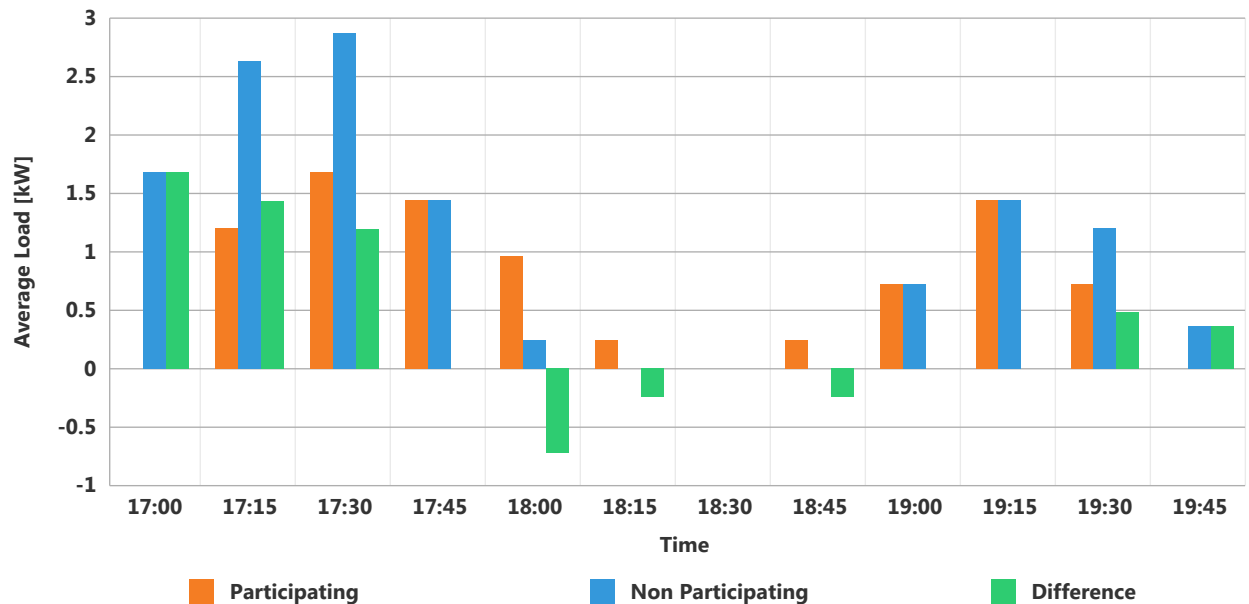


Average Load (kWh)


Total kWh Saved during DR: 0.99 kWh

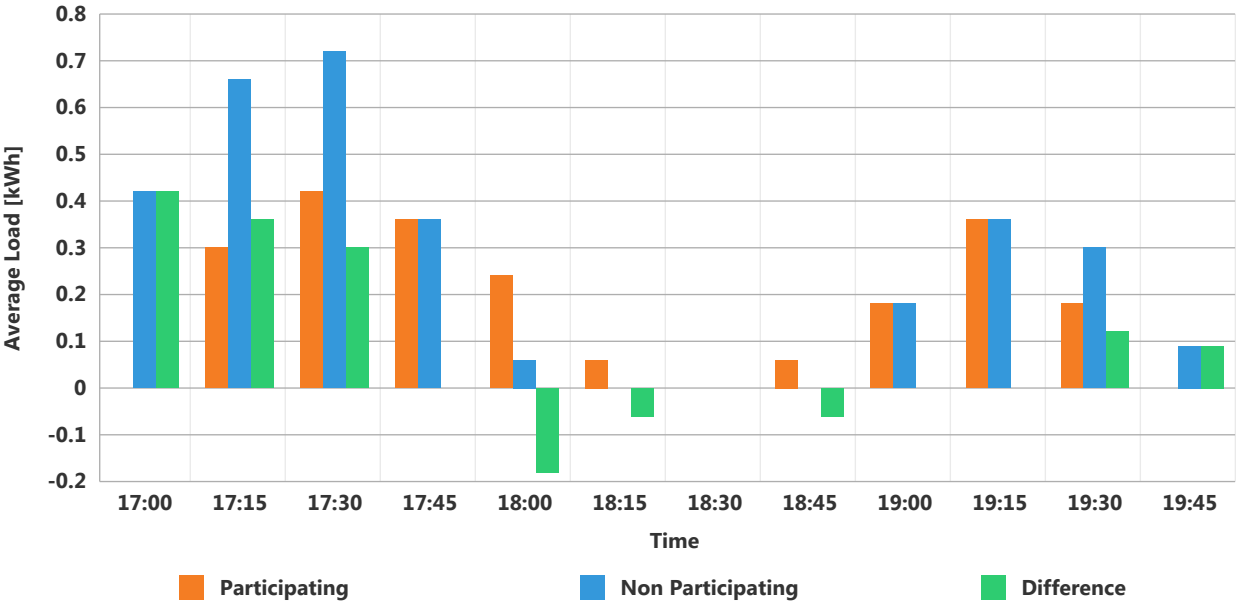

Average Thermostat Temperatures

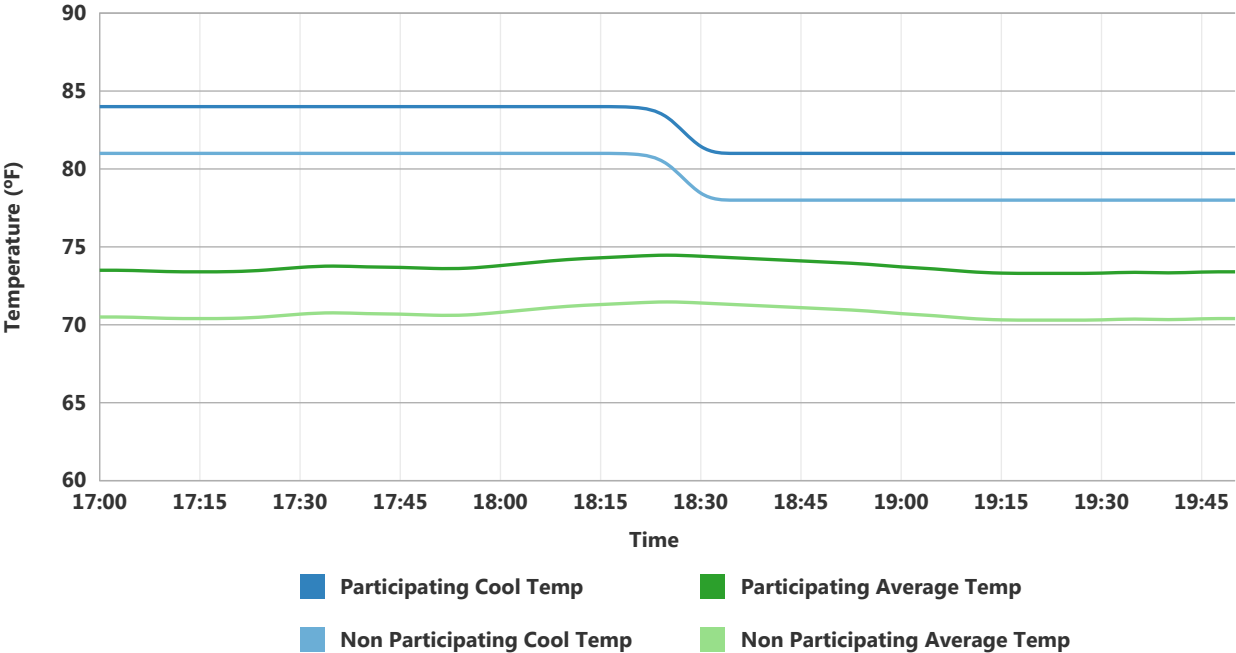

Demand Response Thermostat Participation

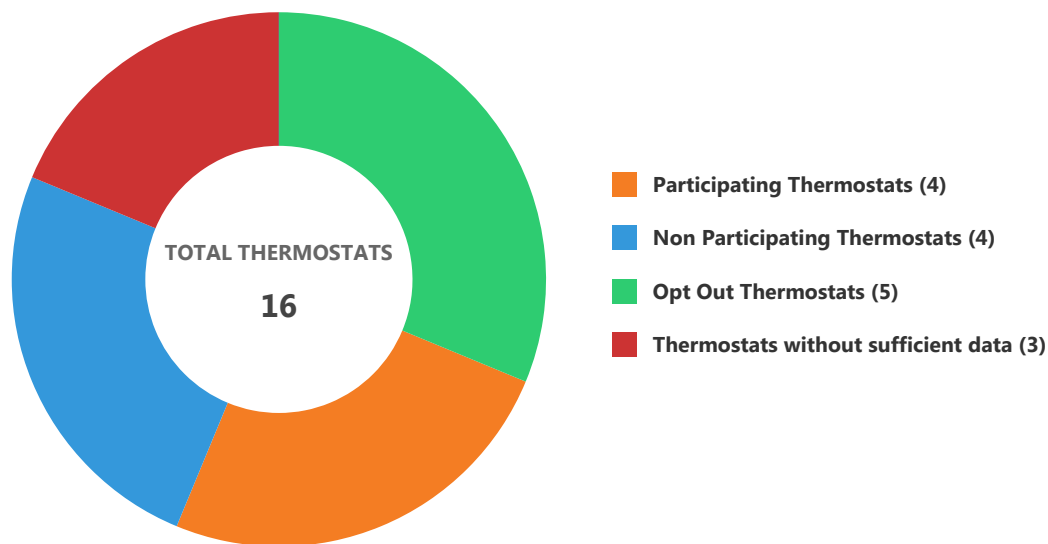

Demand Response Thermostat ID Participation

Participating	Non Participating	Opt Out	No Data
315697894150	315697894151	315697894155	314705625832
315697894152	315697894154	315697894156	315697894149
315697894153	315697894157	315697894158	315697894160
315697894159	315697894162	315697894161	
		315697894163	