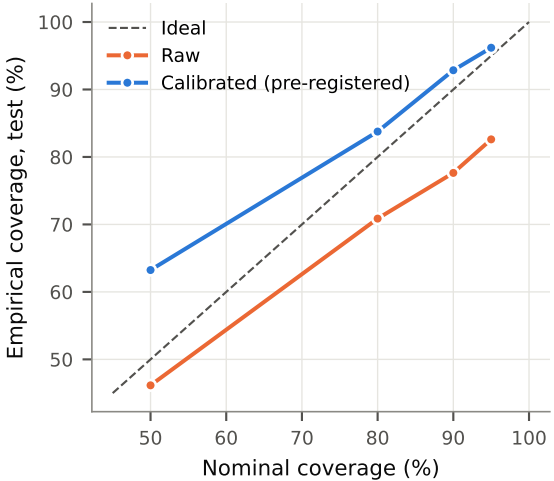
(a) All test cycles
Ideal
Raw
Calibrated (pre-registered)
Empirical coverage, test (%)
Nominal coverage (%)
100
90
80
70
60
50
50
60
70
80
90
100

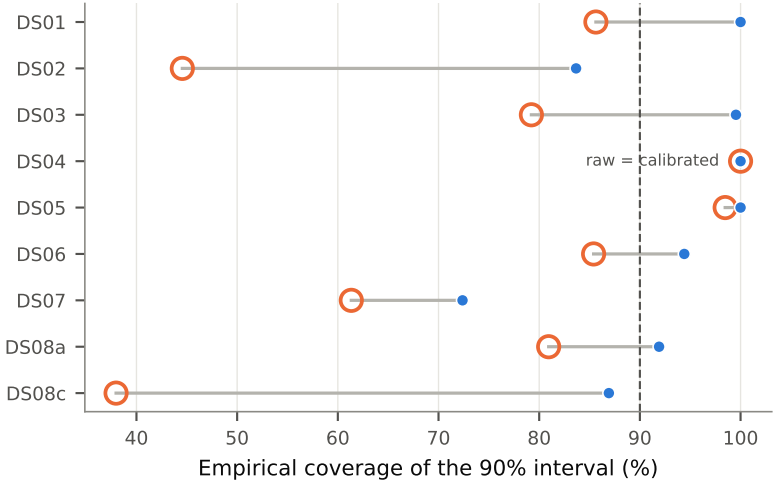
(b) By subset: raw (open orange) → calibrated (blue)
DS01
DS02
DS03
DS04
DS05
DS06
DS07
DS08a
DS08c
raw = calibrated
40
50
60
70
80
90
100
Empirical coverage of the 90% interval (%)