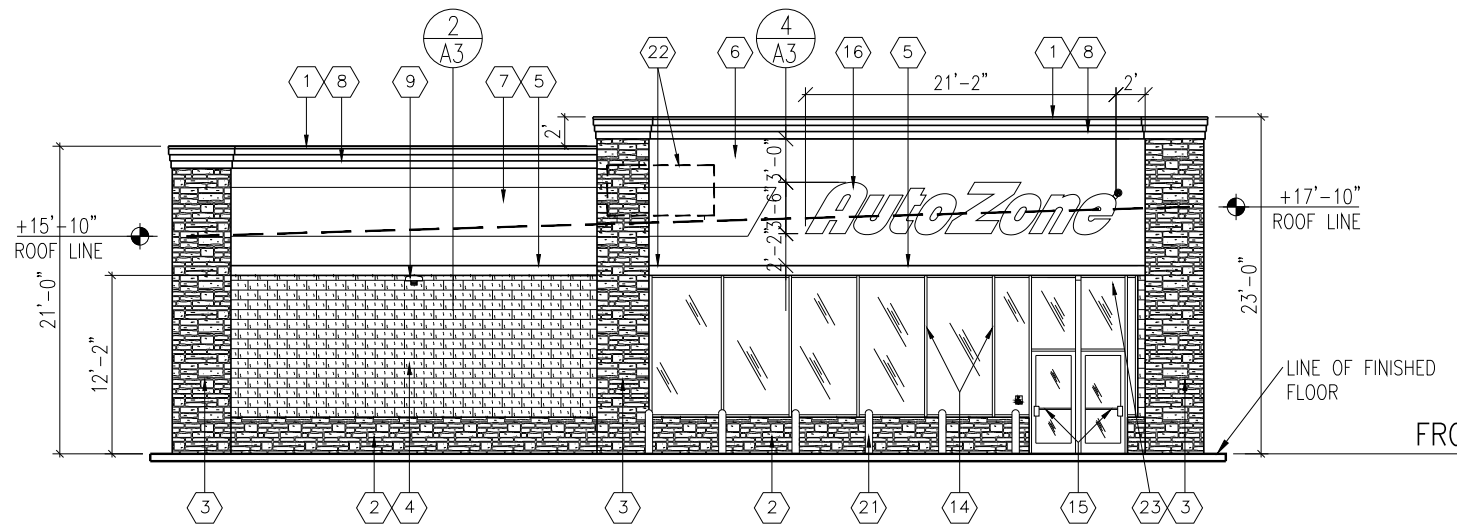

FRONT SIDE WALL
SOUTH

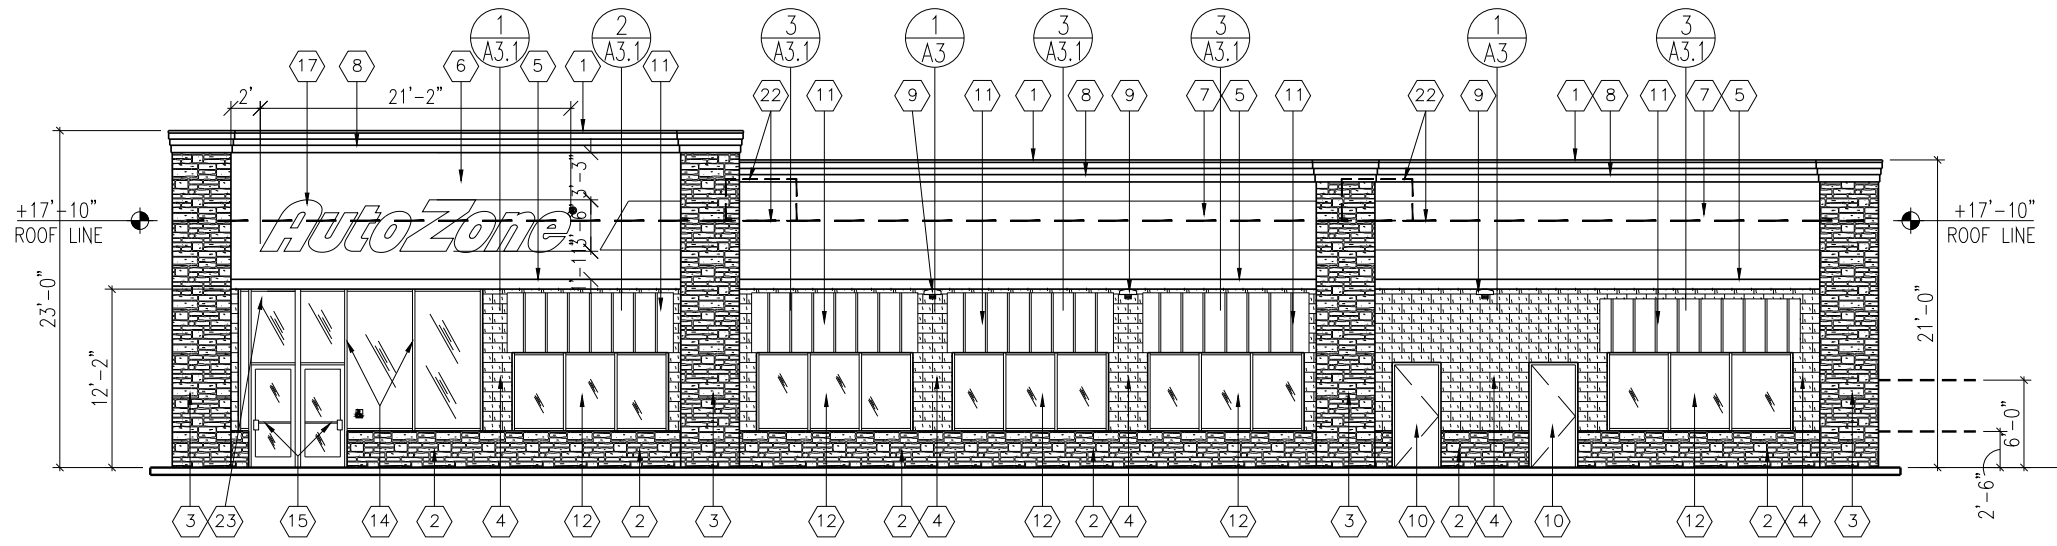

TRANSPARENCY REQUIREMENT CALCULATIONS
CLEVELAND AVE
PRIMARY FRONTAGE
60% OF WALL AREA BETWEEN 30" & 72" A.F.F.
BLDG WALL LENGTH 116'-4" X 3'-6" HT = 407 SF
60% OF 407 SF = 244.2 SF REQUIRED
GLAZING @ STOREFRONT = 58.44 SF
GLAZING @ SECTION 2, 3, 4, 5 (38.33 EA) = 153.32
GLAZING @ SECTION 6 = 44.33
TOTAL OF 256.09 SF PROPOSED
MEETS DESIGN REQUIREMENT SECTION 3372.605.D
**AUTOZONE PROPOSES ADDITIONAL 206.97 OF GLAZING ABOVE
THE 6'-0" (72") HEIGHT REQUIREMENTS

RIGHT SIDE WALL
KINGS VALLEY HWY
EAST

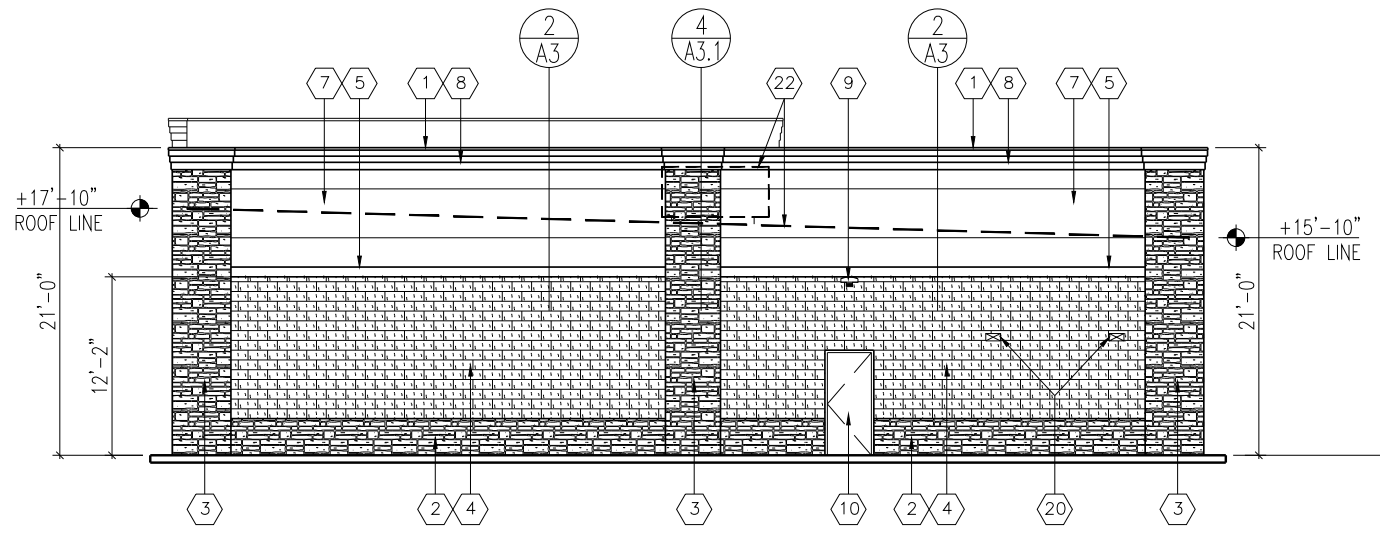

LEFT SIDE WALL
NORTH

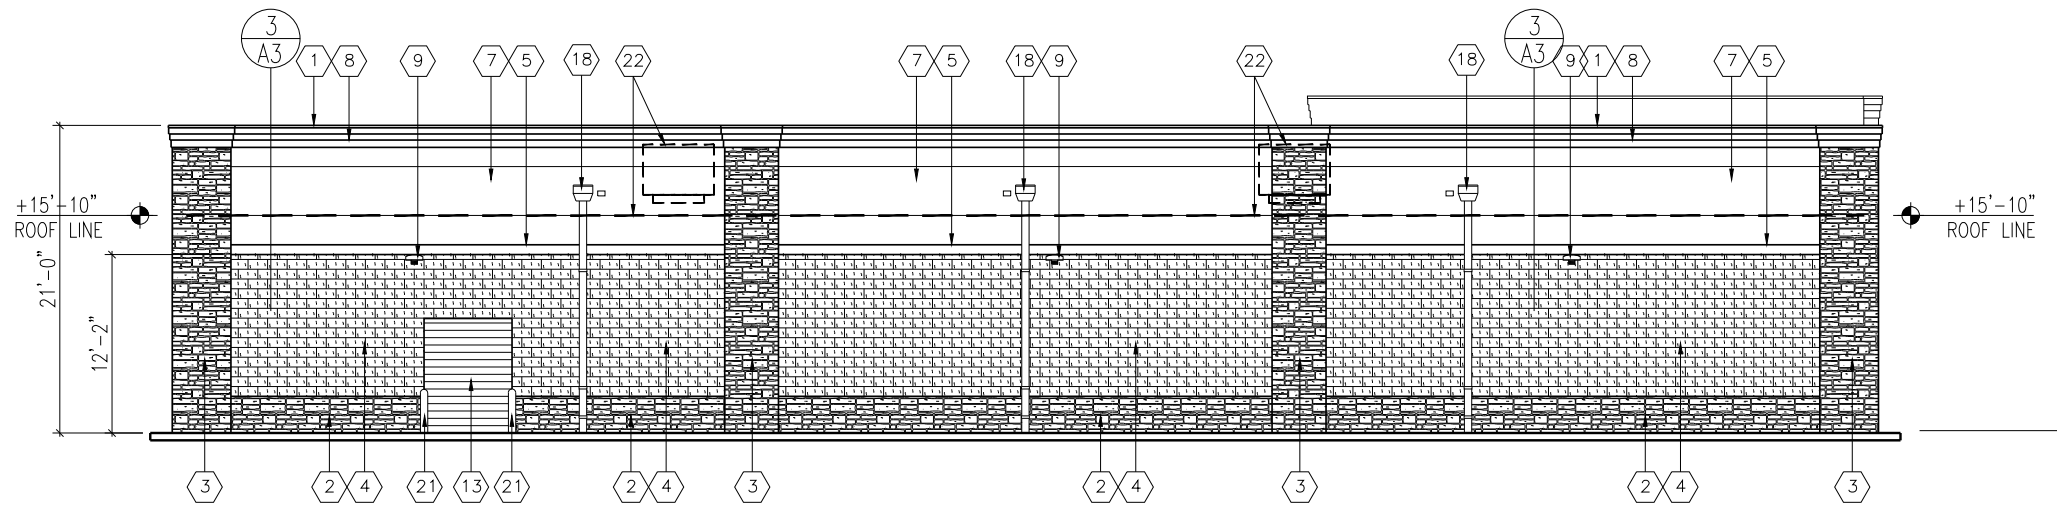

LEFT SIDE WALL
WEST

1/8" = 1'-0"
1 EXTERIOR ELEVATIONS



NOTE: SEE SHEET SN-1 FOR ACTUAL SIGN OVERALL DIMENSIONS

3/4" = 1'-0"
7 ORANGE STRIPE TERMINATION



NOTE: SEE SHEET SN-1 FOR ACTUAL SIGN OVERALL DIMENSIONS

3/4" = 1'-0"
6 ORANGE STRIPE TERMINATION

J.B.H. = JOIST BEARING HEIGHT

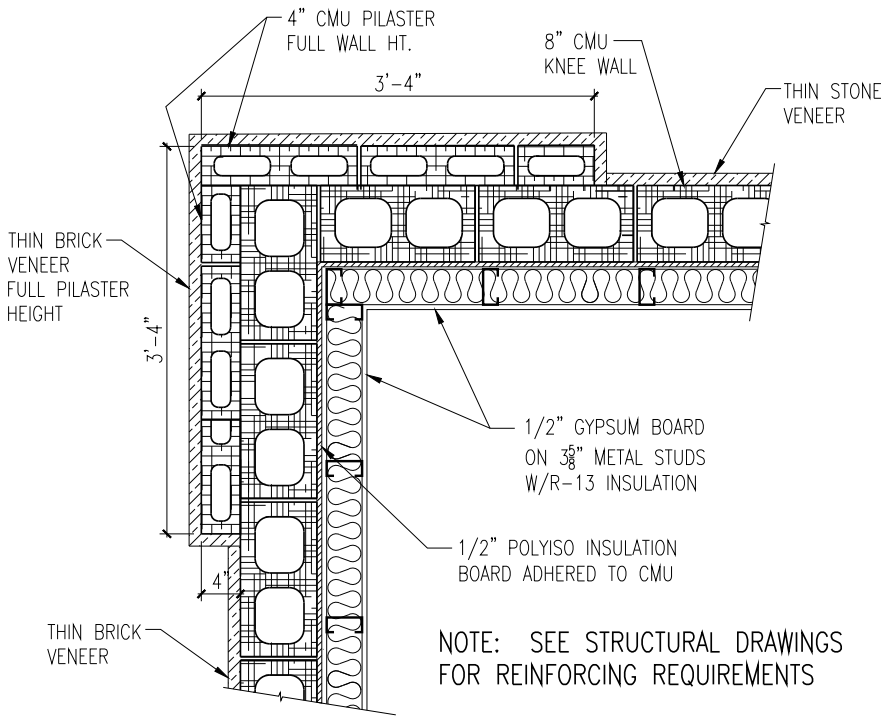

1" = 1'-0" PIL02

4 THIN BRICK CORNER PILASTER DETAIL

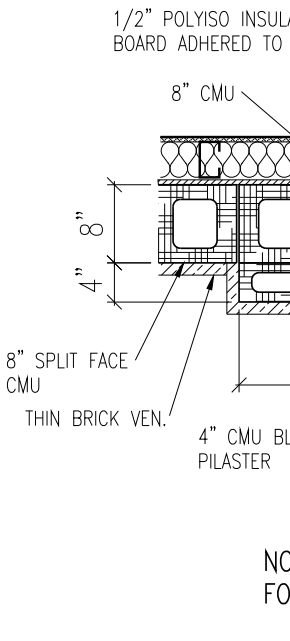

1" = 1'-0"

3 THIN BRICK PI

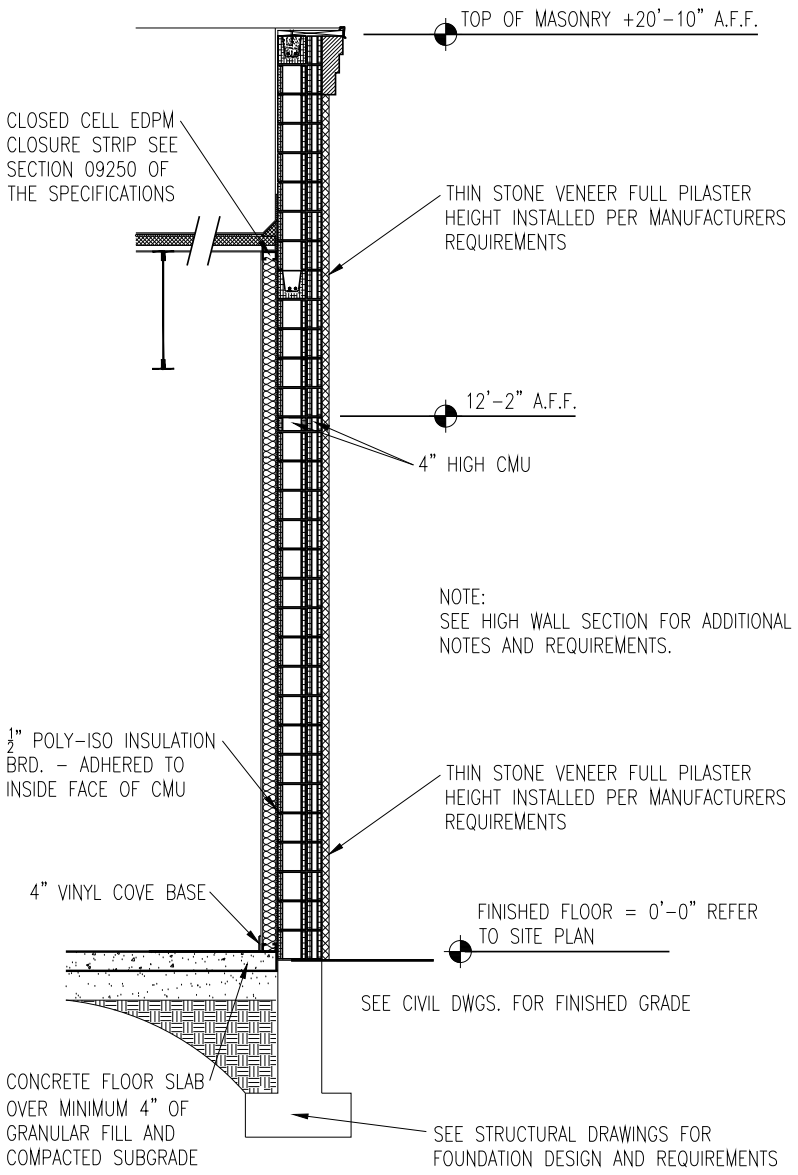
TOP OF MASONRY +20'-10" A.F.F.
CLOSED CELL EDPM
CLOSURE STRIP SEE
SECTION 09250 OF
THE SPECIFICATIONS
THIN STONE VENEER FULL PILASTER
HEIGHT INSTALLED PER MANUFACTURERS
REQUIREMENTS
12'-2" A.F.F.
4" HIGH CMU
NOTE:
SEE HIGH WALL SECTION FOR ADDITIONAL
NOTES AND REQUIREMENTS.
$\frac{1}{2}$" POLY-ISO INSULATION
BRD. - ADHERED TO
INSIDE FACE OF CMU
THIN STONE VENEER FULL PILASTER
HEIGHT INSTALLED PER MANUFACTURERS
REQUIREMENTS
4" VINYL COVE BASE
FINISHED FLOOR = 0'-0" REFER
TO SITE PLAN
SEE CIVIL DWGS. FOR FINISHED GRADE
CONCRETE FLOOR SLAB
OVER MINIMUM 4" OF
GRANULAR FILL AND
COMPACTED SUBGRADE
SEE STRUCTURAL DRAWINGS FOR
FOUNDATION DESIGN AND REQUIREMENTS

3/8" = 1'-0" AWS02.1

4 WALL SECTION END WALL – TYPICAL PILASTER

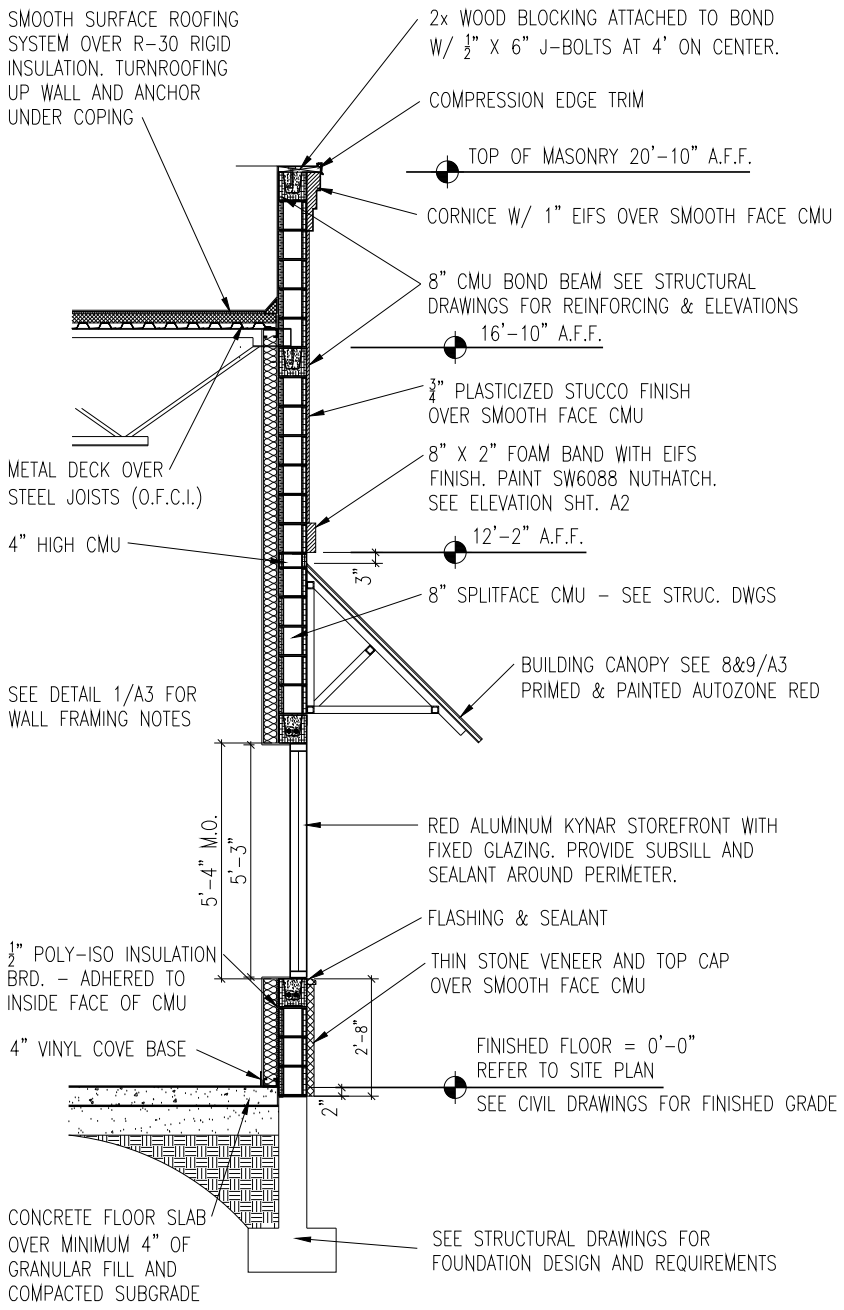
SMOOTH SURFACE ROOFING
SYSTEM OVER R-30 RIGID
INSULATION. TURNROOFING
UP WALL AND ANCHOR
UNDER COPING
2x WOOD BLOCKING ATTACHED TO BOND
W/ $\frac{1}{2}$" X 6" J-BOLTS AT 4' ON CENTER.
COMPRESSION EDGE TRIM
TOP OF MASONRY 20'-10" A.F.F.
CORNICE W/ 1" EIFS OVER SMOOTH FACE CMU
8" CMU BOND BEAM SEE STRUCTURAL
DRAWINGS FOR REINFORCING & ELEVATIONS
16'-10" A.F.F.
$\frac{3}{4}$" PLASTICIZED STUCCO FINISH
OVER SMOOTH FACE CMU
8" X 2" FOAM BAND WITH EIFS
FINISH. PAINT SW6088 NUTHATCH.
SEE ELEVATION SHT. A2
METAL DECK OVER
STEEL JOISTS (O.F.C.I.)
12'-2" A.F.F.
4" HIGH CMU
3"
8" SPLITFACE CMU – SEE STRUC. DWGS
BUILDING CANOPY SEE 8&9/A3
PRIMED & PAINTED AUTOZONE RED
SEE DETAIL 1/A3 FOR
WALL FRAMING NOTES
5'-4" M.O.
5'-3"
RED ALUMINUM KYNAR STOREFRONT WITH
FIXED GLAZING. PROVIDE SUBSILL AND
SEALANT AROUND PERIMETER.
FLASHING & SEALANT
$\frac{1}{2}$" POLY-ISO INSULATION
BRD. – ADHERED TO
INSIDE FACE OF CMU
THIN STONE VENEER AND TOP CAP
OVER SMOOTH FACE CMU
2'-8"
4" VINYL COVE BASE
FINISHED FLOOR = 0'-0"
REFER TO SITE PLAN
2"
SEE CIVIL DRAWINGS FOR FINISHED GRADE
CONCRETE FLOOR SLAB
OVER MINIMUM 4" OF
GRANULAR FILL AND
COMPACTED SUBGRADE
SEE STRUCTURAL DRAWINGS FOR
FOUNDATION DESIGN AND REQUIREMENTS

3/8" = 1'-0" AWS01.3

3 WALL SECTION – HIGH SIDE @ 21'-0" PARAPET / WINDOW

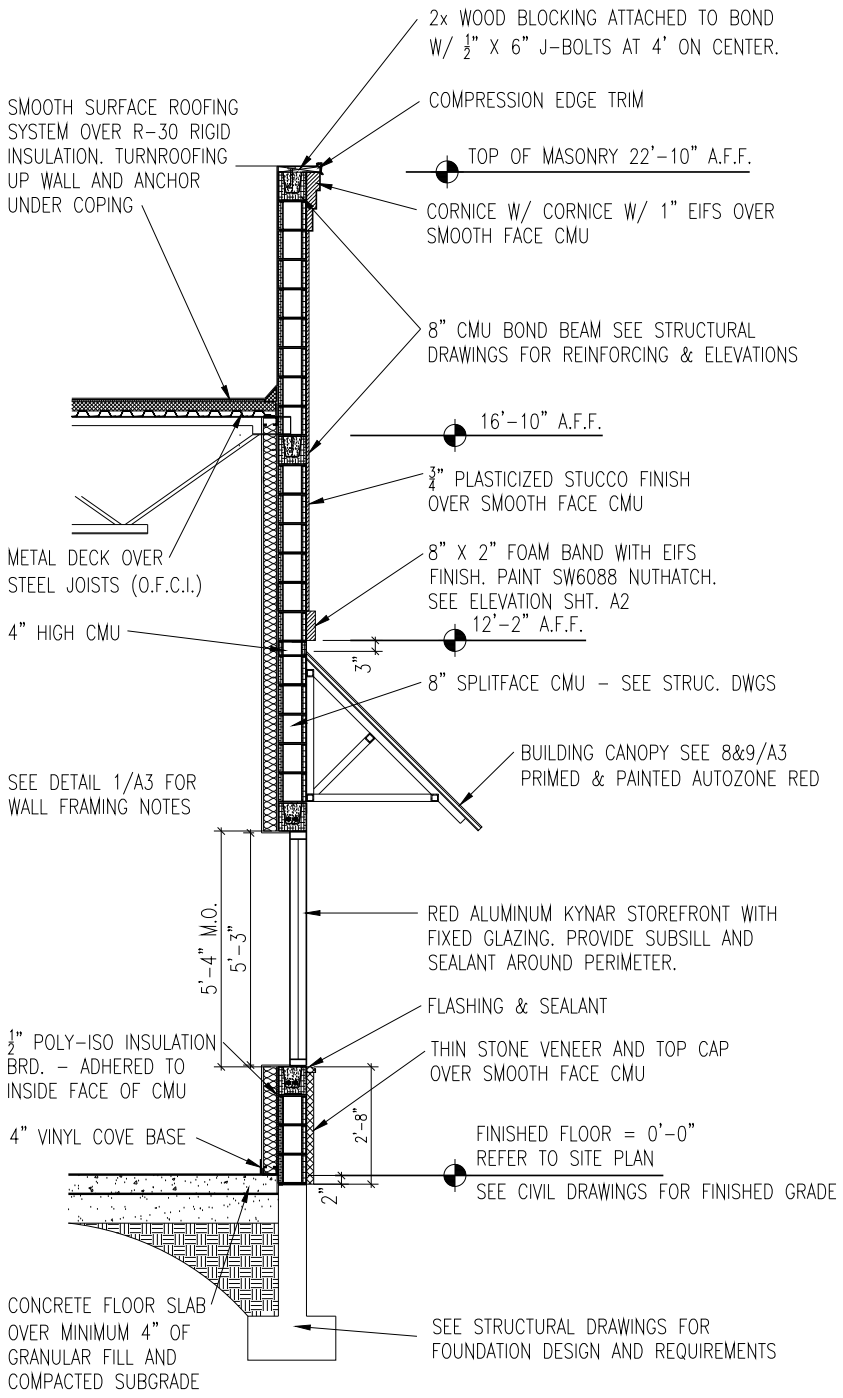
2x WOOD BLOCKING ATTACHED TO BOND
W/ $\frac{1}{2}$" X 6" J-BOLTS AT 4' ON CENTER.
SMOOTH SURFACE ROOFING
SYSTEM OVER R-30 RIGID
INSULATION. TURNROOFING
UP WALL AND ANCHOR
UNDER COPING
COMPRESSION EDGE TRIM
TOP OF MASONRY 22'-10" A.F.F.
CORNICE W/ CORNICE W/ 1" EIFS OVER
SMOOTH FACE CMU
8" CMU BOND BEAM SEE STRUCTURAL
DRAWINGS FOR REINFORCING & ELEVATIONS
16'-10" A.F.F.
$\frac{3}{4}$" PLASTICIZED STUCCO FINISH
OVER SMOOTH FACE CMU
METAL DECK OVER
STEEL JOISTS (O.F.C.I.)
8" X 2" FOAM BAND WITH EIFS
FINISH. PAINT SW6088 NUTHATCH.
SEE ELEVATION SHT. A2
12'-2" A.F.F.
4" HIGH CMU
3"
8" SPLITFACE CMU – SEE STRUC. DWGS
BUILDING CANOPY SEE 8&9/A3
PRIMED & PAINTED AUTOZONE RED
SEE DETAIL 1/A3 FOR
WALL FRAMING NOTES
5'-4" M.O.
5'-3"
RED ALUMINUM KYNAR STOREFRONT WITH
FIXED GLAZING. PROVIDE SUBSILL AND
SEALANT AROUND PERIMETER.
FLASHING & SEALANT
$\frac{1}{2}$" POLY-ISO INSULATION
BRD. – ADHERED TO
INSIDE FACE OF CMU
THIN STONE VENEER AND TOP CAP
OVER SMOOTH FACE CMU
2'-8"
4" VINYL COVE BASE
FINISHED FLOOR = 0'-0"
REFER TO SITE PLAN
2"
SEE CIVIL DRAWINGS FOR FINISHED GRADE
CONCRETE FLOOR SLAB
OVER MINIMUM 4" OF
GRANULAR FILL AND
COMPACTED SUBGRADE
SEE STRUCTURAL DRAWINGS FOR
FOUNDATION DESIGN AND REQUIREMENTS

3/8" = 1'-0" AWS01.2

2 WALL SECTION – HIGH SIDE @ 23'-0" PARAPET / WINDOW

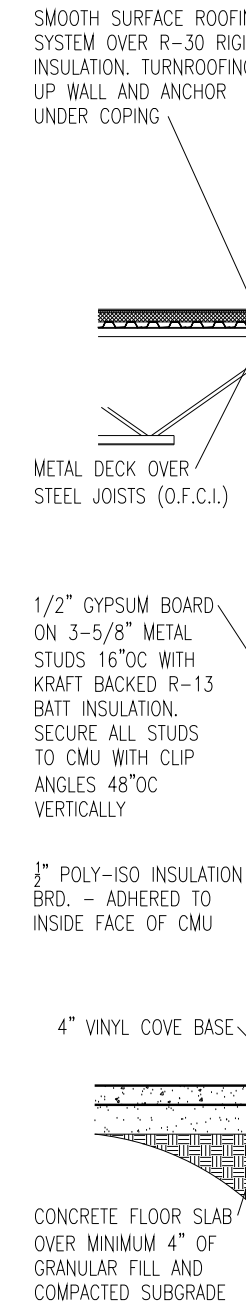

3/8" = 1'-0"

1 WALL SECTION

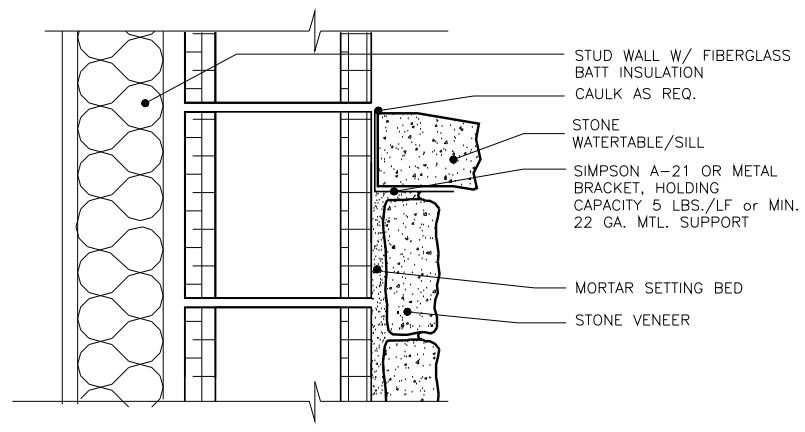
STUD WALL W/ FIBERGLASS BATT INSULATION
CAULK AS REQ.
STONE WATERTABLE/SILL
SIMPSON A-21 OR METAL BRACKET, HOLDING CAPACITY 5 LBS./LF or MIN. 22 GA. MTL. SUPPORT
MORTAR SETTING BED
STONE VENEER

N.T.S. AWS11

7 STONE VENEER WATERTABLE / SILL

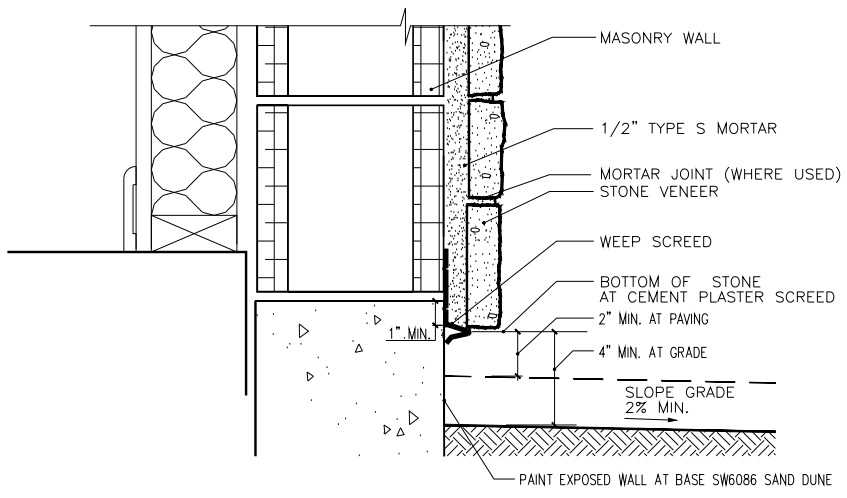

N.T.S. AWS10

6 STONE VENEER OVER MASONRY DETAIL

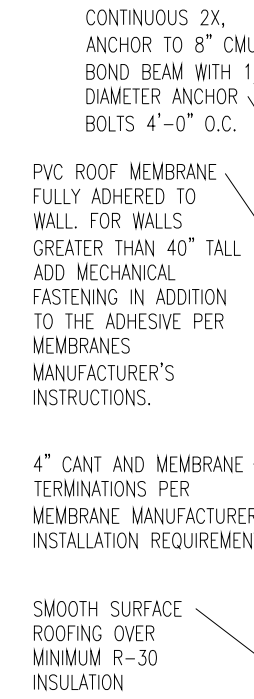
CONTINUOUS 2X, ANCHOR TO 8" CMU BOND BEAM WITH 1 DIAMETER ANCHOR BOLTS 4'-0" O.C.
PVC ROOF MEMBRANE FULLY ADHERED TO WALL. FOR WALLS GREATER THAN 40" TALL ADD MECHANICAL FASTENING IN ADDITION TO THE ADHESIVE PER MEMBRANES MANUFACTURER'S INSTRUCTIONS.
4" CANT AND MEMBRANE TERMINATIONS PER MEMBRANE MANUFACTURER INSTALLATION REQUIREMEN
SMOOTH SURFACE ROOFING OVER MINIMUM R-30 INSULATION

1" = 1'-0"

5 PARAPET / CO

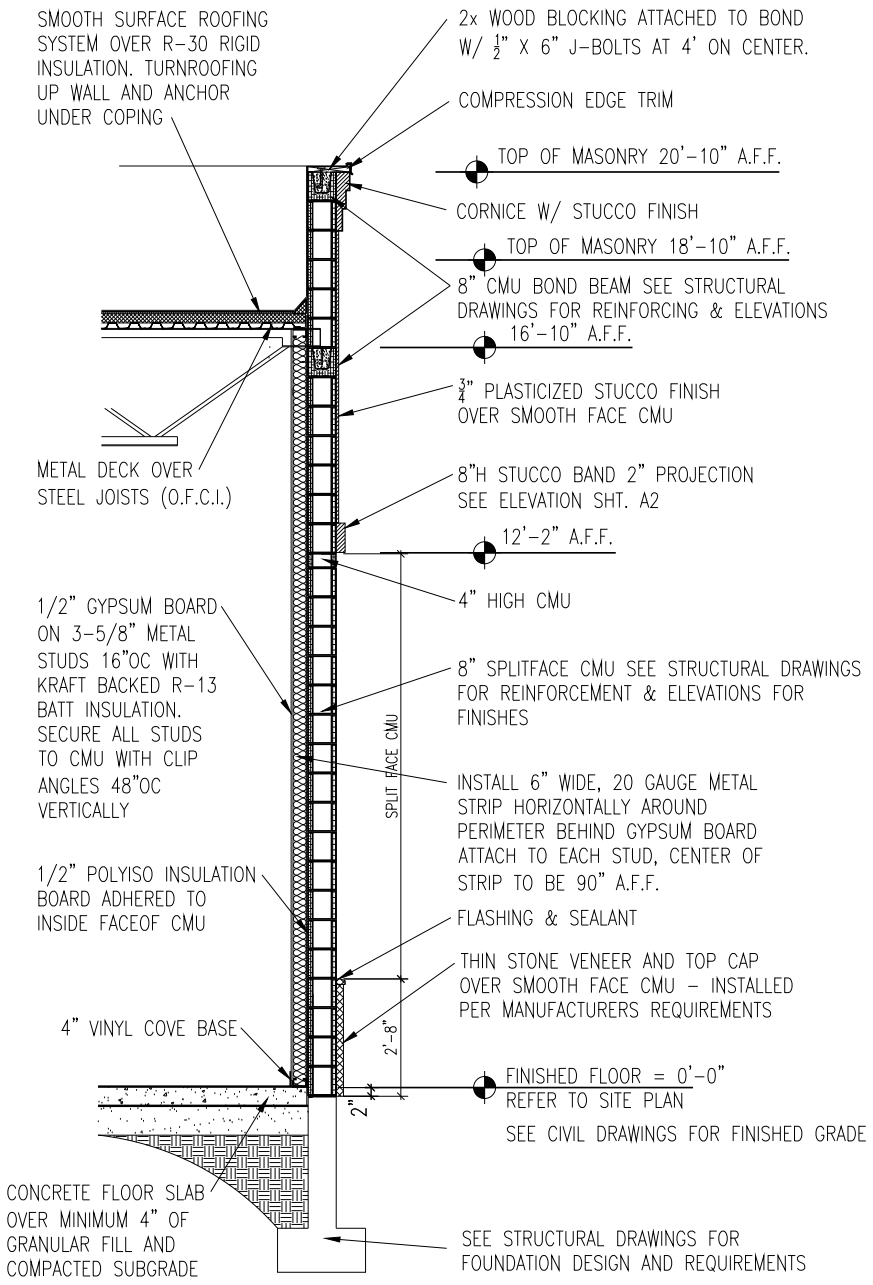
SMOOTH SURFACE ROOFING SYSTEM OVER R-30 RIGID INSULATION. TURNROOFING UP WALL AND ANCHOR UNDER COPING
2x WOOD BLOCKING ATTACHED TO BOND W/ ½" X 6" J-BOLTS AT 4' ON CENTER.
COMPRESSION EDGE TRIM
TOP OF MASONRY 20'-10" A.F.F.
CORNICE W/ STUCCO FINISH
TOP OF MASONRY 18'-10" A.F.F.
8" CMU BOND BEAM SEE STRUCTURAL DRAWINGS FOR REINFORCING & ELEVATIONS
16'-10" A.F.F.
¾" PLASTICIZED STUCCO FINISH OVER SMOOTH FACE CMU
METAL DECK OVER STEEL JOISTS (O.F.C.I.)
8"H STUCCO BAND 2" PROJECTION SEE ELEVATION SHT. A2
12'-2" A.F.F.
4" HIGH CMU
1/2" GYPSUM BOARD ON 3-5/8" METAL STUDS 16"OC WITH KRAFT BACKED R-13 BATT INSULATION. SECURE ALL STUDS TO CMU WITH CLIP ANGLES 48"OC VERTICALLY
8" SPLITFACE CMU SEE STRUCTURAL DRAWINGS FOR REINFORCEMENT & ELEVATIONS FOR FINISHES
SPLIT FACE CMU
INSTALL 6" WIDE, 20 GAUGE METAL STRIP HORIZONTALLY AROUND PERIMETER BEHIND GYPSUM BOARD ATTACH TO EACH STUD, CENTER OF STRIP TO BE 90" A.F.F.
1/2" POLYISO INSULATION BOARD ADHERED TO INSIDE FACEOF CMU
FLASHING & SEALANT
THIN STONE VENEER AND TOP CAP OVER SMOOTH FACE CMU - INSTALLED PER MANUFACTURERS REQUIREMENTS
4" VINYL COVE BASE
2'-8"
2"
FINISHED FLOOR = 0'-0" REFER TO SITE PLAN
SEE CIVIL DRAWINGS FOR FINISHED GRADE
CONCRETE FLOOR SLAB OVER MINIMUM 4" OF GRANULAR FILL AND COMPACTED SUBGRADE
SEE STRUCTURAL DRAWINGS FOR FOUNDATION DESIGN AND REQUIREMENTS

3/8" = 1'-0" AWS01

1 WALL SECTION HIGH SIDE – 21'-0" PARAPET

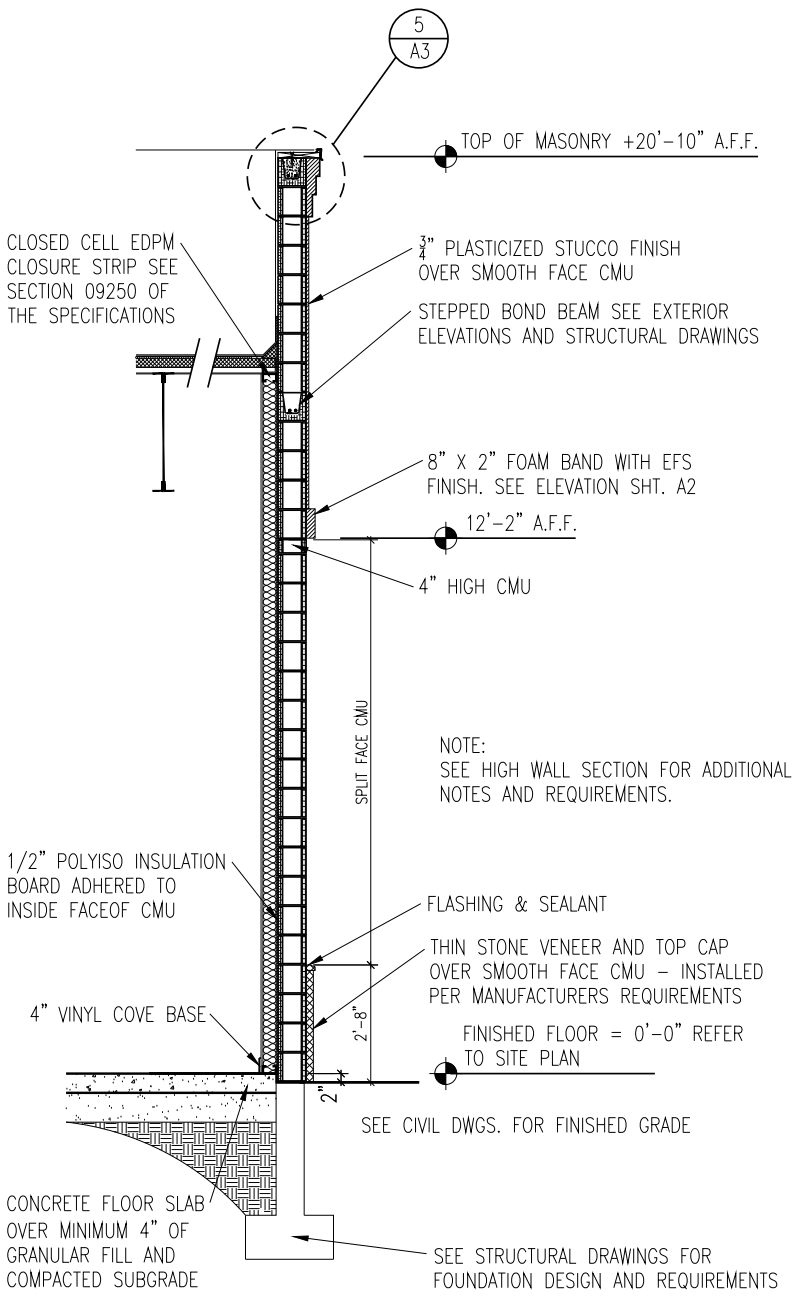
5
A3
TOP OF MASONRY +20'-10" A.F.F.
CLOSED CELL EDPM CLOSURE STRIP SEE SECTION 09250 OF THE SPECIFICATIONS
¾" PLASTICIZED STUCCO FINISH OVER SMOOTH FACE CMU
STEPPED BOND BEAM SEE EXTERIOR ELEVATIONS AND STRUCTURAL DRAWINGS
8" X 2" FOAM BAND WITH EFS FINISH. SEE ELEVATION SHT. A2
12'-2" A.F.F.
4" HIGH CMU
SPLIT FACE CMU
NOTE: SEE HIGH WALL SECTION FOR ADDITIONAL NOTES AND REQUIREMENTS.
1/2" POLYISO INSULATION BOARD ADHERED TO INSIDE FACEOF CMU
FLASHING & SEALANT
THIN STONE VENEER AND TOP CAP OVER SMOOTH FACE CMU - INSTALLED PER MANUFACTURERS REQUIREMENTS
4" VINYL COVE BASE
2'-8"
2"
FINISHED FLOOR = 0'-0" REFER TO SITE PLAN
SEE CIVIL DWGS. FOR FINISHED GRADE
CONCRETE FLOOR SLAB OVER MINIMUM 4" OF GRANULAR FILL AND COMPACTED SUBGRADE
SEE STRUCTURAL DRAWINGS FOR FOUNDATION DESIGN AND REQUIREMENTS

3/8" = 1'-0" AWS02

2 WALL SECTION END WALL – 21'-0" PARAPET

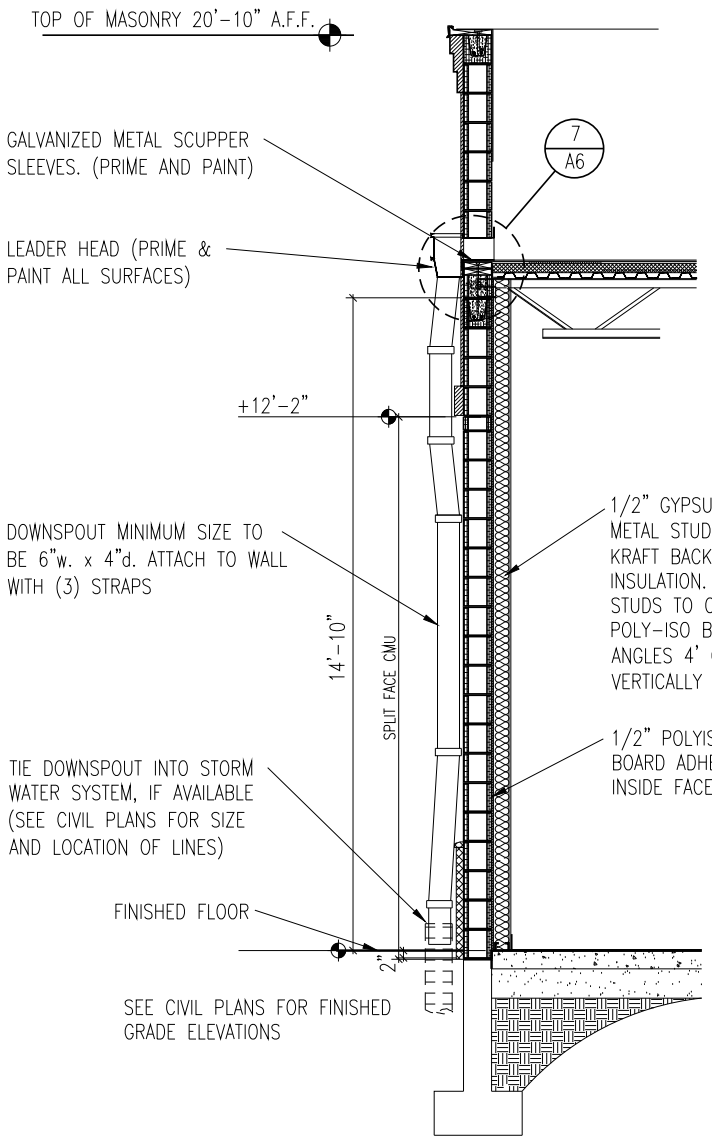
TOP OF MASONRY 20'-10" A.F.F.
7
A6
GALVANIZED METAL SCUPPER SLEEVES. (PRIME AND PAINT)
LEADER HEAD (PRIME & PAINT ALL SURFACES)
+12'-2"
DOWNSPOUT MINIMUM SIZE TO BE 6"w. x 4"d. ATTACH TO WALL WITH (3) STRAPS
14'-10"
SPLIT FACE CMU
1/2" GYPSUM BOARD ON 3⅝" METAL STUDS 16" OC WITH KRAFT BACKED R-13 BATT INSULATION. SECURE ALL STUDS TO CMU, THRU POLY-ISO BRD. WITH CLIP ANGLES 4' ON CENTER VERTICALLY
1/2" POLYISO INSULATION BOARD ADHERED TO INSIDE FACEOF CMU
TIE DOWNSPOUT INTO STORM WATER SYSTEM, IF AVAILABLE (SEE CIVIL PLANS FOR SIZE AND LOCATION OF LINES)
FINISHED FLOOR
2"
SEE CIVIL PLANS FOR FINISHED GRADE ELEVATIONS

3/8" = 1'-0" AWS03

3 WALL SECTION LOW SIDE – 21-0" PARAPET

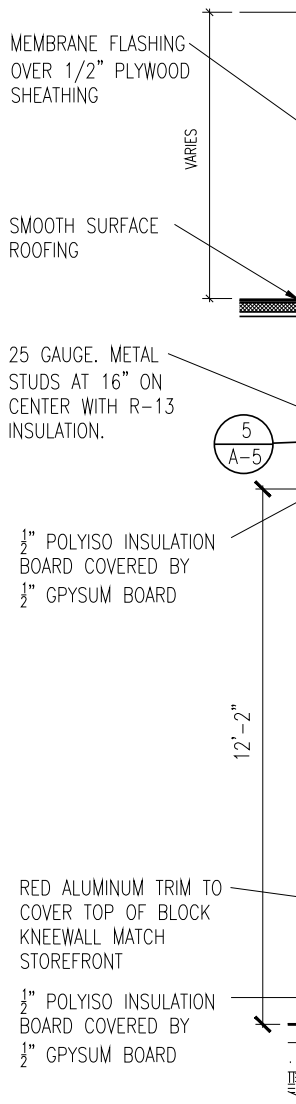
MEMBRANE FLASHING OVER 1/2" PLYWOOD SHEATHING
VARIES
SMOOTH SURFACE ROOFING
25 GAUGE. METAL STUDS AT 16" ON CENTER WITH R-13 INSULATION.
5
A-5
½" POLYISO INSULATION BOARD COVERED BY ½" GPYSUM BOARD
12'-2"
RED ALUMINUM TRIM TO COVER TOP OF BLOCK KNEEWALL MATCH STOREFRONT
½" POLYISO INSULATION BOARD COVERED BY ½" GPYSUM BOARD

3/8" = 1'-0"

4 WALL SECTION

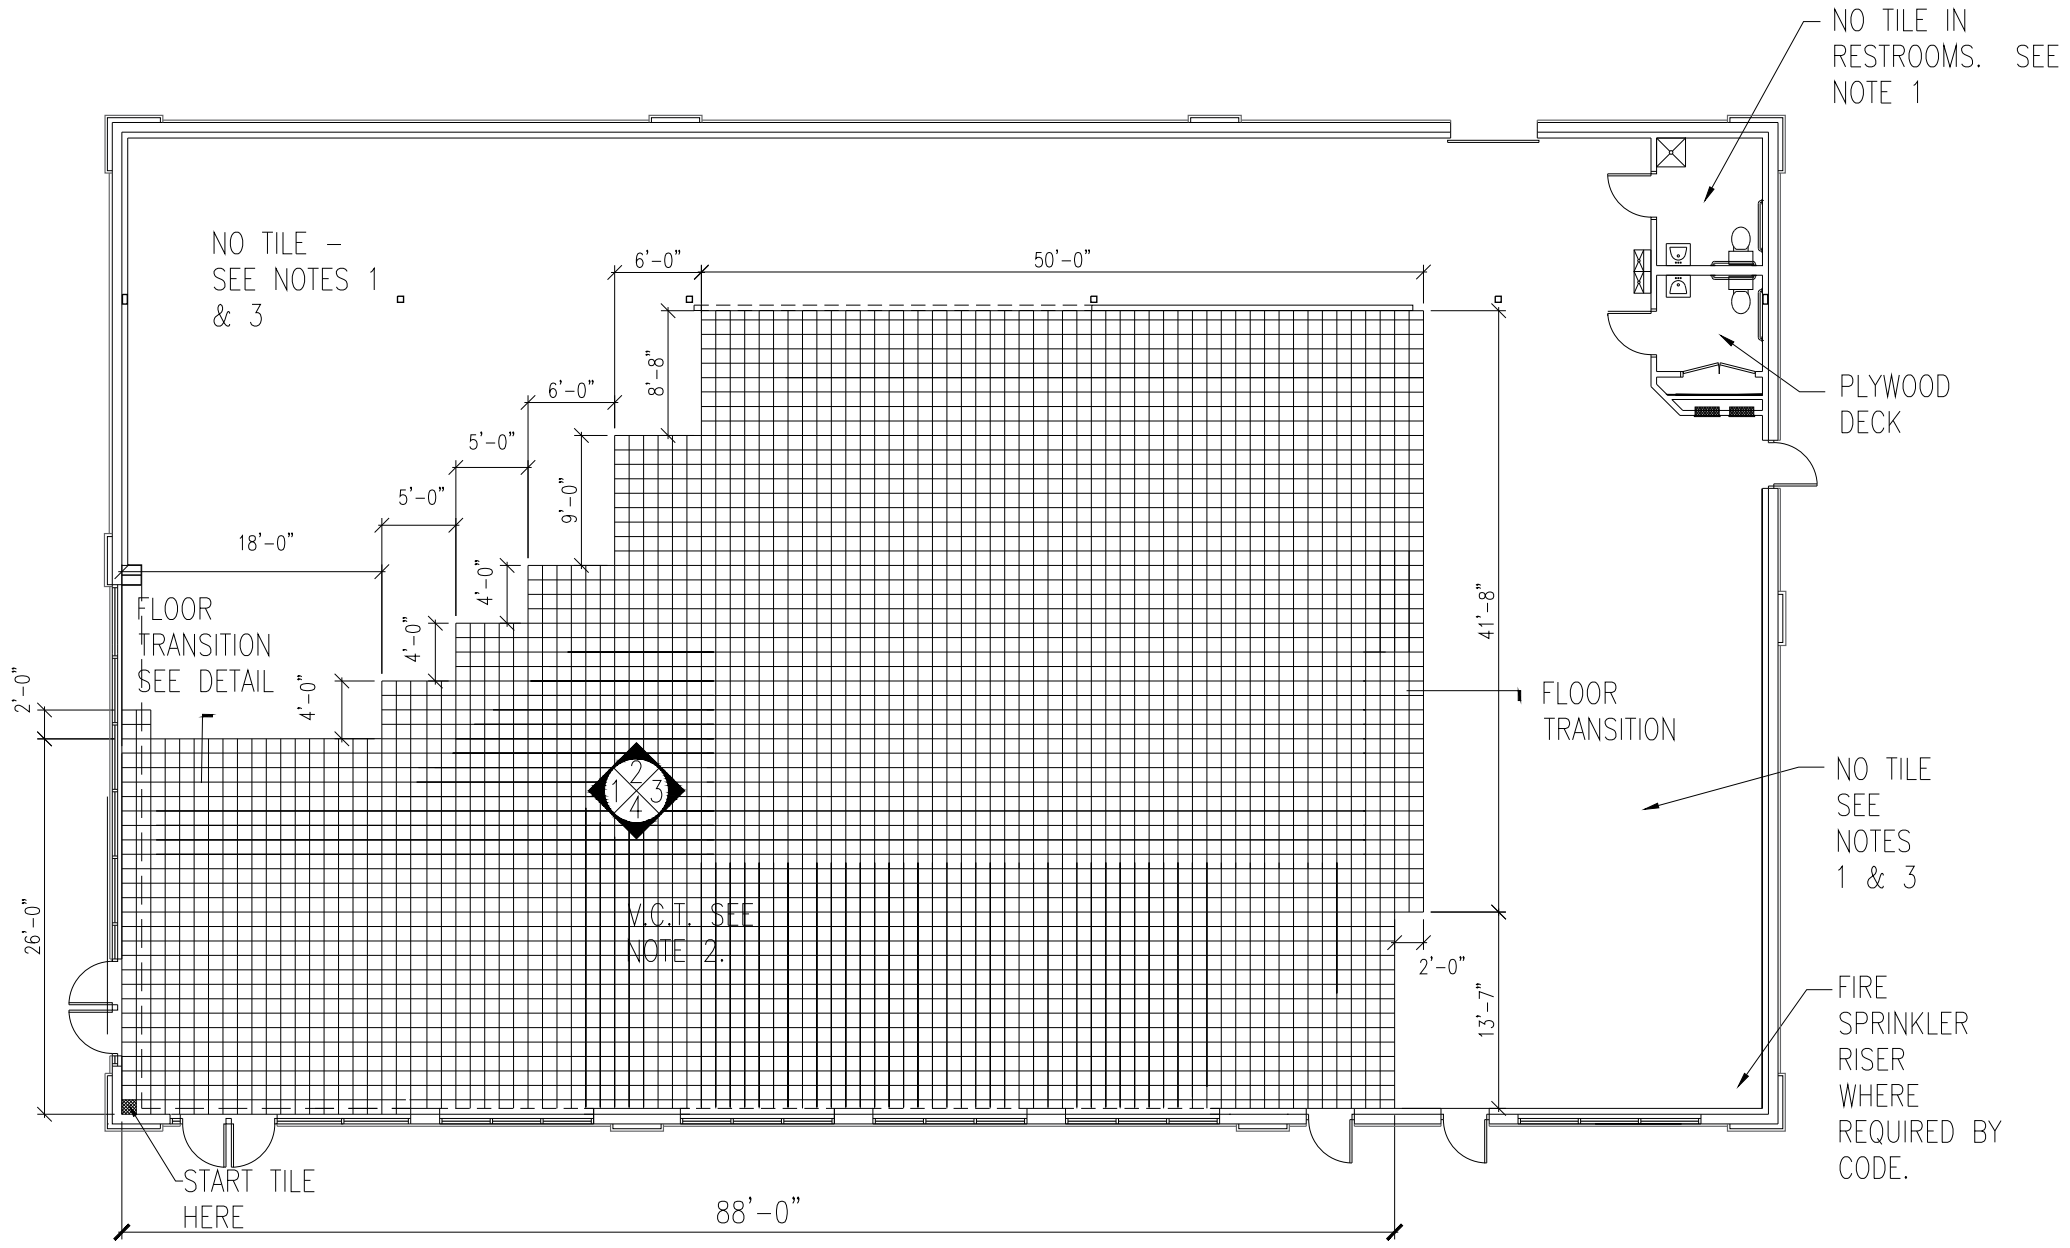

1. SEALED CONCRETE
2. 12" x 12" VINYL COMPOSITION FLOOR TILE
3. ALL GYPSUM BOARD WALLS TO RECIEVE 4" BLACK VINYL BASE
4. INSTALL BLACK NEOPRENE EDGE STRIP WHERE VINYL MEETS SEALED CONCRETE.

1/8" = 1'-0"

INTERIOR TILE PLAN

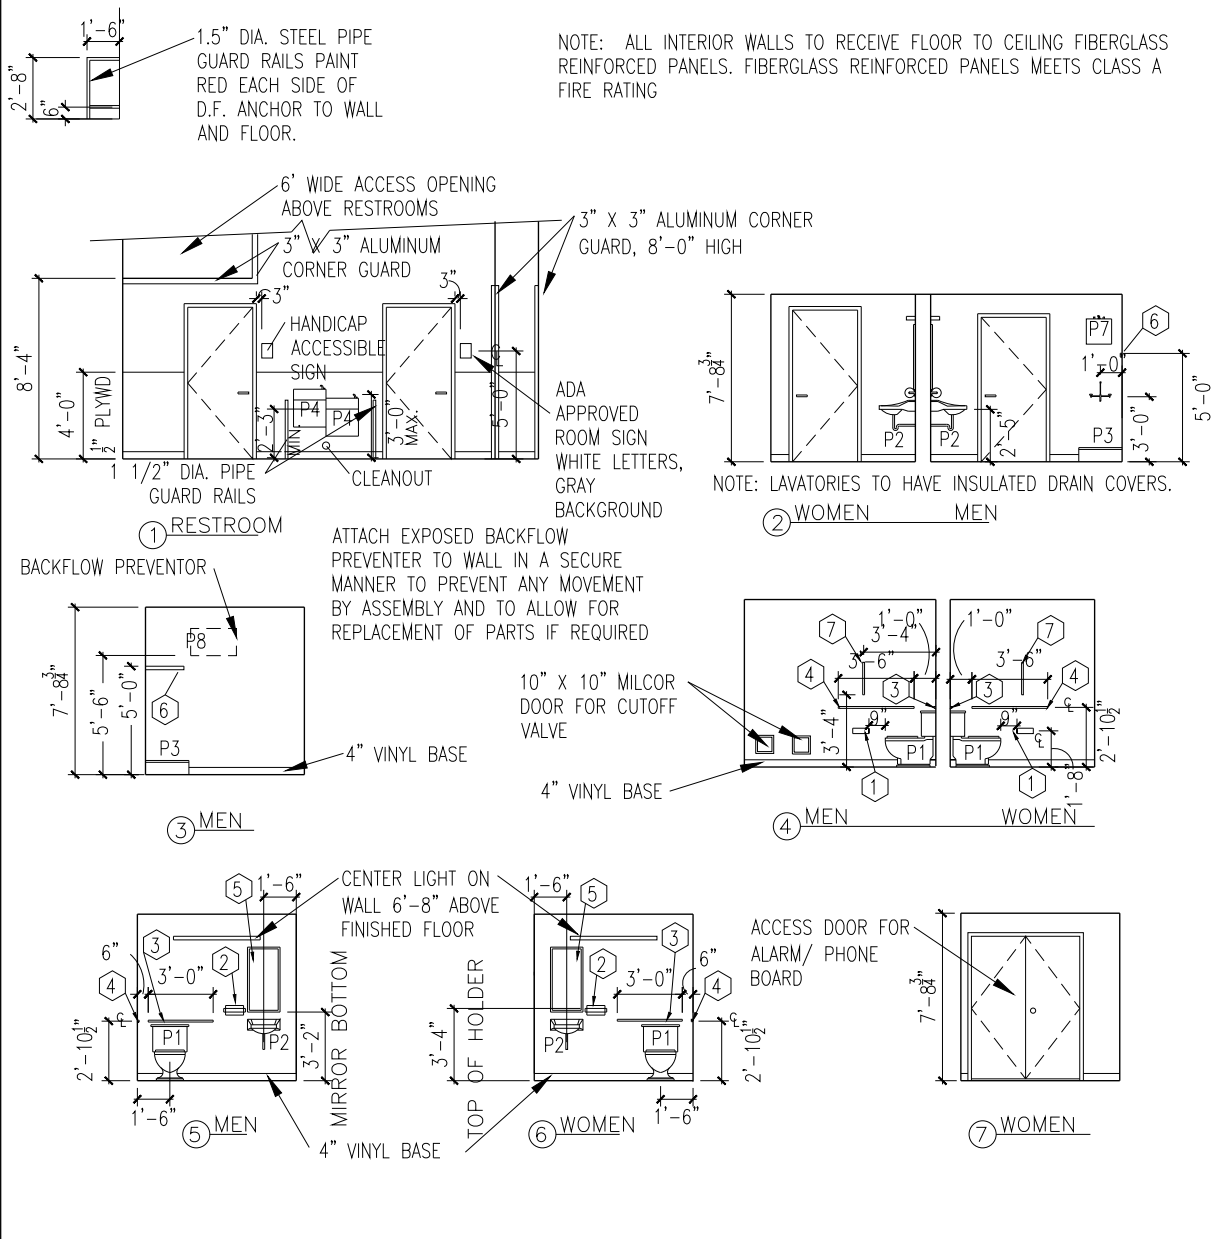

NOTE: ALL INTERIOR WALLS TO RECEIVE FLOOR TO CEILING FIBERGLASS REINFORCED PANELS. FIBERGLASS REINFORCED PANELS MEETS CLASS A FIRE RATING

NOTE: LAVATORIES TO HAVE INSULATED DRAIN COVERS.

ATTACH EXPOSED BACKFLOW PREVENTER TO WALL IN A SECURE MANNER TO PREVENT ANY MOVEMENT BY ASSEMBLY AND TO ALLOW FOR REPLACEMENT OF PARTS IF REQUIRED

3/16" = 1'-0" ABE01L

6 INTERIOR BATHROOM ELEVATIONS

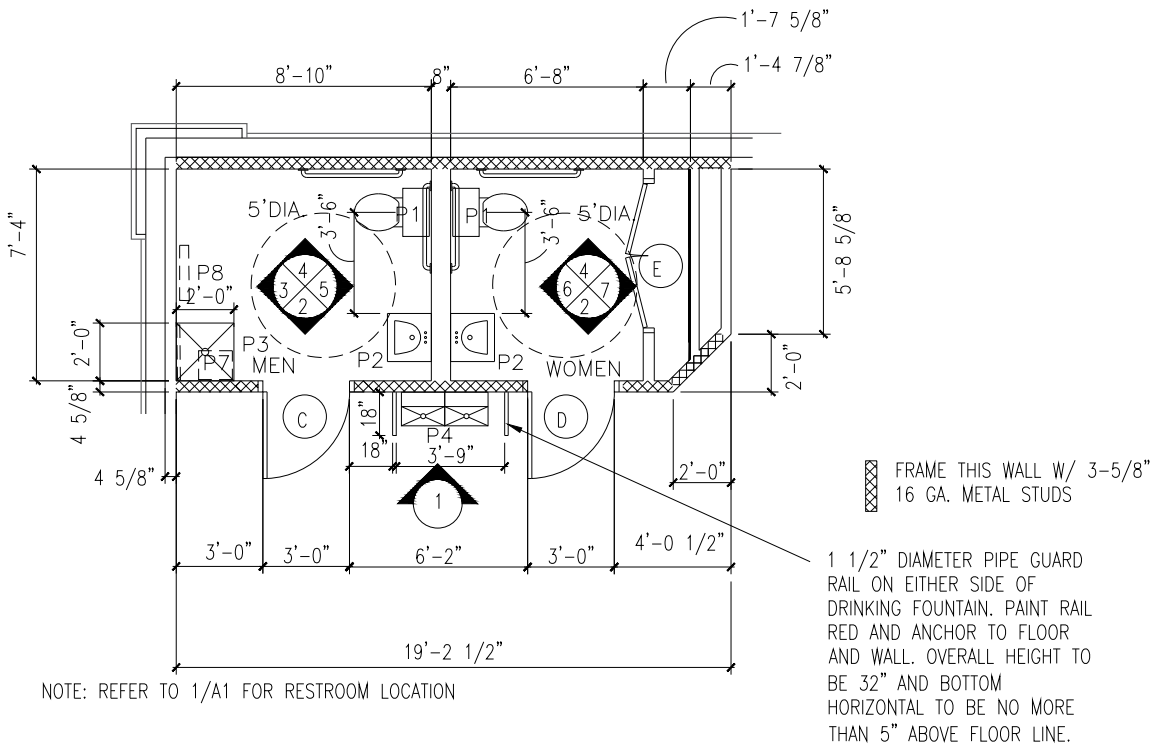
1'-7 5/8"
1'-4 7/8"
8'-10"
8"
6'-8"
7'-4"
5'DIA.
3'-6"
P1
P1
3'-6"
5'DIA.
P8
2'-0"
3 4 5 2
6 4 7 2
E
5'-8 5/8"
2'-0"
P3
MEN
P7
P2
P2
WOMEN
2'-0"
4 5/8"
C
18"
18"
P4
3'-9"
D
1
4 5/8"
2'-0"
3'-0"
3'-0"
6'-2"
3'-0"
4'-0 1/2"
19'-2 1/2"
FRAME THIS WALL W/ 3-5/8" 16 GA. METAL STUDS
1 1/2" DIAMETER PIPE GUARD RAIL ON EITHER SIDE OF DRINKING FOUNTAIN. PAINT RAIL RED AND ANCHOR TO FLOOR AND WALL. OVERALL HEIGHT TO BE 32" AND BOTTOM HORIZONTAL TO BE NO MORE THAN 5" ABOVE FLOOR LINE.

NOTE: REFER TO 1/A1 FOR RESTROOM LOCATION

1/4" = 1'-0" APB0165W2L

7 RESTROOM PLAN

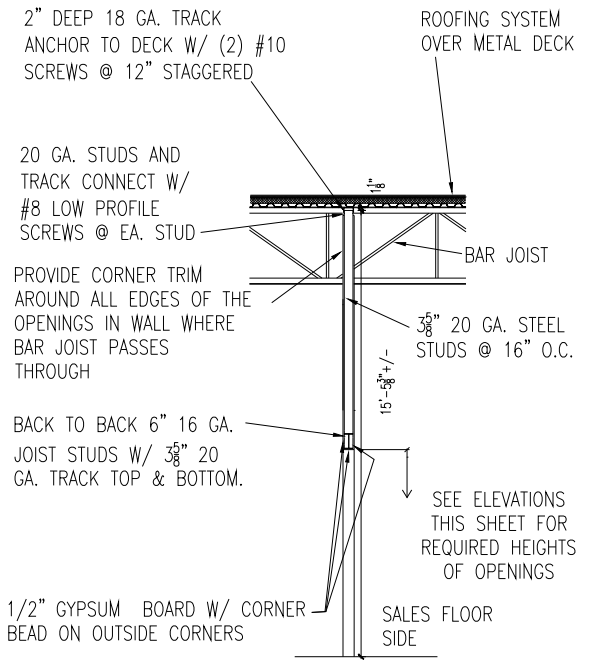
2" DEEP 18 GA. TRACK ANCHOR TO DECK W/ (2) #10 SCREWS @ 12" STAGGERED
ROOFING SYSTEM OVER METAL DECK
1 1/8"
20 GA. STUDS AND TRACK CONNECT W/ #8 LOW PROFILE SCREWS @ EA. STUD
BAR JOIST
PROVIDE CORNER TRIM AROUND ALL EDGES OF THE OPENINGS IN WALL WHERE BAR JOIST PASSES THROUGH
3 5/8" 20 GA. STEEL STUDS @ 16" O.C.
15'-5 3/8"+/-
BACK TO BACK 6" 16 GA. JOIST STUDS W/ 3 5/8" 20 GA. TRACK TOP & BOTTOM.
SEE ELEVATIONS THIS SHEET FOR REQUIRED HEIGHTS OF OPENINGS
1/2" GYPSUM BOARD W/ CORNER BEAD ON OUTSIDE CORNERS
SALES FLOOR SIDE

NOTE: INSTALL 6" WIDE, 20GA. METAL STRIP HORIZONTALLY BOTH SIDES OF WALL BEHIND GYP.BD. ATTACH TO HORIZONTAL TRACK AT 16" O.C. AND EACH STUD, CENTER OF STRIP TO BE 90" A.F.F.

1/4" = 1'-0" AIS047N2

2 CURTAIN WALL

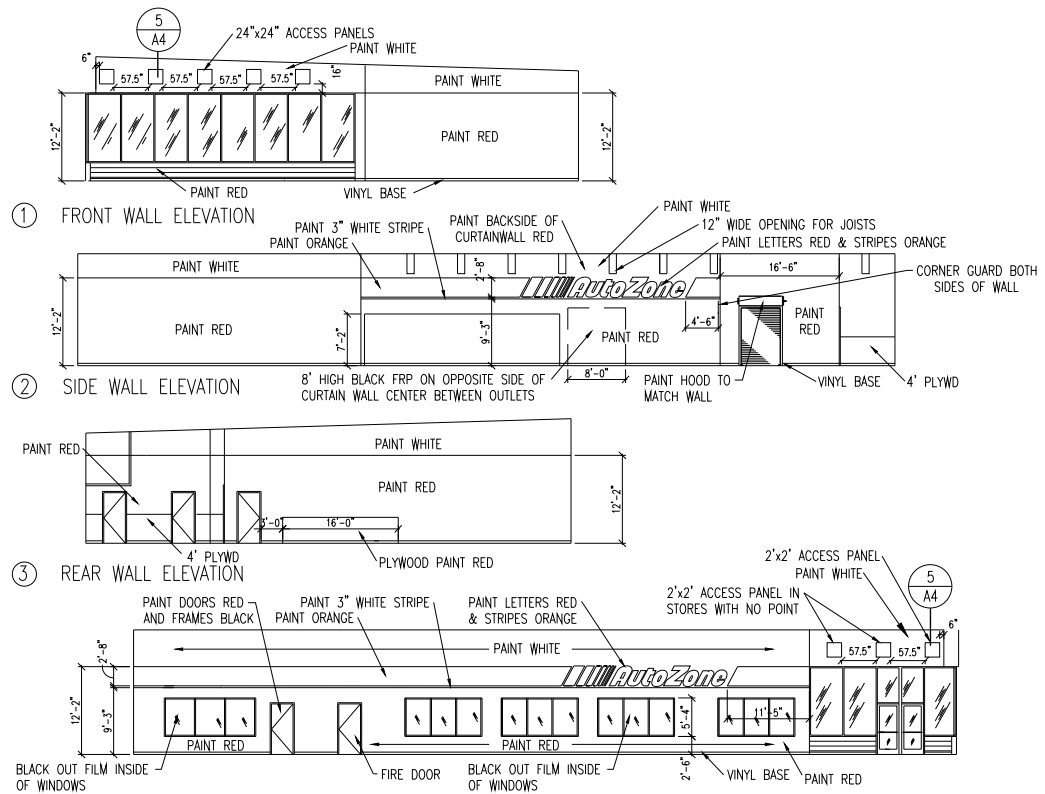

1/16" = 1'-0" AIE017n2L

3 INTERIOR ELEVATIONS


SEALED CONCRETE FLOOR
NEOPRENE REDUCER STRIP. COLOR TO BE BLACK. GLUE TO CONCRETE W/ 3M CONTACT CEMENT.
1/8"
1"
VINYL TILE OR SHEET VINYL FLOORING

FULL SIZE AIS01

4 TRANSITION STRIP


2'-0" x 2'-0" MILCOR ACCESS DOOR, PAINT TO MATCH SURROUNDING SURFACES.
2'-0"
LINE OF SOFFIT (TOP OF STOREFRONT)
1'-4"
SEE INTERIOR ELEVATIONS FOR LOCATION.

1/2" = 1'-0" AIS03

5 ACCESS PANEL SECTION

FIXTURES				ACCESSORIES			
P1	TOILET	P5	NOT USED	1	TOILET PAPER HOLDER	4	GRAB BAR 42" LONG 1-1/2" DIA.
P2	LAVATORY	P6	NOT USED	2	PAPER TOWEL HOLDER	5	MIRROR – 18"x36" H. FRAMED GLASS
P3	MOP SINK	P7	WATER HEATER	3	GRAB BAR 36" LONG 1-1/2" DIA.	6	MOP HOLDER
P4	ELECTRIC DRINKING FOUNTAIN	P8	BACKFLOW PREVENTOR			7	GRAB BAR 18" LONG 1-1/2" DIA.

1/8" = 1'-0" ABL01

8 RESTROOM LEGEND

TILE PLAN / INTERIOR ELEVATIONS / RESTROOM PLAN & ELEVATIONS

AutoZone Store No. 10702
325 NORTH MAIN ST
DALLAS OR 97338

REVISIONS			
1	REV1	4	REV4
2	REV2	5	REV5
3	REV3	6	REV6

ARCHITECTURAL GROUP INTERNATIONAL
15 West Seventh Street, Covington, KY 41011
P: 859.261.5400 F: 859.261.5530
www.agi-us.com
designing where you want

QUIN A. WICHMANN
3225
EXP. 12-31-25

09/01/25

7N2-L

A-4

GENERAL NOTES

1. STOREFRONT SHALL BE AS MANUFACTURED BY EITHER VISTAWALL ARCHITECTURAL PRODUCTS, YKK, OR U.S. ALUMINUM PRODUCTS AND SHALL BE 2" WIDE BY 4 1/2" DEEP. IMPACT FRAMING SHALL BE 2 1/2" WIDE BY 5" DEEP.

2. CONTRACTOR SHALL FIELD VERIFY ALL DIMENSIONS PRIOR TO BEGINNING FABRICATION OF THE FRAMING MEMBERS OR ORDERING GLASS. INSTALLATION SHALL CONFORM TO ALUMINUM MANUFACTURER'S PRINTED SHOP DRAWINGS AND INSTRUCTIONS.

3. STEEL CLIPS AND ANCHORS SHALL BE HOT ROLLED STEEL A-36 ALLOY WITH A MINIMUM OF ONE COAT OF ZINC CHROMATE PRIMER.

4. ALL FASTENERS SHALL BE ZINC OR CADMIUM PLATED OR NON-MAGNETIC STAINLESS STEEL. ALL FASTENERS IN EXPOSED AREAS ARE TO BE PAINTED TO MATCH FINISH OF ALUMINUM.

5. FINISH OF ALUMINUM CLADDING AND FORMED ALUMINUM SHAPES SHALL MATCH THE FINISH OF ADJACENT EXTRUDED ALUMINUM.

6. MITERING AND NOTCHING OF INTERIOR TRIM IS TO BE DONE IN THE FIELD.

1" = 1'-0" ASN01

10 STOREFRONT NOTES


20 PSF MIN
30 PSF WIND UP OF 15 PSF WIND DOWN
140 PLF TO STOREFRONT
VERTICALLY SLOT BOTTOM TO ALLOW FOR 2" MOVEMENT

NOTES:

AWNING SHALL BE DESIGNED FOR A MINIMUM OF W/SL OF 20 PSF MIN. UPLIFT WIND ON SLOPE OF 30 PSF DOWNWARD WIND ON SLOPE OF 15 PSF.

AWNING MANUFACTURER RESPONSIBLE FOR DESIGN OF CONNECTIONS TO LIGHT GAGE FRAMING AT TOP AND STOREFRONT AT BOTTOM. BOTTOM CONNECTION SHALL ALLOW FOR VERTICLE MOVEMENT OF 2".

STOREFRONT SHALL BE DESIGNED FOR HORIZONTAL REACTION OF 140 PLF IN BOTH DIRECTIONS AT BASE OF AWNING.

MA-1 / NTS

10 AWNING LOAD SPECIFICATIONS

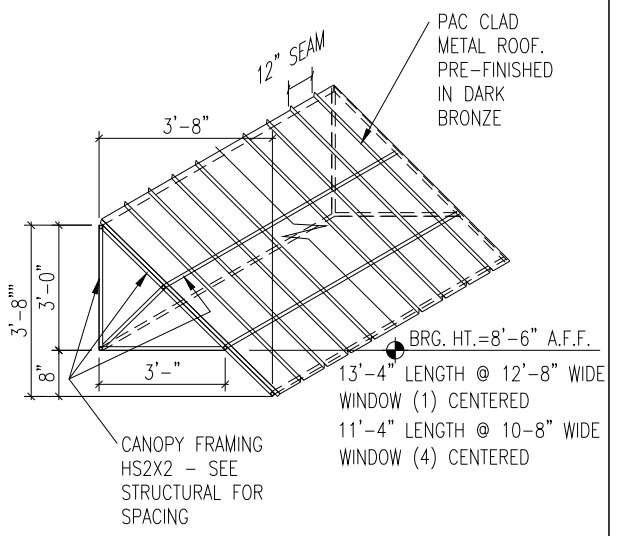
12" SEAM
PAC CLAD METAL ROOF. PRE-FINISHED IN DARK BRONZE
3'-8"
3'-8""
3'-0"
8"
3'-"
BRG. HT.=8'-6" A.F.F.
13'-4" LENGTH @ 12'-8" WIDE WINDOW (1) CENTERED
11'-4" LENGTH @ 10-8" WIDE WINDOW (4) CENTERED
CANOPY FRAMING HS2X2 - SEE STRUCTURAL FOR SPACING

NOTE:
CONTRACTOR TO PROVIDE SHOP DRAWINGS OF METAL CANOPY AND STRUCTURE FOR APPROVAL PRIOR TO INSTALLATION.

MA-1 / NTS

9 STANDING SEAM METAL AWNING DET.

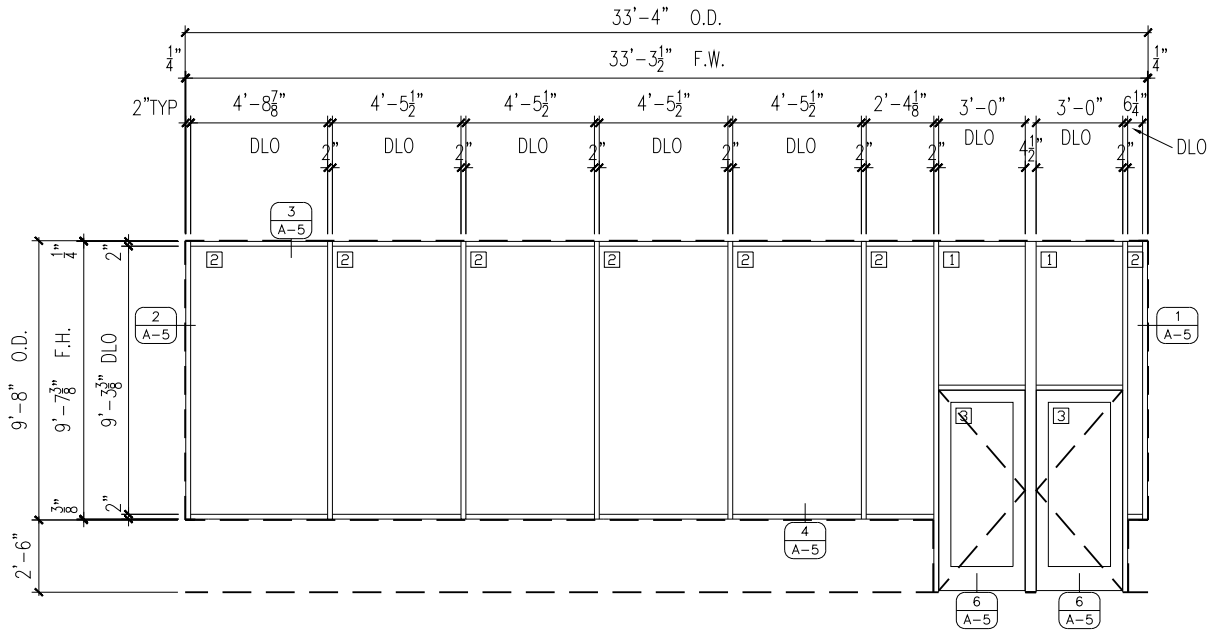

ELEVATION 1

SHGD 0.22, PF 0.03, VT 0.54



10'-8" WIDE LOW WINDOW

SHGD 0.22, PF 0.03, VT 0.54

SHGD 0.22, PF 0.03, VT 0.54

GLAZING SCHEDULE

- ⊟ 1" INSULATED TEMPERED
- ⊟ 1" INSULATED
- ⊟ 1/4" TEMPERED

FRAMING / DOOR FINISH

DOORS - CLEAR ANODIZED

FRAMING - 2"x 4 1/2" ALUMINUM PAINTED RED SHERWIN-WILLIAMS SL4A207 w/ CLEAR TOP COAT

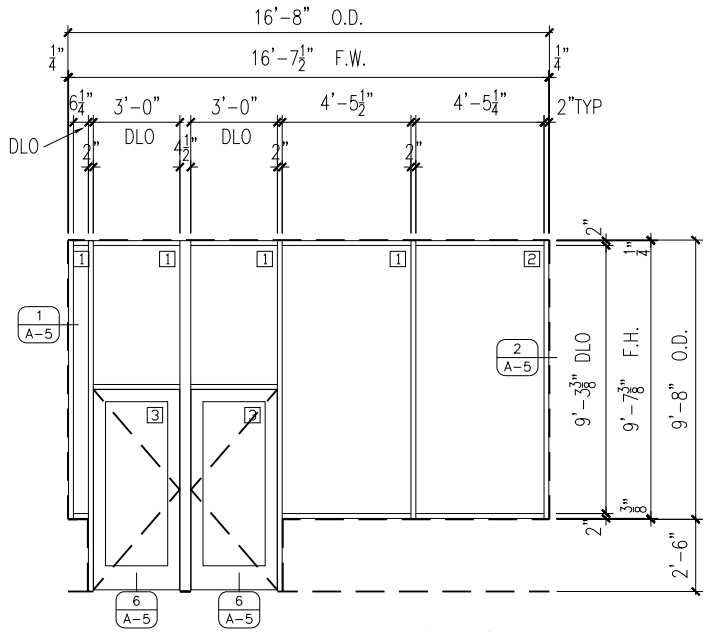

ELEVATION 2

SHGD 0.22, PF 0.03, VT 0.54



12'-8" WIDE LOW WINDOW

SHGD 0.22, PF 0.03, VT 0.54

1/4" = 1'-0" ASE017n2L

7 STOREFRONT ELEVATION

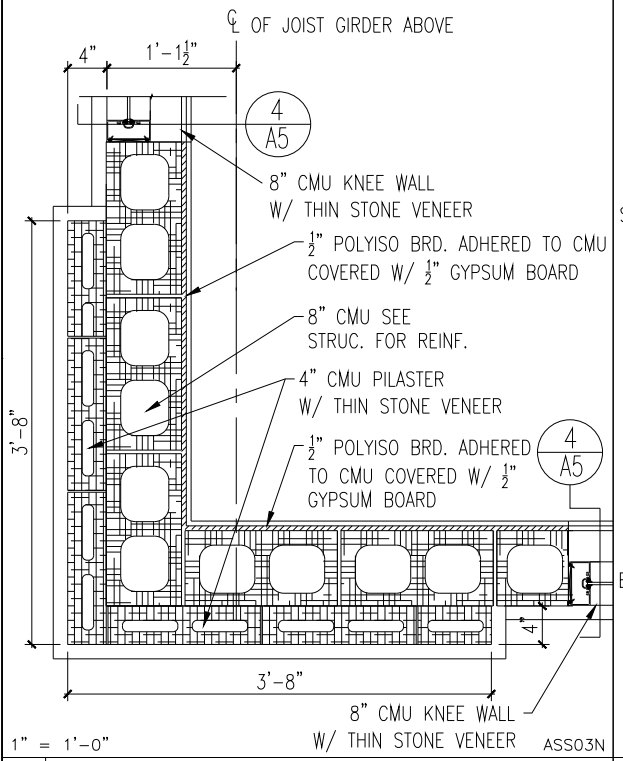
℄ OF JOIST GIRDER ABOVE
4"
1'-1½"
4
A5
8" CMU KNEE WALL W/ THIN STONE VENEER
½" POLYISO BRD. ADHERED TO CMU COVERED W/ ½" GYPSUM BOARD
8" CMU SEE STRUC. FOR REINF.
4" CMU PILASTER W/ THIN STONE VENEER
½" POLYISO BRD. ADHERED TO CMU COVERED W/ ½" GYPSUM BOARD
3'-8"
3'-8"
4"
8" CMU KNEE WALL W/ THIN STONE VENEER

1" = 1'-0" ASS03N

1 JAMB DETAIL @ STOREFRONT CORNER

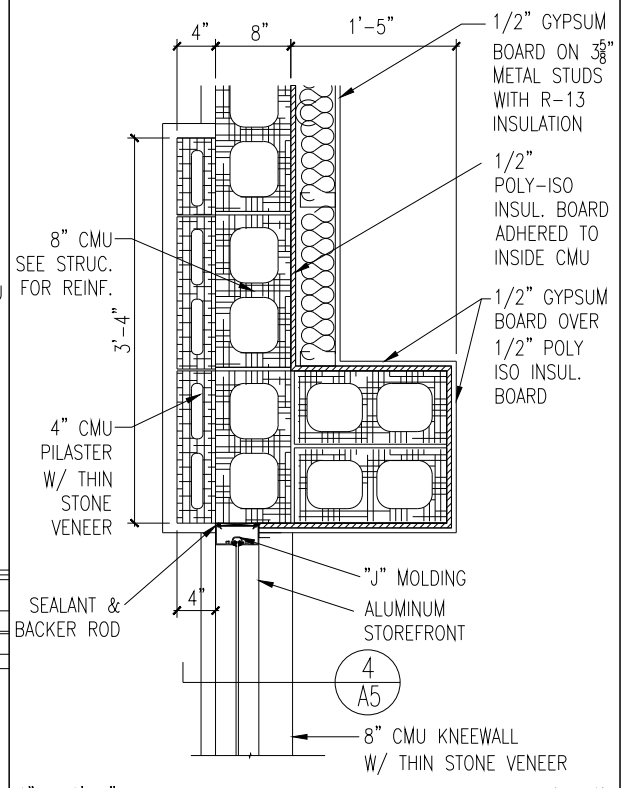
4"
8"
1'-5"
1/2" GYPSUM BOARD ON 3⅝" METAL STUDS WITH R-13 INSULATION
1/2" POLY-ISO INSUL. BOARD ADHERED TO INSIDE CMU
8" CMU SEE STRUC. FOR REINF.
1/2" GYPSUM BOARD OVER 1/2" POLY ISO INSUL. BOARD
3'-4"
4" CMU PILASTER W/ THIN STONE VENEER
SEALANT & BACKER ROD
4"
"J" MOLDING
ALUMINUM STOREFRONT
4
A5
8" CMU KNEEWALL W/ THIN STONE VENEER

1" = 1'-0" ASS01N

2 JAMB / PILASTER DETAIL

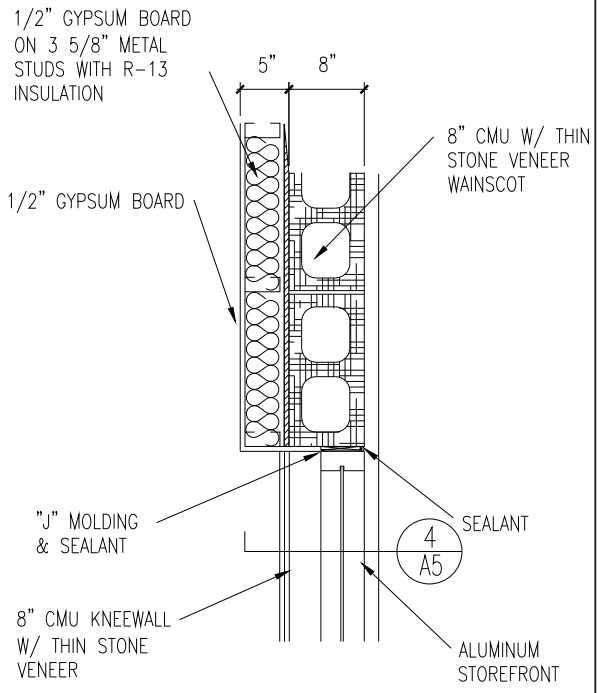
1/2" GYPSUM BOARD ON 3 5/8" METAL STUDS WITH R-13 INSULATION
5"
8"
8" CMU W/ THIN STONE VENEER WAINSCOT
1/2" GYPSUM BOARD
"J" MOLDING & SEALANT
SEALANT
4
A5
8" CMU KNEEWALL W/ THIN STONE VENEER
ALUMINUM STOREFRONT

1" = 1'-0" ASS02N

3 JAMB DETAIL

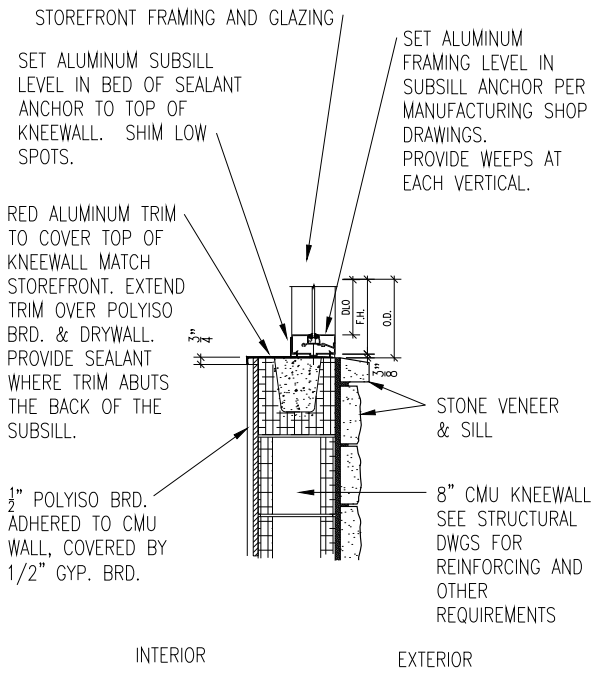
STOREFRONT FRAMING AND GLAZING
SET ALUMINUM SUBSILL LEVEL IN BED OF SEALANT ANCHOR TO TOP OF KNEEWALL. SHIM LOW SPOTS.
SET ALUMINUM FRAMING LEVEL IN SUBSILL ANCHOR PER MANUFACTURING SHOP DRAWINGS. PROVIDE WEEPS AT EACH VERTICAL.
RED ALUMINUM TRIM TO COVER TOP OF KNEEWALL MATCH STOREFRONT. EXTEND TRIM OVER POLYISO BRD. & DRYWALL. PROVIDE SEALANT WHERE TRIM ABUTS THE BACK OF THE SUBSILL.
DLO
F.H.
O.D.
¾"
⅜"
STONE VENEER & SILL
½" POLYISO BRD. ADHERED TO CMU WALL, COVERED BY 1/2" GYP. BRD.
8" CMU KNEEWALL SEE STRUCTURAL DWGS FOR REINFORCING AND OTHER REQUIREMENTS
INTERIOR
EXTERIOR

1" = 1'-0" ASS04

4 SILL DETAIL / KNEEWALL

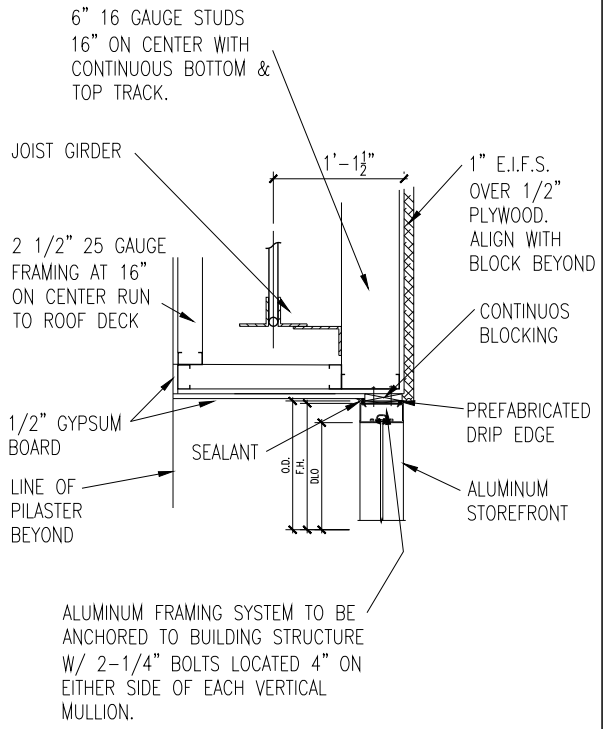
6" 16 GAUGE STUDS 16" ON CENTER WITH CONTINUOUS BOTTOM & TOP TRACK.
JOIST GIRDER
1'-1½"
1" E.I.F.S. OVER 1/2" PLYWOOD. ALIGN WITH BLOCK BEYOND
2 1/2" 25 GAUGE FRAMING AT 16" ON CENTER RUN TO ROOF DECK
CONTINUOS BLOCKING
1/2" GYPSUM BOARD
SEALANT
PREFABRICATED DRIP EDGE
O.D.
F.H.
DLO
LINE OF PILASTER BEYOND
ALUMINUM STOREFRONT
ALUMINUM FRAMING SYSTEM TO BE ANCHORED TO BUILDING STRUCTURE W/ 2-1/4" BOLTS LOCATED 4" ON EITHER SIDE OF EACH VERTICAL MULLION.

1" = 1'-0" ASS037n2

5 HEAD SECTION @ STOREFRONT


DLO
ALUMINUM DOOR BOTTOM
D.S. = 7'-0"
10"
ALUMINUM THRESHOLD SET IN A BED OF SEALANT ANCHOR PER MANUFACTURER'S PRINTED INSTRUCTIONS.
¾"
½"

3" = 1'-0" ASS05

6 THRESHOLD DETAIL

REVISIONS	
1	4
2	5
3	6

AutoZone Store No. 10702
325 NORTH MAIN ST
DALLAS OR 97338

STOREFRONT / VESTIBULE PLAN / DETAILS

ARCHITECTURAL GROUP INTERNATIONAL
15 West Seventh Street, Covington, KY 41011
P: 859.261.5400 F: 859.261.5530
www.agi-us.com
designing where you want

REGISTERED ARCHITECT
QUIN A. WICHMANN
3225
COVINGTON, KY
EXP. 12-31-25
STATE OF OREGON

09/01/25

7N2-L

A-5