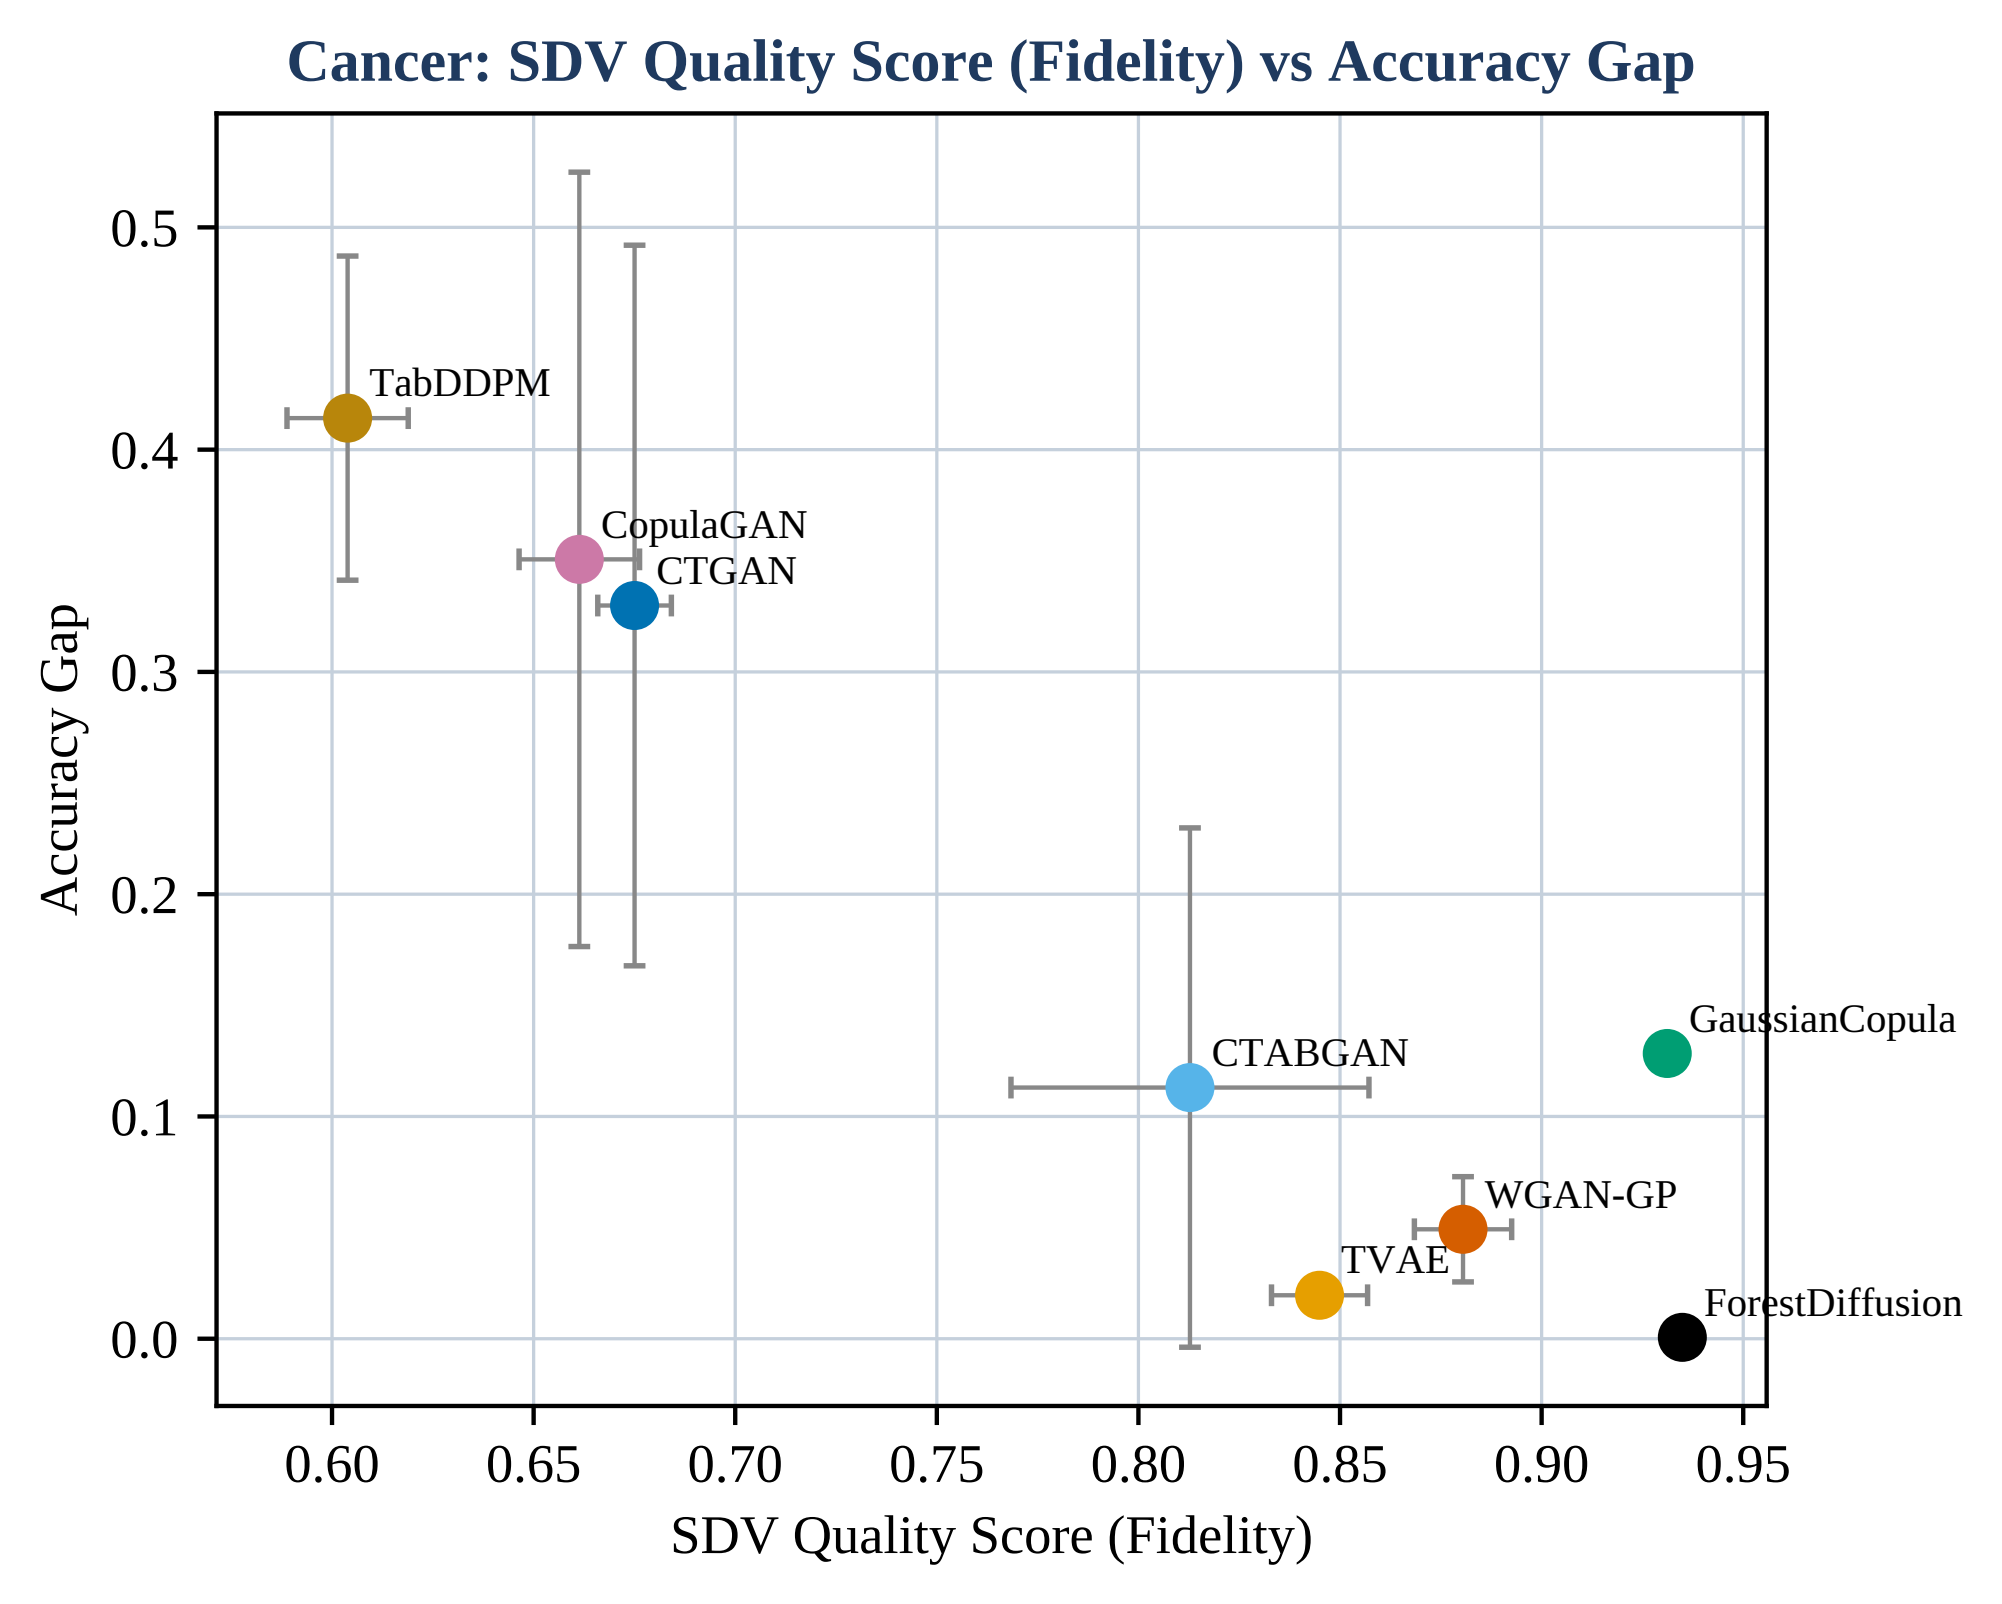
Cancer: SDV Quality Score (Fidelity) vs Accuracy Gap
Accuracy Gap
SDV Quality Score (Fidelity)
0.0
0.1
0.2
0.3
0.4
0.5
0.60
0.65
0.70
0.75
0.80
0.85
0.90
0.95
TabDDPM
CopulaGAN
CTGAN
CTABGAN
GaussianCopula
WGAN-GP
TVAE
ForestDiffusion