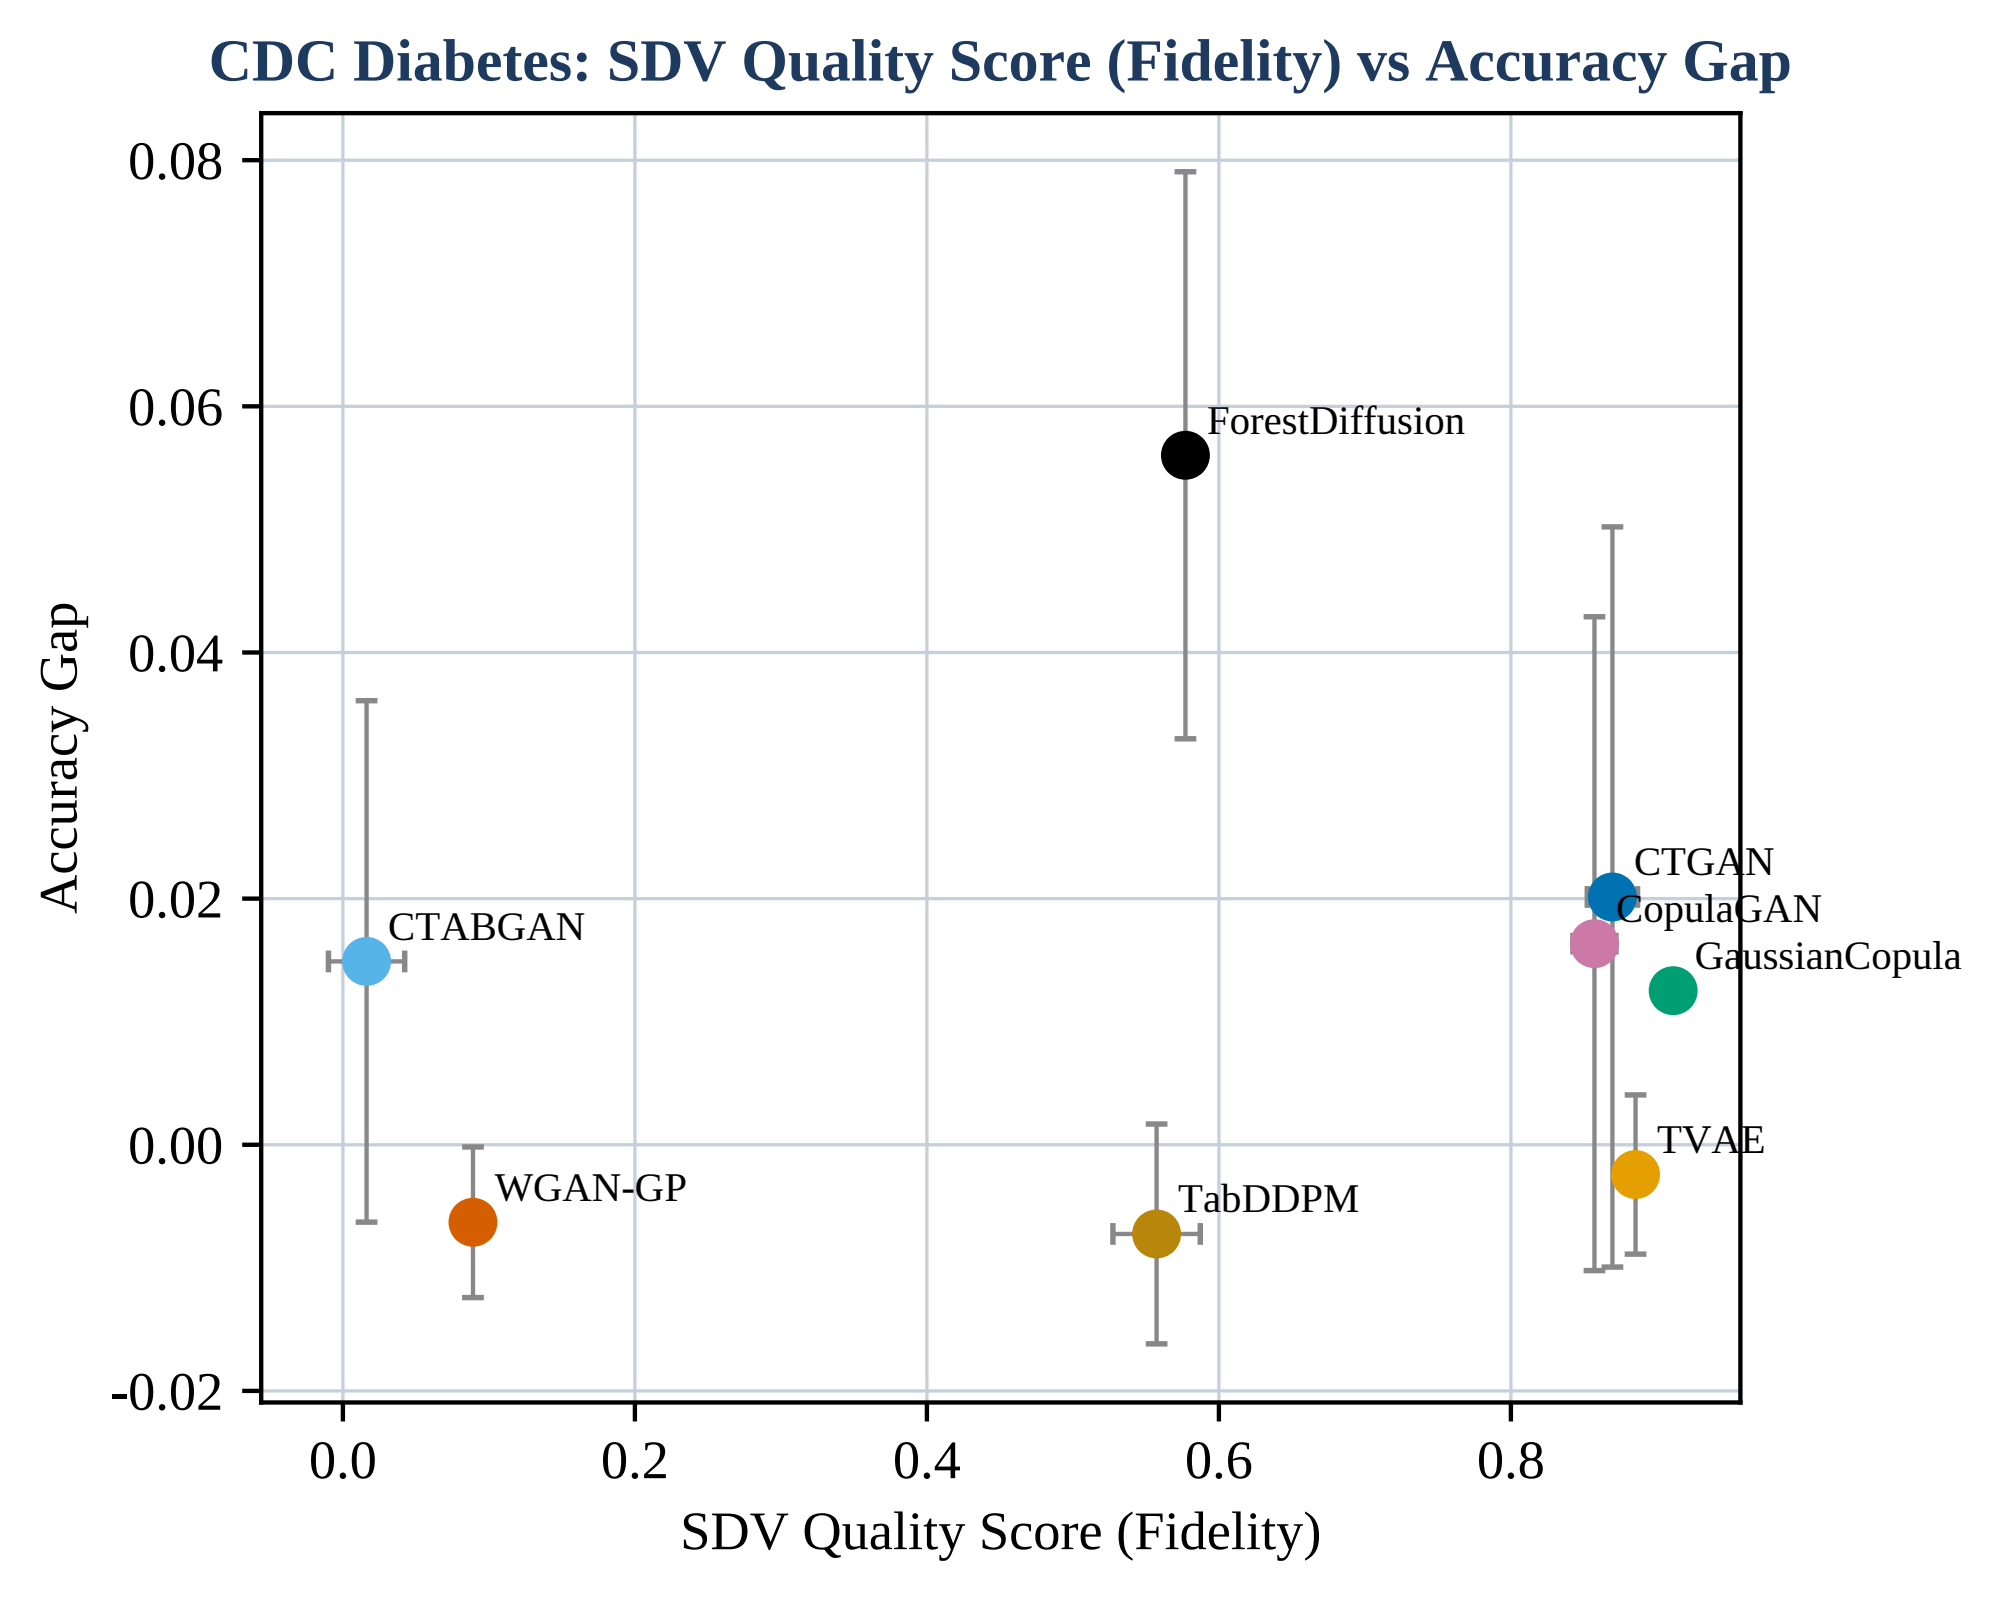
CDC Diabetes: SDV Quality Score (Fidelity) vs Accuracy Gap
Accuracy Gap
SDV Quality Score (Fidelity)
0.08
0.06
0.04
0.02
0.00
-0.02
0.0
0.2
0.4
0.6
0.8
ForestDiffusion
CTABGAN
WGAN-GP
TabDDPM
CTGAN
CopulaGAN
GaussianCopula
TVAE