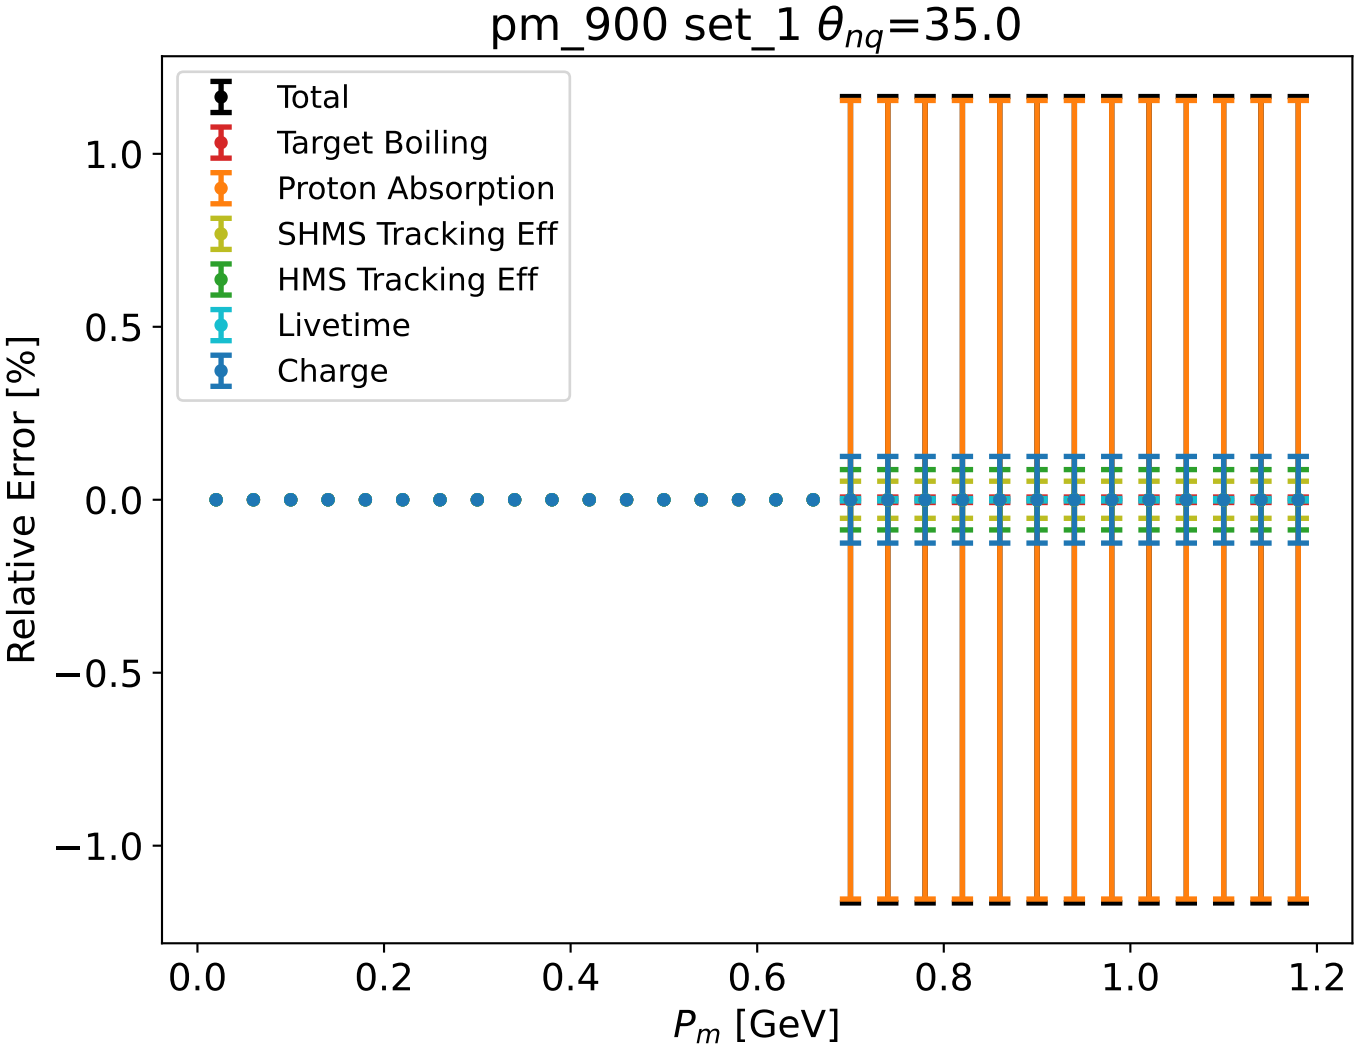
pm_900 set_1 θ_{nq}=35.0
Total
Target Boiling
Proton Absorption
SHMS Tracking Eff
HMS Tracking Eff
Livetime
Charge
Relative Error [%]
1.0
0.5
0.0
−0.5
−1.0
0.0
0.2
0.4
0.6
0.8
1.0
1.2
P_m [GeV]