

Livrable N° 26 12 19-1.0 - Transformateur à l'huile sur socle 26 12 19 - Électricité - transformateur à l'huile, sur socle, moyenne tension





Révision	0	Gestionnaire de livrable	Pascale Côté (POMERLEAU INC.)
Statut	Ouvert	Date de création	15 juin, 2023
		Section du devis	26 12 19 - Électricité - transformateur à l'huile, sur socle, moyenne tension
Responsable Contractor	CLAUDE MIVILLE INC.	Reçu de	
		Soumettre avant	
Date d'échéance finale	6 sept., 2023	Délai	
		Code de coût	
Lieu		Type	1 - FR
Approbateurs	Kariane Rattie (POMERLEAU INC.), Pascal Mc Elhaw (BOUTHILLETTE PARIZEAU INC.)		
Responsable	Pascal Mc Elhaw (BOUTHILLETTE PARIZEAU INC.)		
Copie À	Simon Gaudreault (POMERLEAU INC.), Carl Veilleux (POMERLEAU INC.)		
Description			
LEED	Non		

Flux de travail de livrable

Nom	Date d'envoi	Date d'échéance	Date de retour	Réponse
Pièces jointes d'information générale				
Marie-Michèle Laliberté		22 juin, 2023	23 août, 2023	Soumis DA50 - 26 12 19 - Transformateur à l'huile, sur socle, moyenne tension.pdf
Kariane Rattie	23 août, 2023	24 août, 2023	23 août, 2023	Reçu et transmis pour commentaires
Pascal Mc Elhaw	23 août, 2023	6 sept., 2023		En attente



DWG. NO. ZGS2000-230817-01

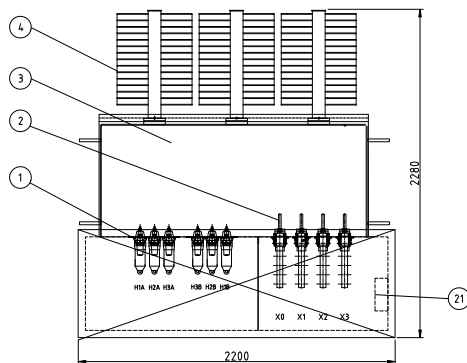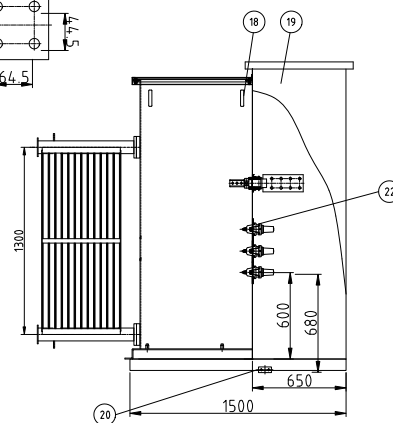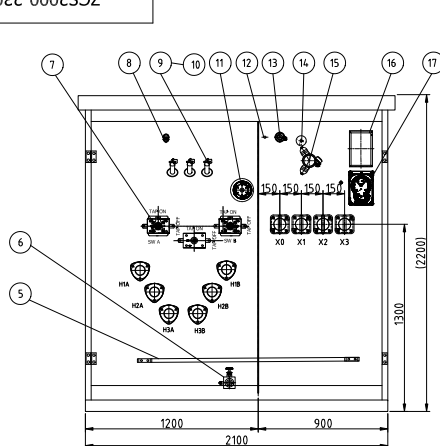


TECHNICAL DATA	
RATING	2000kVA
PRIMARY VOLTAGE	24940V
SECONDARY VOLTAGE	600V/346V
FREQUENCY	60Hz
VECTOR GROUP	Dyn1
WINDING MATERIAL	Aluminum
LOAD LOSS AT RATED VOLTAGE	19500W Td -8%~+10%
NO LOAD LOSSES	2650W Td -12%~+15%
IMPEDANCE	5.75% Tol±10%
ALTITUDE	≤1000m
No. OF TAPPOSITION	5
COLOR	Green
CORE FORM	Three-phase three column
INSULATING OIL	<2PPM PCB
FLUID	MINERAL OIL

ITEM	WEIGHT(Kg)
TANK & ACCESSORIES	4280
TOTAL OIL WEIGHT	1440
TOTAL WEIGHT	5720

ITEM	FITTINGS AND DESCRIPTIONS	QTY
1	HIGH VOLTAGE BUSHING (25KV,200A), Cooper	6
2	LV bushing (1.0KV 2500A)	4
3	TANK AND COVER ASSEMBLY	1
4	RADIATORS	3
5	Grounding copper bar	1
6	Oil drain valve (DN25)	1
7	Load Switch	3
8	Oil fill valve	1
9	High voltage backup current-limiting fuse 38KV140A	3
10	High voltage overload fuse 38KV,65A	3
11	Tap changer	1
12	Vent valve	1
13	Pressure relief device	1
14	Vacuum manometer (YZ-70)	1
15	Oil level Indicator (YZF-90)	1
16	Name plate	1
17	OIL THERMOMETER (BWY-803A)	1
18	LIFTING LUGS	4
19	Front compartment	1
20	Ground Stainless steel	1
21	Terminal box	1
22	Single-pass bushing insert(25KV,200A), Cooper	6

TYPE ZGSL-H-2000/24.94/0.6				DWG. NAME General Assembly Drawing			
DRAWN	CHECKED	CHECKED	APPROVED	FIRST ANGLE PROJECTION	SCALE	1	REV. NO.
Mike W	Irls J	Ells W	Sam				
ZGS2000-230817-01							

CHANGE

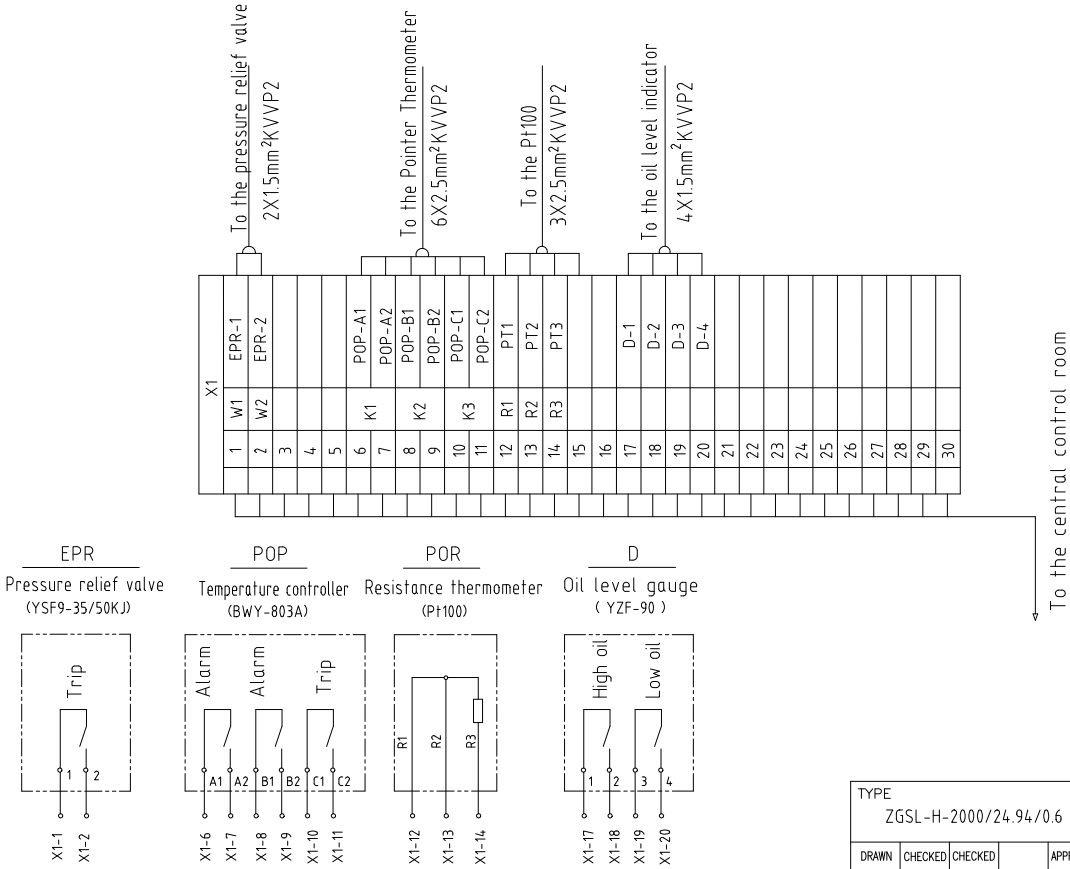

TYPE ZGSL-H-2000/24.94/0.6				DWG. NAME Transformer Secondary Diagram			
DRAWN	CHECKED	CHECKED	APPROVED	FIRST ANGLE PROJECTION	SCALE	1/3	REV. NO.
Mike W	Iris J	Ellia W	Sam	REF. DWG. NO.	DWG. NO. ZGS2000-230817-01		△

NOTE:
1.ALL DIMENSIONS ARE IN MILLIMETERS
2.MATERIAL:STAINLESS STEEL
3 THICKNESS :1mm
4.LETTER COLOR: BLACK

