

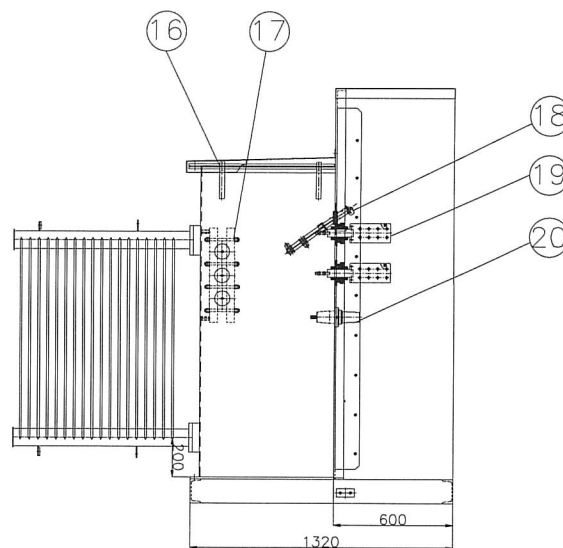


DWG. NO. ZGS1500-230727-02

Because of high current,
double fuse is used in parallel

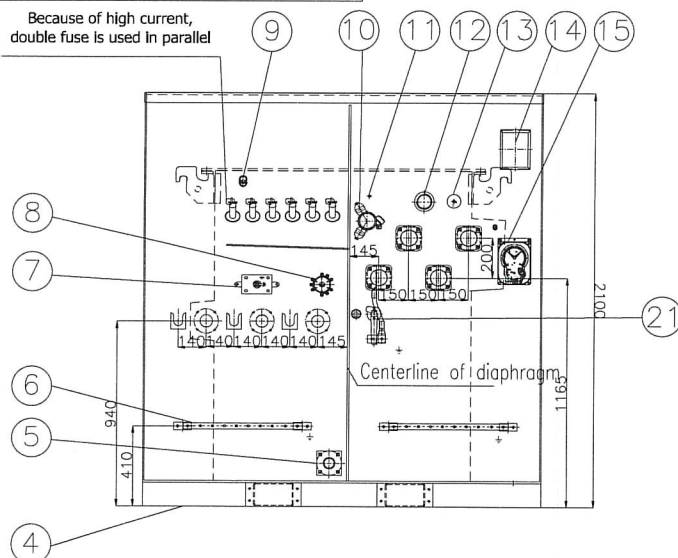

ITEM	WEIGHT(Kg)
Body weight	1760
Tank & accessories	1370
Total oil weight	1020
Total weight	4150

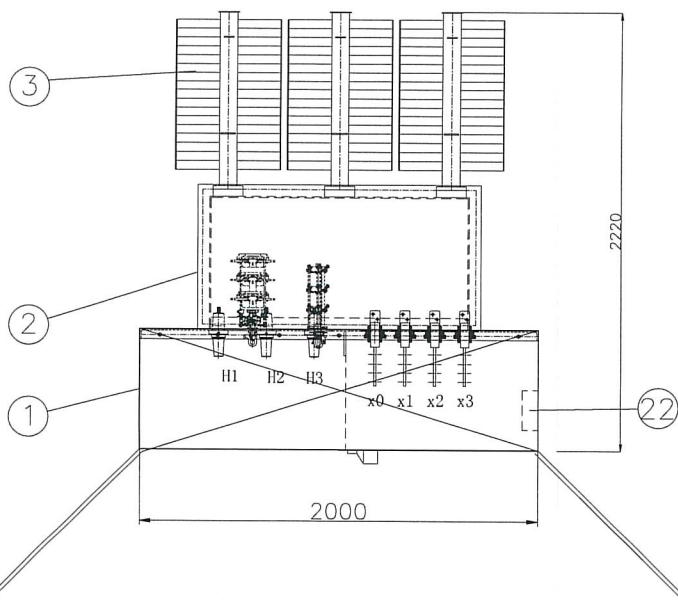

TECHNICAL DATA	
RATING	1500kVA
PRIMARY VOLTAGE	4160V
SECONDARY VOLTAGE	480Y/277V
FREQUENCY	60Hz
VECTOR GROUP	Dyn1
WINDING MATERIAL	Copper
LOAD LOSS AT RATED VOLTAGE	14500W Tol +5%
NO LOAD LOSSES	2000W Tol +5%
IMPEDANCE	5.75% Tol+10%
ALTITUDE	≤1000m
No. OF TAPPOSITION	4 (±2.5%)
COLOR	Musell Green
CORE FORM	Three-phase three column
INSULATING OIL	<2PPM PCB
FLUID	MINERAL OIL

ITEM	FITTINGS AND DESCRIPTIONS	QTY
1	Front compartment	1
2	Tank and cover assembly	1
3	Radiators (PC1000-18/520)	3
4	Base	1
5	Oil drain valve(DN50)	1
6	Ground Stainless steel	7
7	Load Switch	1
8	Tap changer	1
9	OIL FILL VALVE	1
10	Oil-level indicator(YZF-90)	1
11	Vent valve	1
12	Pressure relief device(YZF-35/50 KJ)	1
13	Vacuum monometer(YZ-70)	1
14	Name plate	1
15	OIL THERMOMETER(BWY-803A)	1
16	LIFTING LUGS	4
17	High voltage backup current-limiting fuse 2x250A	6
18	High voltage overload fuse 2X125A	6
19	LV BUSHING (1.0KV 2000A)	4
20	600 A 15 kV Class BOL-T deadbreak connector	3
21	Lock	1
22	Terminal box	1

TYPE
ZGS-Z-1500/4.16/0.48



DWG. NAME
General Assembly Drawing

DRAWN	CHECKED	CHECKED	APPROVED	FIRST ANGLE PROJECTION	SCALE	1/25	REF. DWG. NO.	REV. NO.
Mike Wang	Iris Ji	Ella Wei	Sara					
							DWG. NO.	
							ZGS1500-230727-02	



DWG.
NO.


ZGS1500-230727-02

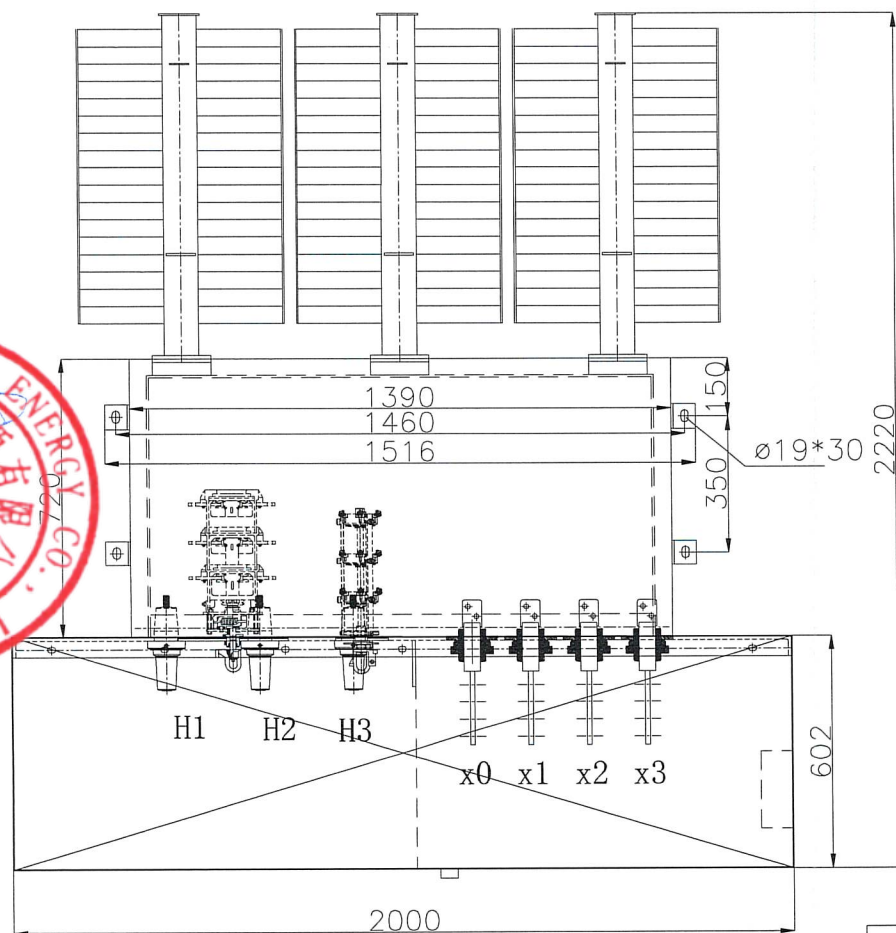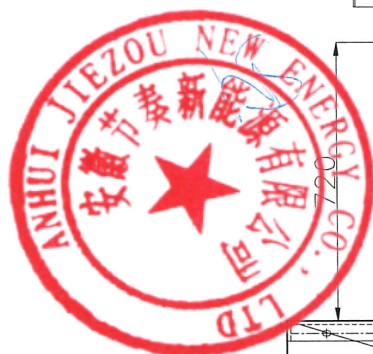

TYPE ZGS-Z-1500/4.16/0.48				DWG. NAME Base Structure Drawing			
DRAWN	CHECKED	CHECKED		APPROVED	FIRST ANGLE PROJECTION	SCALE	1/25
Mike Wang	Iris Ji	Ella Wei		Som	REF. DWG. NO.	 JIEZOU POWER	REV. NO.
					DWG. NO.	ZGS1500-230727-02	

NOTE:

- 1.ALL DIMENSIONS ARE IN MILLIMETERS
- 2.MATERIAL:STAINLESS STEEL
- 3.THICKNESS :1mm
- 4.LETTER COLOR: BLACK

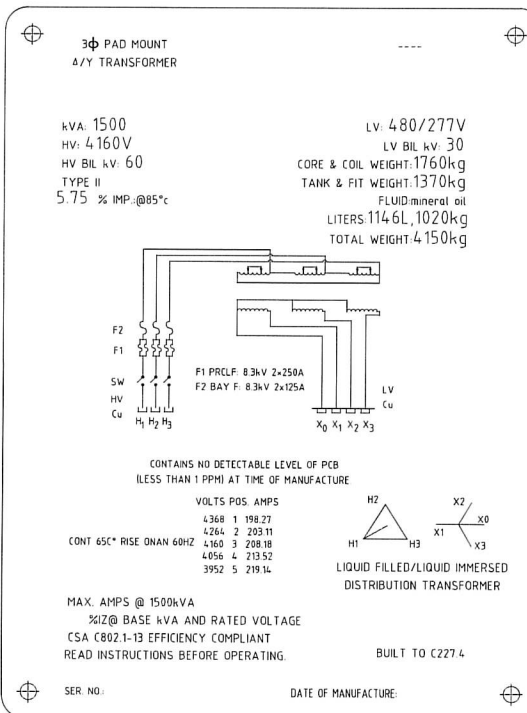

1piece/set

CHANGE	TYPE ZGS-1500/4.16/0.48		DWG. NAME Name plate			
	FIRST ANGLE PROJECTION	SCALE 1/5	DRAWN Mike Wang	CHECKED Iris Ji	CHECKED Ella Wei	APPROVED Sam
						REV. NO.
						△

