





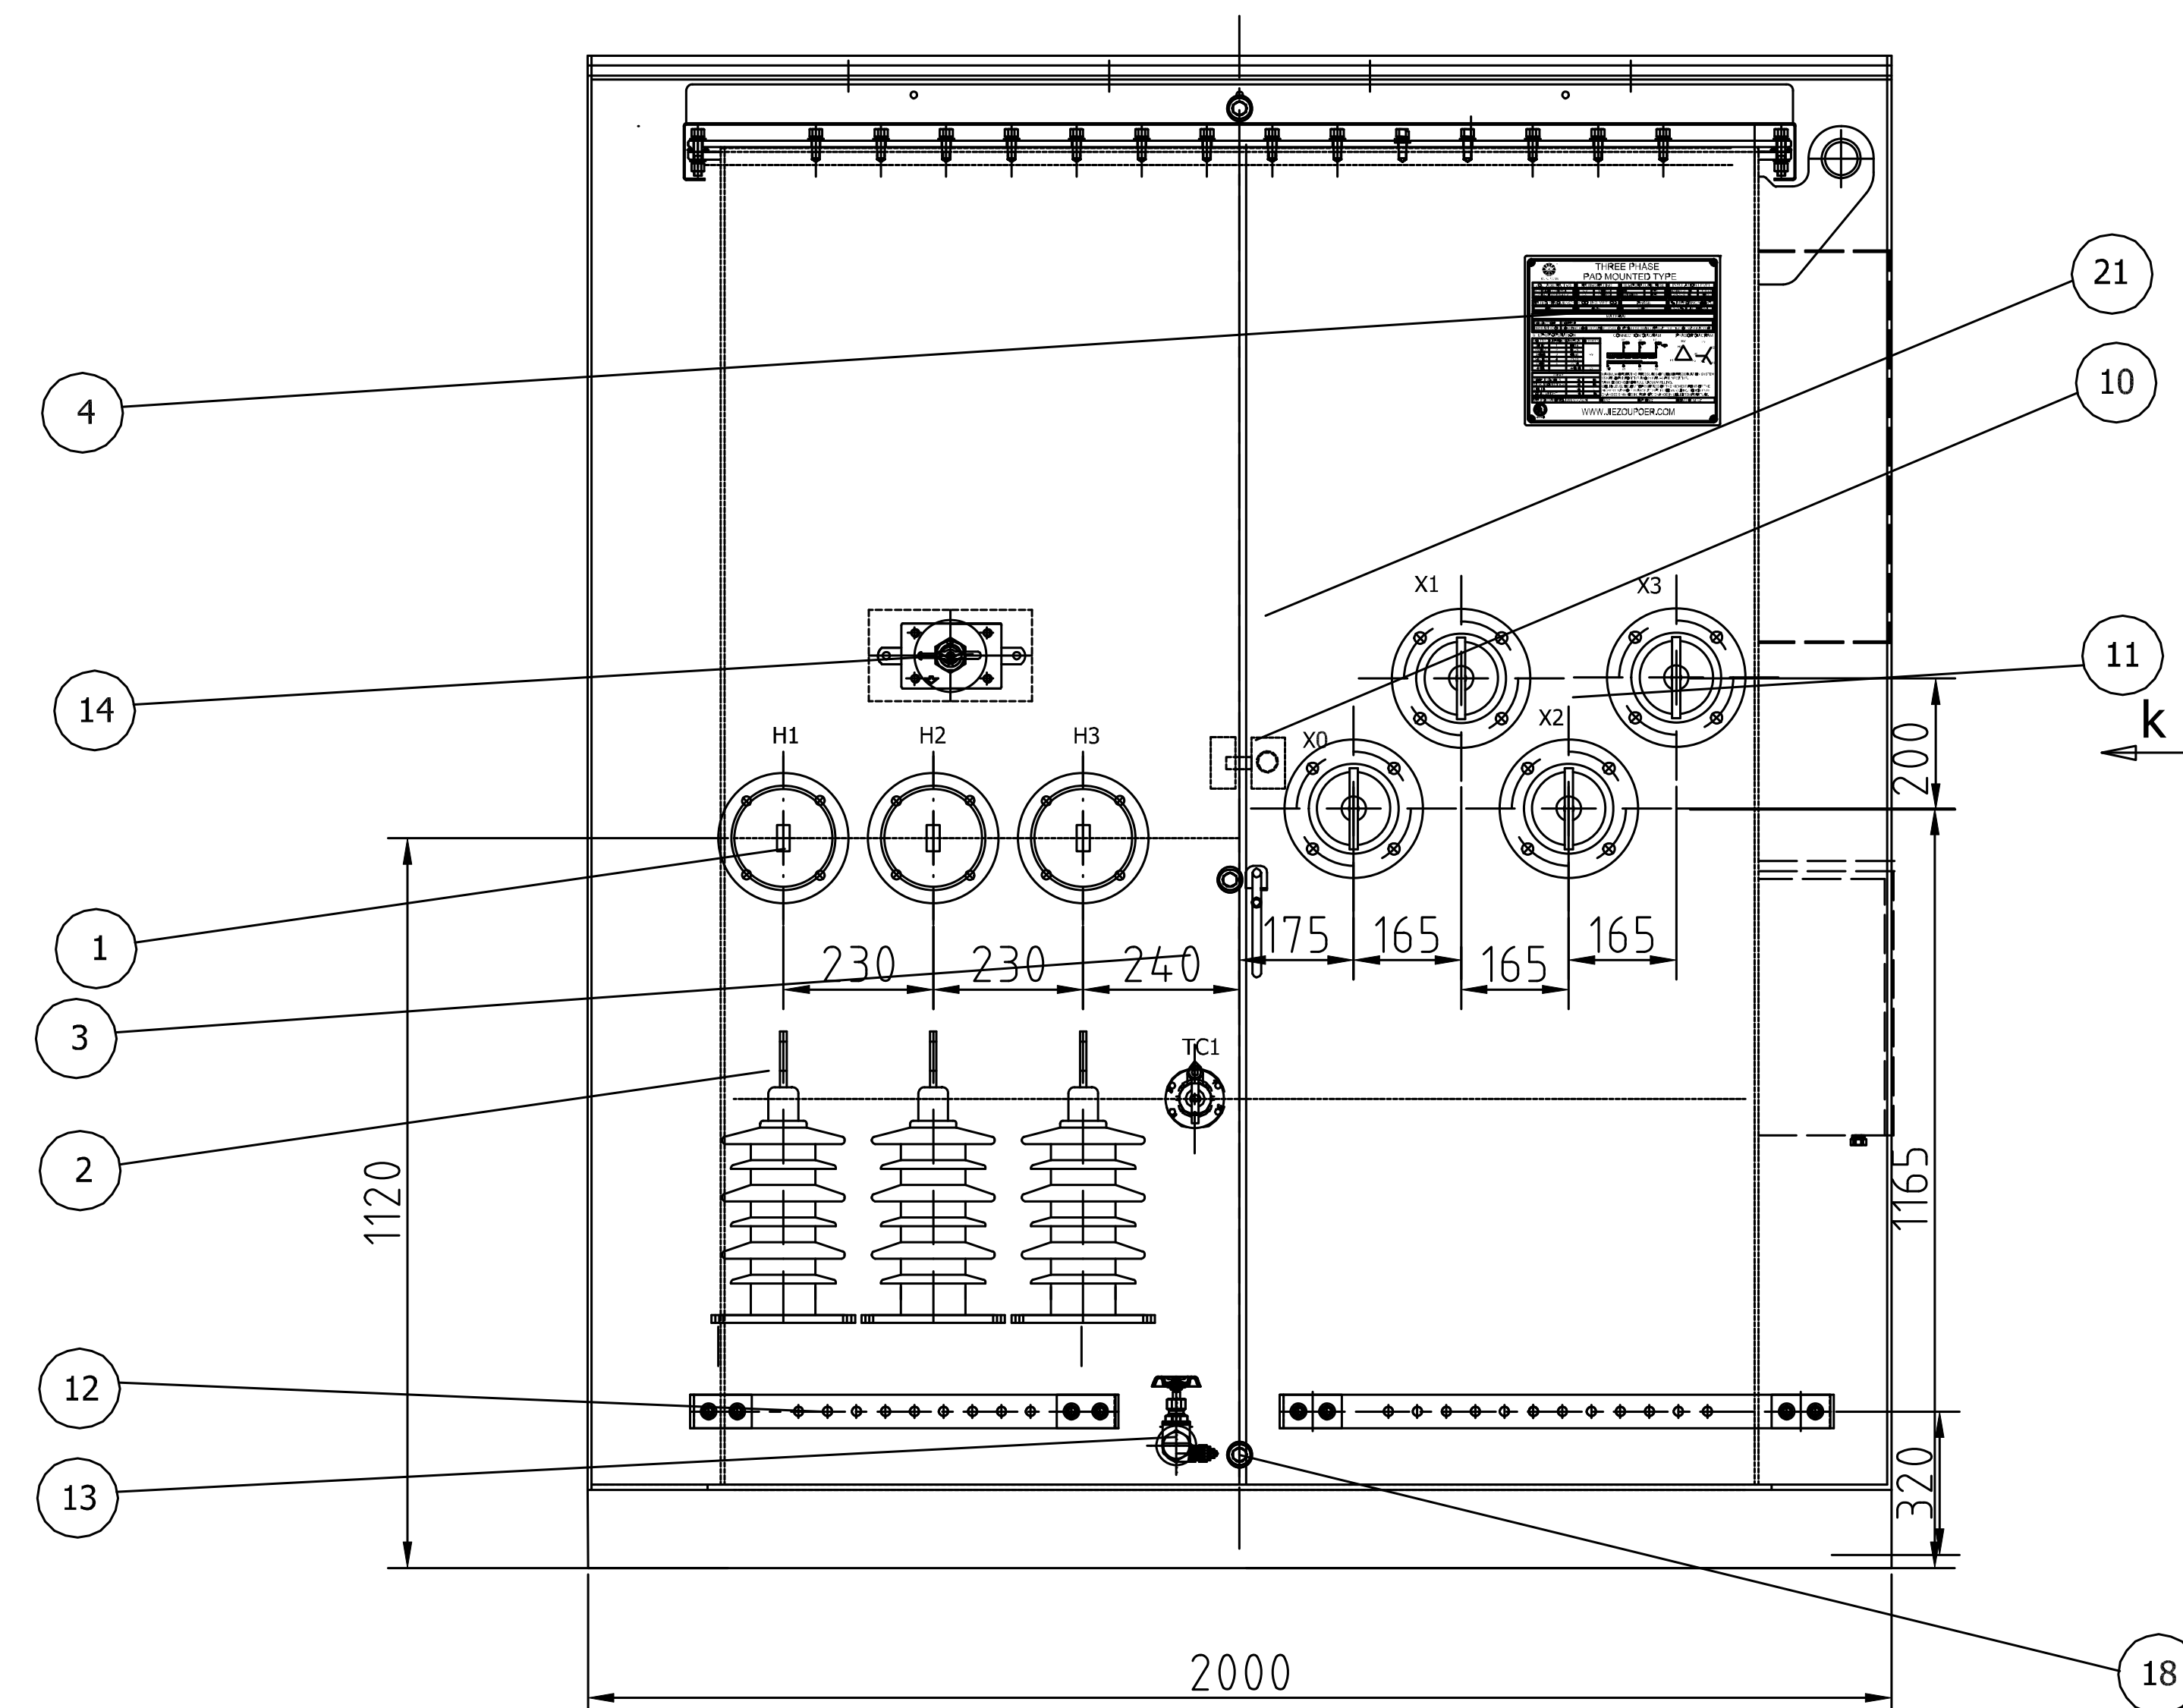


REMOVEABLE GLAND PLATE

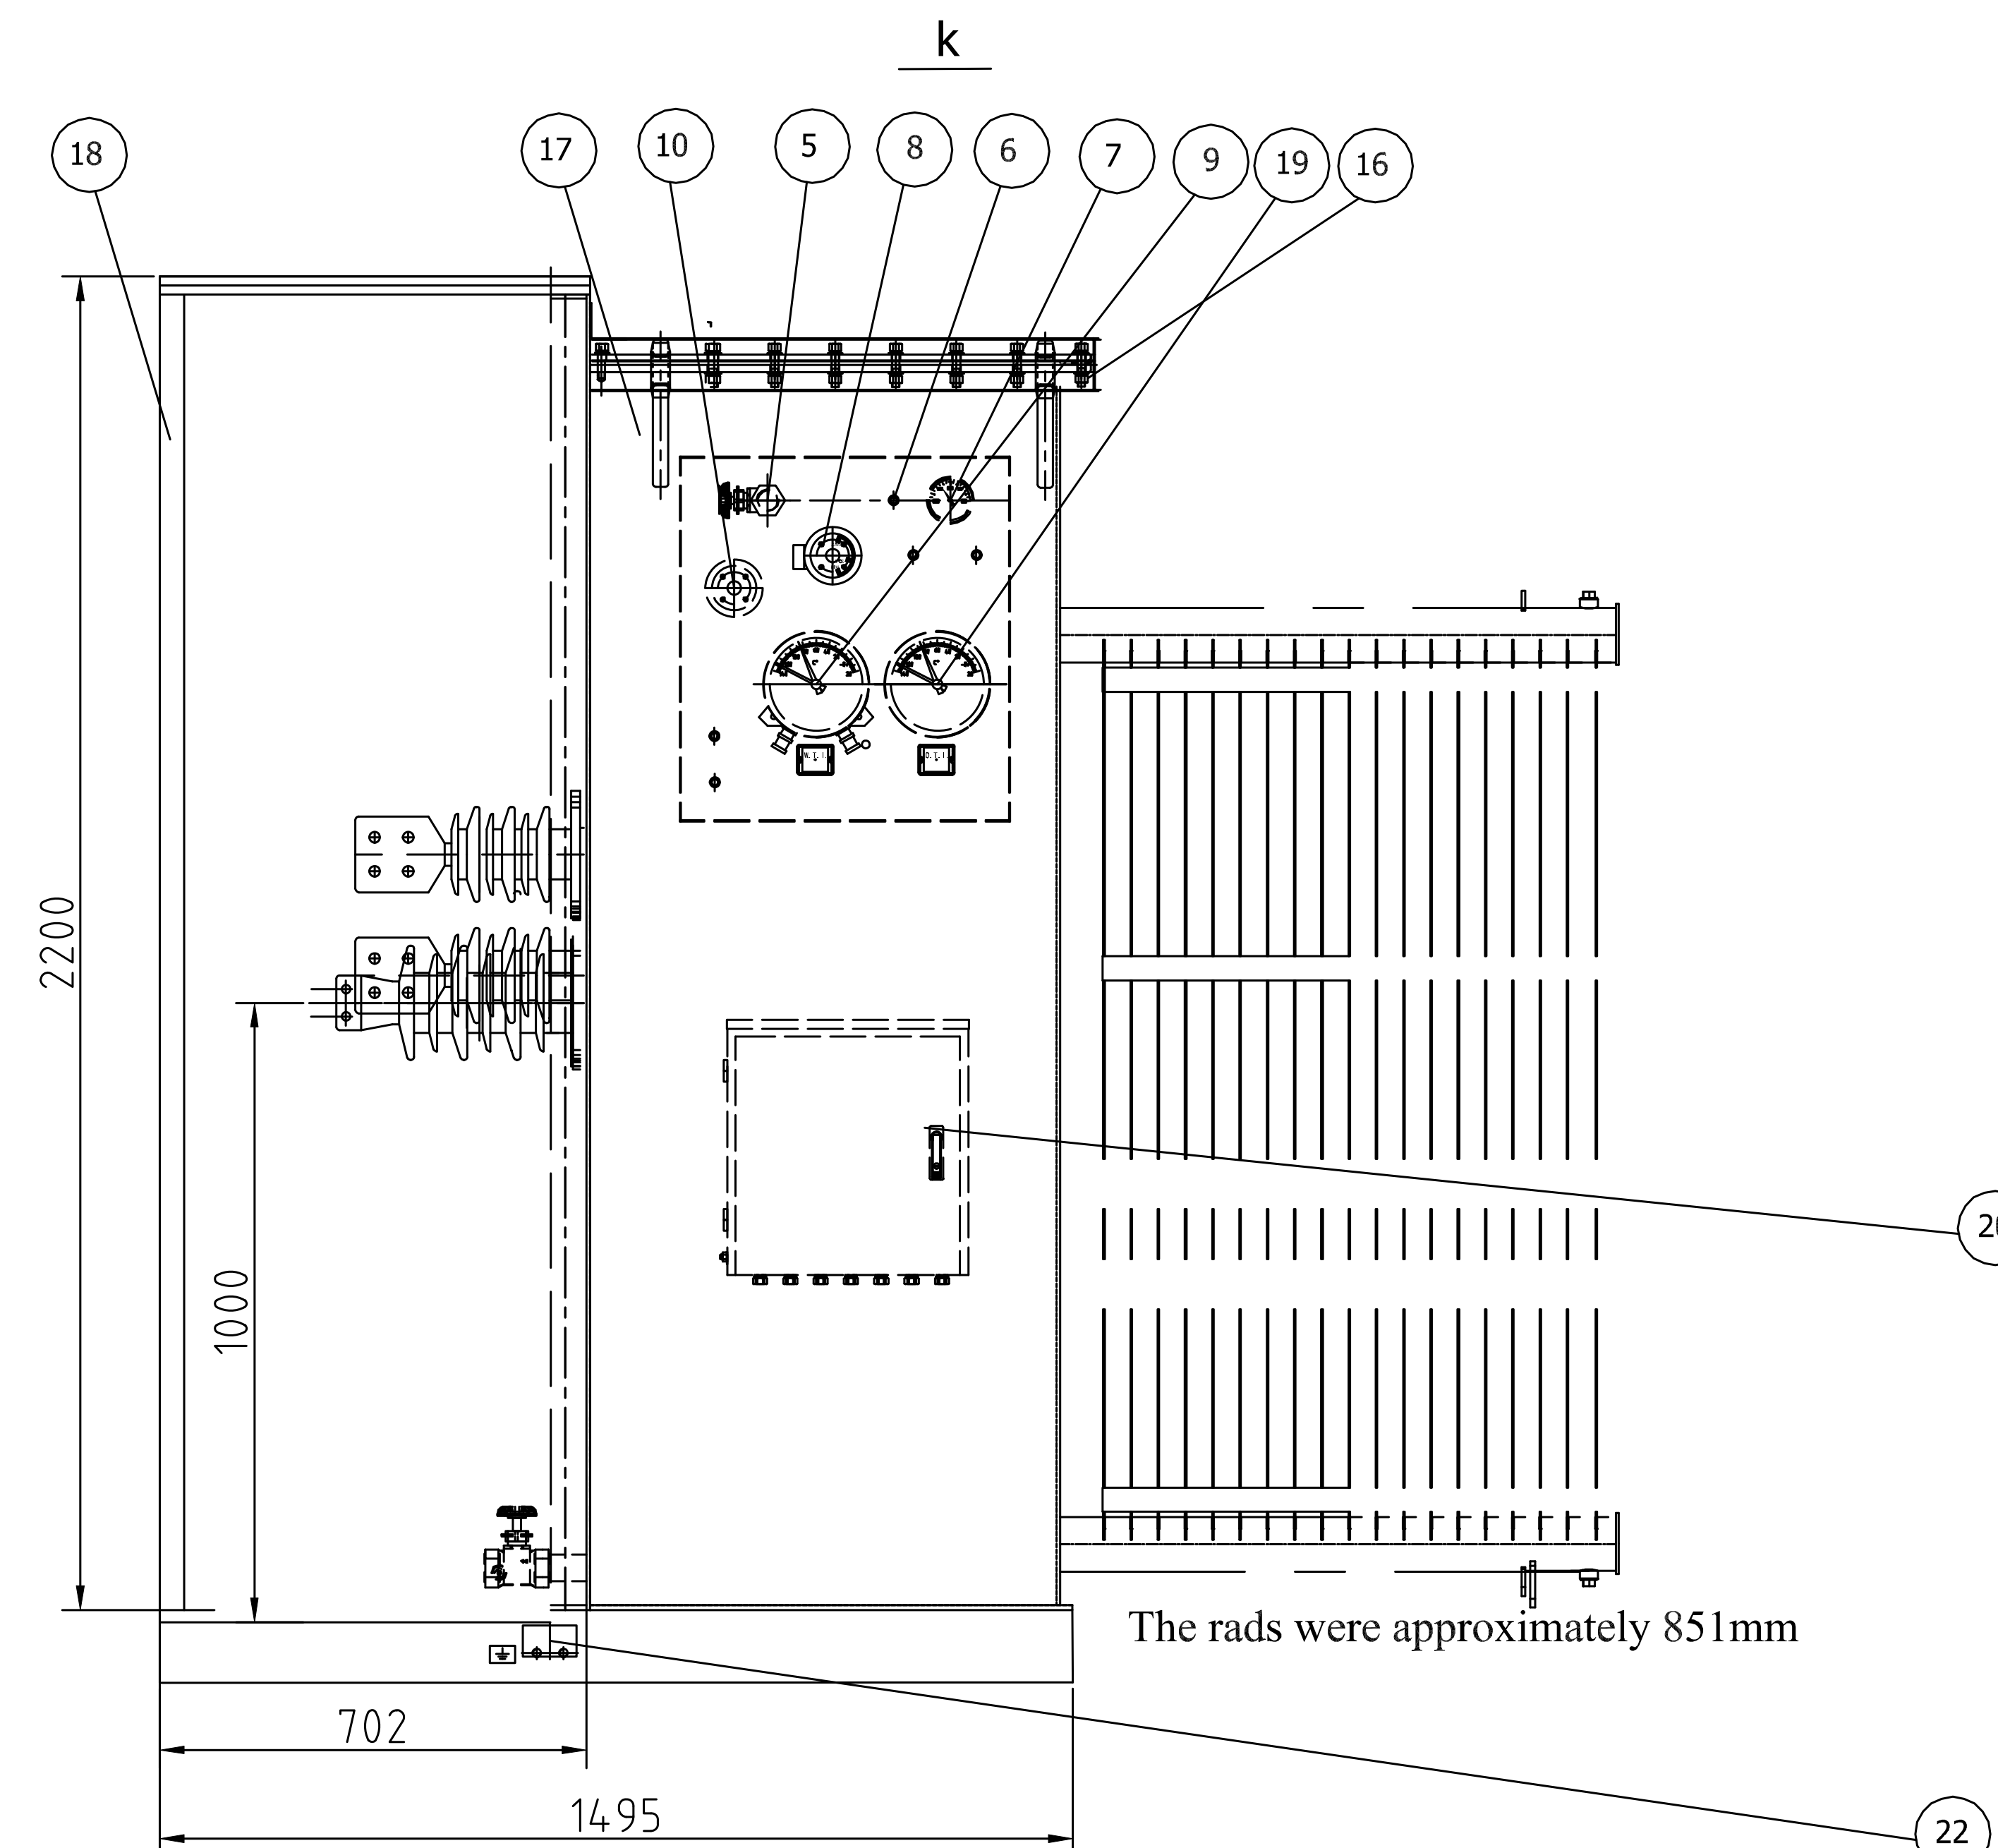

TECHNICAL DATA	
RATING	1500kVA
PRIMARY VOLTAGE(V)	24940 DELTA
SECONDARY VOLTAGE(V)	4160Y/2400
FREQUENCY	60Hz
VECTOR GROUP	Dyn1
CONDUCTOR	AL
INSULATING OIL	MINERAL OIL
TEMPERATURE RISE	65°C
EFFICIENCY	99.26%
LOAD LOSS AT RATED VOLTAGE	14500W
NO LOAD LOSSES	2000
IMPEDANCE	5.75%
ALTITUDE	≤1000m
No. OF TAP POSITION	5
COLOR	ANSI GREY

PARTS LIST		
ITEM	DESCRIPTION	QTY
1	HV BUSHING (25kV,417A)	3
2	17kV MCOV RATING METAL OXIDE SURGE ARRESTER	3
3	TAP CHANGER 3PH (125/35-6×5)	1
4	NAMEPLATE	1
5	1" UPPER FILL VALVE	1
6	PRESSURE RELIEF VALVE	1
7	VACUUM PRESSURE GAUGE	1
8	OIL LEVEL GAUGE W/AIARM CONTACTS	1
9	WINDING TEMPERATURE GAUGE W/AIARM CONTACTS	1
10	DOOR HANDLE	1
11	LV BUSHING(15KV 4 HOLE)	4
12	GROUND BUS	2
13	1"DRAIN VALVE WITH 3/8" SAMPLER	1
14	FIXED PROJECTING CUP	3
15	RADIATOR (Pc-1400-12/520)	3
16	FLIP TOP COVER	1
17	LIFTING LUG	4
18	HINGED DOOR	2
19	OIL TEMPERATURE GAUGE W/AIARM CONTACTS	1
20	NEMA 4 TERMINAL BOX	1
21	KIRK KEY	1
22	GROUND NEMA PAD	2

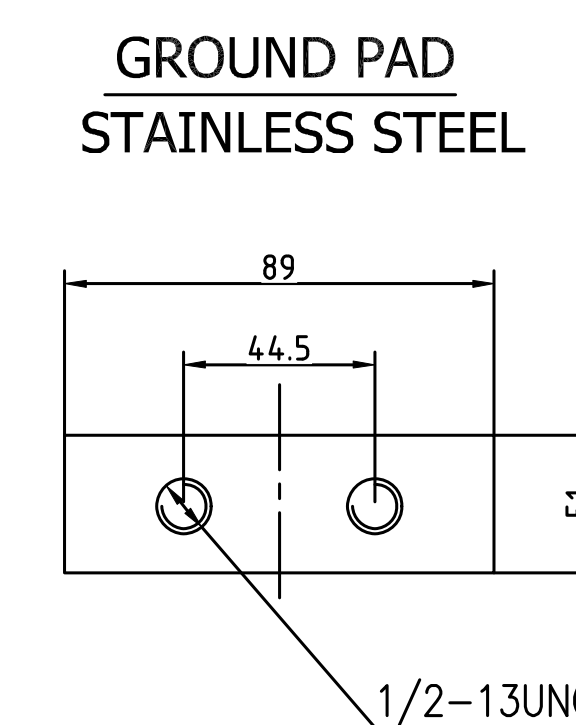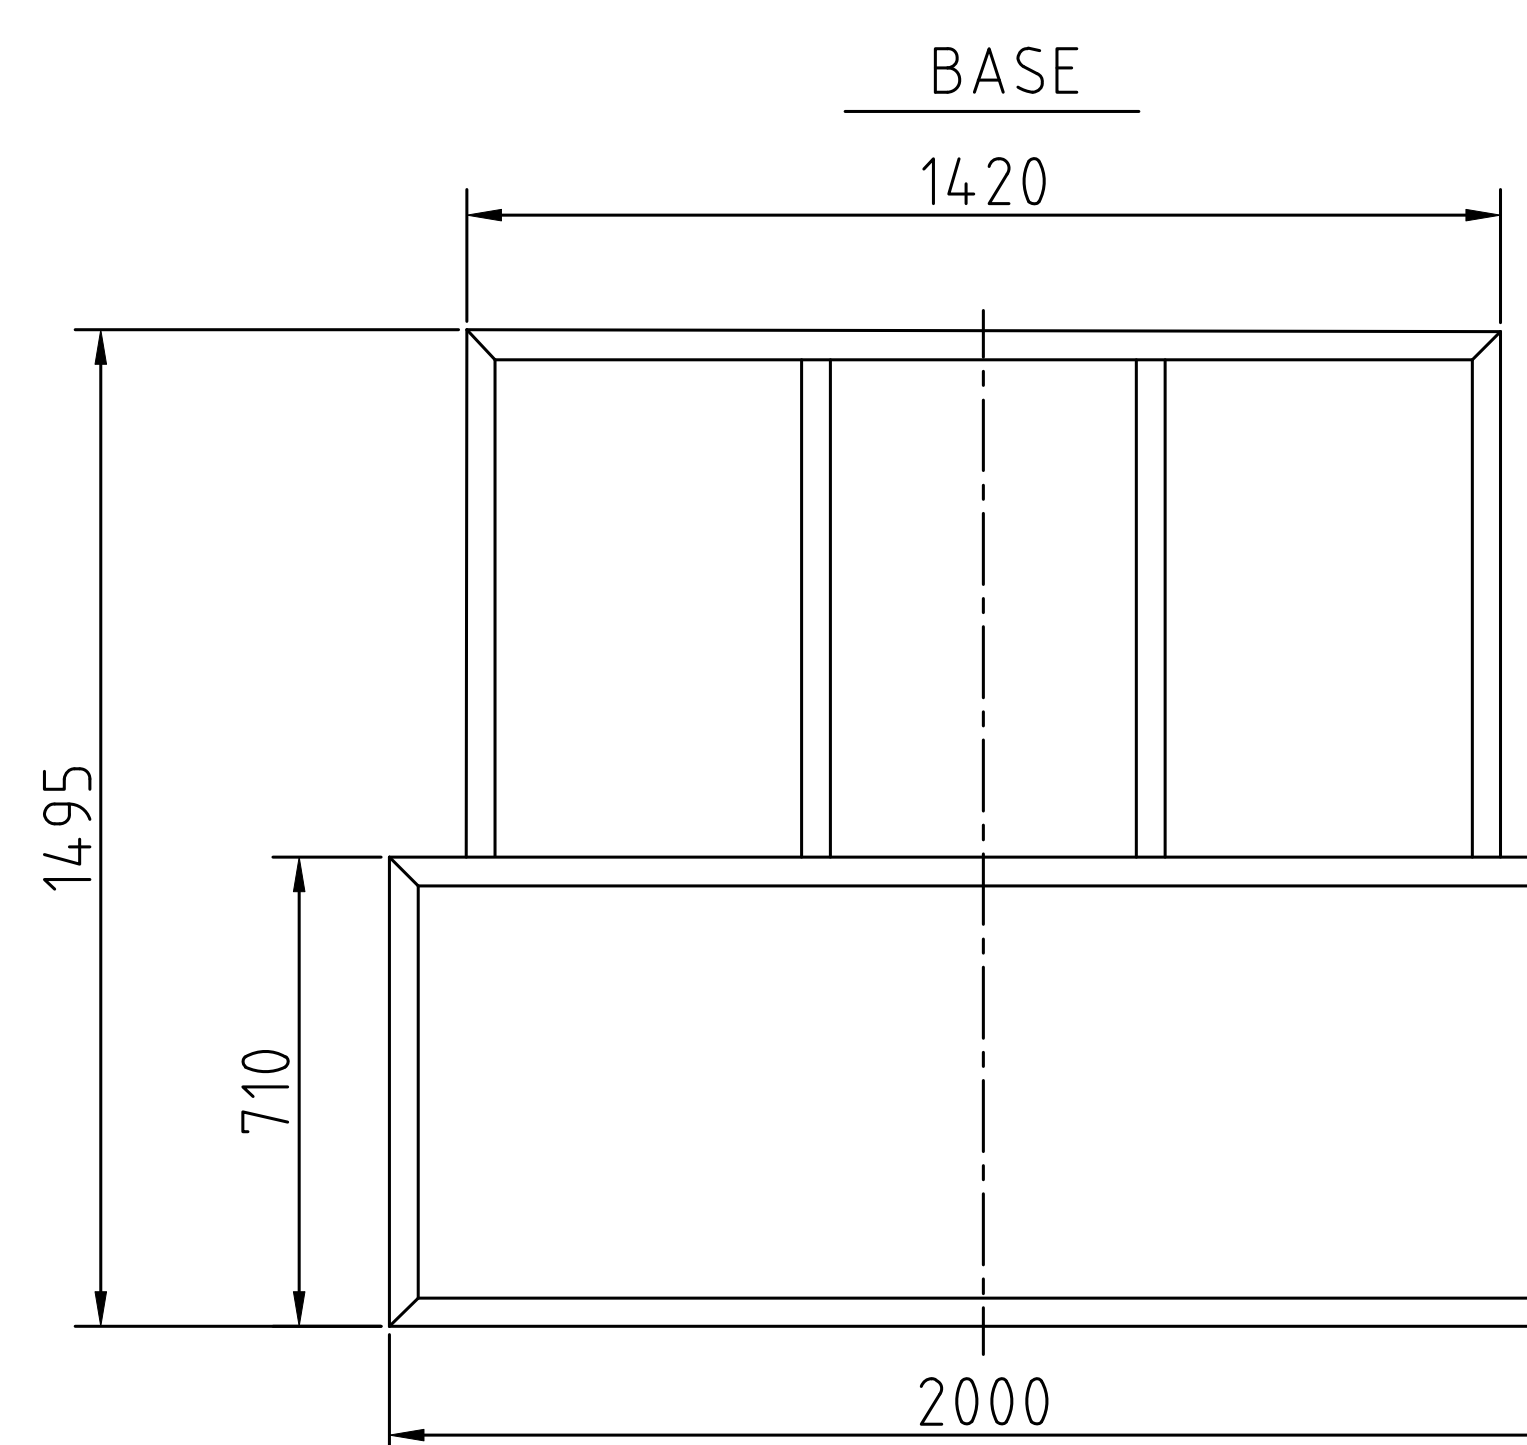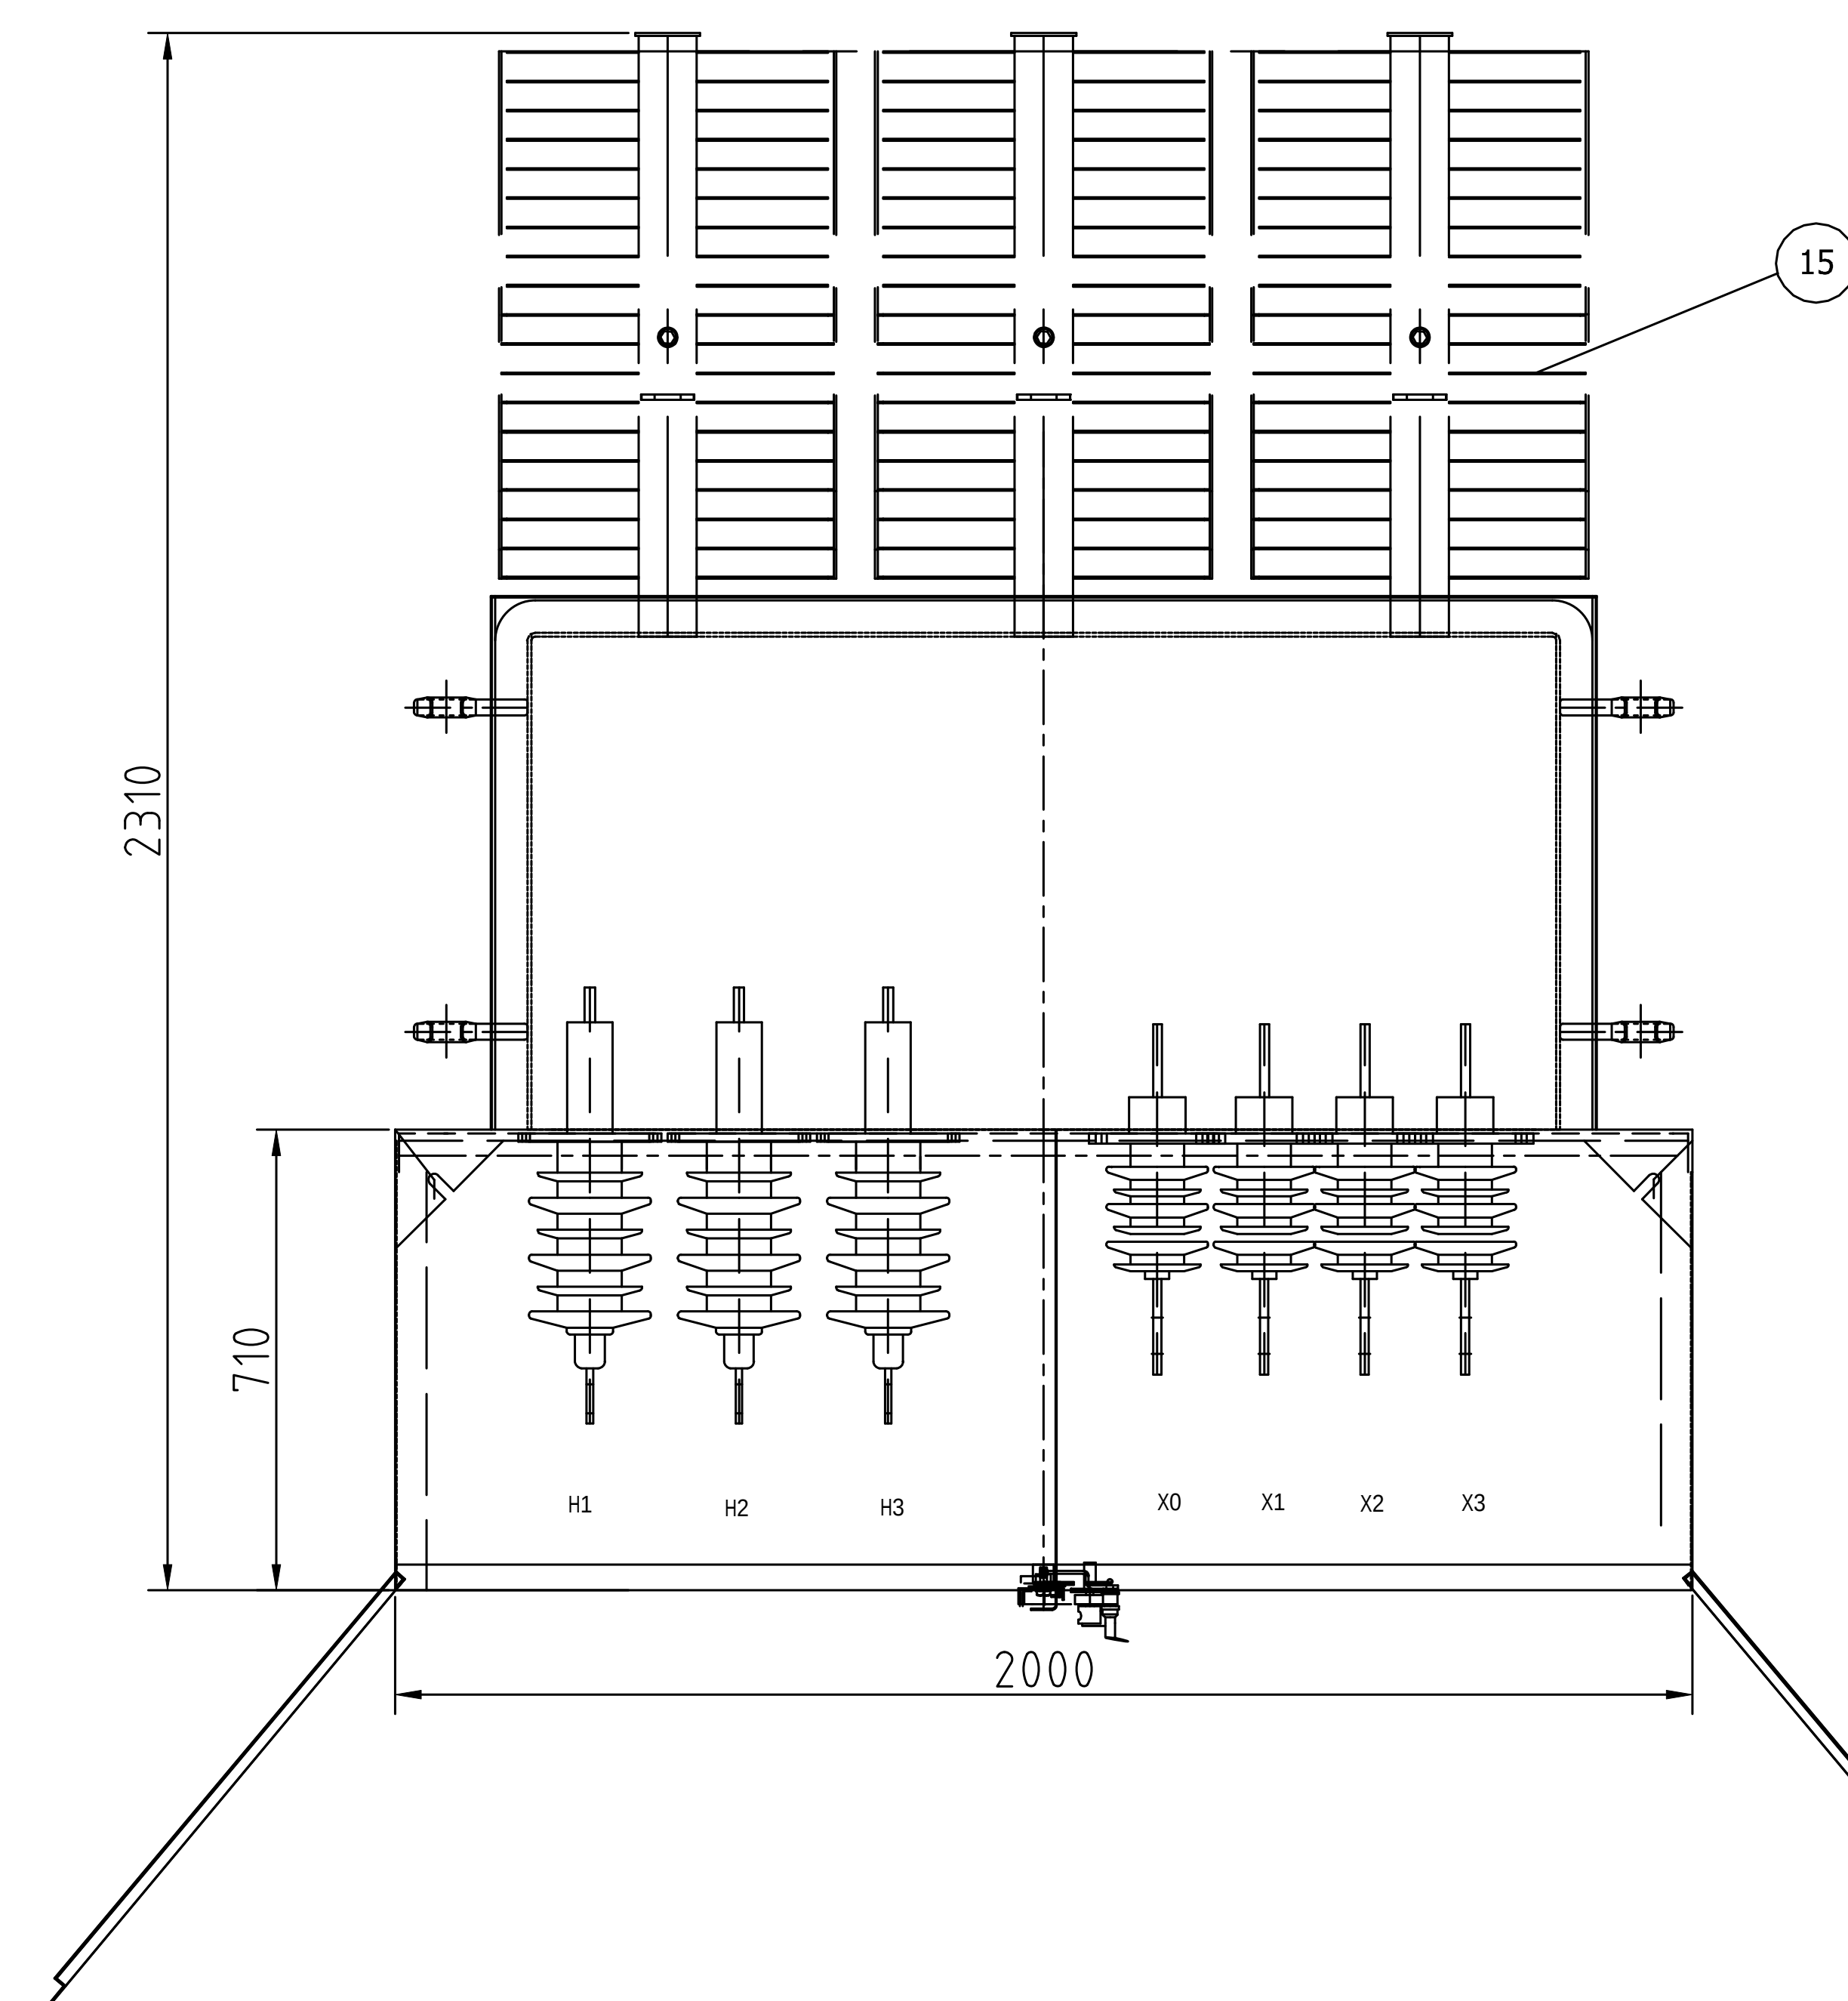

ITEM	WEIGHT
TANK & ACCESSORIES	1540Kg
TOTAL OIL WEIGHT	1260L
TOTAL WEIGHT	4600Kg

TYPE
ZGS-Z-1500/4.16

DWG. NAME	General Assembly Drawing
-----------	--------------------------

	DRAWN	CHECKED	CHECKED		APPROVED
	Gary C	Jack W	Iris J		Sam S

ZGS1500-240226-02

JZD
POWER TRANSFORMER

REV.
NO. Δ

APRIL 15, 2024



THREE PHASE PAD MOUNTED TYPE

VOLTAGE RATING		RATINGRATING		TEMPERATURE RISE		INSULATION LEVEL	
H.V	24.94 kV DETLA	H.V	1500 kVA	OIL	65°C	H.V/H.V.N BIL	125 kV
L.V	4.16 WYE/2.4 k V	L.V	1500 kVA	WINDING	65°C	L.V/L.V.N BIL	30 kV
RATED FREQUENCY		COOLING METHOD		PHASE		% IMPEDANCE@85°C	
60Hz		ONAN		THREE		5.75 %	AT 1500 kVA

MATERIAL	
CONDUCTOR	AL
INSULATING OIL	CONTAINS NO DETECTABLE LEVEL OF PCB (LESS THAN 2 PPM) AT THE TIME OF MANUFACTURE


STEP-UP OPERATION

VOLTS(V)	TAP POSN	AMPS(A)	BETWEEN
26187	1	33.07	HV
25563.5	2	33.87	
24940	3	34.72	
24316.5	4	35.65	
23693	5	36.55	
4160		208.18	LV


WEIGHT		
CORE AND COILS	kg	lbs
TANK AND FITTINGS	kg	lbs
LIQUID	kg	L
TOTAL WEIGHT	kg	lbs

APPLIED STANDARD.	CSA C227. 5	S/N :	PHONE:	DATE OF MFG:
-------------------	-------------	-------	--------	--------------


CONNECTION DIAGRAM

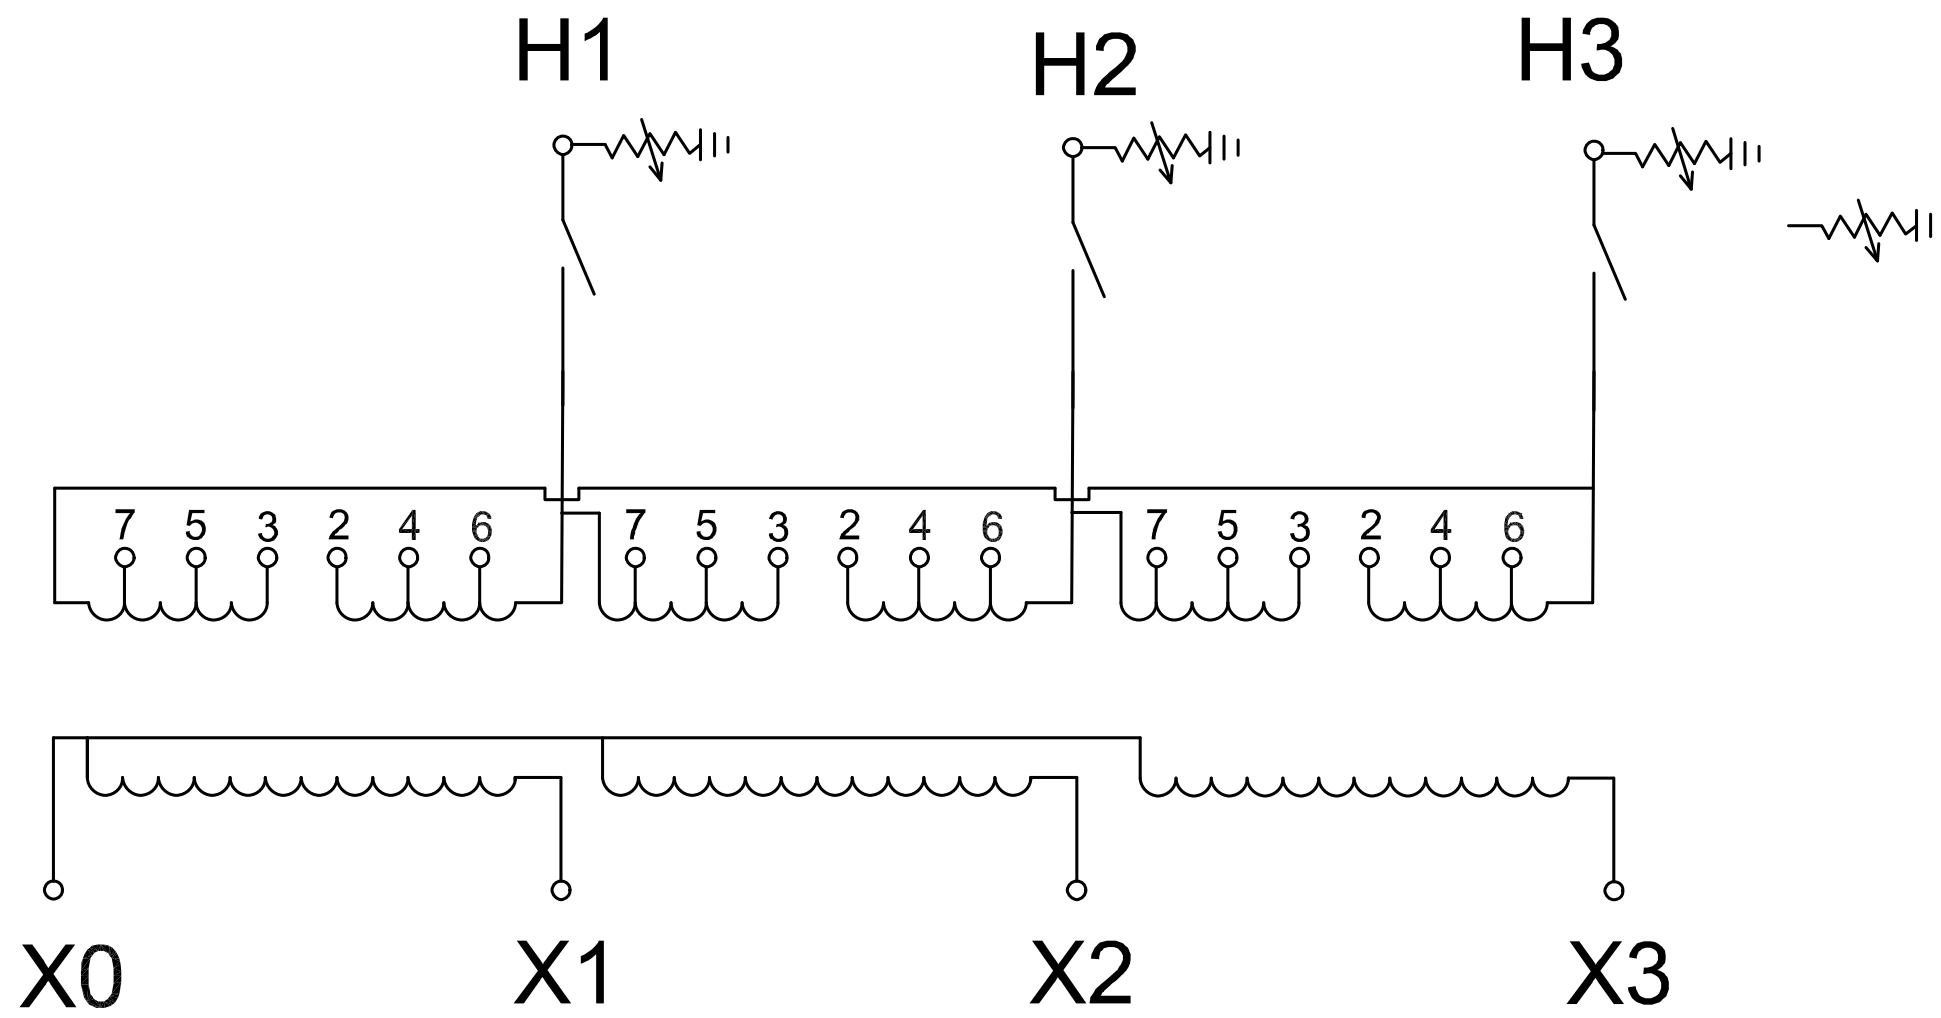

PHASOR DIAGRAM

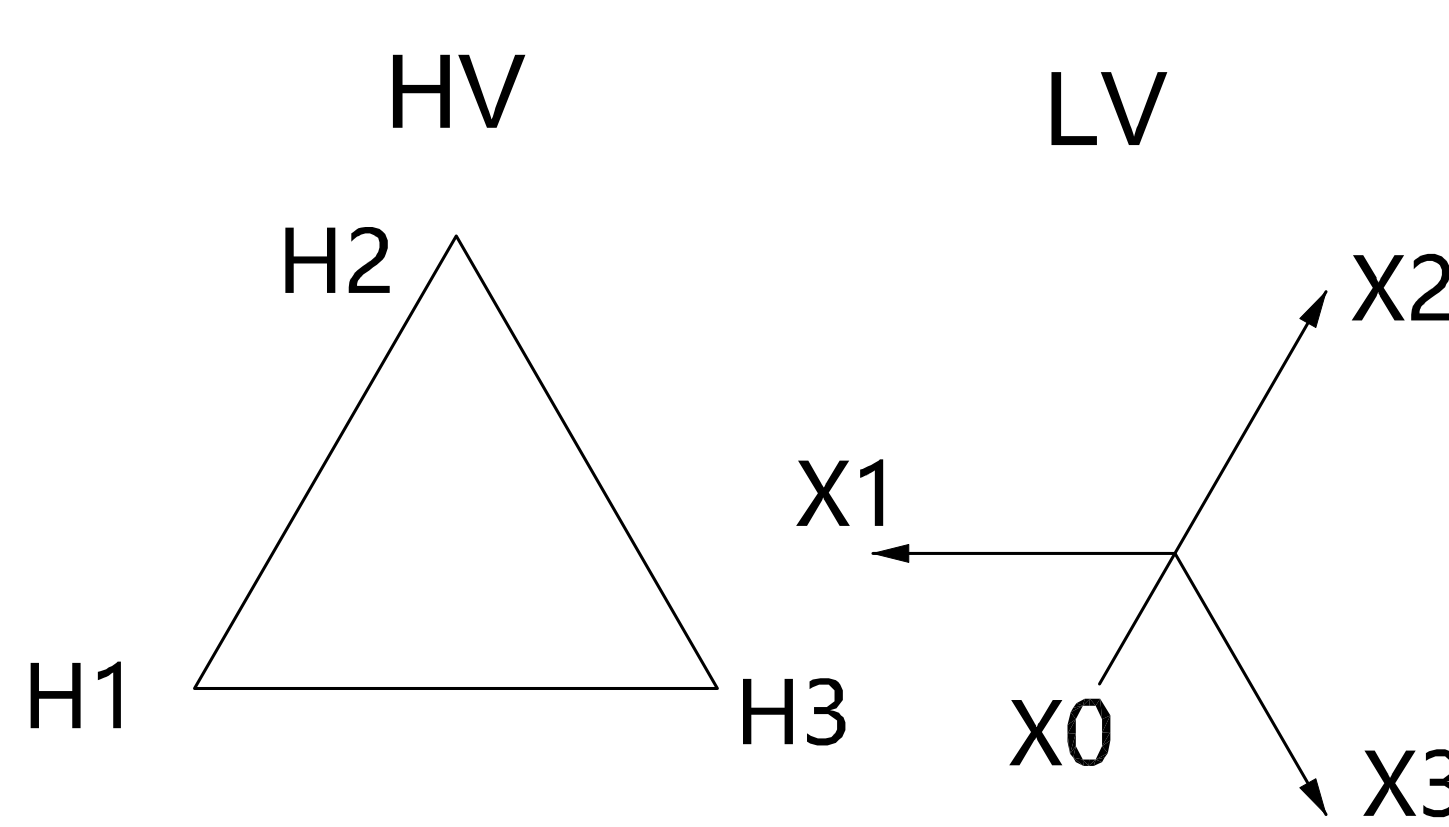


MAXIMUM OPERATING PRESSURES OF LIQUID PRESERVATION SYSTEM
55 KPA (8 PSI) POSITIVE AND 21 KPA (-3 PSI) NEGATIVE.
TANK DESIGNED FOR FULL VACUUM FILLING.
LIQUID LEVEL BELOW TOP SURFACE OF THE HIGHEST POINT OF THE
HIGHEST MANHOLE FLANGE AT 25°C IS 200 MM (7.9 IN). LIQUID LEVEL
CHANGES 5 MM (0.2 IN) PER 10°C CHANGE IN LIQUID TEMPERATURE.

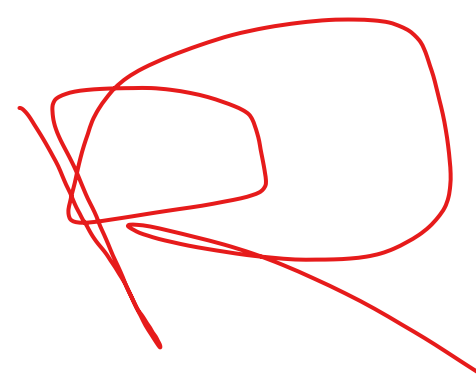


APRIL 15, 2024


WWW.JIEZOUPOWER.COM

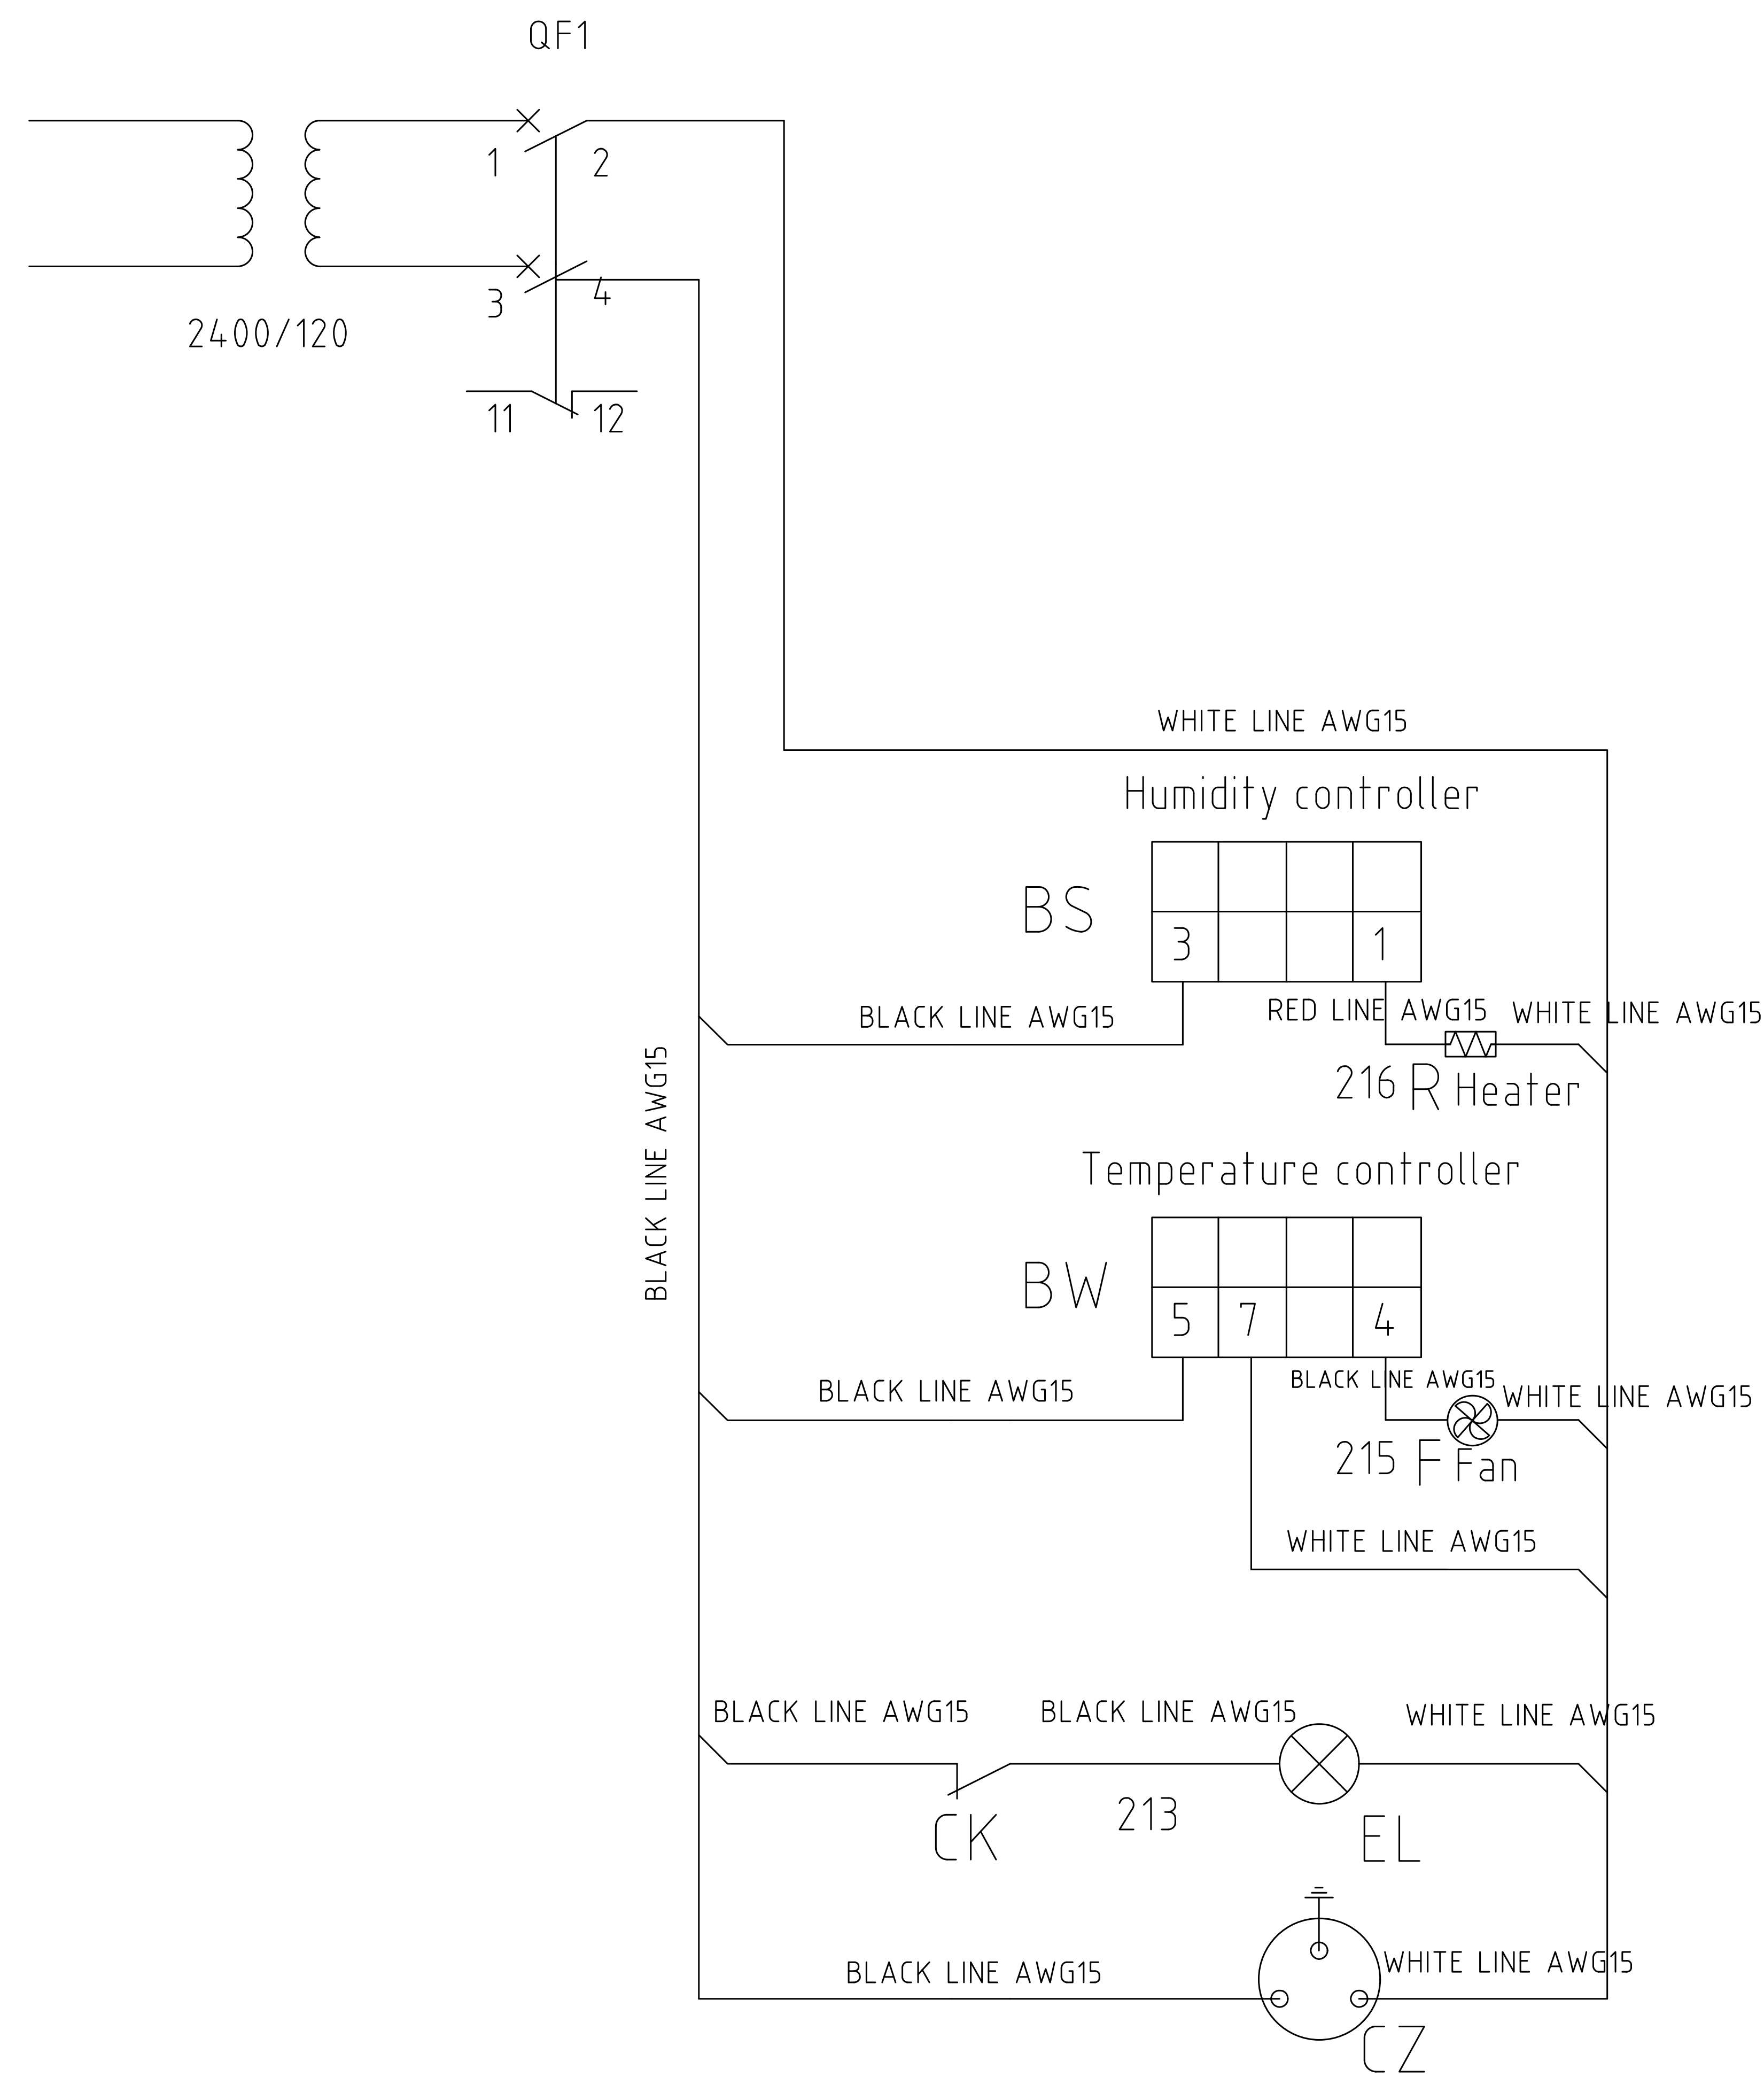


PRESSURE RELIEF VALVE

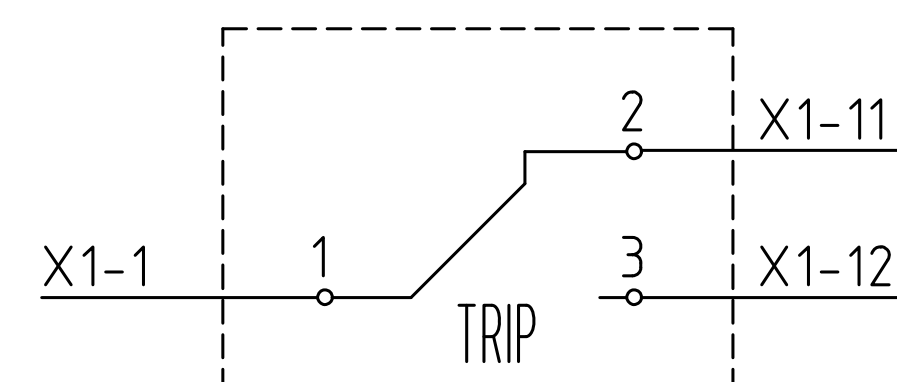


OIL LEVEL GAUGE

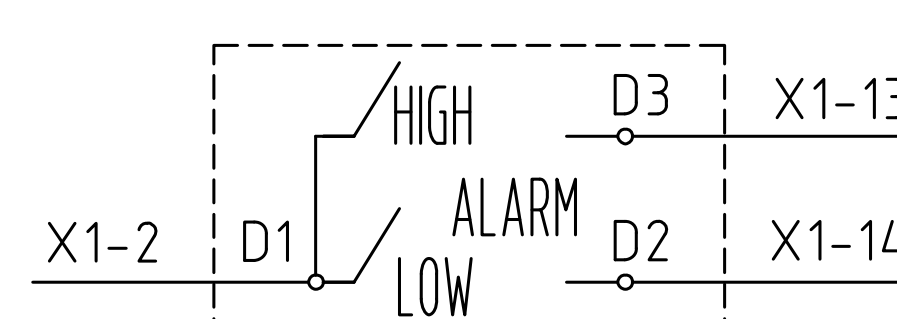


LIQUID TEMPERATURE INDICATOR 1

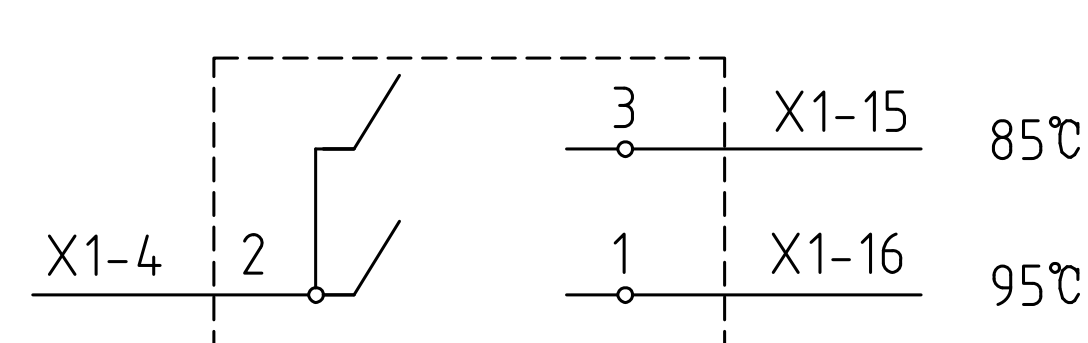

VACUUM PRESSURE GAUGE

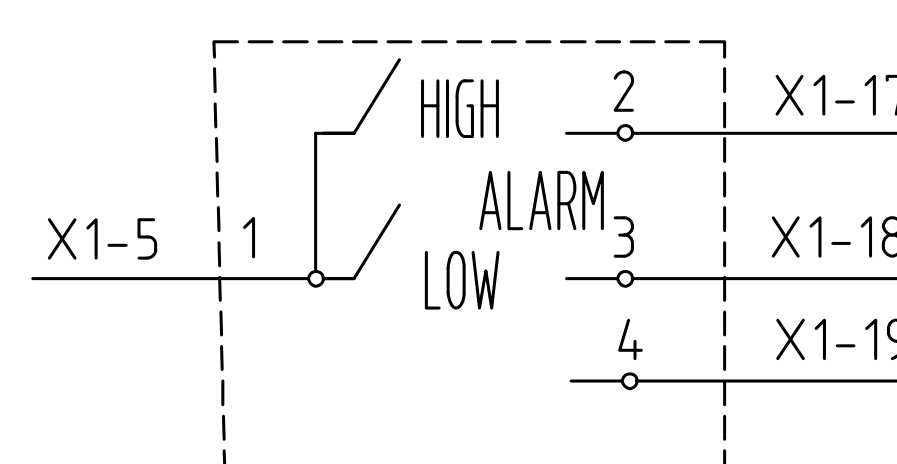

PRESSURE SAFETY DEVICE

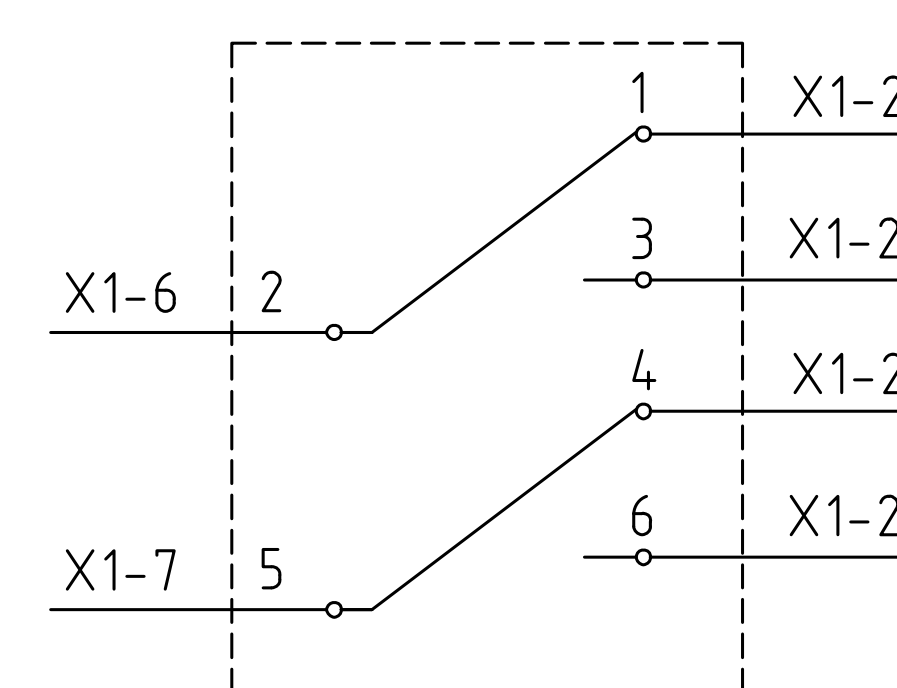


X2:AC power terminal				
Contact	Loop No.	No.	Connector function	Loop No.
		1	AC	A1 Phase 001
		2	Power	
		3		B1 Phase 002

To QF1

X1:BODY PROTECTION WIRING TERMINAL			
JOINT	N.O.	CONNECTOR FUNCTION	JOINT
	1	PRESSURE RELIEF VALVE	1
	2	OIL LEVEL GAUGE	D1
	3	LIQUID TEMPERATURE INDICATOR 1	2
	4	WINDING THERMOMETERBWR-4	A3
	5	VACUUM PRESSURE GAUGE	1
	6	PRESSURE SAFETY DEVICE	2
	7		5
	8		B3
	9	WINDING THERMOMETERBWR-4	C3
	10		D3
	11	PRESSURE RELIEF VALVE	2
	12		3
	13	OIL LEVEL GAUGE	D2
	14		D3
	15	LIQUID TEMPERATURE INDICATOR 1	3
	16		1
	17	VACUUM PRESSURE GAUGE	2
	18		3
	19		4
	20		1
	21	PRESSURE SAFETY DEVICE	3
	22		4
	23		6
	24		A1
	25		A2
	26		B1
	27	WINDING THERMOMETERBWR-4	B2
	28		C1
	29		C2
	30		D1
	31		D2

Winding thermometerBWR-4

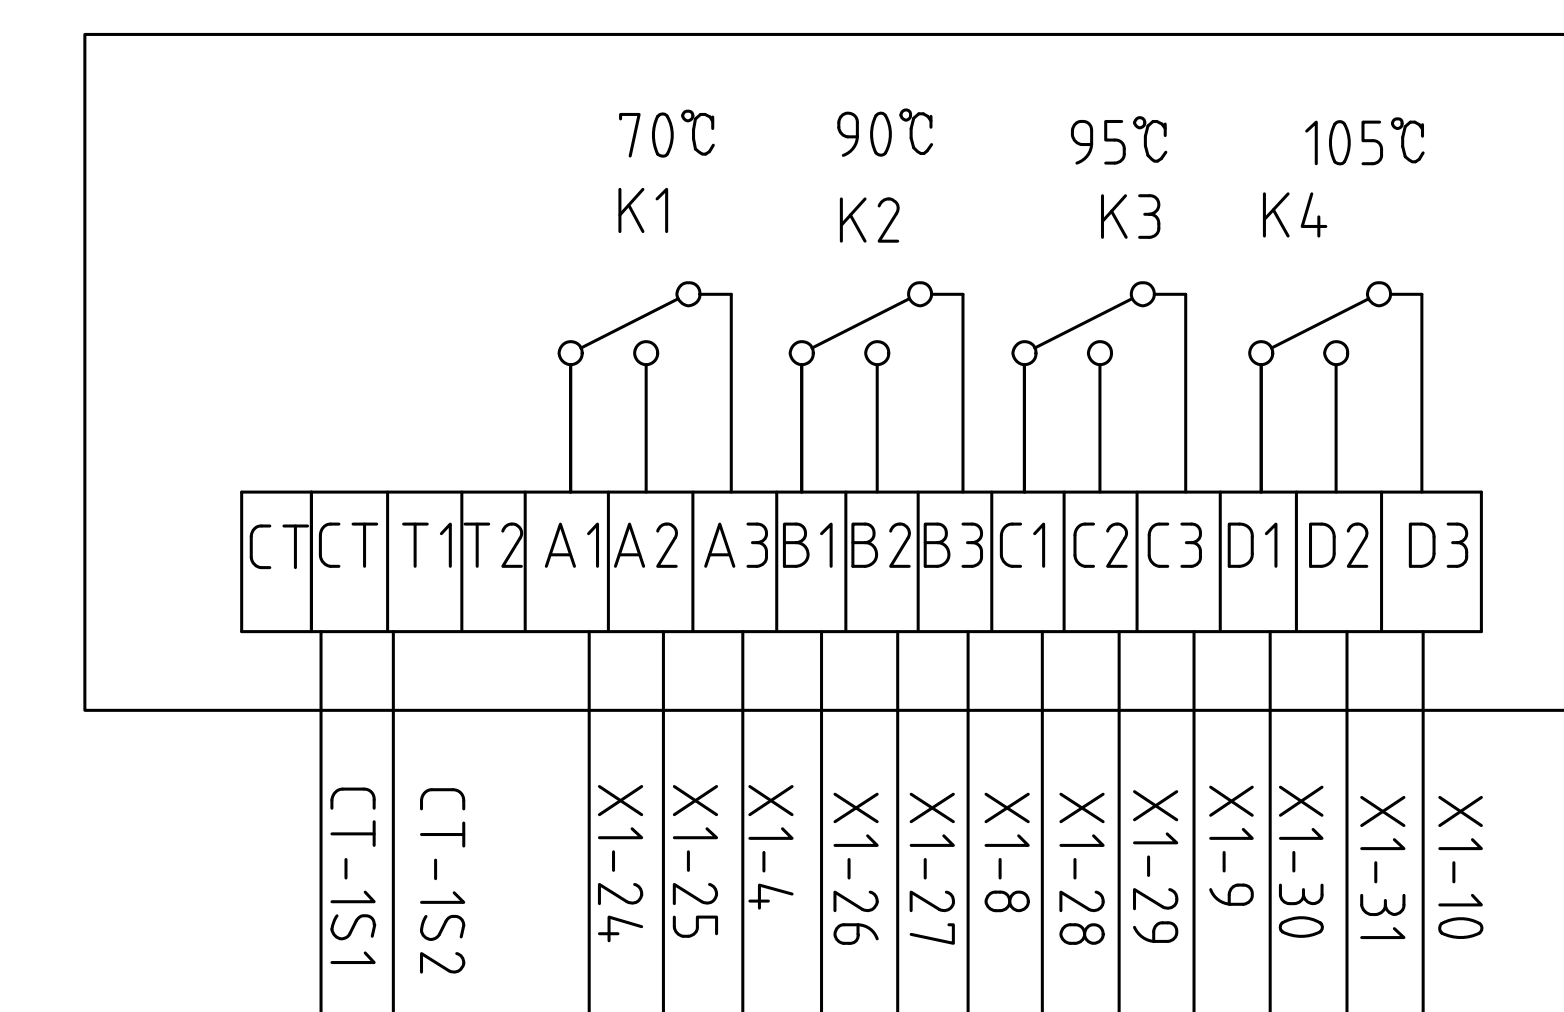

CHANGE

Fan :This is not the fan for the transformer body, this is the exhaust fan IN THE CONTROL CABINET

TYPE ZGS-Z-1500/4.16					DWG. NAME General Assembly Drawing				
DRAWN	CHECKED	CHECKED		APPROVED	FIRST ANGLE PROJECTION	SCALE	1		
Gary C	Jack W	Iris J		Sam S					REV. NO.
ZGS1500-240226-02									