

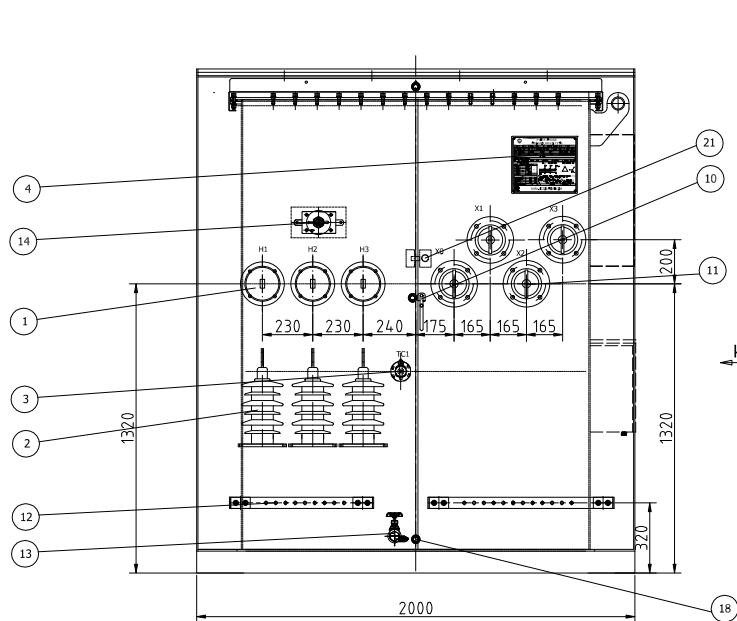
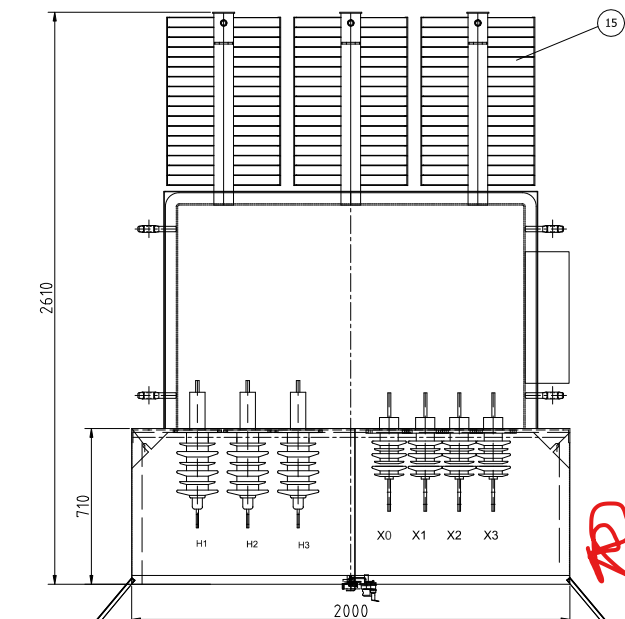
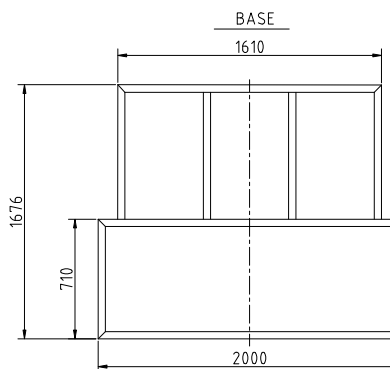


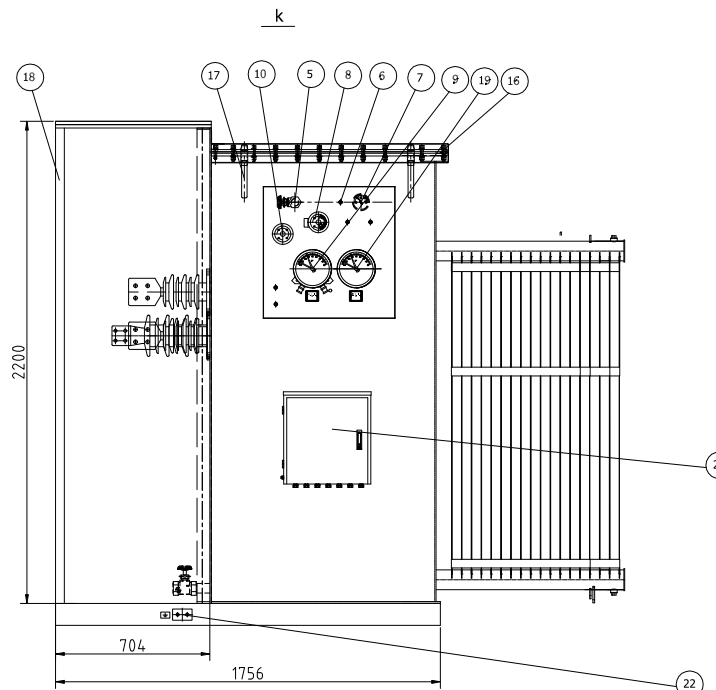

REMOVEABLE GLAND PLATE



APRIL 15, 2024

GROUND PAD
STAINLESS STEEL

TECHNICAL DATA

RATING	3000kVA
PRIMARY VOLTAGE(V)	24940 DELTA
SECONDARY VOLTAGE(V)	4160Y/2400
FREQUENCY	60Hz
VECTOR GROUP	Dyn1
CONDUCTOR	AL
INSULATING OIL	MINERAL OIL
TEMPERATURE RISE	65°C
EFFICIENCY	99.37%
LOAD LOSS AT RATED VOLTAGE	24000W
NO LOAD LOSSES	3850W
IMPEDANCE	5.75%
ALTITUDE	≤1000m
No. OF TAP POSITION	5
COLOR	ANSI GREY

PARTS LIST

ITEM	DESCRIPTION	QTY
1	HV BUSHING (25KV,417A)	3
2	17KV MCOV RATING METAL OXIDE SURGE ARRESTER	3
3	TAP CHANGER 3PH (125/35-6×5)	1
4	NAMEPLATE	1
5	1" UPPER FILL VALVE	1
6	PRESSURE RELIEF VALVE	1
7	VACUUM PRESSURE GAUGE	1
8	OIL LEVEL GAUGE W/AIARM CONTACTS	1
9	WINDING TEMPERATURE GAUGE W/AIARM CONTACTS	1
10	DOOR HANDLE	1
11	LV BUSHING(15KV 4 HOLE)	4
12	GROUND BUS	2
13	1"DRAIN VALVE WITH 3/8" SAMPLER	1
14	FIXED PROJECTING CUP	3
15	RADIATOR (Pc-1500-18/520)	3
16	FLIP TOP COVER	1
17	LIFTING LUG	4
18	HINGED DOOR	2
19	OIL TEMPERATURE GAUGE W/AIARM CONTACTS	1
20	NEMA 4 TERMINAL BOX	1
21	KIRK KEY	1
22	GROUND NEMA PAD	2

ITEM	WEIGHT
TANK & ACCESSORIES	2505Kg
TOTAL OIL WEIGHT	1440L
TOTAL WEIGHT	7680Kg

TYPE
ZGS-Z-3000/4.16-0.6

DWG. NAME

General Assembly Drawing

DRAWN	CHECKED	CHECKED	APPROVED
Gary C	Jack W	Iris J	Sam S

FIRST ANGLE
PROJECTION

SCALE 1

ZGS3000-240226-01

JZP
POWER TRANSFORMERREV.
NO.

0

THREE PHASE PAD MOUNTED TYPE

VOLTAGE RATING		RATINGRATING		TEMPERATURE RISE		INSULATION LEVEL	
H.V	24.94 kV DETLA	H.V	3000 kVA	OIL	65°C	H.V/H.V.N BIL	125 kV
L.V	4.16 WYE/2.4 k V	L.V	3000 kVA	WINDING	65°C	L.V/L.V.N BIL	30 kV
RATED FREQUENCY		COOLING METHOD		PHASE		% IMPEDANCE@85°C	
60Hz		ONAN		THREE		5.75 %	AT 3000 kVA


MATERIAL

CONDUCTOR	AL
INSULATING OIL	CONTAINS NO DETECTABLE LEVEL OF PCB (LESS THAN 2 PPM) AT THE TIME OF MANUFACTURE


STEP-UP OPERATION

VOLTS(V)	TAP POSN	AMPS(A)	BETWEEN
26187	1	66.14	HV
25563.5	2	67.75	
24940	3	69.45	
24316.5	4	71.23	
23693	5	73.10	
4160		416.36	LV

CONNECTION DIAGRAM

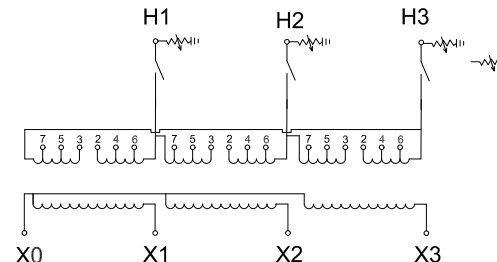

PHASOR DIAGRAM

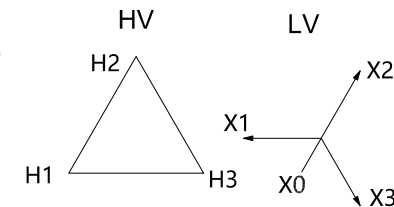

WEIGHT		
CORE AND COILS	kg	lbs
TANK AND FITTINGS	kg	lbs
LIQUID	kg	L
TOTAL WEIGHT	kg	lbs


MAXIMUM OPERATING PRESSURES OF LIQUID PRESERVATION SYSTEM
55 KPA (8 PSI) POSITIVE AND 21 KPA (-3 PSI) NEGATIVE.
TANK DESIGNED FOR FULL VACUUM FILLING.
LIQUID LEVEL BELOW TOP SURFACE OF THE HIGHEST POINT OF THE
HIGHEST MANHOLE FLANGE AT 25°C IS 200 MM (7.9 IN). LIQUID LEVEL
CHANGES 5 MM (0.2 IN) PER 10°C CHANGE IN LIQUID TEMPERATURE.

APPLIED STANDARD.	CSA C227.5	S/N :	PHONE:	DATE OF MFG:
-------------------	------------	-------	--------	--------------




APRIL 15, 2024


WWW.JIEZOUPOWER.COM

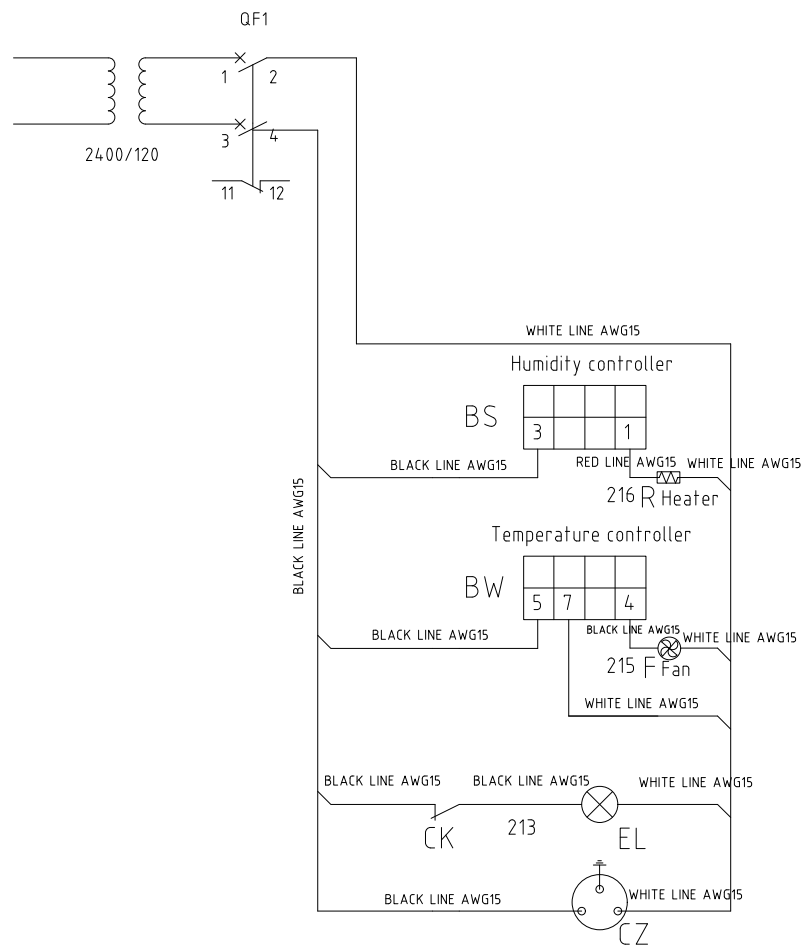


PRESSURE RELIEF VALVE




OIL LEVEL GAUGE




LIQUID TEMPERATURE INDICATOR 1



VACUUM PRESSURE GAUGE



PRESSURE SAFETY DEVICE




X2:AC power terminal			
Contact	Loop No.	Connector Function	Loop No.
1	1	AC	A1 Phase 001
2	2	Power	B1 Phase 002
3	3		

To QF1

X1:BODY PROTECTION WIRING TERMINAL			
JOINT	N.O.	CONNECTOR FUNCTION	JOINT
1	1	PRESSURE RELIEF VALVE	1
2	2	OIL LEVEL GAUGE	D1
3	3	LIQUID TEMPERATURE INDICATOR 1	2
4	4	WINDING THERMOMETERBWR-4	A3
5	5	VACUUM PRESSURE GAUGE	1
6	6	PRESSURE SAFETY DEVICE	2
7	7		5
8	8	WINDING THERMOMETERBWR-4	B3
9	9		C3
10	10		D3
11	11	PRESSURE RELIEF VALVE	2
12	12		3
13	13	OIL LEVEL GAUGE	D2
14	14		D3
15	15	LIQUID TEMPERATURE INDICATOR 1	3
16	16		1
17	17	VACUUM PRESSURE GAUGE	2
18	18		3
19	19		4
20	20		1
21	21	PRESSURE SAFETY DEVICE	3
22	22		4
23	23		6
24	24		A1
25	25		A2
26	26	WINDING THERMOMETERBWR-4	B1
27	27		B2
28	28		C1
29	29		C2
30	30		D1
31	31		D2

Winding thermometerBWR-4

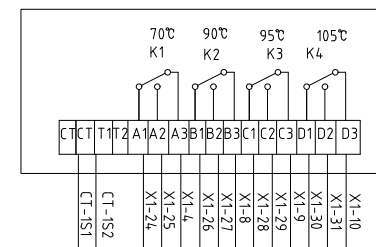

APRIL 15, 2024

CHANGE

Fan :This is not the fan for the transformer body, this is the exhaust fan IN THE CONTROL CABINET.

TYPE ZGS-Z-3000/ 4.16					DWG. NAME General Assembly Drawing		
DRAWN	CHECKED	CHECKED		APPROVED	FIRST ANGLE PROJECTION	SCALE	1
Gary C	Jack W	Iris J		Sam S			REV. NO.
ZGS3000-240226-01							△