
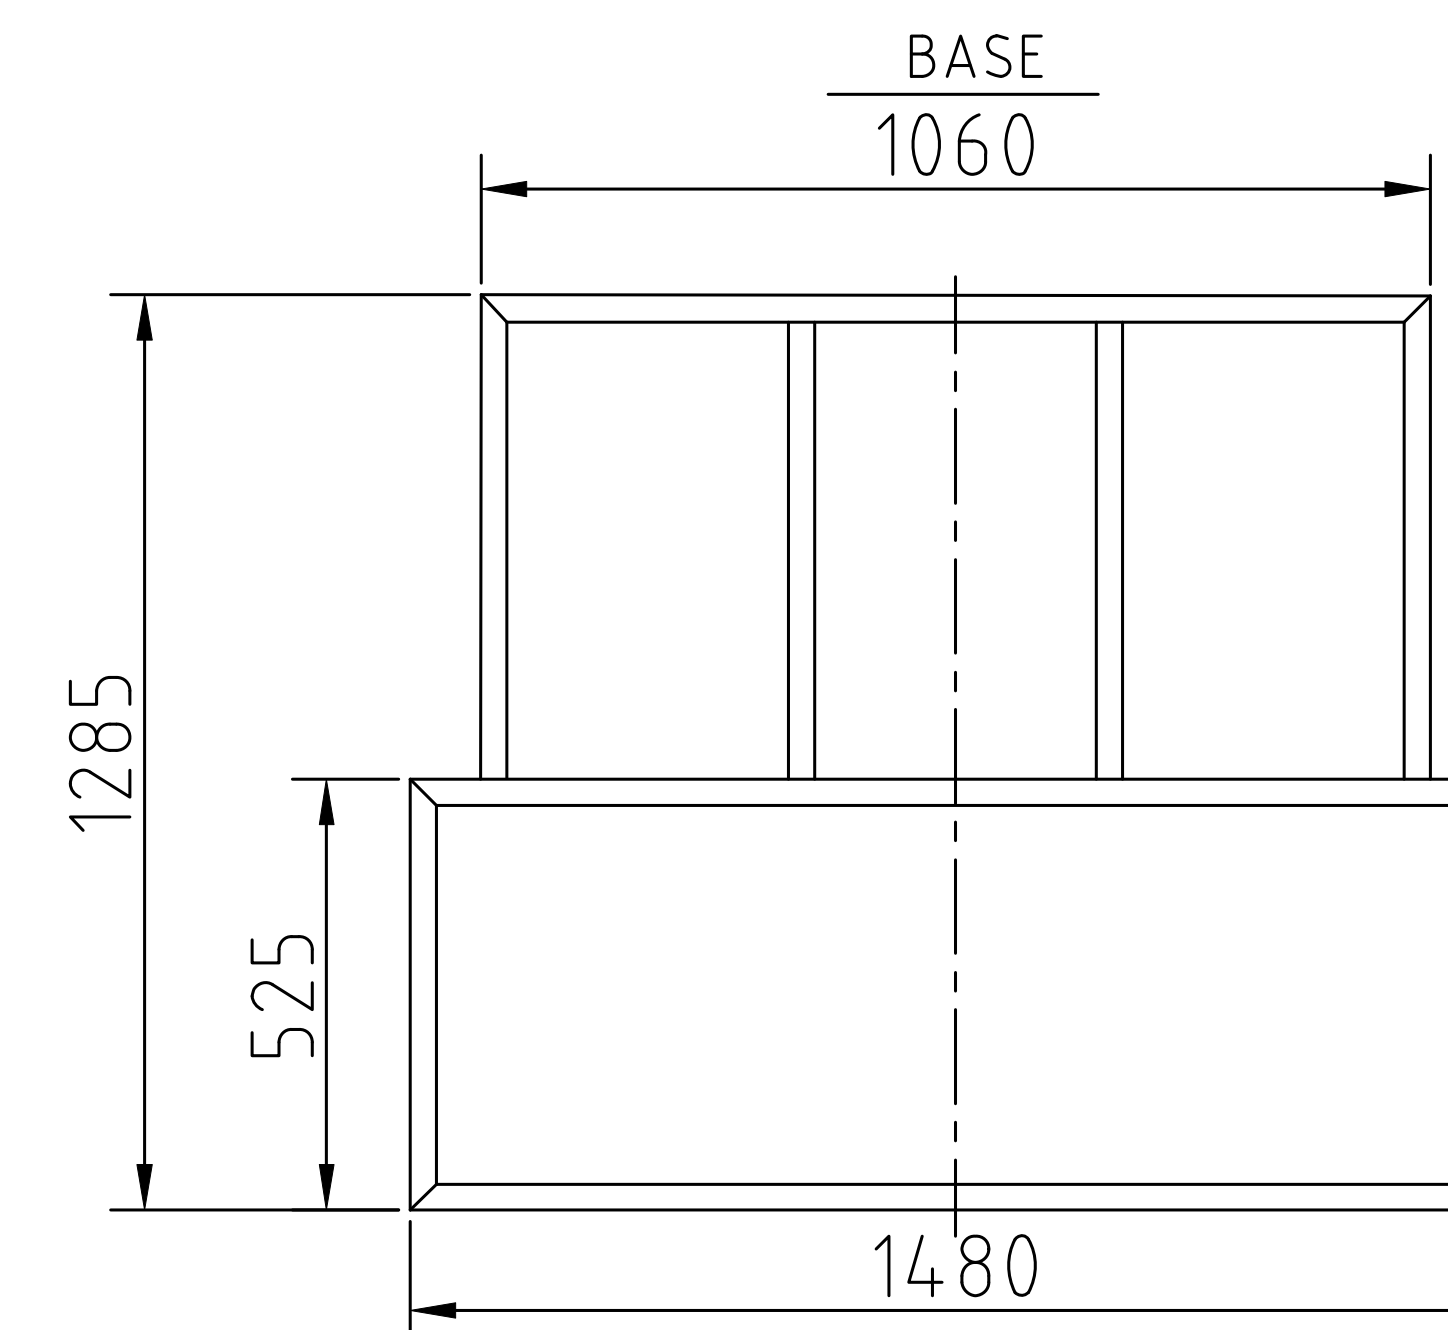
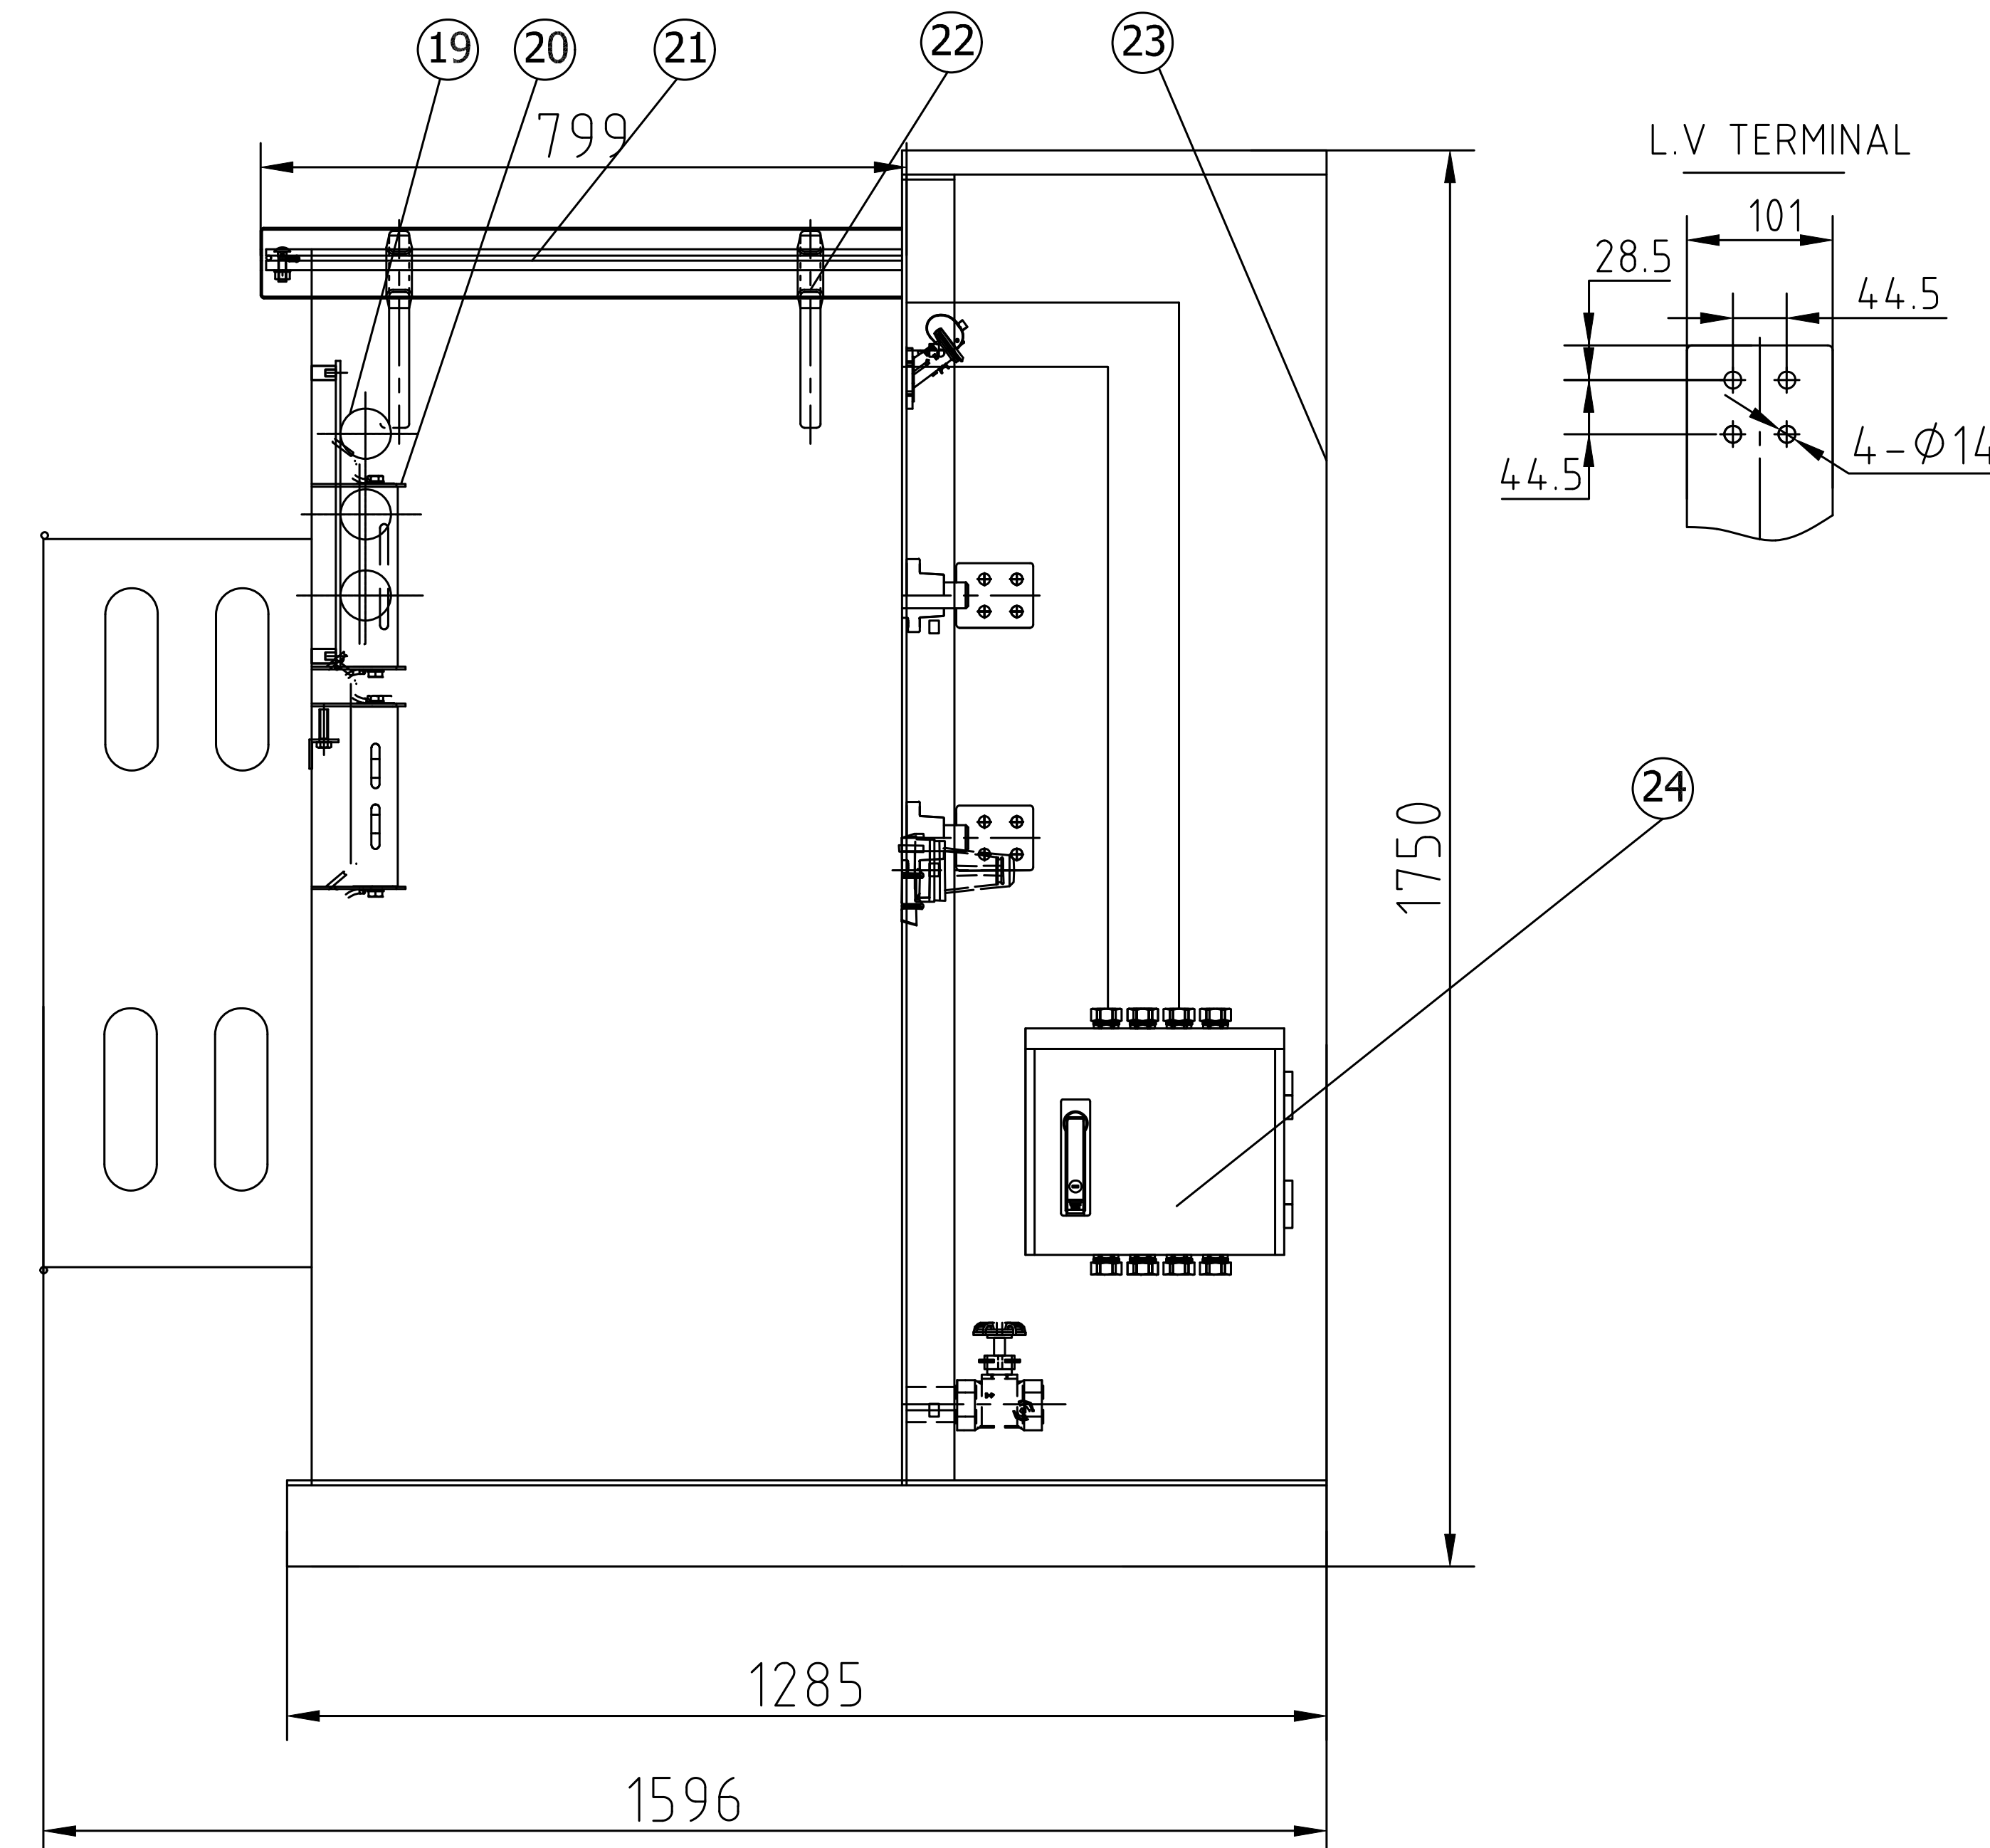
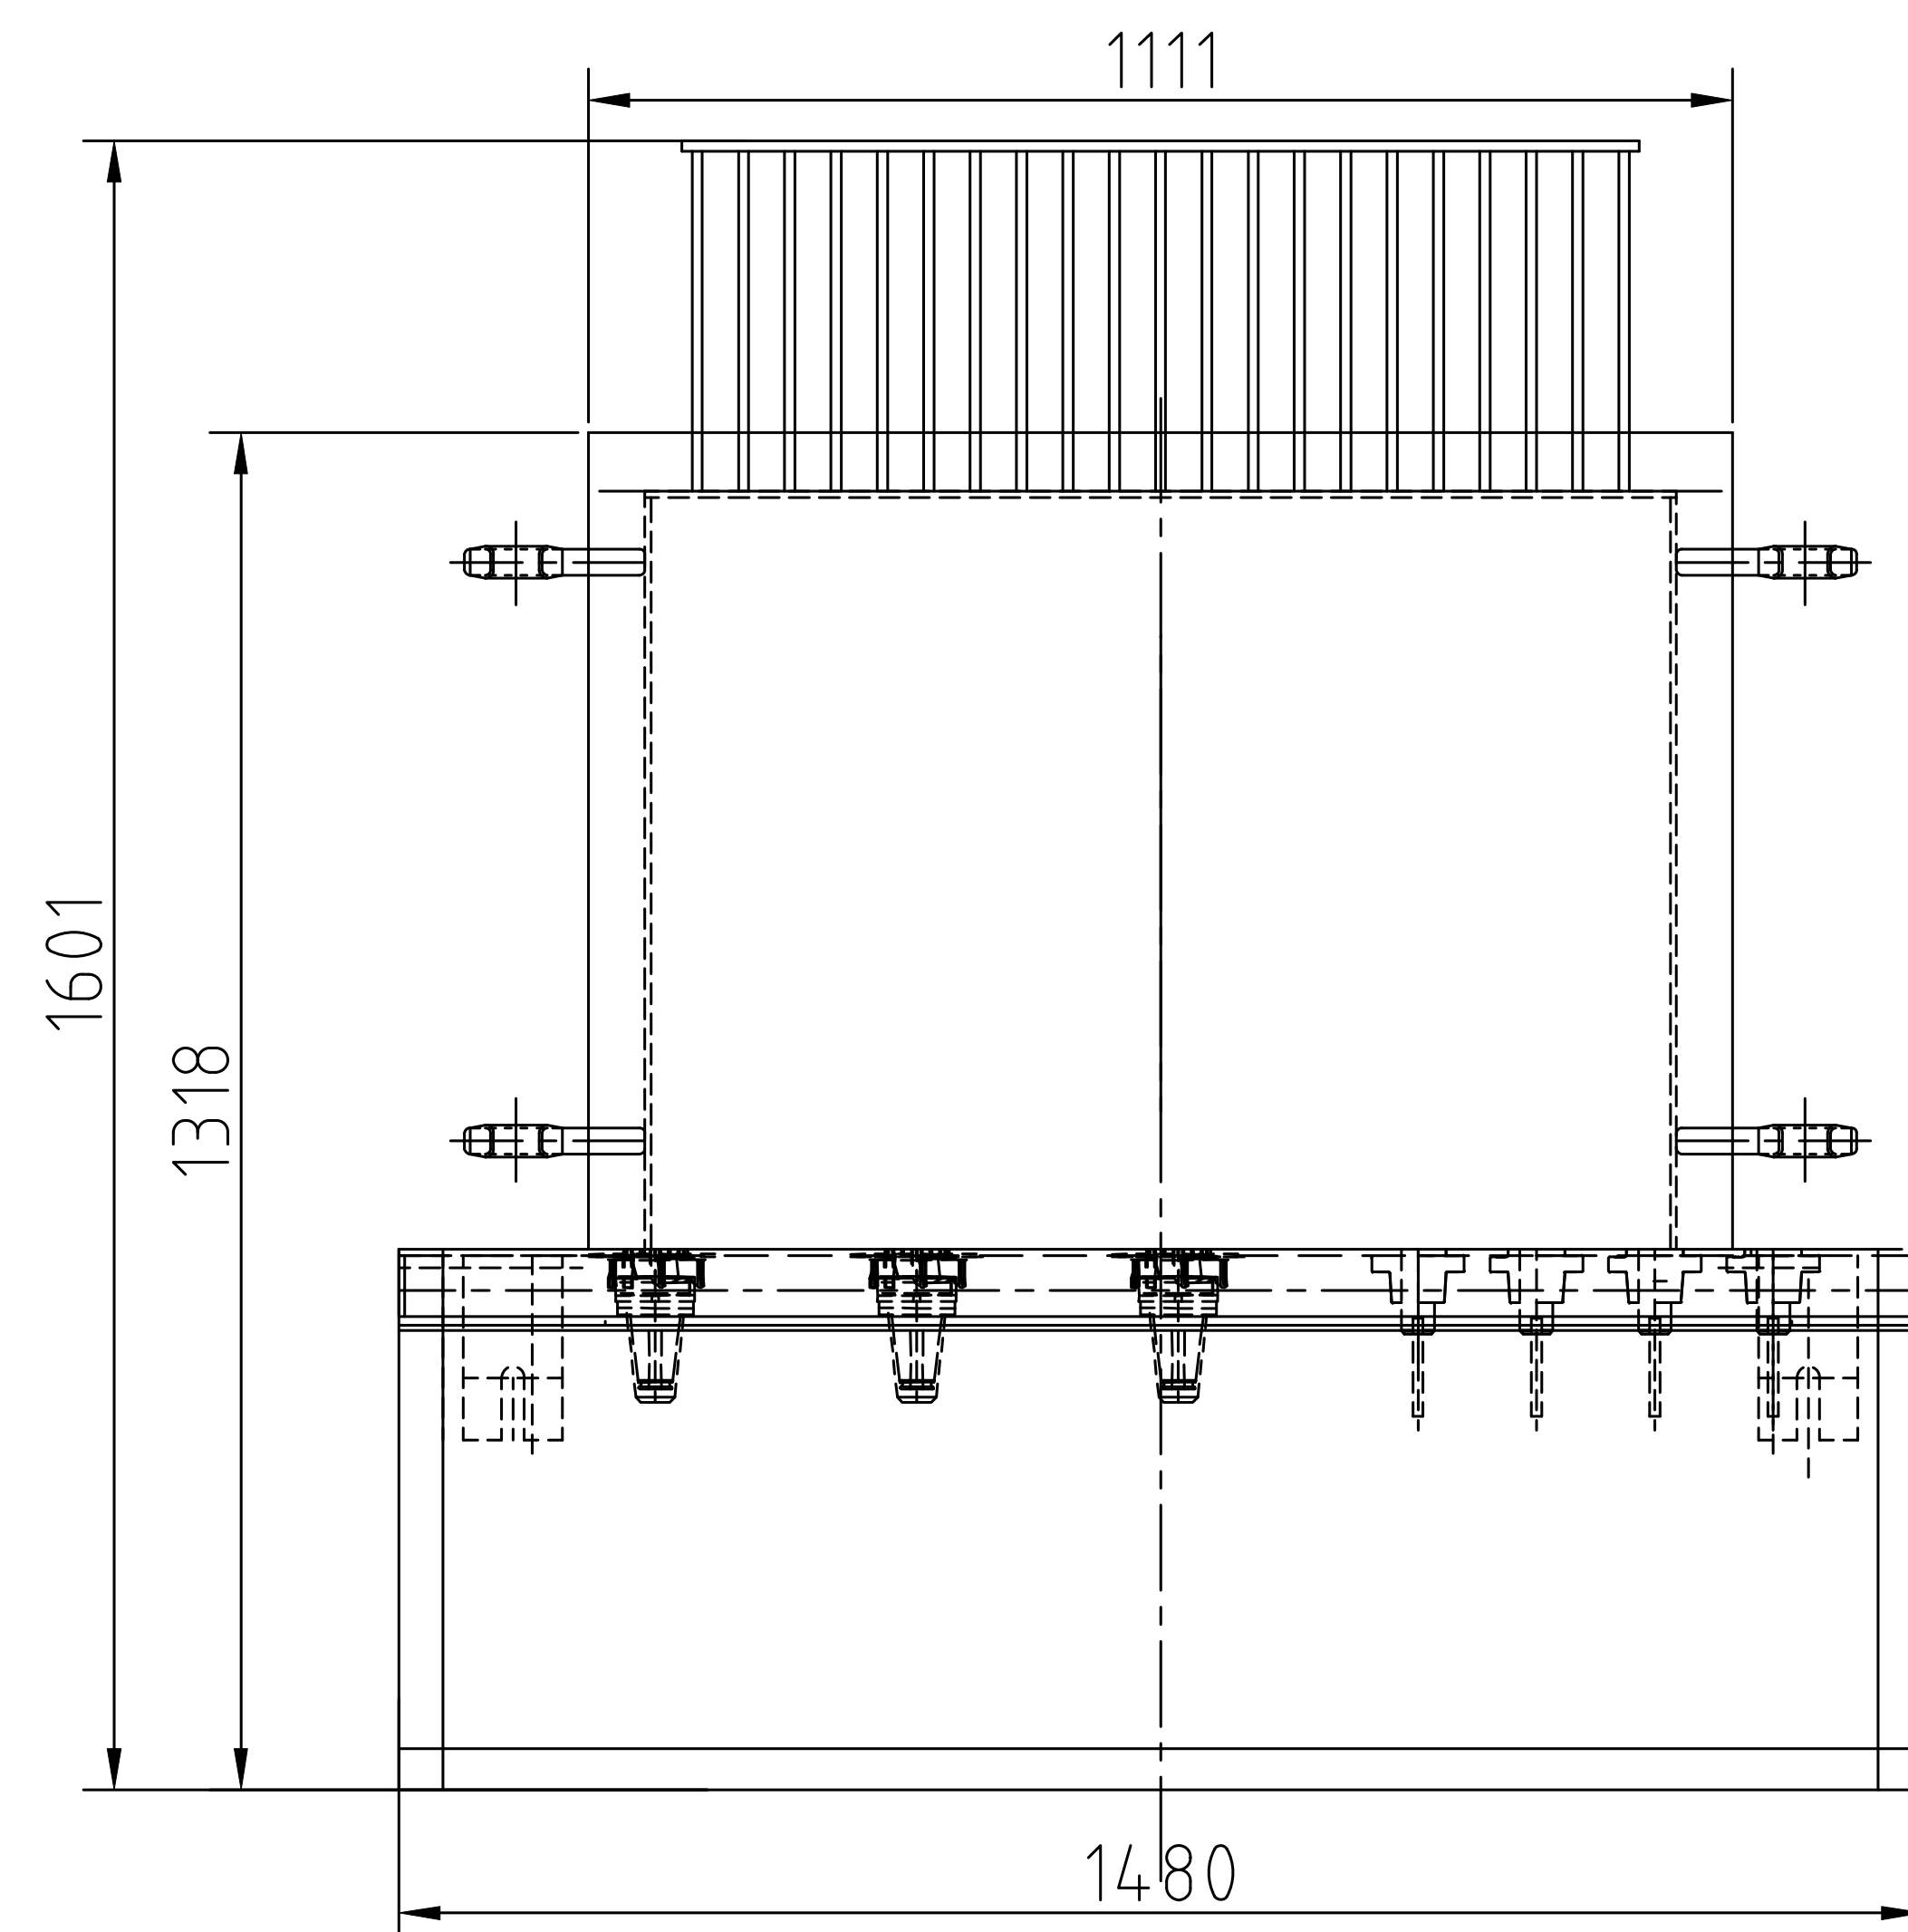


DWG. NO.

ZGSS500-231124-02

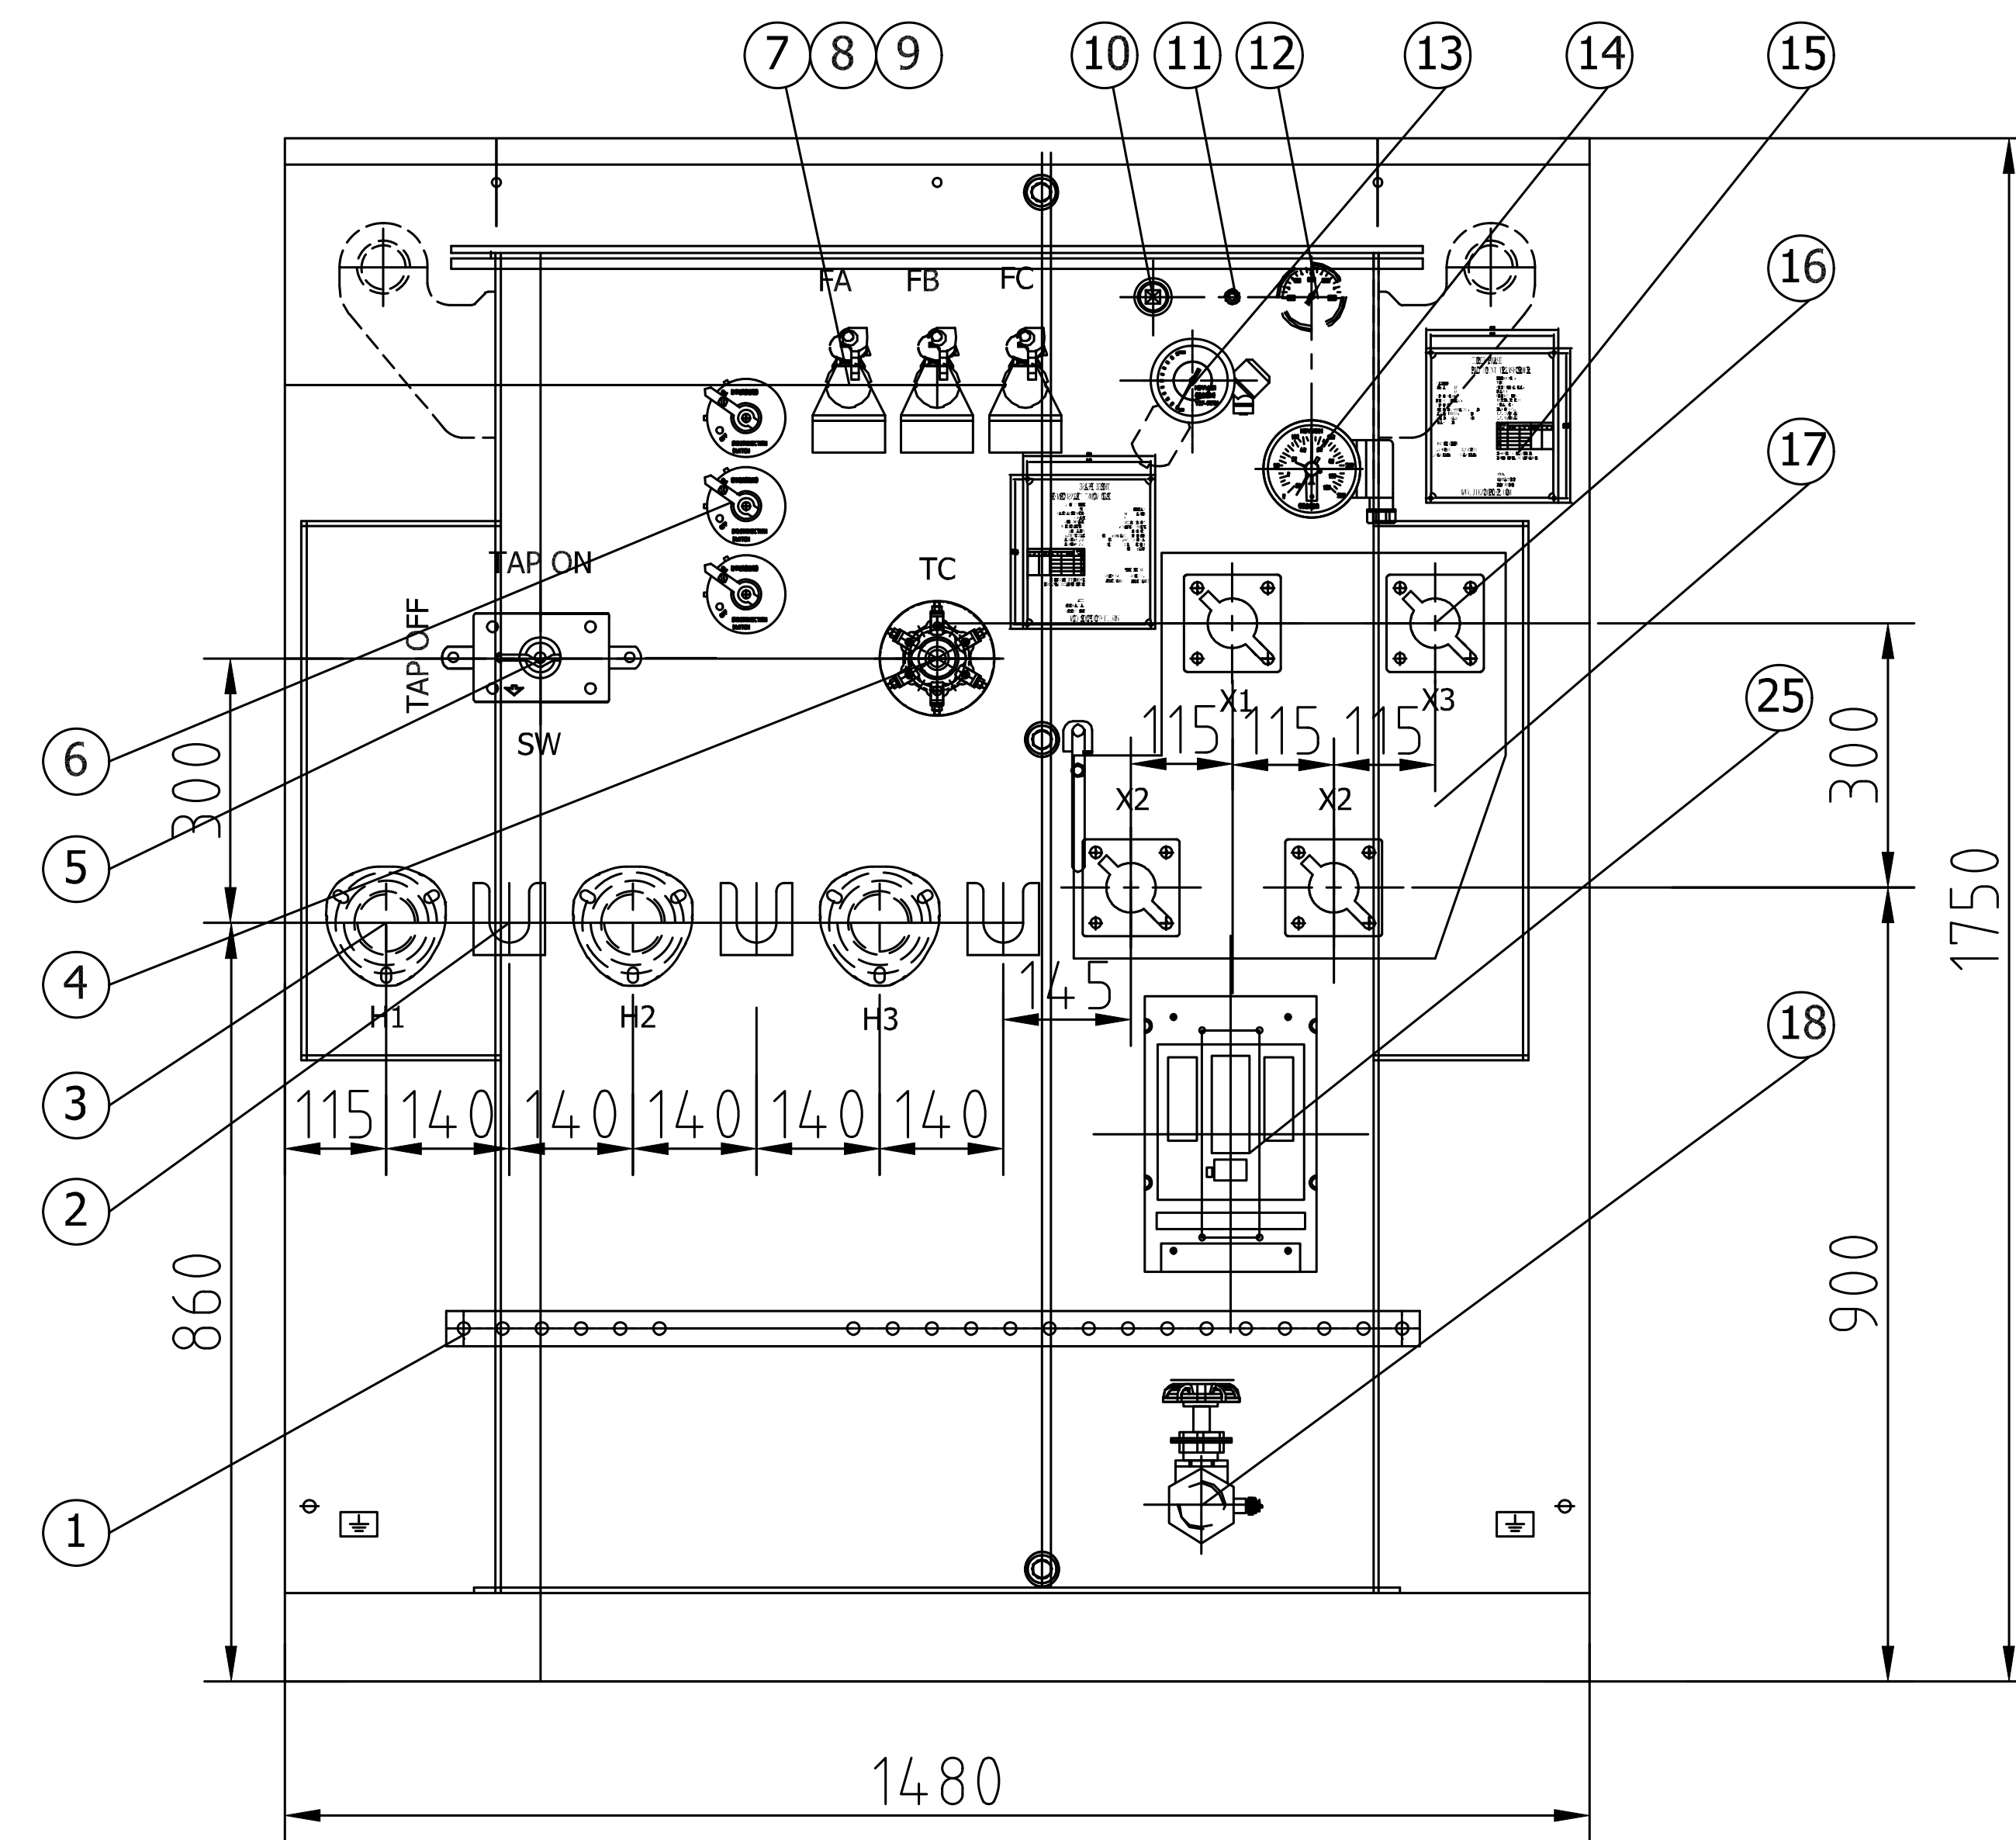

TECHNICAL DATA		
RATING		500kVA
PRIMARY VOLTAGE		7200V DELTA
SECONDARY VOLTAGE		600WYE/347V
FREQUENCY		60Hz
VECTOR GROUP		Dyn1
WINDING MATERIAL		COPPER
INSULATION LEVEL(KV)		H.V BIL 75
		L.V BIL 30
COOLING METHOD		KNAN
INSULATING OIL		FR3
TEMPERATURE RISE		65°C
LOAD LOSS AT RATED VOLTAGE		6700W
NO LOAD LOSSES		700W
EFFICIENCY		99.05%
IMPEDANCE		4%
ALTITUDE		≤5500 Feet
No. OF TAPPOSITION		5
COLOR	Munsel Green 7GY3.29/15	
CORE FORM	THREE-PHASE THREE-COLUMN	

ITEM	WEIGHT
TANK & ACCESORIES	850Kg
TOTAL OIL WEIGHT	740Kg
TOTAL WEIGHT	2450Kg

26	SPARE BAYONET FUSES	3
25	STANDARD SECONDARY CIRCUIT BEREAKER	1
24	CONTRL BOX	1
23	HINGED DOOR	2
22	LIFTING LUG	4
21	RAIN COVER	1
20	ELSP FUSE	3
19	UNDER-OILARRESTER	3
18	1.0" DRAIN/SAMPLING VALVE	1
17	750-4000 PADMOUNT LV PLATE, 304L S.S. 3/16in	1
16	LV BUSHING 4HOLE, 1000 AMP-30 BIL	4
15	NAMEPLATE	2
14	OIL THERMOMETER GAUGE WITH CONTANCTS	1
13	OIL LEVEL GAUGE WITH CONTANCTS	1
12	VACUUM PRESSURE GAUGE	1
11	PRESSURE RELIEF VALVE	1
10	1.0" UPPER FILL PIUG	1
9	BAY-O-NET FUSE HOLDER	3
8	BAY-O-NET FUSE HOLDER DRIP TRAY (DRIP GUARD)	3
7	BAY-O-NET FUSE LINK	6
6	UNDER-OIL ARRESTER DISCONNECTOR	3
5	TWO POSITION LOADBREAKER SWITCH	1
4	TAP CHANGER 3PH	1
3	HV BUSHING WELL WITH LOADBREAKE BUSHING INSERT	3
2	PARKING STAND BRACKET	3
1	CSA GROUND BUS	1
ITEM	DESCRIPTION	QTY
OPTIONAL TRANSFORMER PARTS LIST		


DWG. NAME
General Assembly Drawing

ED	FIRST ANGLE PROJECTION	SCALE	1	PROJECT: MVBA20070
----	---------------------------	-------	---	--------------------

The oil filled transformers are not affected by the air due to elevation (~5,500 feet)

ZGS500-231124-02

JZP
SINCE 1989 FROM USA

REV.
NO.

DWG. NO.

ZGS500-231124-02

OIL LEVEL INDICATOR

OIL TEMPHERAYURE INDICATOR

X1:Body protect

NO.	Function	Joint
1	OLI COM	2
2	High level alarm	1
3	Low level alarm	3
4		
5	OTI COM	2
6	85°	3
7	95°	1
8		
9		
10		
11		
12		
13		
14		
15		
16		
17		
18		
19		
19		

OLI-2

OLI-1

OLI-3

To OLI

OTI-2

OTI-3

OTI-1

To OTI

Cable specifications

Models	Core	Length
ZVVP-2.5	3	4 m
ZVVP-2.5	4	2 m

DWG. NAME

General Assembly Drawing

DRAWN

CHECKED

CHECKED

APPROVED

ELLA W

IRIS J

SAM S

ZGS500-231124-02

ANHUI JIEZOU NEW ENERGY TECHNOLOGY CO., LTD.

安徽捷宙新能源科技有限公司

JZP

SINCE 1989 FROM USA

REV. NO.

0

PROJECT: MVBA20070

NAMEPLATE

150


140



THREE PHASE
PAD MOUNT TRANSFORMER

STANDARDS CSA C227.4
500kVA HV 7200V DELTA
LV 600V WYE/347V
TYPE OF COILING KNAN
PERCENT IMPEDANCE: 4 %
TYPE OF OIL FR3 NO PCB
CORE & COLL (UNTAKING): LBS
TANK & FITTINGS: LBS
LIQUID: GALS LBS
TOTAL: LBS

PRODUCT NO. :
TYPE ZGS-Z-500/7.2/0.6
CONDUCTOR MATERIAL: COPPER
PHASE 3
FREQUENTY 60Hz
TEMPERATURE RISE 65° C/ 65° C
SERIAL NO. :
DATE OF MFG. :
H. V. Um/BIL/AC 15/75/26 kV
L. V. Um/BIL/AC 1.2/30/10 kV

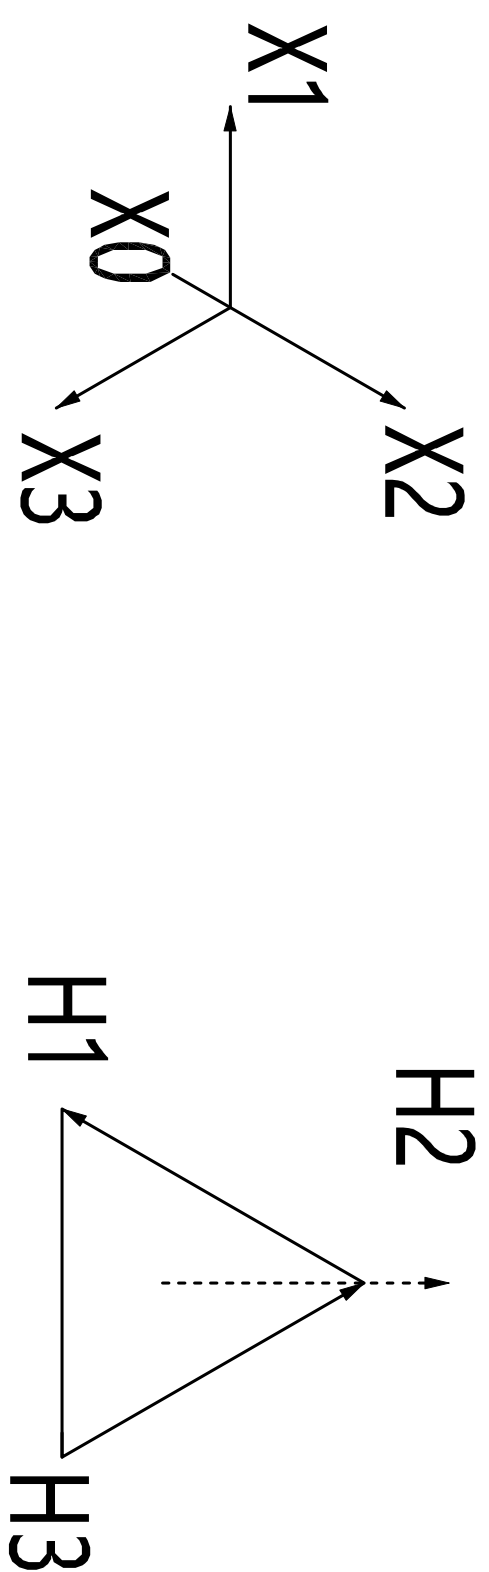

VECTOR GRAPH (Dyn1)



Tapping Range	H. V		L. V	
	Voltage (V)	Current (A)	Voltage (V)	Current (A)
1 +5 %	7560	38.19	600	481.14
2 +2.5 %	7380	39.12		
3 Rated	7200	40.09		
4 -2.5 %	7020	41.12		
5 -5 %	6840	42.21		

L. V WIRING

H. V WIRING

SCHEMATIC DIAGRAM

SCHEMATIC DIAGRAM

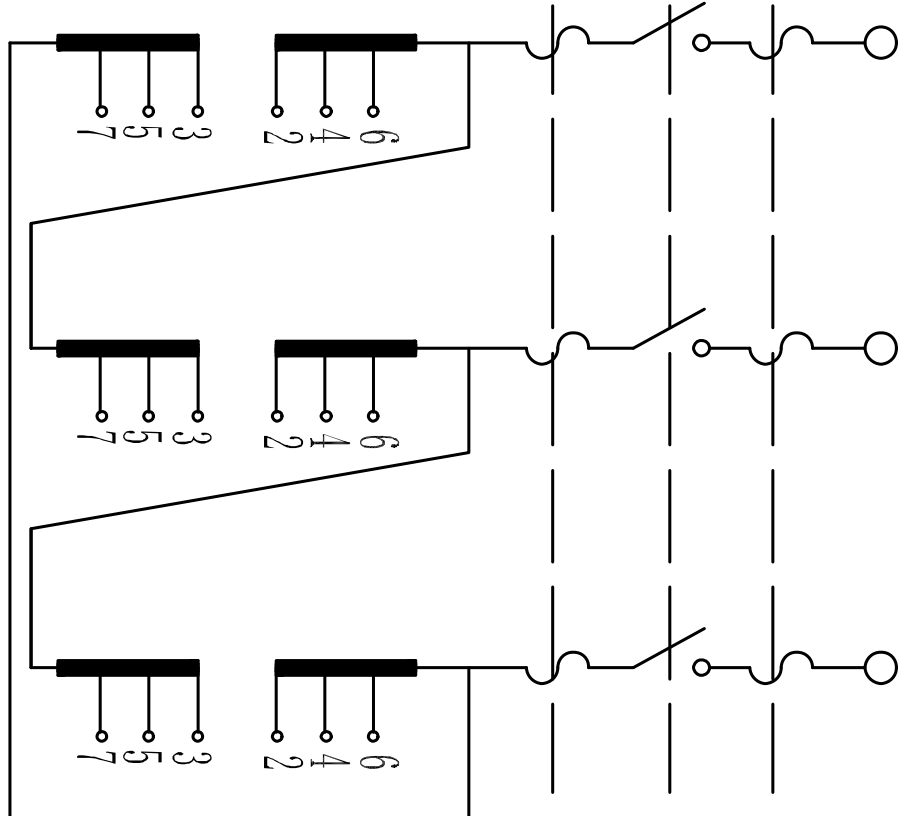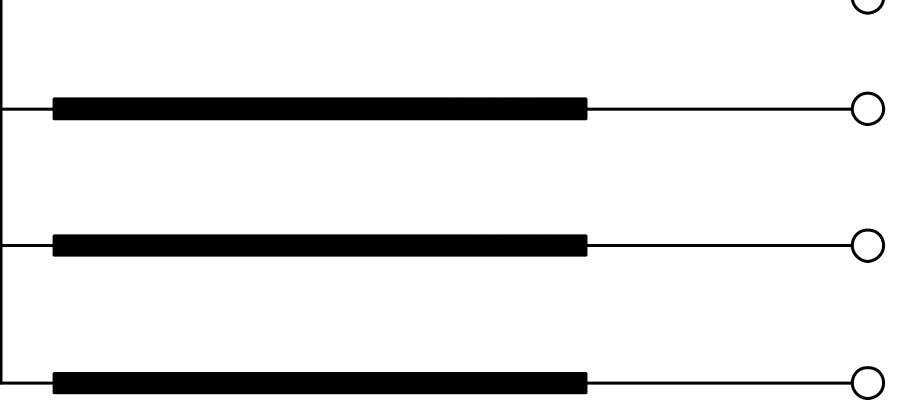

CURRENT LIMITING FUSES
2 POS. LB SWITCH
BAYONET FUSES
4000353C14M
CBUC8150D100

ITEM:
MANUFACTURER:
PART NUMBER:

WWW.JIEZOUPOWER.COM



165

175