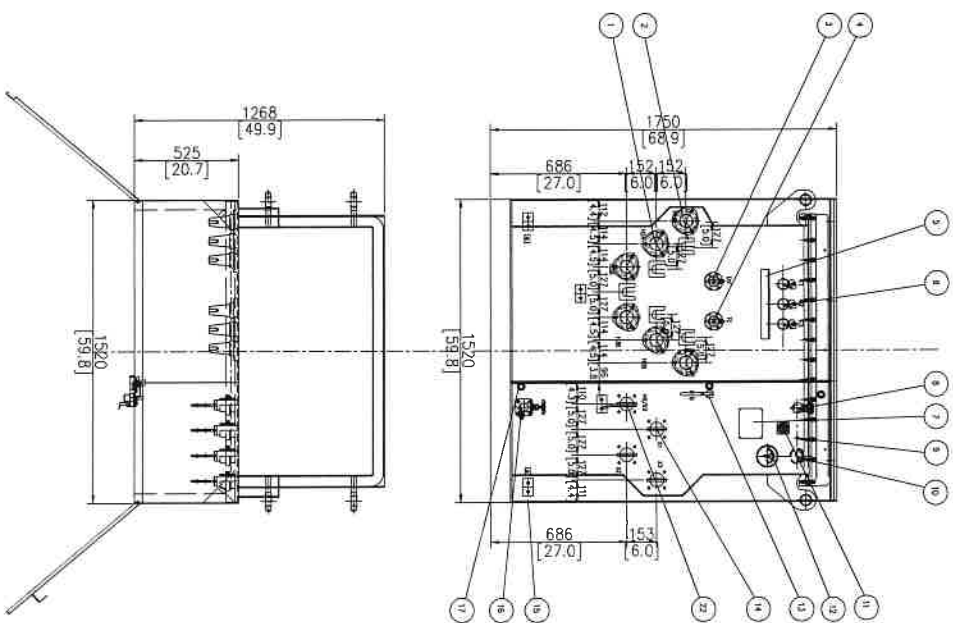


TECHNICAL DATA	
RATING	150KVA
PRIMARY VOLTAGE(V)	720-13800000/450-7500
SECONDARY VOLTAGE(V)	210/80V/1/2U
FREQUENCY	60Hz
VECTOR GROUP	YNd0
CONDUCTOR	ALUMINUM
PRIMARY BIL VOLTAGE	95.4V
SECONDARY BIL VOLTAGE	30kV
INSULATING OIL	MINERAL OIL
TEMPERATURE RISE	65°C
EFFICIENCY	99.16%
LOAD LOSS AT RATED VOLTAGE	1800 W
NO LOAD LOSSES	160 W
IMPEDANCE	3.1+-4.5%
ALTITUDE	≤1500m
No. of TAP POSITION	5
COLOR	MUNSEL GREEN 7.5/3.29/1.5
CORE FORM	THREE-PHASE FIVE-COLUMN

ITEM	WEIGHT
TANK & ACCESSORIES	750kg
TOTAL OIL WEIGHT	980L
TOTAL WEIGHT	2650kg

PARTS LIST		QTY
ITEM	DESCRIPTION	
1	HY BUSHING (5/8"x200A)	5
2	PARKING STAND BRACKET	6
3	DOUBLE VOLTAGE SWITCH	1
4	TAP CHANGER 3PH (VSL13 63/20-6x5)	1
5	DRIP TRAY	1
6	BAYONET FUSE	3
7	NAMEPLATE	1
8	1" UPPER FILL VALVE	1
9	WFO-PRO	1
10	VACUUM PRESSURE GAUGE	1
11	OIL LEVEL GAUGE	1
12	OIL TEMPERATURE GAUGE	1
13	DOOR HANDLE	1
14	LV BUSHING(4 HOLE 1.2KV1000A)	4
15	GROUND STEEL PADS	6
16	"DRAIN VALVE WITH 3/8" SAMPLER	1
17	FIXED PROJECTING CLIP	3
18	FLIP TOP COVER	1
19	LIFTING LUG	4
20	TERMINAL BLOCK	2
21	HINGED DOOR	1
22	GROUND BAR	1

5						BRANN	MIKE W
4						DESIGNED	ELLA W
3						CHECKED	IRIS J
2						APPROVED	SAM S
1						DATE	SCALE
NO.	REVISIONS	DATE	DRAWN	CHK'D	APP'D	MM/DD/YY	

ZGSL-H-150/7.2-13.8/0.208
GENERAL ASSEMBLY DRAWING

Approved: MA Miller


200
185



3 PHASE DISTRIBUTION PAD MOUNTED TRANSFORMER

PRODUCT NO.: TYPE ZGSL-H-150/7.2-13.8
CONDUCTOR MATERIAL: ALUMINUM
PHASE 3
FREQUENCY 60Hz
TEMPERATURE RISE 65°C/65°C
SERIAL NO.:
DATE OF MFG.:


STANDARDS IEEE C57.12.34
150KVA HV 7.2-13.8 KV GRDY/4.16-7.96
LV 208 V GRDY/120
TYPE OF COOLING ONAN
PERCENT IMPEDANCE: %
TYPE OF OIL MINERAL OIL
NO PCB
CORE & COIL:
TANK & FITTINGS:
LIQUID:
TOTAL:

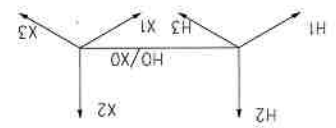

kg
kg
kg
kg
kg

LV	HV	TAP POSN	AMP(A)-DV POSN	VOLTS(V)-DV POSN	208		
					1	2	3
		A-E	B-C	A-E	14490	7560	11.73
					14145	7380	12.03
					13800	7200	12.34
					13455	7020	12.66
					13110	6840	12.98
					12765	6660	13.30
					12420	6480	13.62
					12075	6300	13.94
					11730	6120	14.26
					11385	5940	14.58
					11040	5760	14.90
					10695	5580	15.22
					10350	5400	15.54
					10005	5220	15.86
					9660	5040	16.18
					9315	4860	16.50
					8970	4680	16.82
					8625	4500	17.14
					8280	4320	17.46
					7935	4140	17.78
					7590	3960	18.10
					7245	3780	18.42
					6900	3600	18.74
					6555	3420	19.06
					6210	3240	19.38
					5865	3060	19.70
					5520	2880	20.02
					5175	2700	20.34
					4830	2520	20.66
					4485	2340	20.98
					4140	2160	21.30
					3795	1980	21.62
					3450	1800	21.94
					3105	1620	22.26
					2760	1440	22.58
					2415	1260	22.90
					2070	1080	23.22
					1725	900	23.54
					1380	720	23.86
					1035	540	24.18
					690	360	24.50
					345	180	24.82
					0	0	25.14

H.V. BIL/AC 95/34 kV
L.V. BIL/AC 30/10 kV
DE-ENERGIZE TRANSFORMER
BEFORE OPERATING TAPCHANGER
TANK MUST BE SOLIDLY GROUNDED.
VECTOR GROUP [Ynyn0]

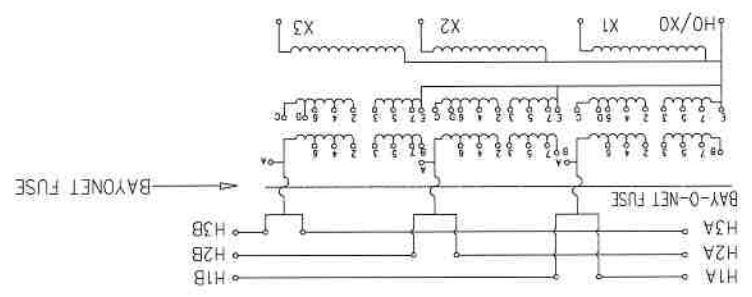

www.jezoupower.com

4-φ4.5
[φ0.2]

Approved: [Signature]