


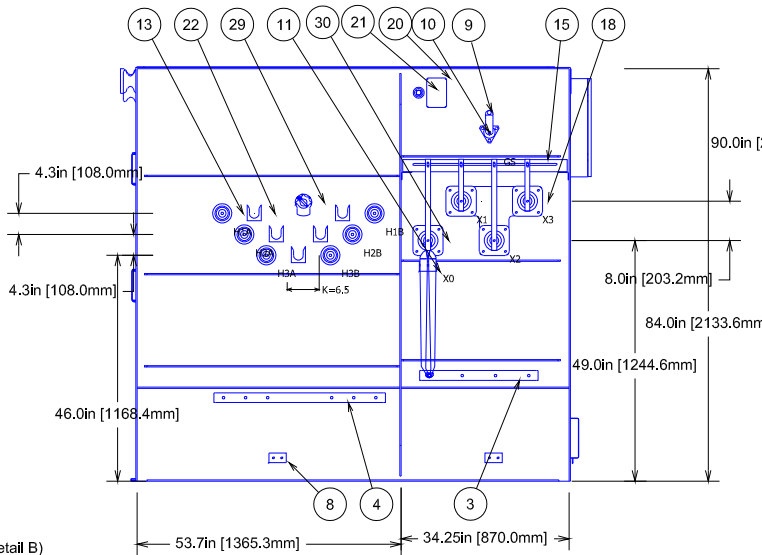


3500KVA 34500V 690Y/398 且参考3.5MVA PMT 资料		
预付时间		2024/6/24
外形图提交时间		预付后1周
生产时间要求		外形图确认后12周
使用场景		风力涡轮发电机升压变压器
描述	提供内容	
标准和使用国家	CSA C227. 4/CSA C88, CSA C802 加拿大	
Type	DEAD FRONT LOOP FEED PAD MOUNTED TRANSFORMER	
Installation	Outdoor	
Altitude above sea level/Ambient temperature	m/℃	1000/50
Altitude		≤1500m
Rated Power	kVA	3500
HV	V	34500 DELTA
LV	V	690Y/398
Rated Frequency	Hz	60
Cooling System		ONAN
Number of winding		2
Number of phase		3
Core/Shell		Core type
Refrigerant		Mineral oil type II (PCB FREE)
Working-Temperature	℃	-40℃ to +40℃
Cooling Method		ONAN
The temperature rise -Top oil	℃	65
The temperature rise --Winding	℃	65
Hot spot	℃	80
Losses		
No load losses at rated voltage and rated frequency on principal tap	W	根据标准
Load loss at rated voltage	W	根据标准
Tolerance		根据标准
Vector Group		根据标准
Core material		Grain oriented silicon steel
Core legged		3 ,DYN11
Winding material		铝
Tap changer		
On load or off-circuit		off-circuit
Position of tapped winding		HV
Tap Voltages HV	%	±2x2.5%
High voltage electrical characteristics of transformers and assembled load break terminals		
Insulation class	kV	34.5
BIL	kV	150
Low voltage		
Insulation class	kV	1.2
BIL	kV	30
Audible sound level	db	根据标准
Electrostatic shield Design 静电屏蔽		有
Impedance	%	6.72
Impedance tolerance		±7.5%
Tank		Mild steel
Colors		ANSI 70 Gray Topcoat
Total Dimentions		
Height 高	mm	参考3.5MVA PMT 资料
Depth 深	mm	参考3.5MVA PMT 资料
Width 宽	mm	参考3.5MVA PMT 资料
Weight 重量		
Oil 油	kg	参考3.5MVA PMT 资料
Total 总重	kg	参考3.5MVA PMT 资料
Accessories including: 配件		
Lifting lug 吊耳		有，根据标准，且参考3.5MVA PMT 资料
Hinged door 铰链门		有，根据标准，且参考3.5MVA PMT 资料
Parking stand bracket 挂架		有，根据标准，且参考3.5MVA PMT 资料
LV bushing 低压套管， 参考附件图纸 2617085B54P， 国产品牌即可		有，根据标准，且参考3.5MVA PMT 资料
Pressure relief valve 压力释放阀-QUALITROL		有，根据标准，且参考3.5MVA PMT 资料
Drain Valve 放油阀-国产品牌即可- 油箱低压侧外面		有，根据标准，且参考3.5MVA PMT 资料
Ground Strap copper 接地铜条		有，根据标准，且参考3.5MVA PMT 资料
HV bushing insert 高压套管负载插头-国产品牌即可		有，根据标准，且参考3.5MVA PMT 资料
Ground pads 接地铜板		有，根据标准，且参考3.5MVA PMT 资料
Nameplate 铭牌		有，根据标准，且参考3.5MVA PMT 资料
Bayonet fuse 插入式熔丝-国产品牌即可		有，根据标准，且参考3.5MVA PMT 资料
Tap changer 调压开关-国产品牌即可		有，根据标准，且参考3.5MVA PMT 资料
LB switch 负荷开关-国产品牌即可		有，根据标准，且参考3.5MVA PMT 资料
Thermometer 油温计-QUALITROL		有，根据标准，且参考3.5MVA PMT 资料
Oil level gauge 油位计-QUALITROL		有，根据标准，且参考3.5MVA PMT 资料
Pressure vacuum gauge 压力真空表-QUALITROL		有，根据标准，且参考3.5MVA PMT 资料
Bushing well 套管座 国产品牌即可		有，根据标准，且参考3.5MVA PMT 资料
Door handle 门把手		有，根据标准，且参考3.5MVA PMT 资料
Kirk Key		有，客供，图纸标出预留位置， 且参考3.5MVA PMT 资料
IR viewing Windows		有，客供，图纸标出预留位置， 且参考3.5MVA PMT 资料
其他要求：	1. 其他未要求细节， 都按最新加标要求设计 且参考3.5MVA PMT 资料 2. 尺寸和设计要靠近 / 相同客供参考图纸 3. 带CUL list	

ITE	DESCRIPTION
1	Welded Cover w/ Handhole
2	Cooling Radiators
3	Copper Ground Bus
4	Copper Ground Bus
5	Current Limiting Backup Fuses (Internal)
6	Drain Valve with Sampler and Cover
7	Gauge Cabinet
8	Ground Pad .50-13 Tap
9	Ground Strap and Nut
10	Ground Shield Bushing
11	Ground Strap and Pad
12	High Security Cabinet w/ Pentahead Door Bolts
13	35kV 600 Amp Deadbreak HV Bushing
14	Internal Cartridge Fusing
15	LV Bushing Support
16	Lifting Lug
17	Liquid Temperature Gauge
18	1.2kV LV Bushing w/12 Hole Spade Supported
19	Magnetic Oil Level Gauge
20	Nameplate
21	One Inch Upper Press. Conn. and Fill Plug
22	Parking Stand
23	Pressure Relief Device
24	Pressure Relief Valve
25	Pressure Vacuum Gauge
26	Schrader Valve
27	Seismic Anchor Provisions
28	Tank Base w/ Jacking and Rolling Facilities
29	5-Position Tap Changer
30	XO Bushing
31	Front Barrier on LV C0mpartment (not shown)

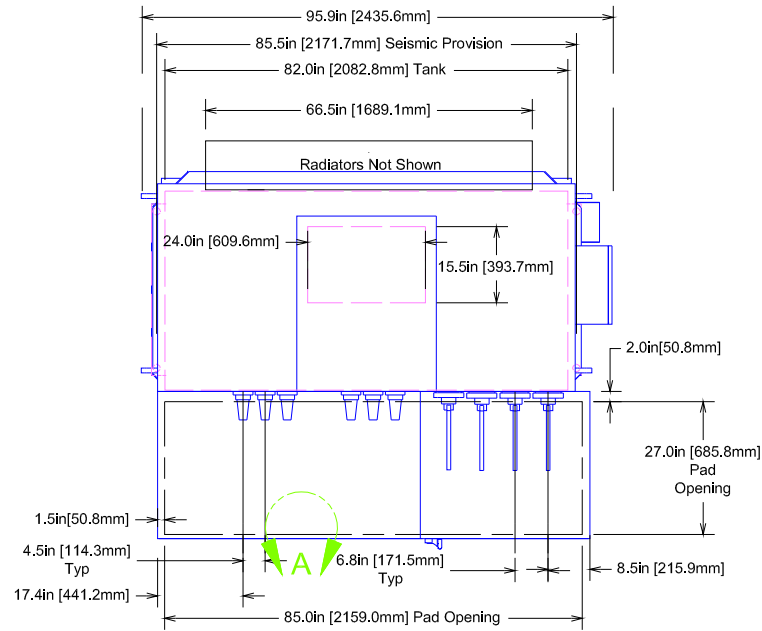


DETAIL A
IR Window

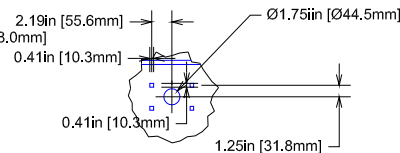



DETAIL B
Fault Indicators

Cabinet and Front
Barrier Removed

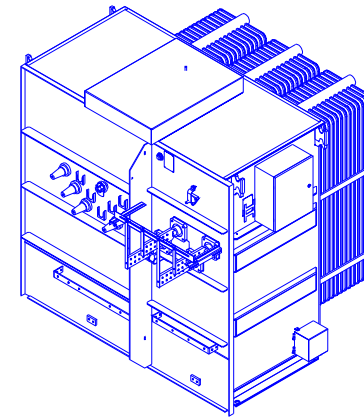

00023A67KCHA

REVISIONS

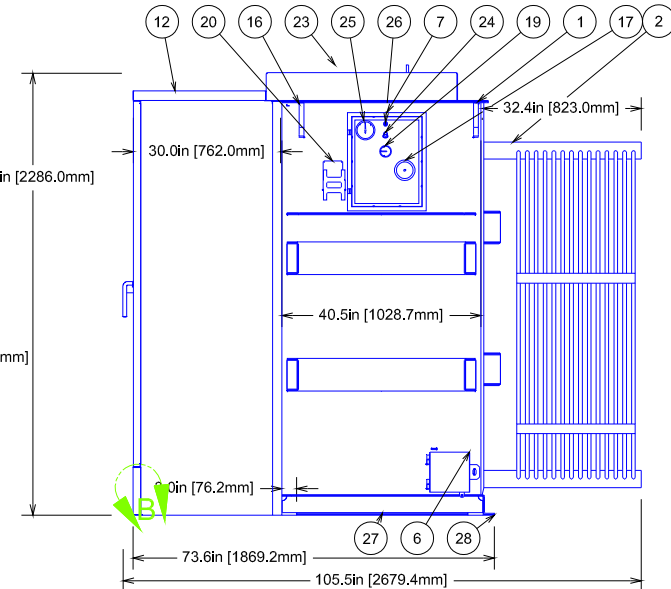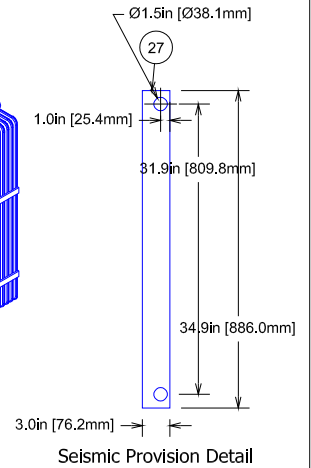

MATERIAL:

ALL DIMENSIONS ARE IN INCHES [MM]

THE INFORMATION ON THIS DOCUMENT WAS
CREATED BY EATON. IT WAS DISCLOSED IN
CONFIDENCE AND IS ONLY TO BE USED FOR
THE PURPOSE IN WHICH IT WAS SUPPLIED.

THIS DRAWING HAS BEEN GENERATED FROM A 3D MODEL.



TITLE: Distribution Transformer Outline Drawing
DESC: COOPER POWER SERIES THREE-PHASE
PAD-MOUNTED COMPARTMENTAL TYPE




DWG: PTP DATE: 11/7/2016 REF: P3D V03R07M02 SHEET #: 1 OF 1 SCALE: REV: 03

00023A67KCHA

JZP drill the hole for the kirk key.
kirk key will be install by client.
And drill the IR viewing Windows and install it here.




KV CLASS: 1.2
BIL (KV): 45
RATED CONT. CURRENT: 3010 A
MIN CREEP DISTANCE: 2.25"

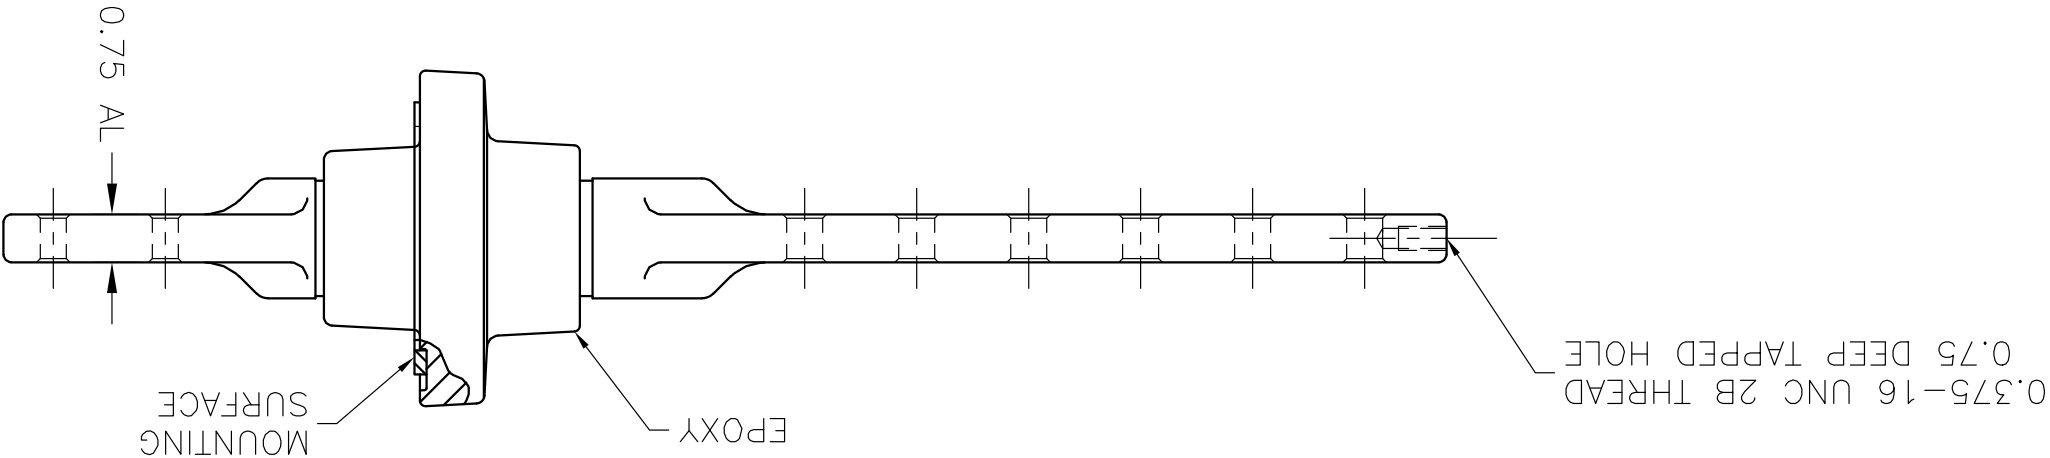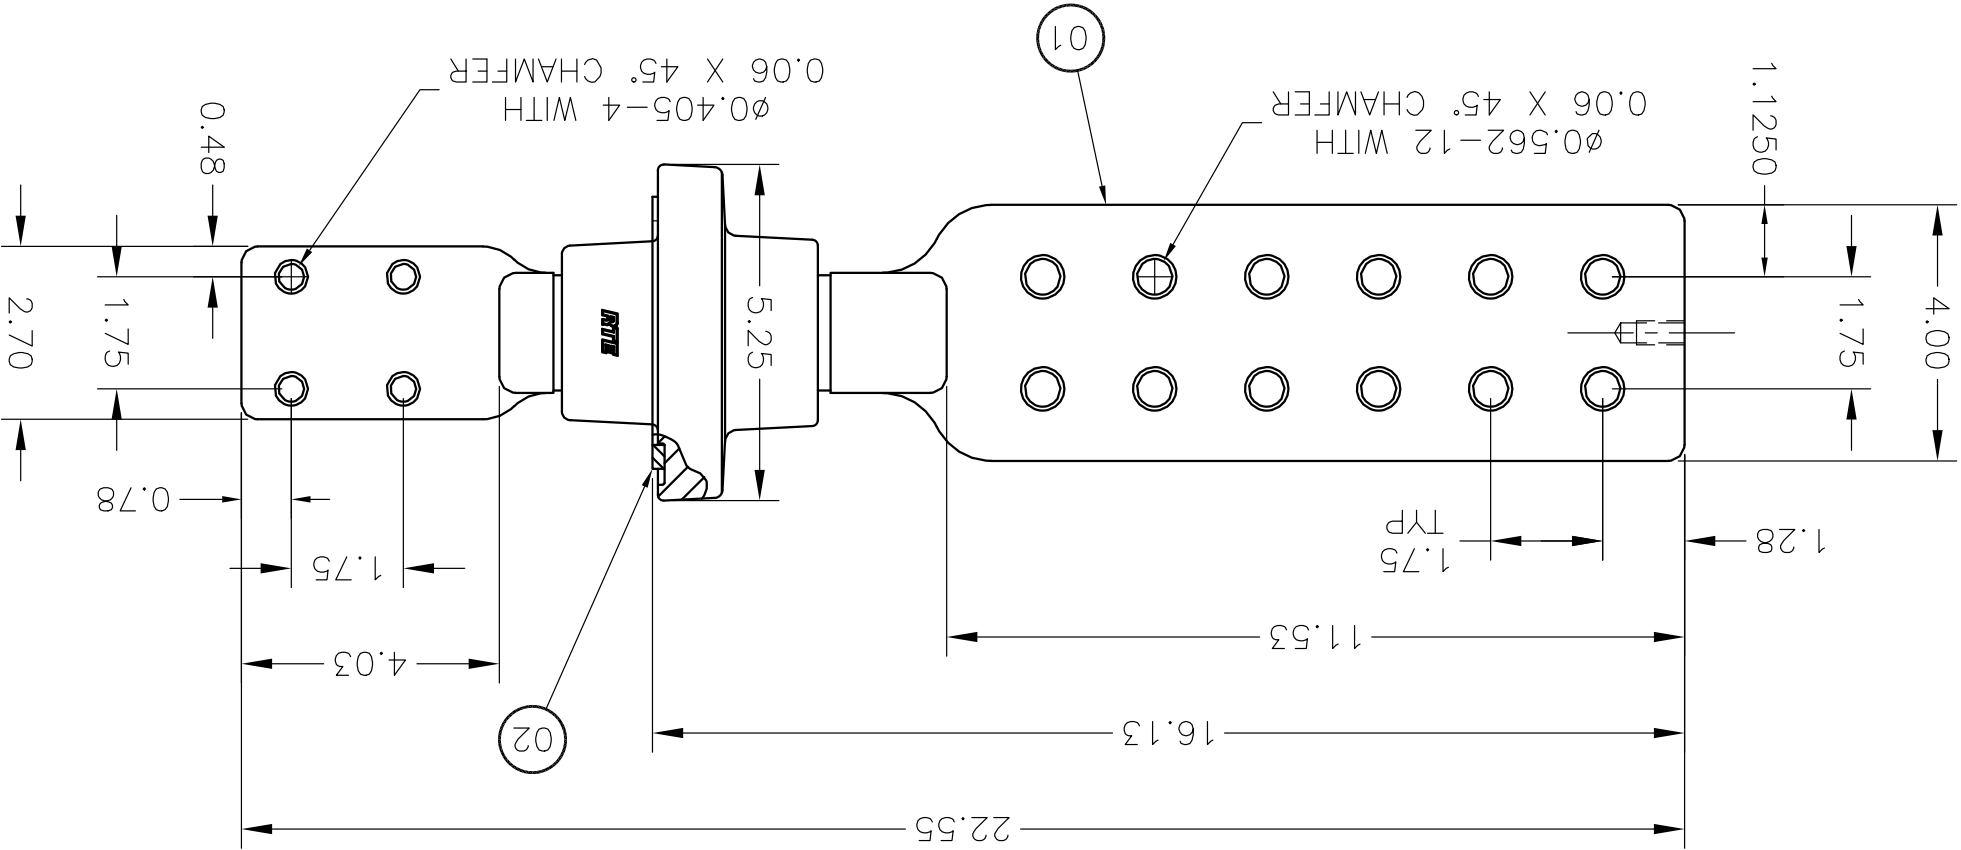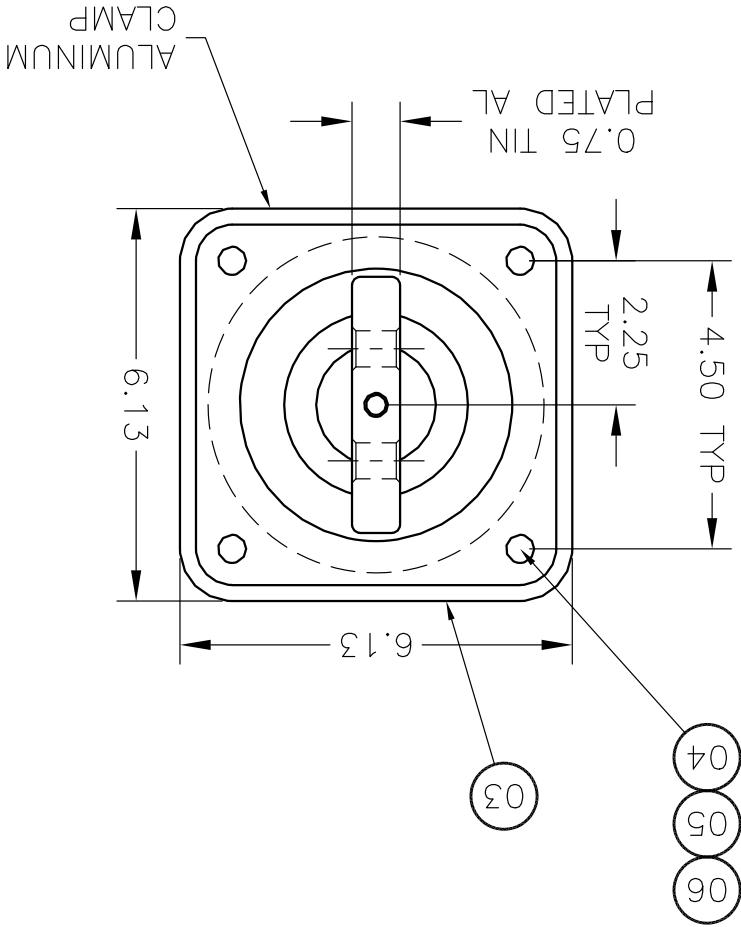

MATERIAL:					
ALL DIMENSIONS ARE IN INCHES					
TOLERANCES UNLESS OTHERWISE SPECIFIED					
TITLE: BUSH ASSY LV					
SUBJ: 1.2KV 3010A					
12 HOLE EXT 4 HOLE INT					
DWG: DATE: 04/06/01					
REF: 2617085B54					
SHEET #: 1 of 1					
SCALE: 1:1					
REV: 01					
2617085B54P					

2617085B54P	
REVISIONS	
REV 01	UPD TD TO SAP/PLM
ECN 500000020884	
04-09-08 JJB	

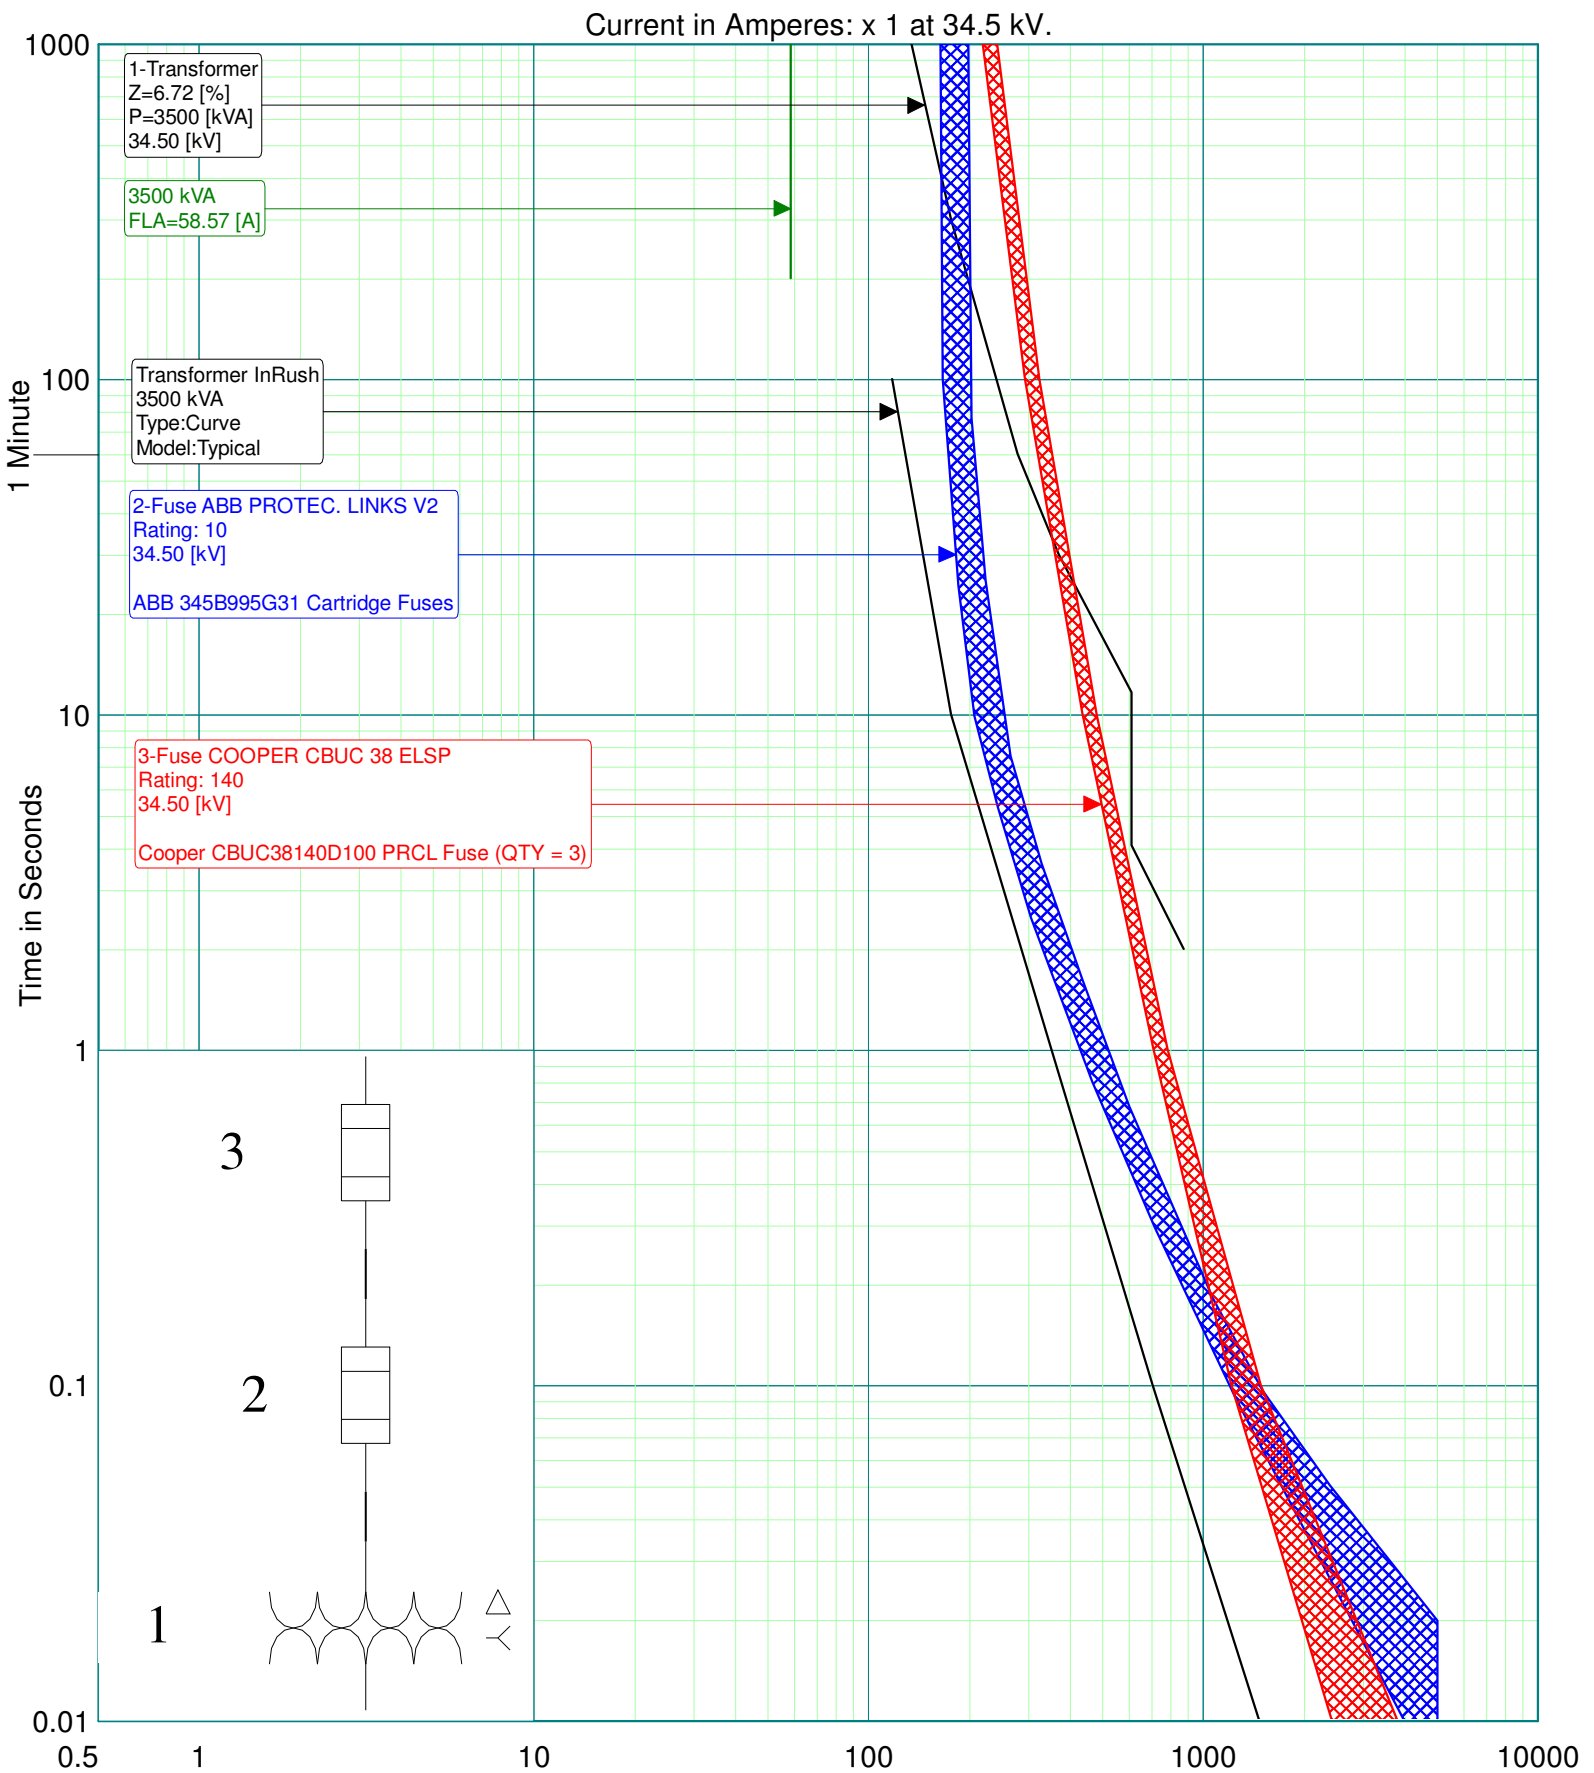

3500 kVA 3ph Transformer - 6.72%
00023A67KCHA

PLOTTING VOLTAGE:34.5 kV
BY:

NO:
DATE: 20/10/2016