

采购合同

合同编号: JZMG240321-3

采购方: 节奏变压器(江苏)有限公司 (以下简称“甲方”)

地址: 江苏省泰州市姜堰区淤溪镇靳潭村西十七组 79 号

合同承办单位名称: 节奏变压器(江苏)有限公司

合同承办单位负责人: Iris

联系电话: 13681643548

供应方: 江苏赛联电气科技有限公司

(以下简称“乙方”)

地址: 南通市海安市曲塘镇曲北路 98 号

电话: 13773753595

传真:

联系人: 丁晓飞

联系电话: 13773753595

甲、乙双方在平等、自愿、公平的基础上, 经过认真磋商, 就甲方购买乙方产品(以下称“合同产品”)事宜达成以下共识:

1 采购的合同产品

产品描述		数量	单位	含税含包装	含税金额	备注
产品名称	产品型号			单价（元）	（元）	
变压器	ZGSL-H-750/24.94/0.48	1	个	81500	81500	详细技术要求见附件
变压器	ZGSL-H-1000/25/0.6	1	个	94000	94000	
合 计		2			175500	
说明：1、产品出口至加拿大； 2、变压器产品上不能出现中文字样，铭牌根据甲方提供的设计模板制作； 3、产品标识、外包装须满足出口要求的木箱包装。						
合计人民币金额(大写)：壹拾柒万伍仟伍佰圆整。					小写：175500 元	

1.1 合同产品的详细规格、说明、标准等内容见附件一《技术要求》。

1.2. 2 上述价格为甲方在本合同项下应向乙方支付的产品最终出厂含税价格。

2 付款时间

合同签订后, 预付款为全款的 30%, 即人民币 52650 元, 发货后票到 30 天支付剩余尾

款 122850 元。

3 付款方式

3.1 所有款项均以人民币结算，支付方式：电汇。

乙方人民币帐号信息如下（如乙方不另行通知，则甲方按如下执行）：

公司名称：江苏赛联电气科技有限公司

地址：南通市海安市曲塘镇曲北路 98 号

电话：13773753595

税号：91320621MA27TCTB23

开户银行：海安农村商业银行曲塘支行

账号：3206210631010000192086

4 交货时间和地点

4.1 交货地点：工厂交货，甲方负责运输与运费。

4.2 交货联系人及电话：Iris 13681643548。

4.3 交货时间：图纸确认后 30 天具备发货条件，如不可抗力因素导致交期延后，需提供告知。

5 包装及运输

5.1 乙方按照本合同附件一向甲方提供的所有产品及相关配件应当是该产品生产商生产的全新的合格产品；并且该产品应适合长距离运输，并符合生产商的产品出厂包装的要求。如果乙方提供的产品的包装不符合生产商的产品通常出厂包装的要求，或产品存在严重划痕或被毁损的现象，甲方均有权要求乙方处理，维修、更换该产品或做退货处理。

6 检验与验收

6.1 甲方或甲方指定的收货人在交货地对乙方提交的合同产品进行检验。如果乙方提交的合同产品与本合同约定不符，则甲方有权要求乙方免费更换或退货，乙方应按照甲方的要求进行更换或退换并承担由此而产生的一切费用。

6.2 验收标准（收货验收）：除非另有约定，甲方将依据本合同的附件一《产品明细》、厂家出厂标准以及乙方的保证与承诺进行验收。

6.3 合同产品的验收期限自甲方签收乙方合同产品之日起算为【 10 】个工作日，甲方应在此期限内验收完毕，逾期视为验收合格。

6.4 甲方收货验收并不免除乙方对合同产品质量应当承担的责任，如果甲方在使用或销售合同产品或含有合同产品的产品时发现因合同产品在设计、安装、制造、材料、工艺等

方面的缺陷导致的任何质量问题，乙方仍应承担责任的。

6.5 如本合同所采购的产品因其自身特点导致甲方无法在验收当时发现其质量问题、设计、安装、制造、材料、工艺等缺陷，则甲方应享有合理的适用或测试使用期间，如在該期间内发现上述产品问题，则乙方应无条件为甲方提供换货或退货处理，在此种情况下乙方无权以甲方已签收作为已交付合格产品的抗辩。

7 服务与保修

7.1 乙方承诺向甲方提供如下售后服务：乙方承诺对合同产品提供 2 年免费保修服务。具体内容详见原厂商服务及《附件二：保修及服务条款》(如有)。该免费保修期自甲方最终验收合格之日起次日起算。

7.2 如果双方对合同产品免费保修期没有约定，乙方则应根据国家有关规定、行业惯例或合同产品的特性，提供免费保修服务。

7.3 当由第三方或甲方自身进行这种服务时，乙方应向指定的服务方提供所需的资料以使其能进行此种服务，并且乙方应提供相应的证明，确保第三方能履行此种服务，若第三方不能尽上述维修义务，则由乙方承担甲方因此遭受的损失。

7.4 乙方应建立相应的备品、备件库，以保证甲方的设备在保修期内的正常运行。乙方保证验收后原设备厂家向最终用户提供最少【 2 】年的备品备件供应保证，若原厂家决定停止生产某种备品备件，乙方应提前【 1 】个月通知用户，以便用户购买足够的备品备件。

8 品质和保证

8.1 乙方保证其提供的合同产品符合国家标准、行业标准以及乙方产品说明书中所规定的产品的功能和性能以及双方约定的其它质量标准（详见附件一《产品明细》）。前述产品说明书中包含排除乙方法定或约定义务内容的，或该说明书中承诺的质量标准低于国家或行业推荐性标准的，均属无效；除非甲方明确书面同意接受，否则本合同附属、补充文件约定及产品支持文件中规定的乙方责任限制条款不适用于甲方。

8.2 乙方保证提供的产品能够使甲方实现合同目的并满足甲方需求。

8.3 乙方向甲方做出下列陈述和保证：

8.3.1 其所提供的合同产品为产品原始生产厂家生产和制造。

8.3.2 合同产品及其各部件为全新的、未使用过的，合同产品中的软件部分（如有）无病毒、无明显错误，能够充分实现、提供、具备相关产品说明中描述的功能、特点、内容和标准等。

8.3.3 合同产品没有设计或制造上的缺陷，并且根据产品的情况提供了适当的警示说明。

8.4 本合同所包括的软件产品乙方均应提供软件版权所有人颁发的永久软件使用许可证。

9 所有权及知识产权

9.1 乙方保证对其依据本合同向甲方所交付的合同产品拥有合法的所有权、知识产权及其它权益，保证不侵犯任何第三方合法的所有权、知识产权及其它任何权益，否则，由此产生的一切责任由乙方承担，并保证不使甲方受到任何损害。

9.2 合同产品中的硬件产品的所有权及风险、软件产品的使用权许可自甲方对合同产品验收合格并出具验收合格证明之日起转移给甲方。

9.3 在发生或可能发生乙方产品侵权的情况下，乙方应自行承担费用采取下列甲方接受的补救措施：（1）使甲方得到继续使用和销售符合本合同的合同产品的权利；（2）修改合同产品，使其不侵犯他人权利并符合本合同约定；（3）用不侵权且符合本合同约定的合同产品替换该侵权的合同产品。

10 保密信息

双方应对本合同履行过程中所知悉的双方的知识产权、商业秘密、技术成果、经营计划和战略、客户信息及其它非技术性信息承担保密义务。未经双方书面同意，不得向社会公众或第三方通过任何途径出示、泄露，不得对上述信息进行复制、传播和销售。双方同时应约束其员工履行保密义务。本条所约定的双方承担保密义务不因本合同履行完毕而失效。

11 违约责任

11.1 质量瑕疵的补救措施和索赔

（1）乙方提供的货物不符合质量标准或存在货物质量缺陷，甲方有权根据法定质量检测部门出具的检验证书向乙方提出索赔。

（2）在质量保证期内，如果乙方对缺陷货物负有责任而甲方提出索赔，乙方应按照甲方同意的下列一种或多种方式解决索赔事宜：

1) 乙方同意退货并将货款退还给甲方，由此发生的一切费用和损失由乙方承担。

2) 根据货物的质量状况以及甲方所遭受的损失，经过买卖双方商定降低货物的价格。

3) 乙方应在接到甲方通知后七天内负责采用符合合同规定的规格、质量和性能要求的新零件、部件和设备来替换有缺陷的部分或修补缺陷部分，其费用由乙方负担。同时，乙方应在约定的质量保证期基础上相应延长修补和/或替换件的质量保证期。

（3）如果在甲方发出索赔通知后十天内乙方未作答复，上述索赔应视为已被乙方接受。

如果乙方未能在甲方发出索赔通知后十天内或甲方同意延长的期限内,按照上述规定的任何一种方法采取补救措施,甲方有权从应付货款中扣除索赔金额或者没收质量保证金,如不足以弥补甲方损失的,甲方有权进一步要求乙方赔偿。

11.2 迟延交货的违约责任

乙方应按照本合同规定的时间、地点交货和提供服务。在履行合同过程中,如果乙方遇到可能妨碍按时交货和提供服务的情形时,应及时以书面形式将迟延的事实、可能迟延的期限和理由通知甲方。甲方在收到乙方通知后,应尽快对情况进行评价,并确定是否同意迟延交货时间或延期提供服务。

11.3 如果乙方违反了本合同第9条和第10条的约定,则甲方有权单方解除本合同,并不承担任何违约责任,给甲方造成损失的,乙方还应承担损害赔偿责任。

11.4 若乙方提供产品或服务不符合合同约定,甲方有权拒付到期款项。

12 不可抗力

12.1 不可抗力系指双方在缔结协议时不能预见、并且它的发生及后果是不能克服和不能避免的客观情况。一方因不可抗力不能履行合同或不能完全履行合同的,根据不可抗力的影响,可以部分或全部地免除责任。由于不可抗力原因致使合同无法履行时,无法履行合同义务的一方应以合理方式立即将不能履行合同的事实通知另一方,并在不可抗力事件发生后15天内用特快专递向对方发出事件发生地点有关政府部门、公证机关或商会出具的证明,以证实不可抗力的存在;如因一方怠于通知而造成另一方损失或损失扩大的,则怠于通知的一方应负责赔偿另一方的相应损失。

12.2 一方迟延履行后发生不可抗力的,不能免除责任。

13 争议解决

双方当事人应在履约过程中应遵守诚信原则,如果产生争议,则应先进行友好协商,如果不能达成一致意见,双方均同意在原告方所在地人民法院诉讼解决。

14 一般条款

14.1 本合同一式【2】份,甲方执【1】份、乙方执【1】份,自合同双方法定代表人或授权代表签字并盖章之日起生效。

14.2 任何一方未行使其于本合同项下的任何权利均不得构成或被视为该方对这些权

利的放弃或丧失。

14.3 如本合同中的任何条款或约定被确认无效或不可执行，则不影响本合同其他条款的效力和可执行性。

14.4 除非得到另一方的事先书面许可，任何一方不得转让或转移本合同或本合同项下的任何义务。

14.5 本合同货物在安装等过程中发生的一切人身、财产安全事故由乙方自行承担。

14.6 在合同履行过程中，甲、乙双方可就合同履行的内容、时间、地点和方式等协商进行变更。协商一致后，双方应签订书面的补充协议。对本合同的任何修改仅得以经双方有权代表签字并盖章生效后的书面补充协议进行。除了双方签署书面补充协议，并成为合同不可分割的一部分之外，本合同条件不得有任何变更。

14.7 本合同及其附件（含补充协议）构成合同双方之间就本合同项下之合作所达成的全部合同，并替代双方以前或执行本合同过程中所做的任何口头交流、声明或合同。

14.8 本合同未尽事宜由双方共同协商，另行订立书面文件，该类文件经合同各方盖章生效后与本合同具有同等法律效力。

14.9 本合同包含以下附件，附件是本合同的重要组成部分，经双方当事人共同签署确认的附件方为有效附件，与本合同具有同等法律效力：《附件一：产品明细》、《附件二：保修服务条款》（如有）

15.其他事项：（1）设计、生产标准：CSA C227.4，CSA 802.1。（2）乙方发货前，提供英文版测试报告。（3）变压器铭牌按后续甲方提供铭牌模板制作。

甲方：（盖章）

负责人（签字）：

日期：2024年06月28日



乙方：（盖章）

负责人（签字）：

日期：2024年06月28日



1000KVA 25/0.6KV 三相美式箱变加标, 见如下参数

750 KVA 24940 GRD Y/14400 - 480Y/277, 三相美式箱变加标, 见如下参数

Product brand:	JIEZOU
Product type:	Radial Feed Pad mounted transformer
Standard:	CSAC227.4 , CSA C802.1
Rated capacity:	1000 kva
Primary voltage and insulation level:	25 kv
Tapping range	±2x2.5%
Secondary voltage(load)and insulation level:	600V
Impedance:	按标准
Impedance tolerance	±7.5%
Vector group:	按标准
Frequency:	60hz
Nos. Of phase:	Three
Cooling method:	ONAN
winding Material	Aluminum

Technical data

Type of installation:	outdoor
Altitude above sea level	≤1000m
Ambient temperature	20℃
Material core: :	Silicon steel
Oil top temperature rise:	65℃
Winding temperature rise:	65℃
Hot Spot:	80℃
No-load losses:	As per efficiency Standard and drawing design
Load-losses:	As per efficiency Standard and production drawing design
Loss tolerance:	按标准
Ambient temperature for operation:	-45℃ to 50℃
Noise level:	<55
Tank Colour :	Munsell Green
Oil type:	Mineral Oil-No PCB(45#)

Weight information:

Oil Weight:	按标准
Machine weight:	按标准
Total weight:	按标准

Dimension information:

Length:	按标准
Width:	按标准
Height:	按标准

Accessories

PRV,oil level indicator, oil temperature indicator, pressure vacuum gauge,三表一阀
 BAY O NET fuse CLF FUSE protection, 熔丝保护
 one load break switch
 one tap changer

Test

Routine Test/Type test	YES
------------------------	-----



Product brand:	JIEZOU
Product type:	Radial Feed Pad mounted transformer
Standard:	CSAC227.4 , CSA C802.1
Rated capacity:	750 kva
Primary voltage and insulation level:	24940 GRD Y/14400
Tapping range	±2x2.5%
Secondary voltage(load)and insulation level:	480Y/277
Impedance:	按标准
Impedance tolerance	±7.5%
Vector group:	按标准
Frequency:	60hz
Nos. Of phase:	Three
Cooling method:	ONAN
winding Material	Aluminum

Technical data

Type of installation:	outdoor
Altitude above sea level	≤1000m
Ambient temperature	20℃
Material core: :	Silicon steel
Oil top temperature rise:	65℃
Winding temperature rise:	65℃
Hot Spot:	80℃
No-load losses:	As per efficiency Standard and drawing design
Load-losses:	As per efficiency Standard and production drawing design
Loss tolerance:	按标准
Ambient temperature for operation:	-45℃ to 50℃
Noise level:	<55
Tank Colour :	Munsell Green
Oil type:	Mineral Oil-No PCB(45#)

Weight information:

Oil Weight:	按标准
Machine weight:	按标准
Total weight:	按标准

Dimension information:

Length:	按标准
Width:	按标准
Height:	按标准

Accessories


PRV,oil level indicator, oil temperature indicator, pressure vacuum gauge,三表一阀
BAY O NET fuse CLF FUSE protection, 熔丝保护
one load break switch
one tap changer

Test

Routine Test/Type test	YES
------------------------	-----

NOTE:

- 1.ALL DIMENSIONS ARE IN MILLIMETERS
- 2.MATERIAL:STAINLESS STEEL
- 3.THICKNESS :1mm
- 4.LETTER COLOR: BLACK

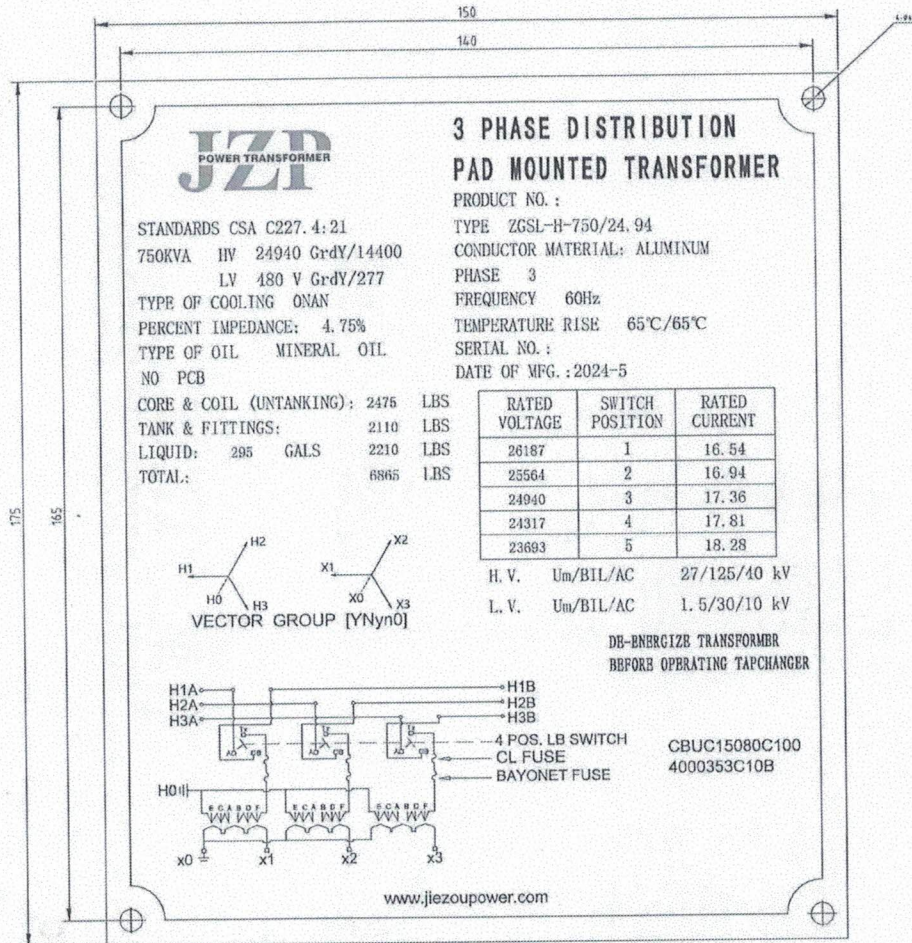



CHANGE

4/0.48		DWG. NAME Name Plate			
1 / 2		DRAWN	CHECKED	CHECKED	APPROVED
		Mike	Jack	Iris	SAM
	REF. DWG. NO.				REV. NO.
	DWG. NO.	JZP-ZGS750-240521-002			

JZP
POWER TRANSFORMER

ON
DWG

JZP-ZGS750-240521-002

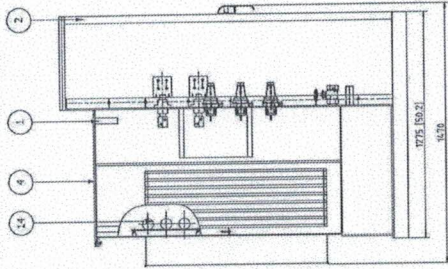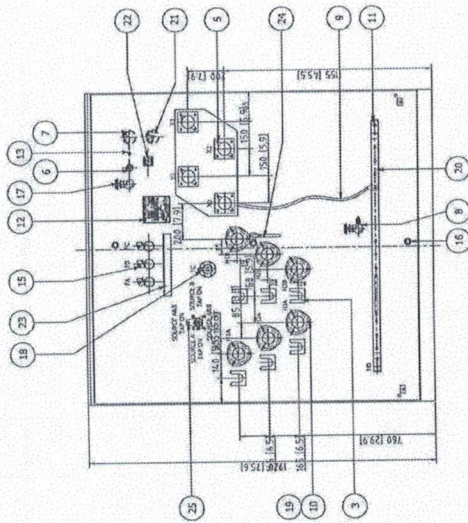

TECHNICAL DATA	
RATING	750KVA
PRIMARY VOLTAGE(V)	24,940GrdY/14,400
SECONDARY VOLTAGE(V)	480GrdY/277
FREQUENCY	60Hz
VECTOR GROUP	YNyn0
WINDING MATERIAL	ALUMINUM
LOAD LOSS AT RATED VOLTAGE	≤8.175kW
NO LOAD LOSSES	≤1.370W
IMPEDANCE	4.75%
ALTITUDE	≤1,000m
No. OF TAP POSITION	5
COLOR	Munsell 7GY3.29/1.5



PARTS LIST		
ITEM	DESCRIPTION	QTY
1	LIFTING LUG	4
2	HINGED DOOR	2
3	PARKING STAND BRACKET	6
4	FLIP TOP COVER	1
5	LV BUSHING(FTG1-1/1500 4 HOLE)	4
6	FILL PLUG	1
7	VACUUM PRESSURE GAUGE (YZ-70)	1
8	1" DRAIN VALVE WITH 3/8" SAMPLER	1
9	GROUND STRAP COPPER	1
10	H.V BUSHING WELL(25KV,200A)	6
11	GROUND TERMINAL	1
12	NAME PLATE(STAINLESS STEEL)	1
13	PRESSURE RELIEF VALVE	1
14	ELSP FUSE(CBUC15080C100)	3
15	BAYONET FUSE(4000353C108)	3
16	PENTAHEAD BOLT ARRANGEMENT	3
17	1" UPPER FILL VALVE	1
18	TAP CHANGER(WSLI13 63/20-6x5)	1
19	LOADBREAK BUSHING INSERT(25KV,200A)	6
20	CEA GROUND BRACKET	1
21	OIL TEMPERATURE INDICATOR (BWS-70)	1
22	OIL LEVEL INDICATOR (UHZ-01)	1
23	DRIP TRAY	1
24	DOOR HANDLE	1
25	FOUR POSITION LOADBREAK SWITCH	1

ITEM	WEIGHT(LBS)
CORE WEIGHT	2475 LBS
TOTAL OIL WEIGHT	295 GALS
TOTAL WEIGHT	6665 LBS

NOTE

1. DIMENSION UNIT : mm
2. DIMENSION TOLERANCE : ±5%
3. FIVE LEGGED CORE ASSEMBLY.
4. THE POSITION OF PART ACCESSORIES COULD BE CHANGED SLIGHTLY IN THIS DRAWING DURING DETAIL DESIGNING.

L.V TERMINAL

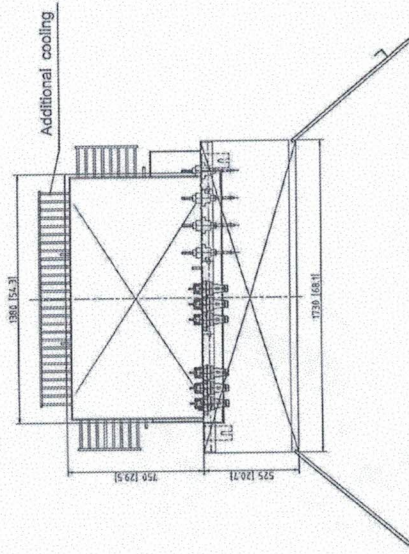

DWG. NAME	
General Assembly Drawing	
TYPE	ZGSL-H-750/24,94/0.48
DRAWN	Mike
CHECKED	Jack
APPROVED	Sam

CHANGE

高压CHARDON套管，插入+后备COPPER品牌

JZP-ZGS750-240521-002


JZP
POWER TRANSFORMER

REV. NO.



NOTE:

- 1.ALL DIMENSIONS ARE IN MILLIMETERS
- 2.MATERIAL:STAINLESS STEEL
- 3.THICKNESS :1mm
- 4.LETTER COLOR: BLACK

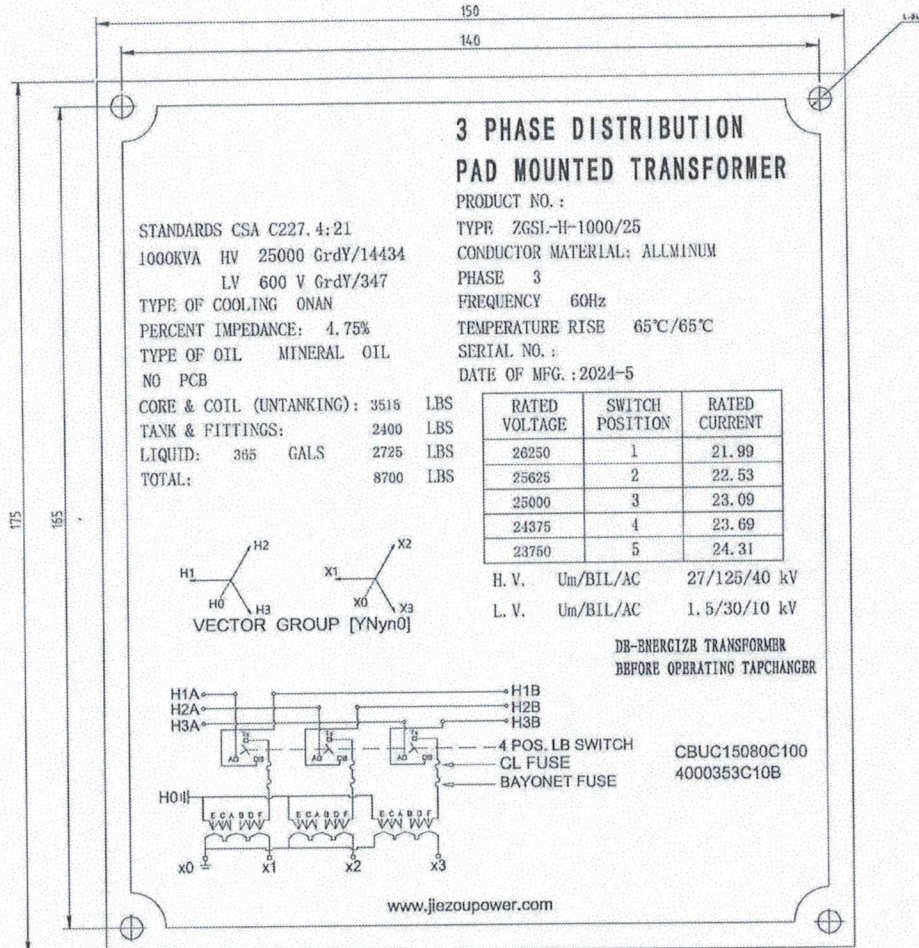

CHANGE	TYPE ZGSL-H-1000/25/0.6		DWG. NAME Name Plate			
	FIRST ANGLE PROJECTION	SCALE 1/2	DRAWN Mike	CHECKED Jack	CHECKED Iris	APPROVED SAM
			REF. DWG. NO.			REV. NO.
			DWG. NO.	JZP-ZGS1000-240521-001		




JZP-ZGS1000-240521-001

TECHNICAL DATA

TECHNICAL DATA	
RATING	1000KVA
PRIMARY VOLTAGE(V)	25000GRDY/114434
SECONDARY VOLTAGE(V)	600Y/347
FREQUENCY	50-Hz
VECTOR GROUP	YNn0
WINDING MATERIAL	ALUMINUM
LOAD LOSS AT RATED VOLTAGE	8900W
NO LOAD LOSSES	1400W
IMPEDANCE	4.75%
ALTITUDE	≤1000m
NO. OF TAP POSITION	5
COLOR	Munsell 7G/3.29/1.5

PARTS LIST		QTY
ITEM	DESCRIPTION	
1	LIFTING LUG	4
2	HINGED DOOR	2
3	PARKING STAND BRACKET	6
4	FLIP TOP COVER	1
5	L.V BUSHING(FTG-1/1250 8-HOLE)	4
6	VACUUM PRESSURE GAUGE (YZ-70)	1
7	FILL PLUG	1
8	1" DRAIN VALVE WITH 3/8" SAMPLER	1
9	GROUND STRAP COPPER	1
10	H.V BUSHING WELL(25KV/200A)	6
11	GROUND TERMINAL	1
12	NAME PLATE(STAINLESS STEEL)	1
13	PRESSURE RELIEF VALVE	1
14	ELSP FUSE(CBUC15125C100)	3
15	BAYONET FUSE(4000353C12B)	3
16	FOUR POSITION LOADBREAK SWITCH	1
17	1" UPPER FILL VALVE	1
18	TAP CHANGER(WSLIIT3 63/70-6x5)	1
19	LOADBREAK BUSHING INSERT(25KV/200A)	6
20	CEA GROUND BRACKET	1
21	TEMPERATURE INDICATOR(BWS-70)	1
22	OIL LEVEL GAUGE(UHZ-01)	1
23	DIP TRAY	1
24	DOOR HANDLE	1
25	PENTHEAD BOLT ARRANGEMENT	3

ITEM	WEIGHT(LBS)
CORE WEIGHT	3515 LBS
TOTAL OIL WEIGHT	365 GALS
TOTAL WEIGHT	8700 LBS

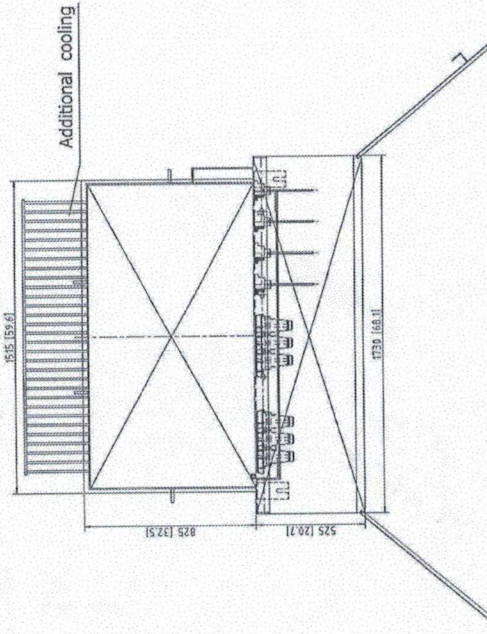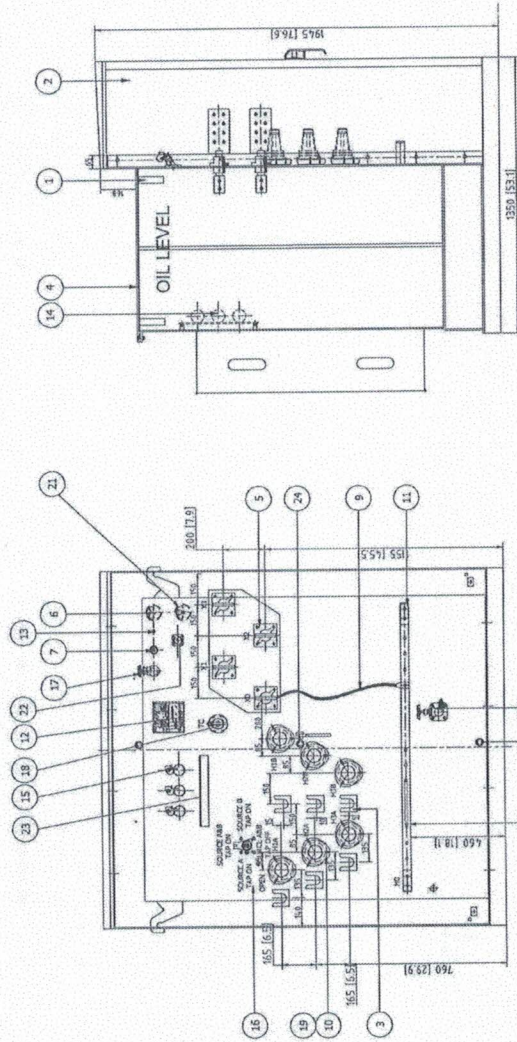

DWG. NAME	General Assembly Drawing
TYPE	ZGSL-H-1000/25/0.6

DRAWN	CHECKED	CHECKED	APPROVED	FIRST ANGLE PROJECTION	SCALE	1
-------	---------	---------	----------	---------------------------	-------	---

Mike	Jack	Iris	Sam		REV. NO.
------	------	------	-----	---	----------

效率按99.15%(空负载不按图纸),高压CHARDON套管,插入+后各COPPER品牌

CHANGE

REV.

