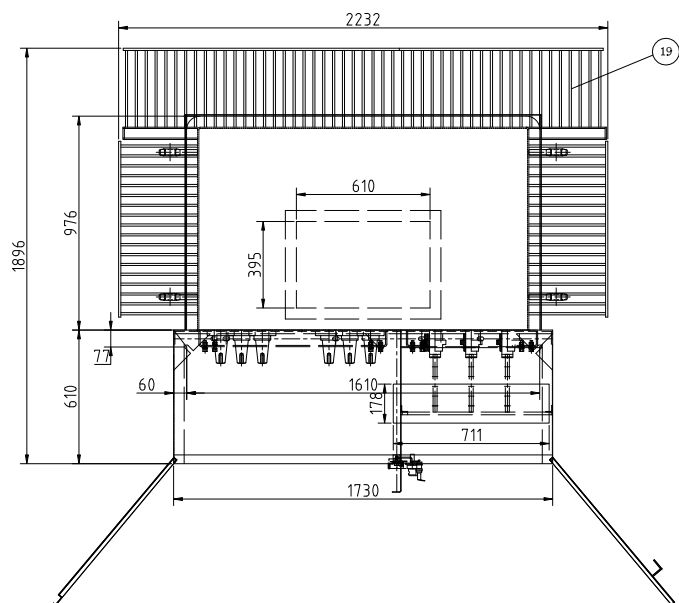


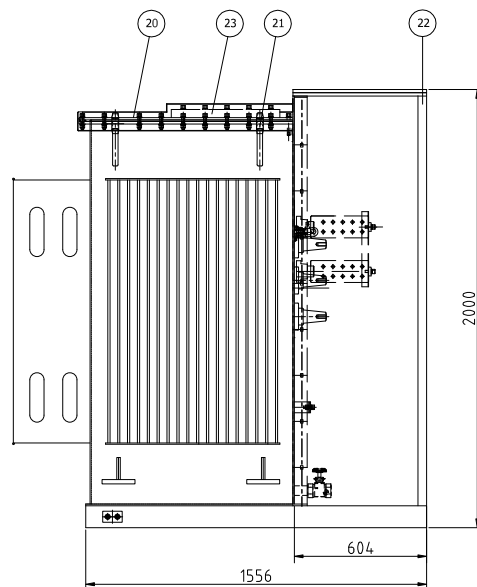
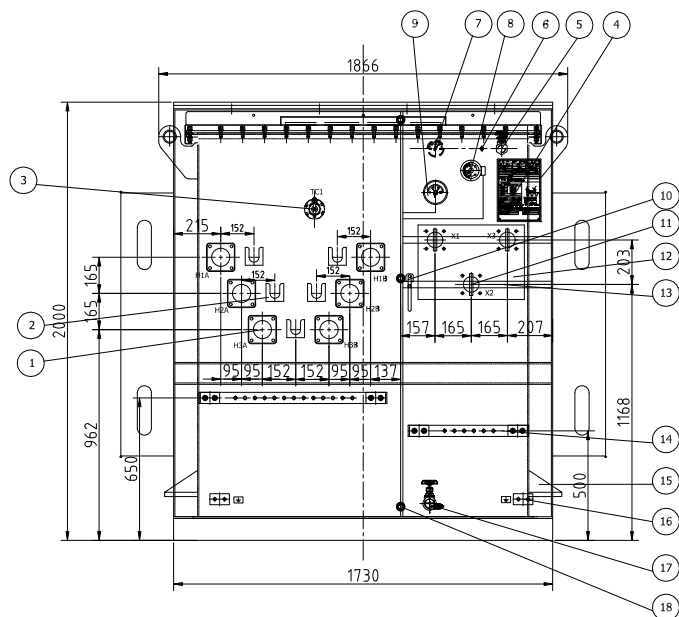


X1:BODY PROTECTION WIRING TERMINAL			
JOINT	N.O.	CONNECTOR FUNCTION	JOINT
	1		1
	2		2
	3	OIL LEVEL GAUGE	3
	4		4
	5		2
	6		1
	7		3
	8		
	9		
	10		

TECHNICAL DATA	
RATING	3000kVA
PRIMARY VOLTAGE(V)	4160 DELTA
SECONDARY VOLTAGE(V)	600Y/347
FREQUENCY	60Hz
VECTOR GROUP	Dyn1
CONDUCTOR	COPPER
INSULATING OIL	MINERAL OIL (45#
TEMPERATURE RISE	65°C
EFFICIENCY	99.37%
LOAD LOSS AT RATED VOLTAGE	22000W
NO LOAD LOSSES	3500
IMPEDANCE	5.5%
ALTITUDE	≤1000m
No. OF TAP POSITION	5
COLOR	MENNSSELL GREEN
CORE FORM	Three-phase Three-column

PARTS LIST		
ITEM	DESCRIPTION	QTY
1	HV BUSHING (15kV,600A)	6
2	PARKING STAND BRACKET	5
3	TAP CHANGER 3PH (WSTII3 500/10-6×5)	1
4	NAMEPLATE	1
5	1" UPPER FILL VALVE	1
6	PRESSURE RELIEF VALVE	1
7	VACUUM PRESSURE GAUGE	1
8	OIL LEVEL GAUGE W/AIARM CONTACTS	1
9	OIL TEMPERATURE GAUGE W/AIARM CONTACTS	1
10	DOOR HANDLE	1
11	LV BUSHING(10 HOLE)	4
12	750-4000 PADMOUNT LV PLATE, 304L S.S. 3/16in	1
13	LV BUSHING ADDITIONAL SUPPORT	2
14	GROUND BUS	2
15	JACK	4
16	GROUND STEEL PADS	4
17	1"DRAIN VALVE WITH 3/8" SAMPLER	1
18	FIXED PROJECTING CUP	3
19	RADIATOR	3
20	FLIP TOP COVER	1
21	LIFTING LUG	4
22	HINGED DOOR	2
23	HANDHOLE	1
24	TANK BASE	1

TYPE
ZGS-H-3000/4.16-0.6

DWG. NAME	General Assembly Drawing
-----------	--------------------------

DRAWN	CHECKED	CHECKED		APPROVED
Mike W	Ella W	Iris J		Sam

0	FIRST ANGLE PROJECTION	SCALE	1
---	------------------------	-------	---

ZGS-H-3000-231009-01

REV
NO.

DWG. NO.		ZGS-H-3000-231009-01		NOTE: 1. ALL DIMENSIONS ARE IN MILLIMETERS & [mm] 2. MATERIAL- STAINLESS STEEL 3. THICKNESS :1mm 4. LETTER COLOR: BLACK 3 PHASE DISTRIBUTION PAD MOUNTED TRANSFORMER PRODUCT NO. : TYPE ZGS-H-3000/4.16 CONDUCTOR MATERIAL: COPPER PHASE 3 FREQUENCY 50Hz TEMPERATURE RISE 65°C/65°C SERIAL NO. : DATE OF MFG. : <table><thead><tr><th>RATED VOLTAGE</th><th>SWITCH POSITION</th><th>RATED CURRENT</th></tr></thead><tbody><tr><td>4368</td><td>1</td><td>305.53</td></tr><tr><td>4264</td><td>2</td><td>306.20</td></tr><tr><td>4160</td><td>3</td><td>316.36</td></tr><tr><td>4056</td><td>4</td><td>327.03</td></tr><tr><td>3952</td><td>5</td><td>338.27</td></tr></tbody></table> H.V. 211L/AC 60/19 kV L.V. 211L/AC 30/10 kV DE-ENERGISE TRANSFORMER BEFORE OPERATING TAPCHANGER STANDARD: CSA C227.4 3000KVA HV 4160 V DELTA LV 600 V GROUND/347 TYPE OF COOLING ONAN PERCENT IMPEDANCE: % TYPE OF OIL MINERAL OIL NO PCB CORE & COILS: 3300 kg TANK & FITTINGS: 2200 kg LIQUID: 1005 L 1425 kg TOTAL: 6940 kg VECTOR GROUP [Dyn11] TANK MUST BE SOLIDLY GROUND. WINDING DIAGRAM: H1A H1B H2A H2B H3A H3B www.jiezoupower.com			RATED VOLTAGE	SWITCH POSITION	RATED CURRENT	4368	1	305.53	4264	2	306.20	4160	3	316.36	4056	4	327.03	3952	5	338.27
RATED VOLTAGE	SWITCH POSITION	RATED CURRENT																						
4368	1	305.53																						
4264	2	306.20																						
4160	3	316.36																						
4056	4	327.03																						
3952	5	338.27																						
TYPE ZGS-H-3000/4.16-0.6				DWG. NAME NAMEPLATE																				
DRAWN	CHECKED	CHECKED		APPROVED	FIRST ANGLE PROJECTION	SCALE 1																		
Mike W	Ella W	Iris J		Sam	JIEZOU POWER																			
ZGS-H-3000-231009-01																								
					REV. NO.																			