

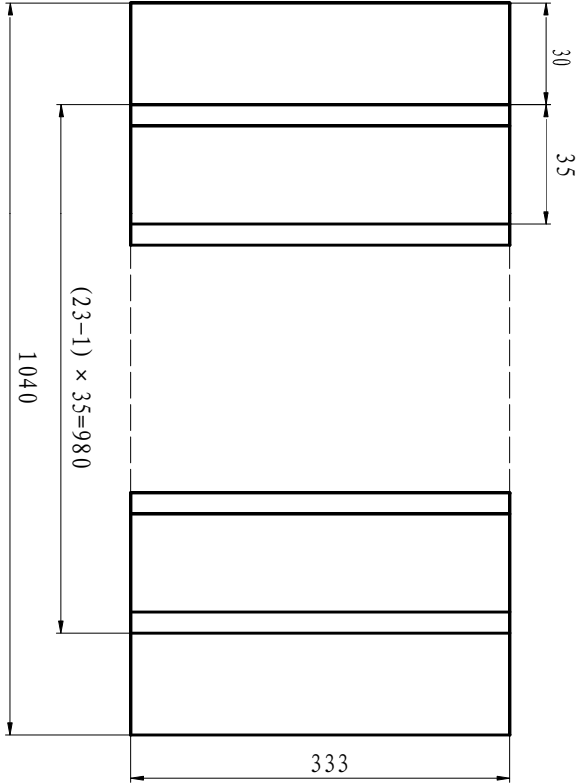
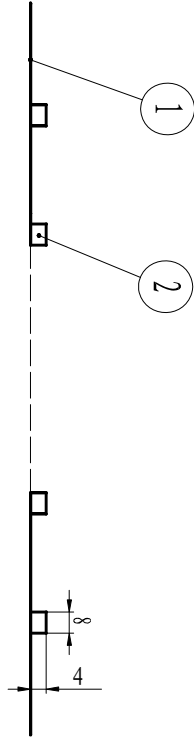


1. 去毛刺,粘接牢固.

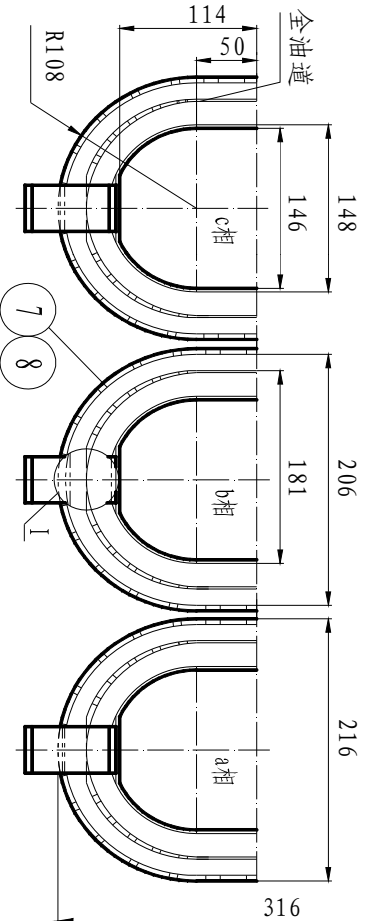


借(通)用件登记														
描 图														
描 校														
		2	8JZ. 123. 001		撑条 4×8×333		23	纸板100/00			0.28			
		1			纸带 1040×333		1	0.08点胶纸						
旧底图总号		序 号	代 号				名 称		材 料		单件重量	总计重量	备 注	
底图总号														
签 字		标记	处数	更改文件号		签 字	日期	ZGS-H-500/12. 47 撑条帘						
		设计												
		校对												
		审核												
日 期		审 批	准 定					ZGS-H-500/12. 47 撑条帘						
工 艺		日期												
2024/6/24													纸板100/00	
节奏变压器（江苏）有限公司														


1. 线圈为箱绕式半油道,左绕向.
2. 低压模具尺寸: 146×237
3. 油道标注尺寸均为油道放置前尺寸.
4. 模具上先垫一张:1.0×335×665纸板.
5. 主绝缘放置顺序,先放项7撑条帘,然后

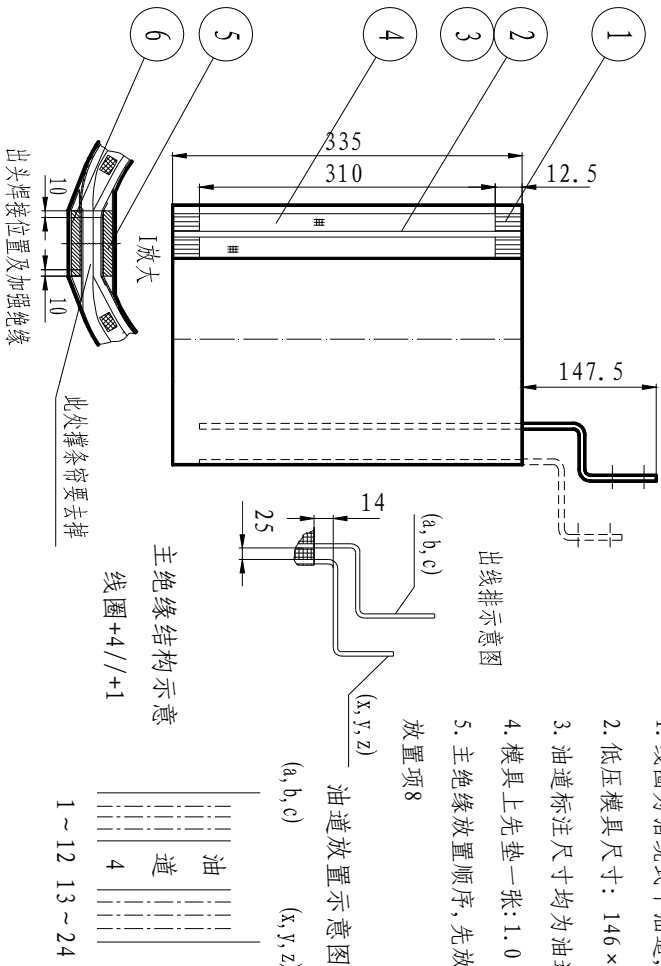

低压电压 480V		相电流 601.4A	低压线圈匝数 1×24=24	匝	辐向 29	铜箔规格		0.85×310			
并绕铜箔 1 张		低压铜箔排列 1叠×1并	铜箔长度 3×1×18.3								
8		纸板 335×900	3	1.0纸板100/00		1	用于主空道				
7	5JZ. 123. 2449. 1	撑条帘	1			0.8	用于主空道				
6	8JZ. 511. 2449. 2	导电排	1	5×40 铜排 TMY		2.6					
5	8JZ. 511. 2449. 1	导电排	1	5×40 铜排 TMY		2.9					
4		层间绝缘	1卷	0.15×333 点胶纸,AMA		2.7					
3	5JZ. 123. 2449. 3	撑条帘	1			0.8					
2		低压导线	1	0.85×310 铜箔		129					
1		端绝缘 0.5×12.5	4盘	0.5纸盘		0.4					
旧底图总号	序号	代 号	名 称	数 量	材 料	单件重量	总计重量	备 注			
底图总号											
签 字	标记	处数	更改文件号	签 字	日期	ZGS-H-500/12.47					
设 计	校 对	审 核	审 批	准 准	日期	低压线圈					
箱 绕						图样标记			数 量	重 量	比 例
						S		1	139.27		
						共 1 页			第 1 页		
						节奏变压器（江苏）有限公司					


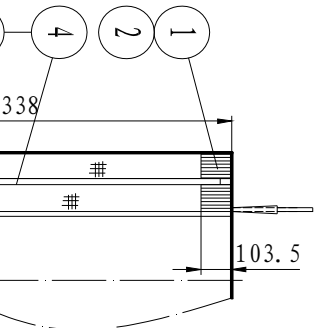


A(B, C)层间绝缘放置示意图



1. 线圈为多层长圆筒式，左绕向。
2. 线圈ABC出头和分接头长均为100，出头和用皱纹纸包扎后辐向引出。
3. 分接2, 3之间抽头用10-15mm宽纸板隔开。
4. 线圈分接抽头按具体工艺实施。
5. 最外层匝数排列根据实际抽头定，保证匝数即可，然后用紧缩带拉紧。

分接抽头示意图

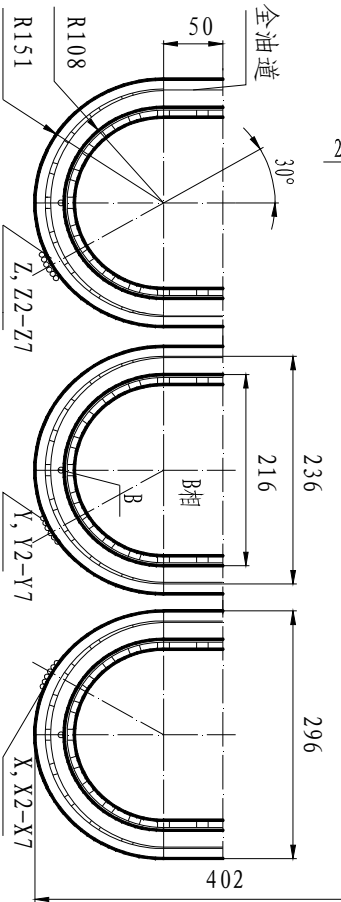



注：层间绝缘放置说明：首层5张长8 中间层：3长0短最后一层为：4长0短，油道尺寸均为放置前线圈尺寸。

额定容量	500 kVA	额定电压	12470V	相电流	22.1A	绕制层号	1-4	油道	5-11	12	13	14
导线规格	1.8 × 4.75	线圈导线长度	3 × 1 × 660.9 M	每层匝数	48	道	48		48	48	59	20
ZB-0.3	2.1 × 5.05	线圈匝数	655 匝	轴向并绕	1根	累计匝数	192	4	528	576	635	655

借(通)用件登记

描图	6		纸板 140/-55 × 1130	各6	1.0 纸板100/00			垫平不满匝
	5	5JZ. 123. 2449. 2	撑条帘	1			0.9	高压油道
描校	4		高压导线	1	1.8 × 4.75 纸包铜线		149	ZB-0.3
	3	5JZ. 751. 2449	层间绝缘	1			3.3	
	2		紧缩带	1卷	150D纱			
	1	5JZ. 750. 2449. 3	端绝缘	1			19.4	
旧底图总号	序号	代号	名称	数量	材料	单件重量	总计重量	备注
底图总号								
签字	标记	处数	更改文件号	签字	日期	ZGS-H-500/12.47		
	设计		标准化			6JZ. 602. 2449. 1		
	校对		审 定			高压线圈		
日 期	审 核		批 准			12470 ± 2 × 2.5%		
工 艺			日 期	2024/6/24		节奏变压器（江苏）有限公司		


1. 去毛刺,粘接牢固.

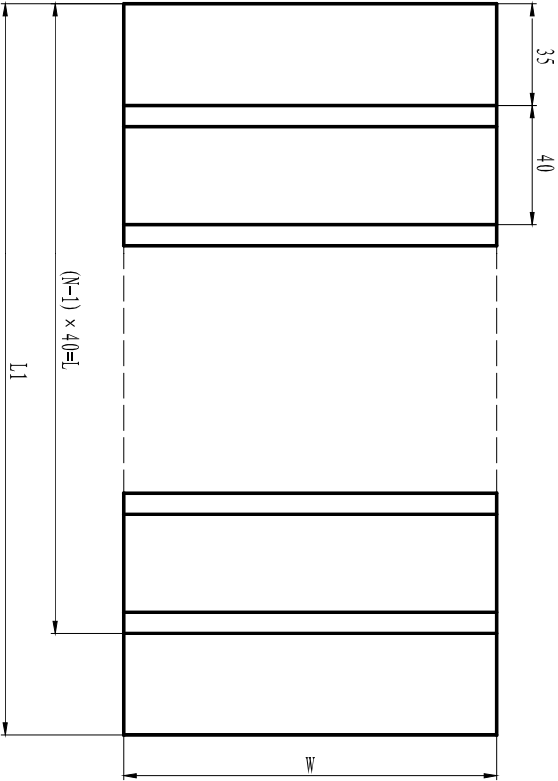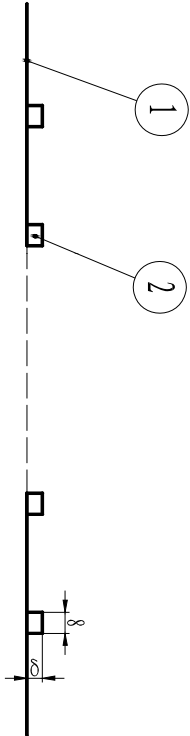

代 号	δ	N	W	L	L1	数量	备 注
5JZ.123.2449.1	4	22	333	840	900	3	用于主空道
5JZ.123.2449.2	4	24	333	920	980	3	用于高压油道

借(通)用件登记													
描 图													
		8JZ. 123. 001	撑条 4 × 8 × 333	66	纸板100/00		0.81	主空道					
	2	8JZ. 123. 001	撑条 4 × 8 × 333	72	纸板100/00		0.88	高压油道					
描 校			纸带 333 × 900	3	0.08点胶纸		0.04	主空道					
	1		纸带 333 × 980	3	0.08点胶纸			高压油道					
旧底图总号	序号	代 号	名 称	数 量	材	料	单件重量	总计重量	备 注				
底图总号													
签 字	标记	处数	更改文件号	签 字	日期	ZGS-H-500/12.47			5JZ. 123. 2449. 1-2				
	设计					撑条帘			图样标记	数 量	重 量	比 例	
	校 对								S	1套	0.9191		
日 期	审 核		审 定						共 1 页		第 1 页		
工 艺			日 期	2024/6/24	纸板100/00			节奏变压器（江苏）有限公司					


1. 纸板条去毛刺。
2. 如果采用自动绕线机绕制, 不用粘接项2电话纸。

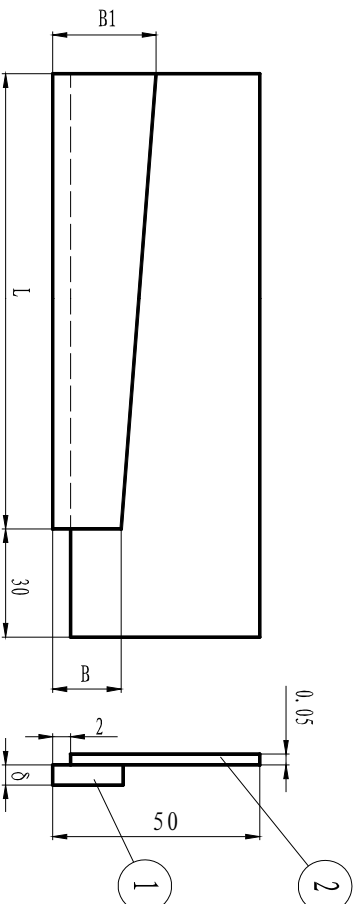

借(通)用件登记	10-14	1	104	108	1145	20	1175	20	每层均为2mm.			
						0						
		5-9	1	104	108	1070	20	1100		20	每层均为2mm.	
							0					
		1-4	1	104	108	955	16	985		16		每层均为2mm.
							0					
	描 图	层 号	项1	B	B1	L	数量	L+30	数量	备 注		

[illegible]

1. 去毛边, 裁剪整齐.

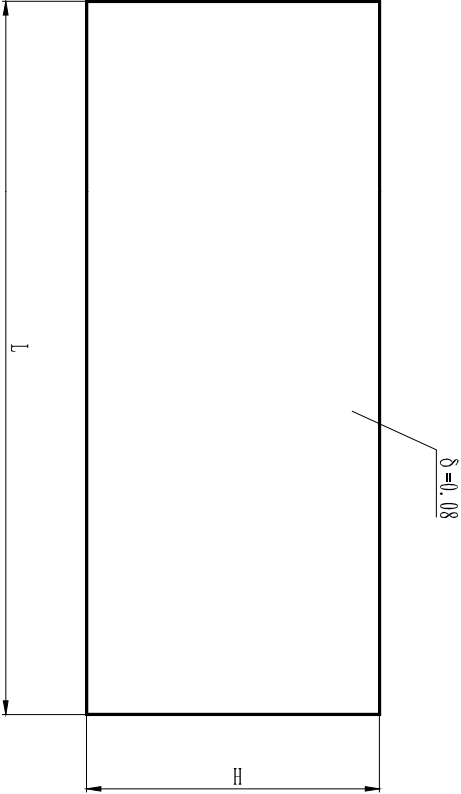

9-14	168	1150	0	0
	336		3/4	16
5-9	168	1070	0	0
	336		3	12
1-4	168	960	0	0
	336		3/5	11
层 间	H	L	每层间数量	总 计

借(通)用件登记

描 图

描 校

旧底图总号

底图总号

签 字

日 期

设计	校 对	审 核	工 艺	日 期		设计	校 对	审 核	工 艺	日 期	