
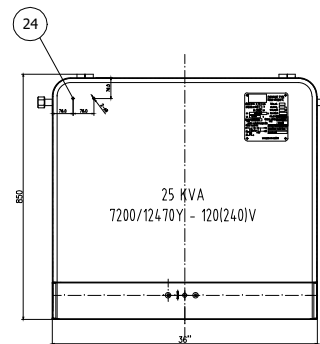


PARTS LIST		
ITEM	DESCRIPTION	QTY
1	HV BUSHING (15kV,200A)	2
2	PARKING STAND BRACKET	1
3	TWO POSITION LOADBREAKER SWITCH	2
4	BAY-O-NET FUSE	1
5	FUSE HOLDER	1
6	TAP CHANGER 1PH	1
7	OIL LEVEL GAUGE	1
8	1" UPPER FILL VALVE	1
9	PRESSURE RELIEF VALVE	1
10	LIFTING LUG	4
11	LV BUSHING(1.2kV 5/8)	3
12	4 HOLE SPAD	3
13	NAMEPLATE	1
14	GROUND STEEL PADS (TTC2)	4
15	FIXED PROJECTING CUP	1
16	PADLOCK	1
17	1"DRAIN VALVE WITH 3/8" SAMPLER	1
18	CURRENT LIMITING FUSE	2
19	TANK	1
20	COVER	1
21	BOLT FOR LIFTING	1
22	HOLD-DOWN PLATE	4
23	CUPPED WASHER	4
24	GROUND PAD	2
25	EQUIPOTENTIAL DEVICE(COPPER)	1

JIE ZOU POWER

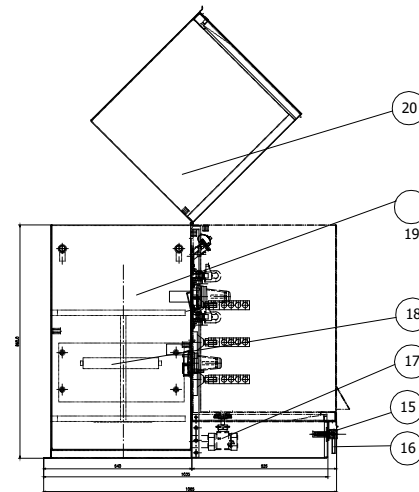

PADMOUNT TYPE
 ONAN 60HZ,65°C


SINGLE	PH.	25	kVA	SERIAL NO.	
IMPEDANCE AT 85°C				%	VOL OF OIL
BIL			95/30	kV	TOTAL MASS
HV.			7200±2×2.5%		V
LV.			120/240		V
BAYONET FUSE			4000353C08B		CURRENT LIMITING FUSE
					CBUC15030C100
ENERGY EFFICIENCY PER DOE 2016			< 1PPM PCB		
CURRENT LIMITING FUSE			APPLIED STANDARD:IEEE.C57.12.25		

BAYONET FUSES

PRODUCTION PLACE: CHINA

DATE OF MFG.

WWW.JIEZOUPOWER.COM

						DWG:			
REMARK	SUBAREA	ALTERATION NO.	SIGNATION	DATE		Nameplate			
DESIGN			VERIFY						
CHECK			APPROVE	LY					A/0
CRAFT									
STANDARDIZE			DATE						
						 JIEZOU POWER			