




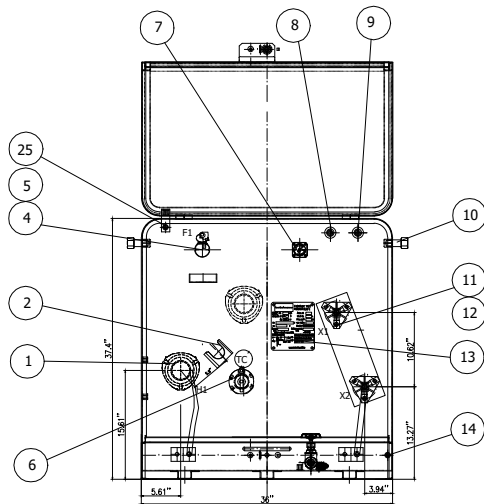



1

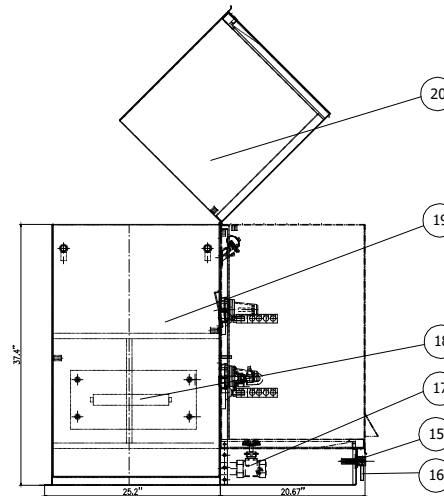


2

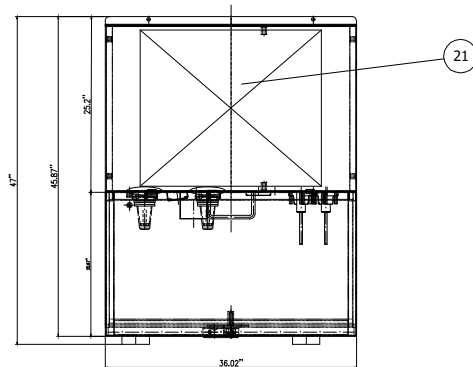


3

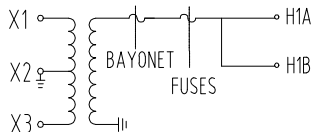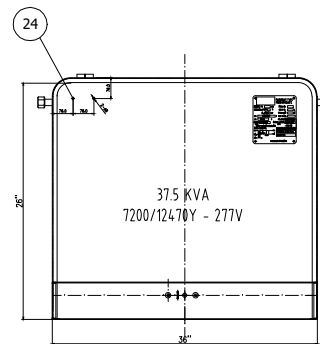


L.V TERMINAL
DETAIL



HOLD-DOWN PLATE
DETAIL



CUPPED WASHER
DETAIL



Design			
Check			
Approve			
	Date	12/04/2024	

JZPDHL-H-37.5/7.2/0.277

Outling Drawing

JIE ZOU POWER

DWG



JIEZOU POWER

TECHNICAL DATA

RATING	37.5kVA
PRIMARY VOLTAGE(V)	7200/12470Y
SECONDARY VOLTAGE(V)	277
INSULATION LEVEL(kV) H.V BIL	95
INSULATION LEVEL(kV) L.V BIL	30
FREQUENCY	60Hz
VECTOR GROUP	II6
CONDUCTOR	AL
CORE FLUX DENSITY	≤1.35 T
CURRENT DENSITY	≤2.3A/mm ²
LOAD LOSS AT RATED VOLTAGE	360W
NO LOAD LOSSES	35W
TEMPERATURE RISE	65°C
EFFICIENCY	99.05%
IMPEDANCE	2-2.5%
INSULATING OIL	MINERAL OIL
ALTITUDE	≤1000m
No. OF TAP POSITION	±2*2.5%
COLOR	Munsell Green 7GY 3.29/1.5
POLARITY	ADDITIVE
APPLIED STANDARD.	IEEE.C57.12.25/D0E 2016

ITEM	WEIGHT
TANK & ACCESSORIES	500 LBS
TOTAL OIL WEIGHT	122 GAL
TOTAL WEIGHT	1645 LBS

PARTS LIST

ITEM	DESCRIPTION	QTY
1	HV BUSHING (15kV,200A)	2
2	PARKING STAND BRACKET	1
3	NON	N
4	BAY-O-NET FUSE	1
5	FUSE HOLDER	1
6	TAP CHANGER	1
7	OIL LEVEL GAUGE	1
8	1" UPPER FILL VALVE	1
9	PRESSURE RELIEF VALVE	1
10	LIFTING LUG	4
11	LV BUSHING(1.2kv 5/8)	3
12	4 HOLE SPAD	2
13	NAMEPLATE	1
14	GROUND STEEL PADS (TTC2)	4
15	FIXED PROJECTING CUP	1
16	PADLOCK	1
17	1"DRAIN VALVE WITH 3/8" SAMPLER	1
18	CURRENT LIMITING FUSE	2
19	TANK	1
20	COVER	1
21	BOLT FOR LIFTING	1
22	HOLD-DOWN PLATE	4
23	CUPPED WASHER	4
24	GROUND PAD	2
25	EQUIPOTENTIAL DEVICE(COPPER)	1

					Nameplate	DWG:			
						QTY	WEIGHT	SCALE	
									A/0
REMARK	SUBAREA	ALTERATION NO.	SIGNATION	DATE					
DESIGN			VERIFY						
CHECK			APPROVE	JY					
CRAFT									
STANDARDIZE			DATE	12/04/2024					