
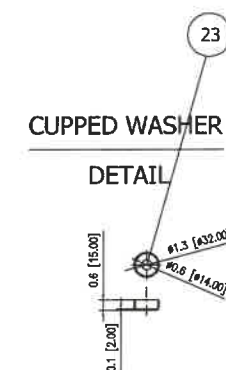
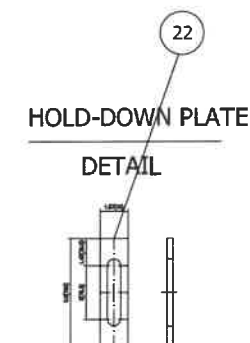
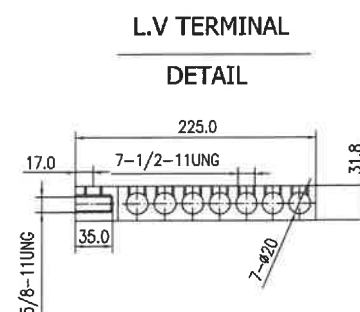
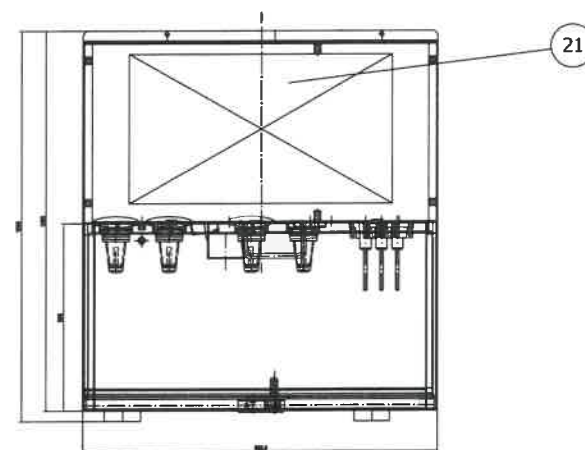
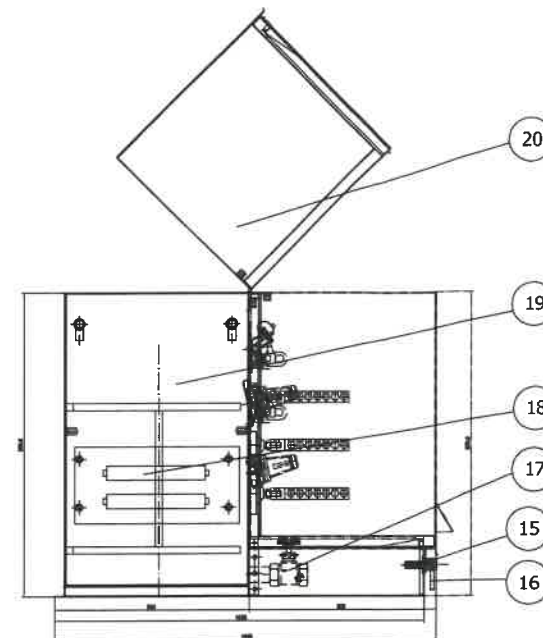


FINAL 4/8/24

DWG. NO.

ZGD50-240131-01

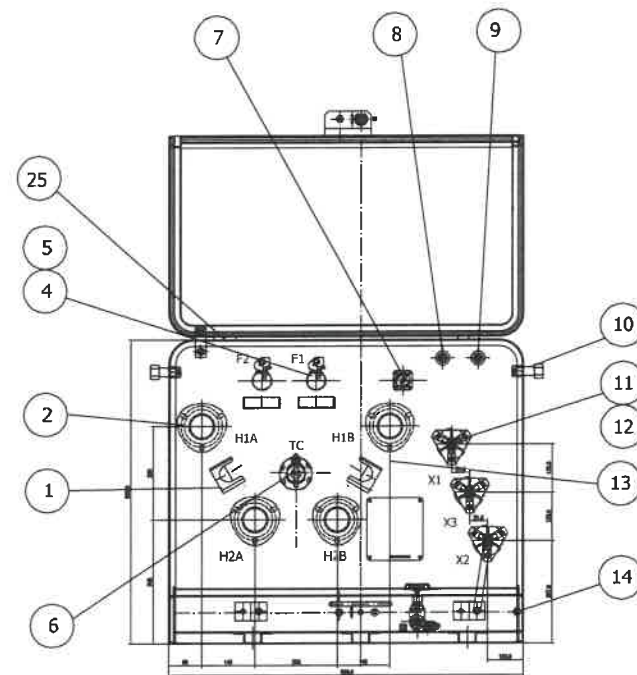

NAMEPLATE

DETAIL


JZP

PADMOUNT TYPE
ONAN 60HZ,65°C

SINGLE

PH.

50

kVA

IMPEDANCE AT 85°C

%

BIL

125/30

kV

HV.

13800/23900Y

V

LV.

240/120

V

SERIAL NO.

VOL OF OIL

TOTAL MASS

MAT HV.&LV.

POLARITY

SUBTRACTIVE POLAR

BAYONET FUSE

4000353C06

CURRENT LIMITING FUSE

CBUC15030C100

ENERGY EFFICIENCY PER DOE 2016

CURRENT LIMITING FUSE

X1

X2

X3

BAYONET FUSES

< 1PPM PCB


SWITCH POSITION	RATED VOLTS	% RATED VOLTAGE
1	14400	104.3
2	13800	100.0
3	13200	95.7
4	12870	93.3
5	12540	90.9

APPLIED STANDARD. IEEE 537.12

PRODUCTION PLACE. CHINA

DATE OF MFG.

WWW.JIEZOUPOWER.COM

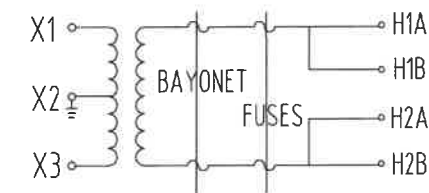

TECHNICAL DATA

RATING	50kVA
PRIMARY VOLTAGE(V)	13800±2*2.5%
SECONDARY VOLTAGE(V)	240/120
INSULATION LEVEL(kV) H.V BIL	125
INSULATION LEVEL(kV) L.V BIL	30
FREQUENCY	60Hz
VECTOR GROUP	II6
CONDUCTOR	AL
INSULATING OIL	MINERAL OIL
TEMPERATURE RISE	65°C
EFFICIENCY	99.11%
LOAD LOSS AT RATED VOLTAGE	630
NO LOAD LOSSES	80
IMPEDANCE	1.8%
ALTITUDE	≤1000m
No. OF TAP POSITION	5
COLOR	Munsell Green 7GY 3.29/1.5
POLARITY	SUBTRACTIVE POLARITY
APPLIED STANDARD.	IEEE.C57.12.25

ITEM	WEIGHT
TANK & ACCESSORIES	390 Lbs
TOTAL OIL WEIGHT	350 Lbs
TOTAL WEIGHT	1560 Lbs

PARTS LIST		
ITEM	DESCRIPTION	QTY
1	PARKING STAND BRACKET	2
2	HV BUSHING (15kV,200A)	4
4	BAY-O-NET SELECTION	2
5	FUSE HOLDER	2
6	TAP CHANGER 1PH	1
7	OIL LEVEL GAUGE	1
8	1" UPPER FILL VALVE	1
9	PRESSURE RELIEF VALVE	1
10	LIFTING LUG	4
11	LV BUSHING(1.2kv 5/8)	3
12	7 HOLE SPAD	3
13	NAMEPLATE	1
14	GROUND STEEL PADS (TTC2)	4
15	FIXED PROJECTING CUP	1
16	PADLOCK	1
17	1"DRAIN VALVE WITH 3/8" SAMPLER	1
18	CURRENT LIMITING FUSE	2
19	TANK	1
20	COVER	1
21	BOLT FOR LIFTING	1
22	HOLD-DOWN PLATE	4
23	CUPPED WASHER	4
24	GROUND PAD	2
25	EQUIPOTENTIAL DEVICE(COPPER)	1

TYPE
ZGDL-H-50/13.8/0.12(0.24)

DWG. NAME
50KVA SINGLE PHASE PAD MOUNTED
GENERAL ASSEMBLY DRAWING

DRAWN	CHECKED	CHECKED		APPROVED
GARY	JACK	IRIS		SAM

FIRST ANGLE PROJECTION	SCALE	1
---------------------------	-------	---

ZGD-50-240131-01

JZP
POWER TRANSFORMER

REV.
NO.







△

Church Index 4/8/24

FINAL 4/8/24

DWG.
NO.



ZGD-100-240131-02

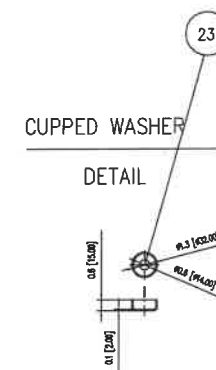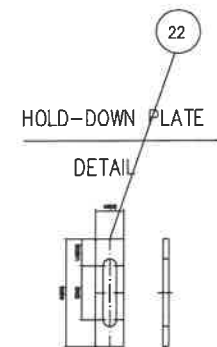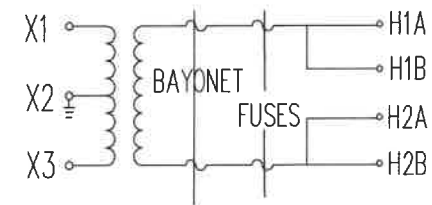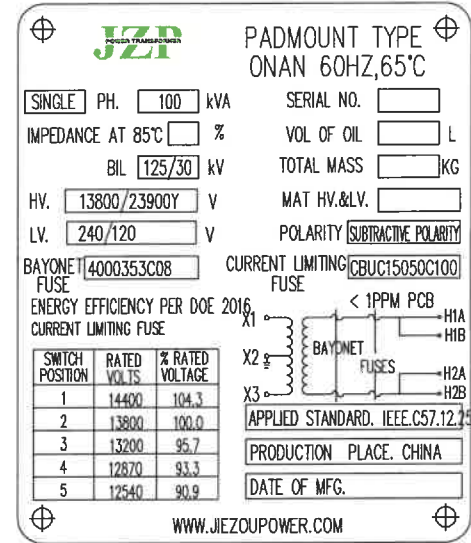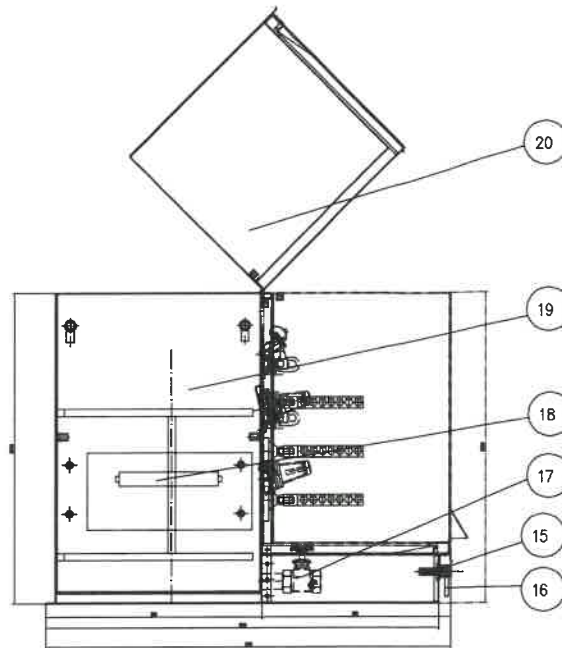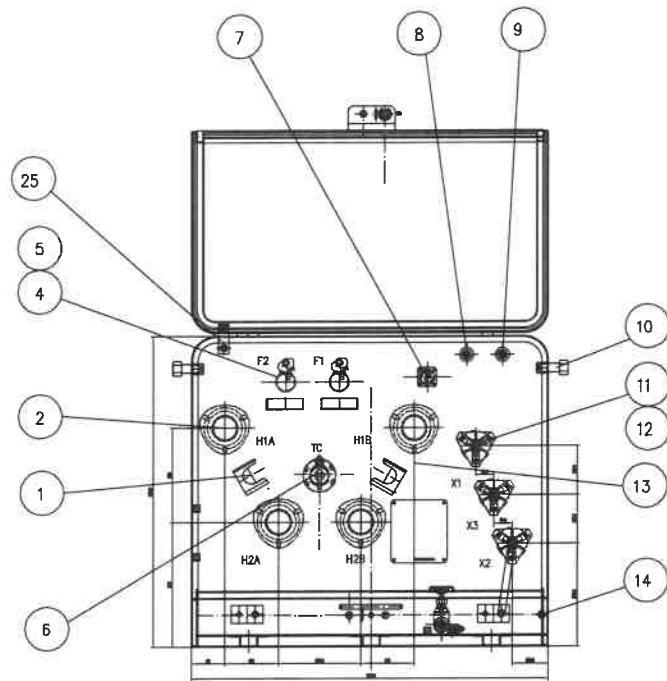

TECHNICAL DATA	
RATING	100kVA
PRIMARY VOLTAGE(V)	13800±2%5%
SECONDARY VOLTAGE(V)	240/120
INSULATION LEVEL(kV) H.V BIL	125
INSULATION LEVEL(kV) L.V BIL	30
FREQUENCY	60Hz
VECTOR GROUP	II6
CONDUCTOR	AL
INSULATING OIL	MINERAL OIL
TEMPERATURE RISE	65°C
EFFICIENCY	99.25%
LOAD LOSS AT RATED VOLTAGE	1080
NO LOAD LOSSES	120
IMPEDANCE	1.8%
ALTITUDE	≤1000m
No. OF TAP POSITION	5
COLOR	Munsell Green 7GY 3.29/1.5
POLARITY	SUBTRACTIVE POLARITY
APPLIED STANDARD.	IEEE.C57.12.25

ITEM	WEIGHT
TANK & ACCESSORIES	400 Lbs
TOTAL OIL WEIGHT	390 Lbs
TOTAL WEIGHT	1920 Lbs

PARTS LIST		
ITEM	DESCRIPTION	QTY
1	PARKING STAND BRACKET	2
2	HV BUSHING (15kV,200A)	4
4	BAY-O-NET SELECTION	2
5	FUSE HOLDER	2
6	TAP CHANGER 1PH	1
7	OIL LEVEL GAUGE	1
8	1" UPPER FILL VALVE	1
9	PRESSURE RELIEF VALVE	1
10	LIFTING LUG	4
11	LV BUSHING(1.2kV 5/8)	3
12	7 HOLE SPAD	3
13	NAMEPLATE	1
14	GROUND STEEL PADS (TTC2)	4
15	FIXED PROJECTING CUP	1
16	PADLOCK	1
17	1"DRAIN VALVE WITH 3/8" SAMPLER	1
18	CURRENT LIMITING FUSE	2
19	TANK	1
20	COVER	1
21	BOLT FOR LIFTING	1
22	HOLD-DOWN PLATE	4
23	CUPPED WASHER	4
24	GROUND PAD	2
25	EQUIPOTENTIAL DEVICE(COPPER)	1

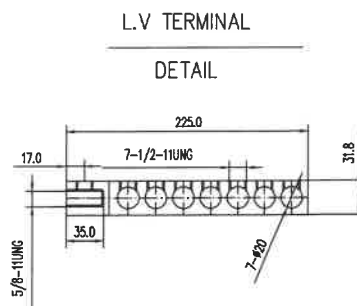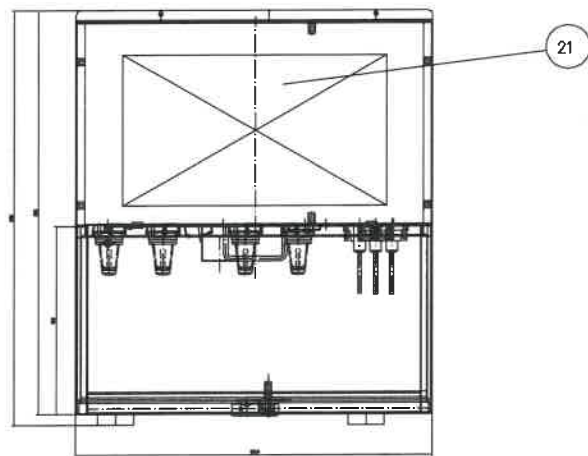

TYPE
ZGDL-H-100/13.8/0.12(0.24)

DWG. NAME
100KVA SINGLE PHASE PAD MOUNTED
GENERAL ASSEMBLY DRAWING

DRAWN	CHECKED	CHECKED		APPROVED
GARY	JACK	IRIS		SAM

FIRST ANGLE
PROJECTION

SCALE	1
-------	---

1

REV.
NO.

JZP
SINCE 1989 FROM USA

ZGD-100-240131-02

 $\triangle O$