
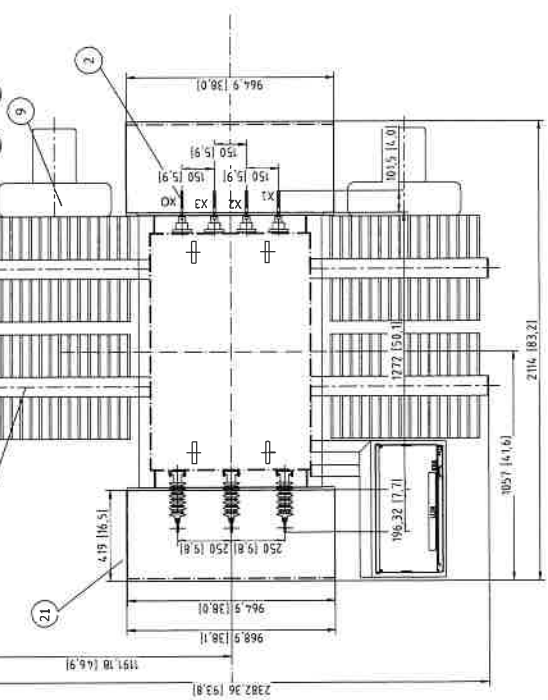


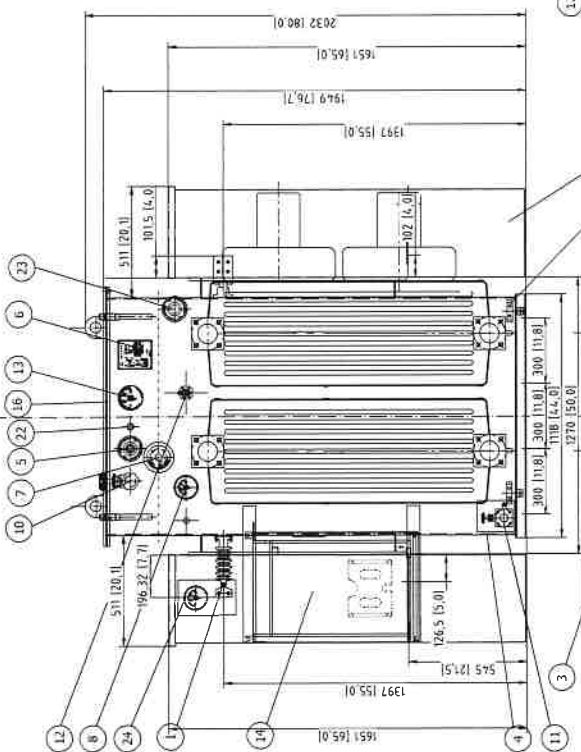

ITEM	FITTINGS AND DESCRIPTIONS	QTY
1	HY BUSHING (15KV 417A)	3
2	LV BUSHING (1.2KV 2000A)	4
3	RADIATORS(P1300-16/480)	4
4	PROTECTIVE COVER WITH LOCK	1
5	PRESSURE RELIEF DEVICE	1
6	NAME PLATE.	1
7	LIQUID LEVEL INDICATOR	1
8	LIQUID TEMPERATURE INDICATOR	1
9	FANS	4
10	OIL FILL VALVE	1
11	DRAIN VALVE WITH SAMPLING DEVICE	1
12	TAP CHANGER,125/15-6×5	1
13	VACUUM PRESSURE GAUGE	1
14	AIR COOLING CONTROL BOX	1
15	THROAT FLANGE,H.V	1
16	TANK AND COVER ASSEMBLY	1
17	BASE WELDED TO TANK	1
18	LIFTING EYE FOR ACTIVE PART WITH TANK COVER	4
19	GROUND PAD ON TANK WALL	2
20	LOW VOLTAGE CABLE BOX	1
21	HIGH VOLTAGE CABLE BOX	1
22	PRESSURE VACUUM GAUGE AND AIR TEST VALVE	1
23	SUDDEN PRESSURE RELAY	1
24	WINDING TEMPERATURE INDICATOR	1


TYPE	DWG. NAME

500KVA, 13.8kV, 55kV General Assembly Drawing

DRAWN	CHECKED	CHECKED	APPROVED	FIRST ANGLE REJECTION	SCALE	1
-------	---------	---------	----------	--------------------------	-------	---

WIKI W	ELLA W	IRIS J	SAM S
--------	--------	--------	-------

51500 730814-01

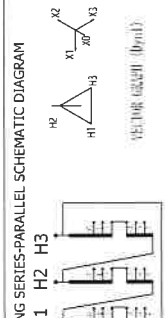REV.
NO.

ITEM	WEIGHT(kg)
TANK & ACCESORIES	1800
TOTAL OIL WEIGHT	980
TOTAL WEIGHT	4500


CHANGE



SUBSTATION TRANSFORMER

STANDARDS IEEE. C57. 12. 00
1500kVA HV 13200V DELTA
LV 550V Grdy/318

TYPE OF COLING ONAN/ONAF
PERCENT IMPEDANCE: 5.65 %
TYPE OF OIL 45# NO PCB
CORE & COLL (UN TAKING): LBS
TANK & FITTINGS: LBS
LIQUID: GALS LBS
TOTAL: LBS

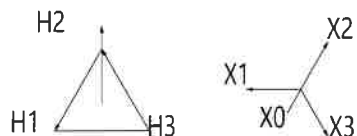


VECTOR GRAPH (Dyn1)

H. V WIRING

L. V WIRING

SCHEMATIC DIAGRAM

SCHEMATIC DIAGRAM

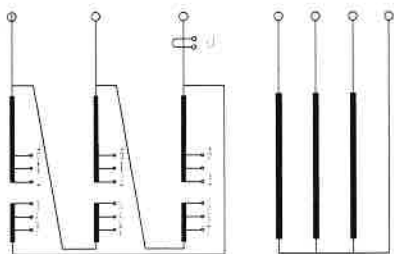

PRODUCT NO. :
TYPE SF-1500/1933/13.2/0.55
CONDUCTOR MATERIAL: ALUMINUM
PHASE 3
FREQUENCY 60Hz
TEMPERATURE RISE 65° C/ 65° C
SERIAL NO. :
DATE OF MFG. :
H. V. Um/BIL/AC 15/95/34 kV
L. V. Um/BIL/AC 0.55/30/10 kV

Tapping Range	H. V			L. V		
	Voltage (V)	Current (A)		Voltage (V)	Current (A)	
		ONAN	ONAF		ONAN	ONAF
1 2-3	13860	62.48	83.02	550	1574.59	2091.11
2 3-4	13530	64.01	85.05			
3 4-5	13200	65.61	87.17			
4 5-6	12870	67.29	89.41			
5 6-7	12540	69.06	91.76			

DE-ENERGIZE TRANSFORMER
BEFORE OPERATING TAPCHANGER

ITEM:
MANUFACTURER:
PART NUMBER:


WWW.JIEZOUPOER.COM






SUBSTATION TRANSFORMER

STANDARDS IEEE. C57. 12. 00
1500kVA HV 13200V DELTA
LV 550V Grdy/318
TYPE OF COLING ONAN/ONAF
PERCENT IMPEDANCE: 5.65 %
TYPE OF OIL 45# NO PCB
CORE & COLL (UNTAKING): LBS
TANK & FITTINGS: LBS
LIQUID: GALS LBS
TOTAL: LBS

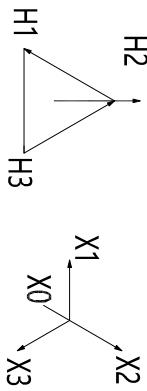

VECTOR GRAPH (Dyn1)

H. V WIRING L. V WIRING

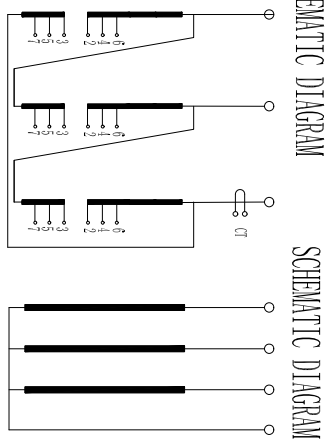

PRODUCT NO. :
TYPE SF-1500/1933/13.2/0.55
CONDUCTOR MATERIAL: ALUMINUM
PHASE 3
FREQUENCY 60Hz
TEMPERATURE RISE 65° C/ 65° C
SERIAL NO. :
DATE OF MFG. :
H. V. Um/BIL/AC 15/95/34 kV
L. V. Um/BIL/AC 0.55/30/10 kV


Tapping Range	H. V		L. V	
	Voltage (V)	Current (A) ONAN ONAF	Voltage (V)	Current (A) ONAN ONAF
1 2-3	13860	62.48 83.02	550	1574.59 2091.11
2 3-4	13530	64.01 85.05		
3 4-5	13200	65.61 87.17		
4 5-6	12870	67.29 89.41		
5 6-7	12540	69.06 91.76		

DE-ENERGIZE TRANSFORMER
BEFORE OPERATING TAPCHANGER

ITEM:
MANUFACTURED:
PART NUMBER:

WWW.JIEZOUPOER.COM



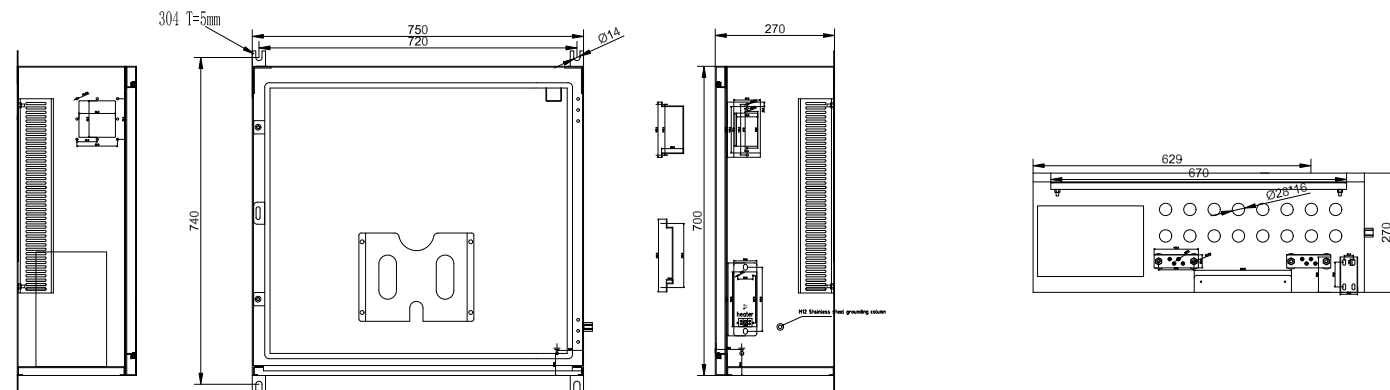


Left view

Front View

Right view

Top view

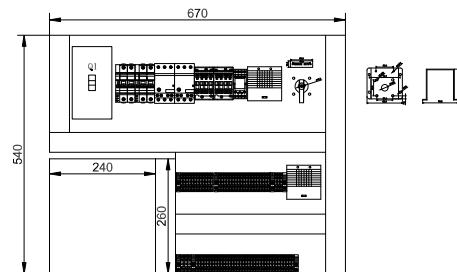

Layout view

Technical conditions






1. The control box is wall mounted.
2. The material of the control box is 2.0mm stainless steel plate.
3. The protection grade of this control box is NEMA 3R .




TYPE 1500KVA,13.2/0.55kV					DWG. NAME General Assembly Drawing					
DRAWN	CHECKED	CHECKED		APPROVED	FIRST ANGLE PROJECTION	SCALE	1			
MIKE W	ELLA W	IRIS J		SAM S	JZP SINCE 1989 FROM USA					REV. NO.
S1500-230814-01										

CHANGE


Power supply, fan signal

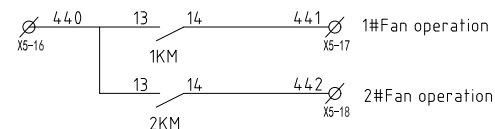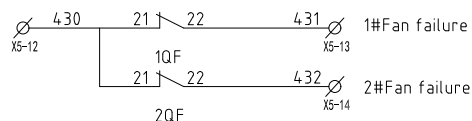


PRESSURE RELIEF VALVE




OIL LEVEL GAUGE




LIQUID TEMPERATURE INDICATOR 1



VACUUM PRESSURE GAUGE




SUDDEN PRESSURE RELAY




X1:BODY PROTECTION WIRING TERMINAL			
JOINT	N.O.	CONNECTOR FUNCTION	JOINT
1	1	PRESSURE RELIEF VALVE	1
2	2	OIL LEVEL GAUGE	D1
3	3	LIQUID TEMPERATURE INDICATOR 1	2
4	4	WINDING THERMOMETERBWR-4	A3
5	5	VACUUM PRESSURE GAUGE	1
6	6	PRESSURE SAFETY DEVICE	2
7	7		5
8	8		B3
9	9	WINDING THERMOMETERBWR-4	C3
10	10		D3
11	11	PRESSURE RELIEF VALVE	2
12	12		3
13	13	OIL LEVEL GAUGE	D2
14	14		D3
15	15	LIQUID TEMPERATURE INDICATOR 1	3
16	16		1
17	17	VACUUM PRESSURE GAUGE	2
18	18		3
19	19		4
20	20		1
21	21	SUDDEN PRESSURE RELAY	3
22	22		4
23	23		6
24	24		A1
25	25		A2
26	26		B1
27	27	WINDING THERMOMETERBWR-4	B2
28	28		C1
29	29		C2
30	30		D1
31	31		D2




Winding thermometerBWR-4

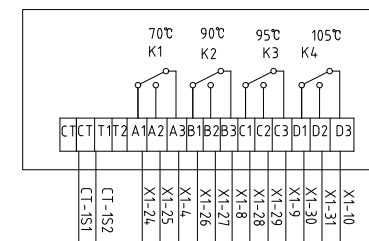


CHANGE

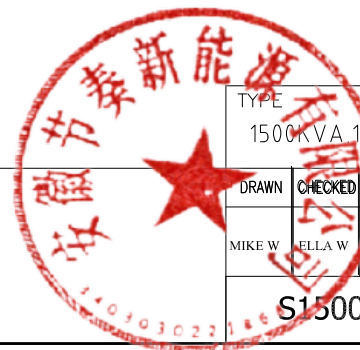

TYPE		DWG. NAME	
1500kVA 1.2/0.55kV		General Assembly Drawing	
DRAWN	CHECKED	APPROVED	FIRST ANGLE PROJECTION
MIKE W	ELLA W	SAM S	SCALE 1
S1500-230814-01		JZP SINCE 1989 FROM USA	
		REV. NO.	
		0	

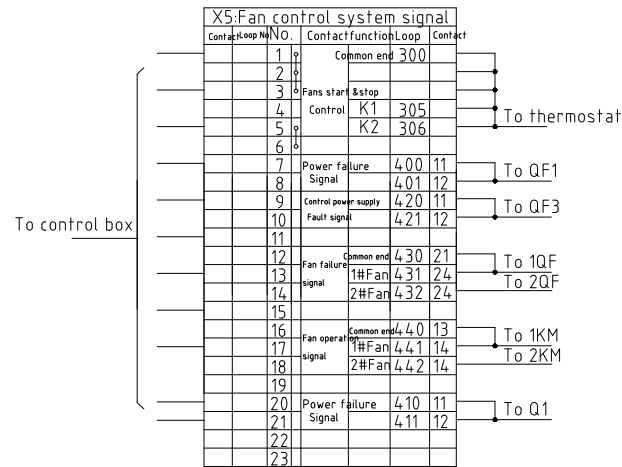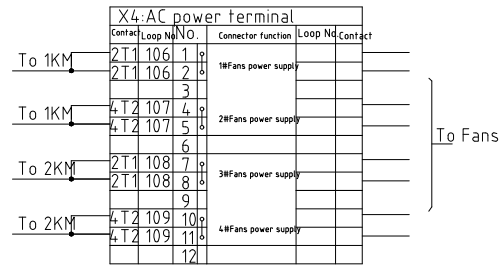

CHANGE

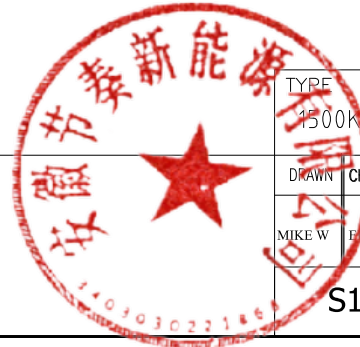

TYPE				DWG. NAME			
1500KVA,13.2/0.55kV				General Assembly Drawing			
DRAWN	CHECKED	CHECKED	APPROVED	FIRST ANGLE PROJECTION	SCALE	1	
MIKE W	E-LA W	IRIS J	SAM S				
S1500-230814-01							

JZP
SINCE 1989 FROM USA

REV.
NO.

0

No.	Component code	Component name	Model	Qty	Brand
1	Q1	AC air circuit breaker	M1S15T22L	1	NOARK
2	QF1	AC air circuit breaker	BIN2C20	1	NOARK
3	QF3	AC air circuit breaker	BIN2C10	1	NOARK
4	SD	Auxiliary contact	AX3111N	2	NOARK
5	KA2	Intermediate relay	RXM4AB2F7	1	Scheider
6	1QF 2QF	Motor protection circuit breaker	EX9S32A/AX5111/ 4A	2	NOARK
7	BS	Humidity controller (Including humidity sensor)	3118.000 AC115V	1	WEITU
8	BC	Temperature controller (including temperature probe)	3110.000 AC115V	1	WEITU
9	1KM 2KM	AC contactor	EX9C0911G7 115V 60HZ	2	NOARK
10	R	Condensate load heater	DJR-S-50W	1	MENGYOU
11	SA	State transition switch (manual stop automatic)	3LBB-20/R1159.1G251	1	RUNKE
12	CZ	RECEPTACLE	GFCI 115V	1	ZHONGTONG
13	CK	Limit switch	D4V-8112Z	1	OMRON
14	EL	flashlight(LED)	LI-04 AC115V	1	BOSENG
15		Respiratory net mask	FU9801 B P2+Rain cover	1	KAKU
16	F	Fan	Series 80 AC115V, load is 1/3P	4	SUNTRONIX
17	TC	Transformer	JBK	1	JIUCHUAN
18	X1	Terminal	UK5N	35	PHOENIX
19	X3	Terminal	UK35N	3	PHOENIX
18	X4	Terminal	UK5N	12	PHOENIX
19	X5	Terminal	UK2.5B	19	PHOENIX
20		bronze medal	100×30×4	2	BOMEITE
21		Mounting plate	670×540	1	BOMEITE
22		Indicating signs	50×15×3	1	BOMEITE
23		Gland head	φ20-M25×1.5	16	BOMEITE
24		Control Panel and Board			BOMEITE



TYPE 1500KVA,13.2/0.55kV				DWG. NAME General Assembly Drawing			
DRAWN	CHECKED	CHECKED	APPROVED	FIRST ANGLE PROJECTION	SCALE	1	
MING W	ELLA W	IRIS J	SAM S				REV. NO.
S1500-230814-01							

CHANGE