

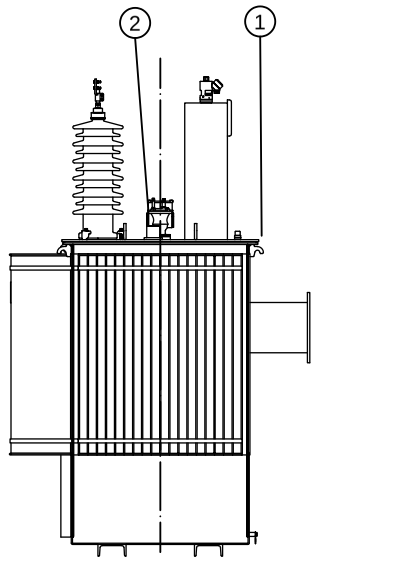
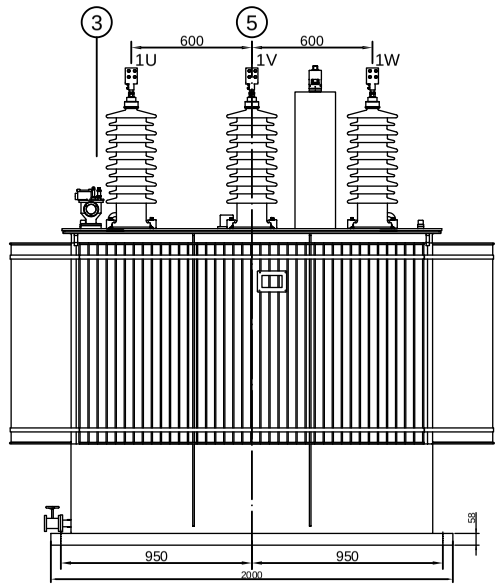
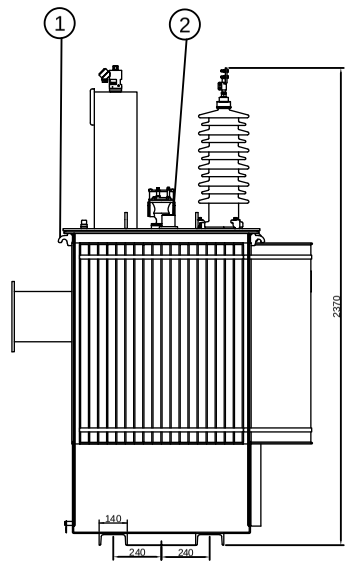


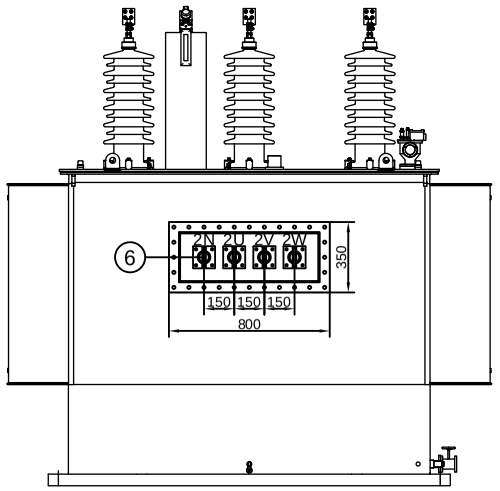



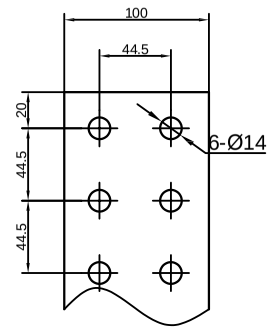





T2 transformer

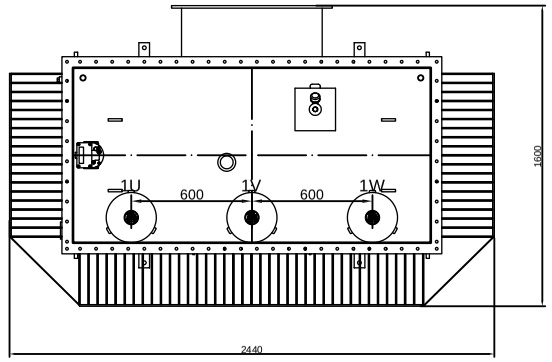

secondary terminal
material: Copper

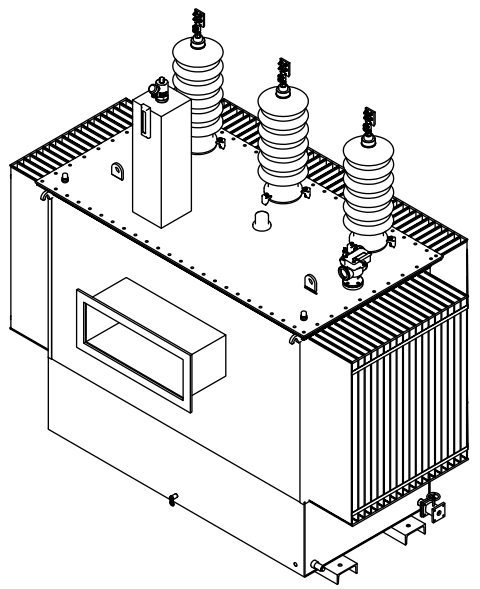


primary terminal
material: Copper




| Tap | Voltage | Amps | Connections |
|---|---|---|---|
| 1 | 39900 | 21.7 | |
| 2 | 38950 | 22.23 | |
| 3 | 38000 | 22.79 | |
| 4 | 37050 | 23.37 | |
| 5 | 36100 | 23.99 | |

HV side







DIAGRAM VECTOR
Dyn1



LV bushing enclosure

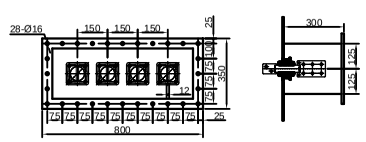


LV side






| Item | Q'TY | Description | Reference |
|---|---|---|---|
| 6 | 4 | LV bushing (epoxy) | |
| 5 | 3 | HV bushing (procelain) | |
| 4 | 1 | Tubular oil level gauge | |
| 3 | 1 | Buchholz | |
| 2 | 1 | HV taps | |
| 1 | 4 | Lifting lug | |

| | | | | | |
|---|---|---|---|---|---|
| Standards | ANSI/IEEE C57.12.10-2010 | | | | |
| Rated power | 1500 | kVA | Frequency | 60 | Hz |
| Rated Primary voltage | 38 | kV | Impedance | 6 | % |
| Rated secondary voltage | 0.48 | kV | Weight | 5800 | kg |
| Off-Load Tapping on HV Coil | ±2x2.5 | % | Phase | 3 | |
| Winding Material (HV/LV) | AL/AL | Vector group | | Dyn1 | |
| Climatic Class | C2 | Type of cooling | | AN | |
| Environmental Class | E1 | Insulation class | | A | |
| Fire Behaviour Class | F1 | Protection Class | | IP56 | |
| Power Frequency Withstand Voltage (HVLV) | 70/3 | kV | | | |
| Lightning Impulse Withstand Voltage (HV/LV) | 250/30 | kV | | | |
| Oil Temp. Rise | 55 | K | | | |
| Average Winding Temp. Rise (HV/LV) | 65 | K | | | |

| | | | |
|---|---|---|---|
| CLIENT | | | |
| MANUFACTURER | | | |
| DWG NO: | | | |
| TITLE | 1500kVA, 38/0.48kV Oil-immersed distribution transformer outline drawings | | |
| DRAWN | CHECKED | APPROVED | DATA |
| | | | 2025/1/17 |
| SCALE | SIZE | REV | SHEET |
| 1:1 | A3 | A | 1 of 1 |

| REV. | DATA | DESCRIPTION | ARRROVED |
|---|---|---|---|
| C | | | |
| B | | | |
| A | | | |