

# Data Centre Cooling

Dr Peadar Grant

October 1, 2021


# Temperature scales

Temperature Scales			
Fahrenheit	Celsius	Kelvin	
212	100	373	Boiling point of water at sea-level
194	90	363	
176	80	353	
158	70	343	
140	60	333	
122	50	323	
104	40	313	
86	30	303	Average room temperature
68	20	293	
50	10	283	
32	0	273	Melting (freezing) point of ice (water) at sea-level
14	-10	263	
-4	-20	253	
-22	-30	243	
-40	-40	233	
-58	-50	223	
-76	-60	213	
-94	-70	203	-89°C (-129°F) Lowest recorded temperature. Vostok, Antarctica July, 1983
-112	-80	193	
-130	-90	183	
-148	-100	173	
Reference: Ahrens (1994)			Department of Atmospheric Sciences University of Illinois at Urbana-Champaign


# ASHRAE 2011 guidelines

Classes (a)	Equipment Environmental Specifications							
	Product Operations (b)(c)					Product Power Off (c) (d)		
	Dry-Bulb Temperature (°C) (e) (g)	Humidity Range, non-Condensing (h) (i)	Maximum Dew Point (°C)	Maximum Elevation (m)	Maximum Rate of Change (°C/hr) (f)	Dry-Bulb Temperature (°C)	Relative Humidity (%)	Maximum Dew Point (°C)
<b>Recommended</b> (Applies to all A classes; individual data centers can choose to expand this range based upon the analysis described in this document)								
A1 to A4	18 to 27	5.5°C DP to 60% RH and 15°C DP						
<b>Allowable</b>								
A1	15 to 32	20% to 80% RH	17	3050	5/20	5 to 45	8 to 80	27
A2	10 to 35	20% to 80% RH	21	3050	5/20	5 to 45	8 to 80	27
A3	5 to 40	-12°C DP & 8% RH to 85% RH	24	3050	5/20	5 to 45	8 to 85	27
A4	5 to 45	-12°C DP & 8% RH to 90% RH	24	3050	5/20	5 to 45	8 to 90	27
B	5 to 35	8% RH to 80% RH	28	3050	NA	5 to 45	8 to 80	29
C	5 to 40	8% RH to 80% RH	28	3050	NA	5 to 45	8 to 80	29

# Fan-assisted ventilation

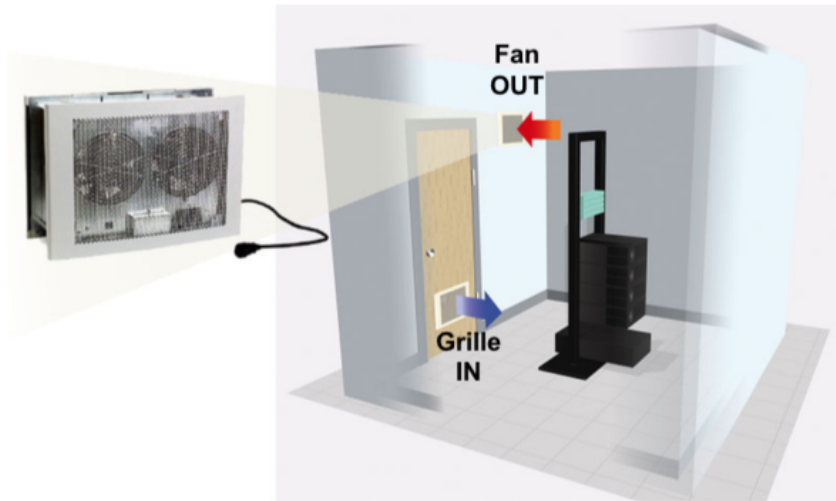

# Cooling method selection

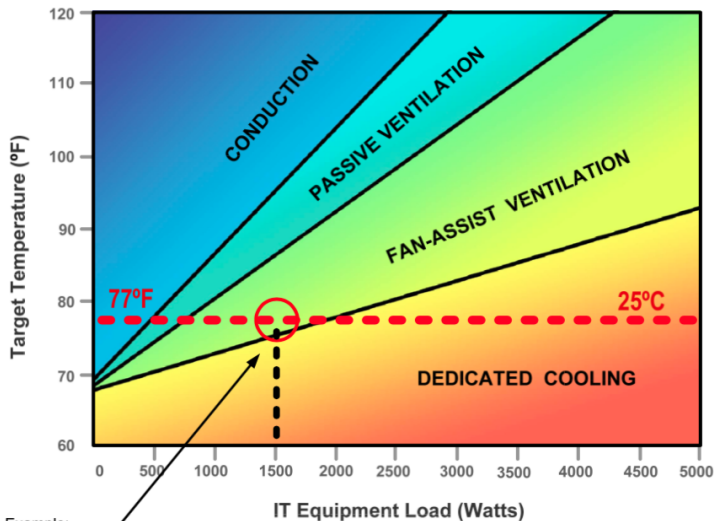


Example:  
1500 W maintained at 77°F (25°C)  
falls within the "fan-assist" range



# Willis carrier (A/C inventor)



# Refrigeration cycle

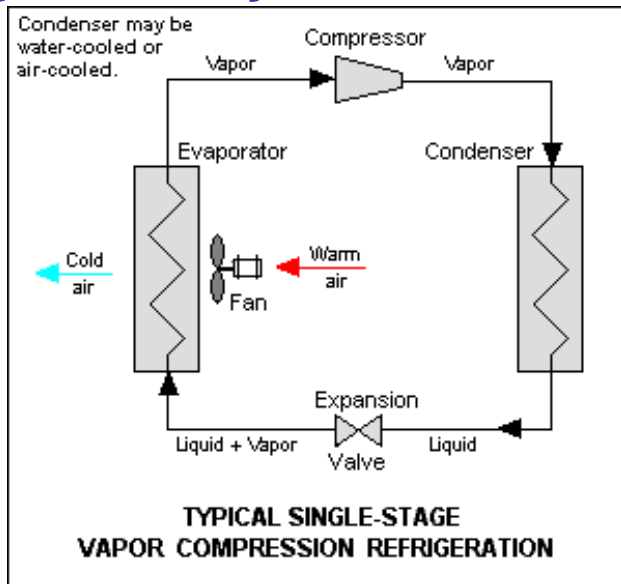


# Self-contained Air Cooled DX CRAC

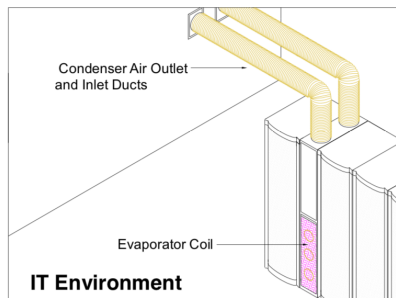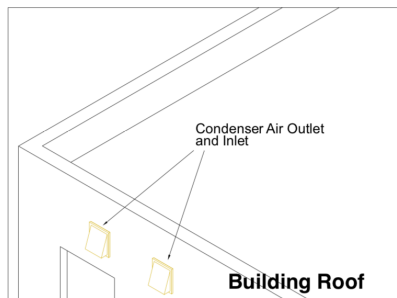




# Air cooled DX CRAC

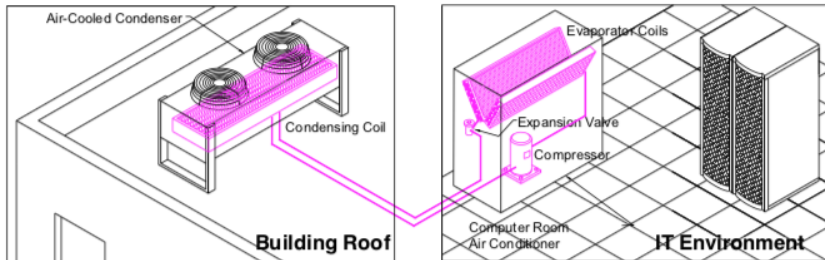


# Glycol-cooled DX CRAC

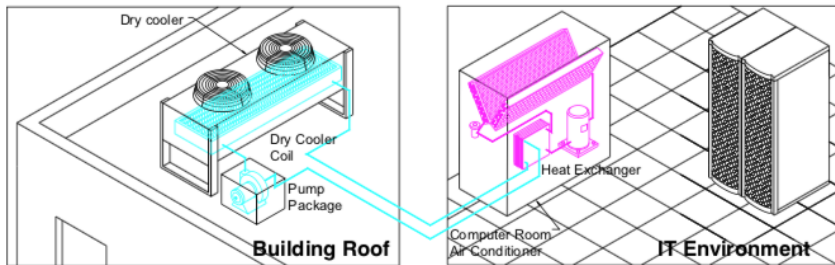




# Dry cooler



# Water-cooled DX CRAC

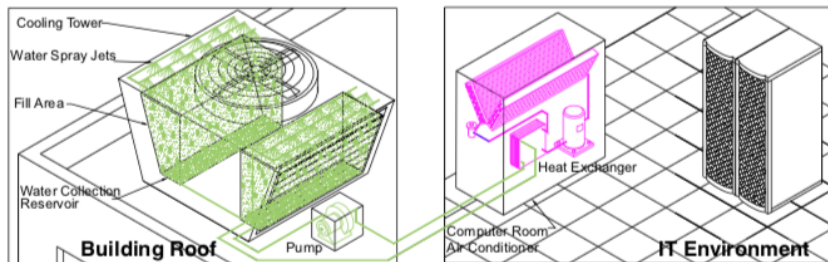

# Chilled-water example

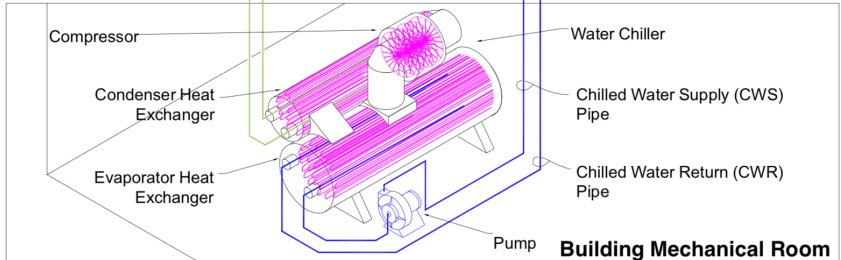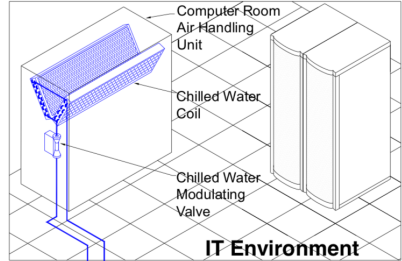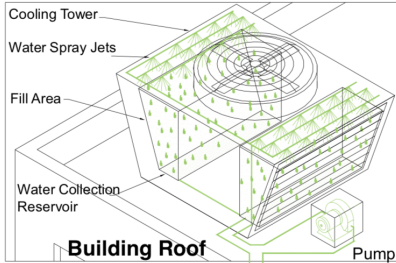

# CRAH side view

