
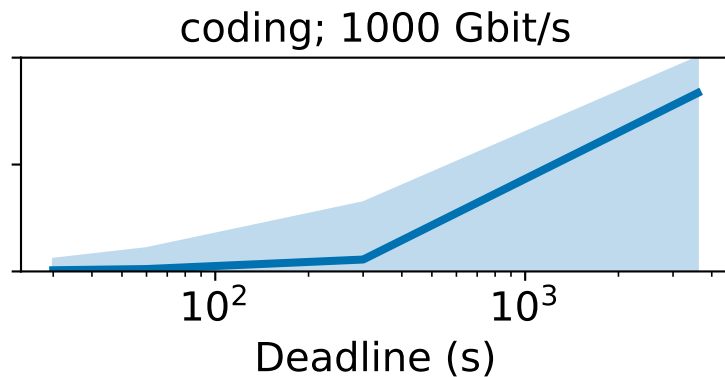
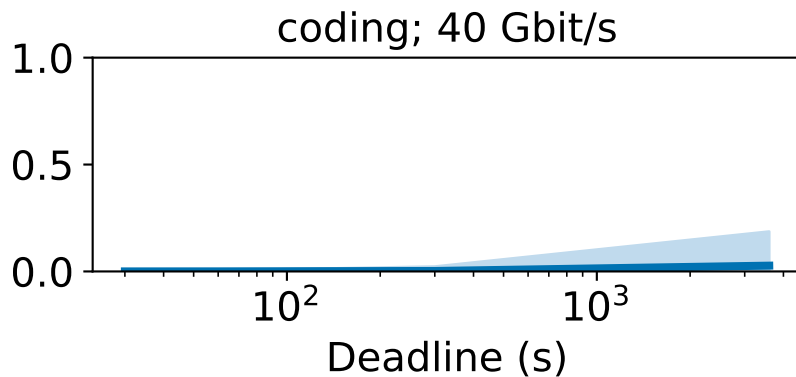
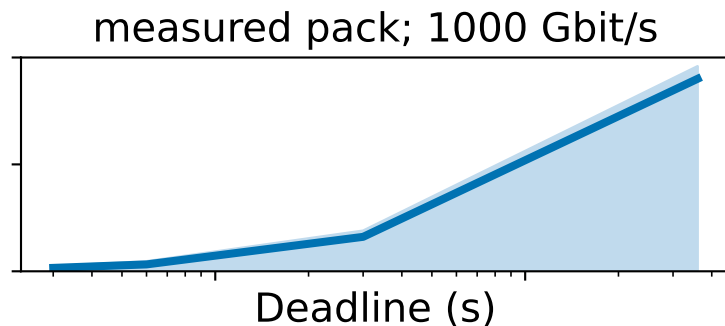


Action ambiguity in the initial static LP; resident load 50%

Ranges do not certify equivalent executed completion

Source workload assigned to KV

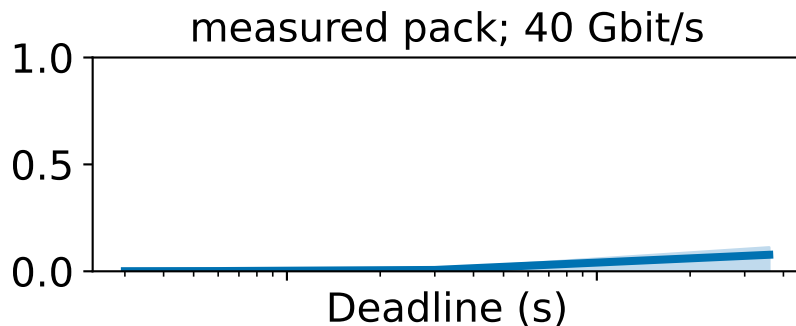

Same maximum planned shed; debt unconstrained Queue-Haul LP