
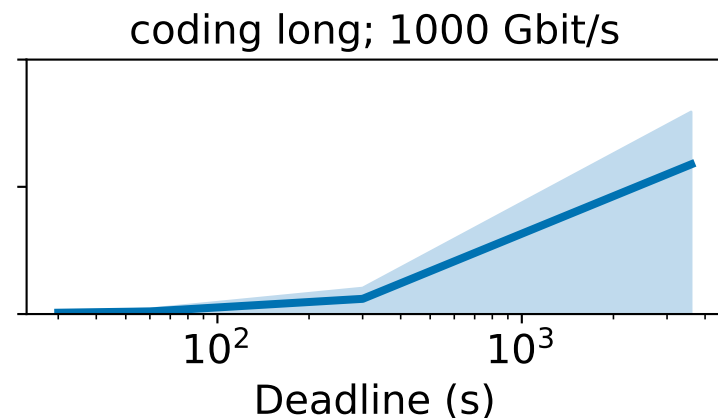
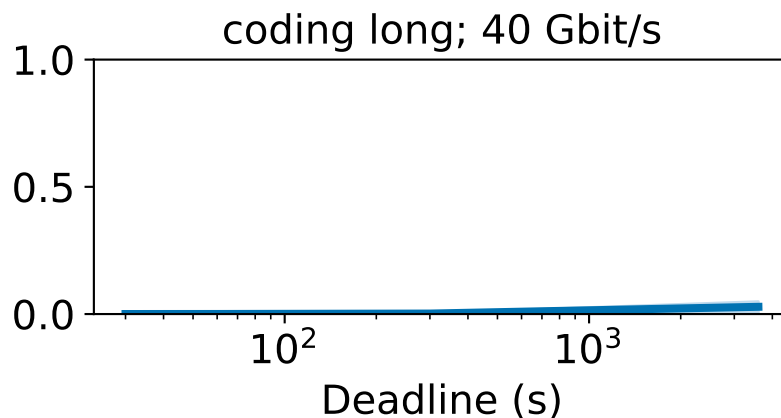
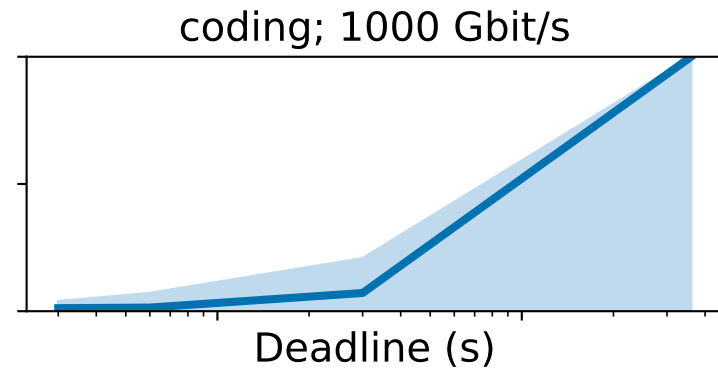
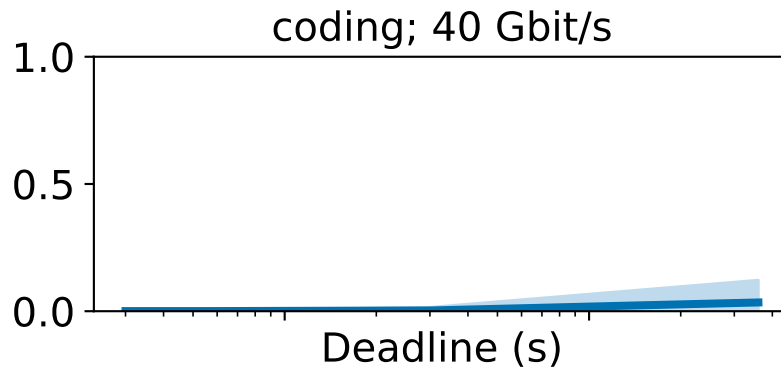
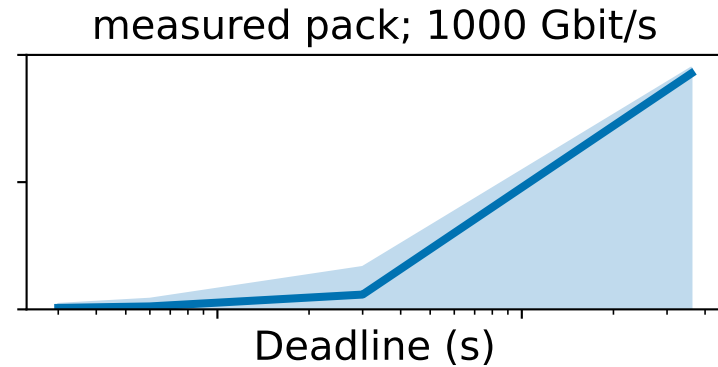


Action ambiguity in the initial static LP; resident load 50%
Ranges do not certify equivalent executed completion

Source workload assigned to KV

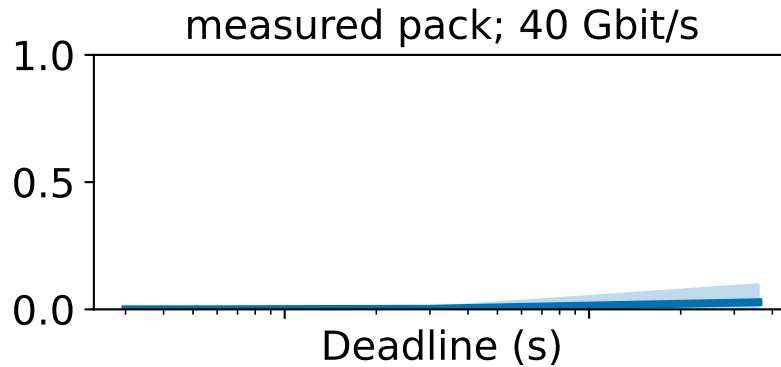

Same maximum planned shed; secondary cost unconstrained Queue-Haul LP