Bar Bending Schedule

Reinforcement Detail Report

Project	Tower A Ground Floor
Client	Skyline Developers
Element	Column
Date	05 May 2026
Prepared by	XYZ Engineering

For Construction Use

Final check by qualified structural engineer required before fabrication.

Project Details

1. Element & Dimensions

Parameter	Value	Parameter	Value
Element Type	Column	Width × Depth	300 × 300 mm
Storey Height	3000 mm	Clear Cover	40 mm

2. Reinforcement Details

Parameter	Value	Parameter	Value
Main Bar Dia	20 mm	Main Bar Quantity	6 nos.
Lateral Tie Dia	8 mm	Tie Spacing	200 mm
Hook Type	135°	Lap Length	0 mm

3. Calculation Settings

Parameter	Value	Parameter	Value
Quantity Mode	Standard	Standards	IS 456:2000, IS 2502:1963
Wastage Factor	5% (industry default)	Standard Rod	12 m

Bar Bending Schedule (BBS)

Element: **Column** | Total bars: 21 | Net weight: 63.85 kg

Bar Mark	Element	Description	Dia (mm)	Cutting Len (mm)	Qty	Total Len (m)	Weight (kg)
M1	Column	Main Vertical Bar	20.0	3920.0	6	23.52	58.07
T1	Column	Lateral Tie	8.0	976.0	15	14.64	5.78
TOTAL						38.16	63.85

✓ **Engineering Verified** — Independent recalculation of total_length & weight per row.

Bar Shape Drawings

Schematic drawings of every bar in the schedule. Numbers next to each shape are exact mm dimensions. *Drawings are not to scale.*

M1 — Main Vertical Bar

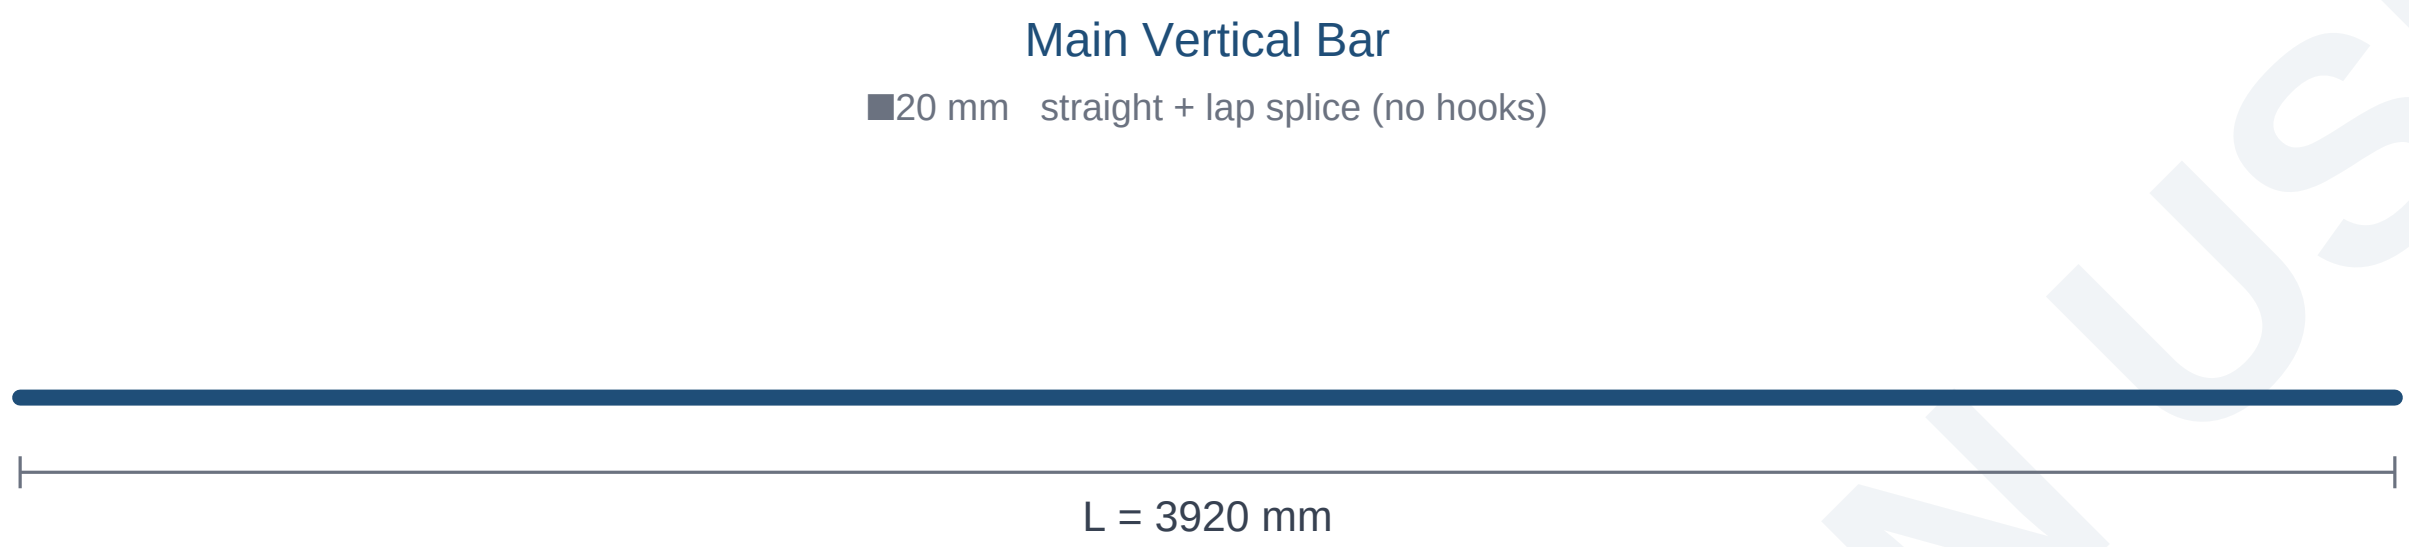

Dia: **20.0 mm** · Cutting length: **3920.0 mm** · Quantity: **6** · Weight: **58.07 kg**

T1 — Lateral Tie

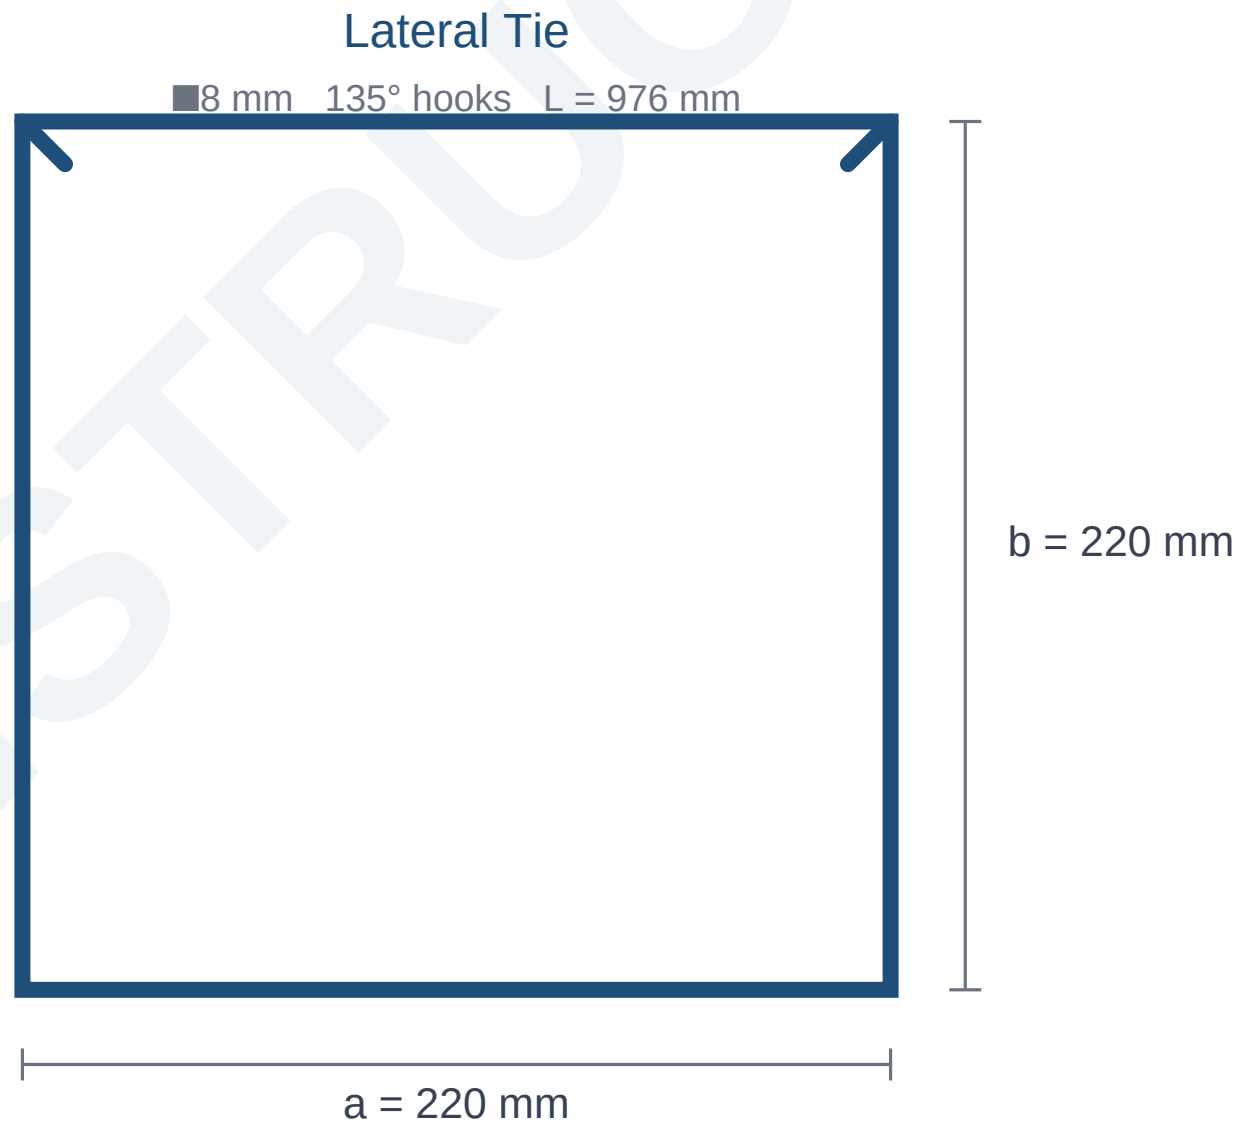

Dia: **8.0 mm** · Cutting length: **976.0 mm** · Quantity: **15** · Weight: **5.78 kg**

Final Steel Order Summary

Diameter-wise grouping with 5% wastage applied. Standard rod length = 12 m. Hand this directly to your supplier.

Diameter (mm)	Net Length (m)	Net Weight (kg)	Wastage %	Order Length (m)	Order Weight (kg)	12 m Rods
8.0	14.64	5.78	5%	15.37	6.07	2
20.0	23.52	58.07	5%	24.7	60.97	3
GRAND TOTAL				40.07	67.04	

Total Bars	**21**
Net Weight (no wastage)	**63.85 kg**
Order Weight (with 5%)	**67.04 kg**
Total Order Length	**40.07 m**

Disclaimer. This bar bending schedule is auto-generated based on the inputs provided. Final dimensions, lap lengths, and detailing must be verified against site drawings and reviewed by a qualified structural engineer before steel fabrication. The issuing party accepts no responsibility for errors arising from incorrect input data or unverified use on site.