



Питание
оперативных целей

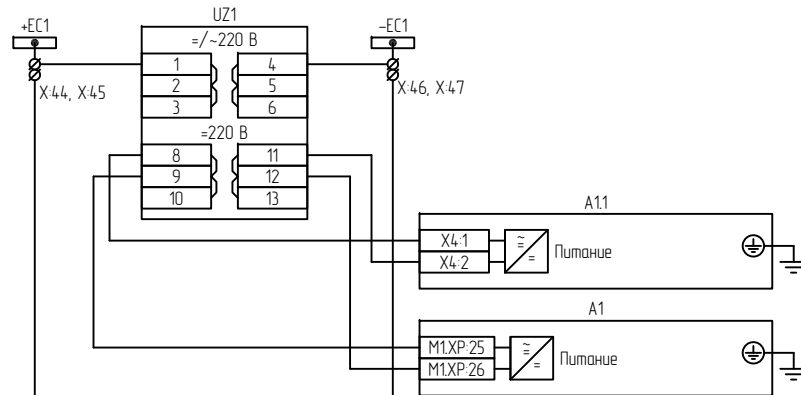

Контроль положения
испытательных
блоков

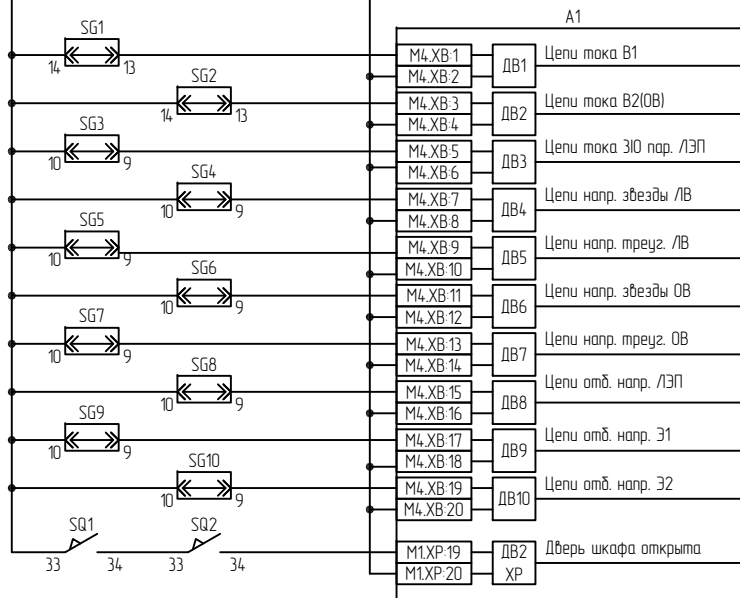

Контроль положения
дверей шкафа

The diagram illustrates the electrical control system for a pump. It features a power supply +EH1 connected to a terminal block with terminals X48 and X49. This terminal block is connected to a control unit A1. Inside A1, there are two sections: 'Неисправность' (Fault) and 'Срабатывание' (Trip). The 'Неисправность' section contains a normally open contact KD1 and a normally closed contact M1XP2. The 'Срабатывание' section contains a normally open contact KD3 and a normally closed contact M1XP12. The output of the 'Неисправность' section is connected to a terminal block with terminals X50 and X51, which is connected to a power supply -EH1. The output of the 'Срабатывание' section is connected to a terminal block with terminals 1 and 2, which is connected to a lamp HL1.

Срабатывание защит

A1		
SFP port	SFP Модуль 100BASE-FX	M14.X1.T M14.X1.R
SFP port	SFP Модуль 100BASE-FX	M14.X2.T M14.X2.R
SFP port	SFP Модуль 100BASE-FX	M14.X3.T M14.X3.R
SFP port	SFP Модуль 100BASE-FX	M14.X4.T M14.X4.R

A1		
SFP port	SFP модуль	M7.X6.TX M7.X6.RX
SFP port	SFP модуль	M7.X7.TX M7.X7.RX