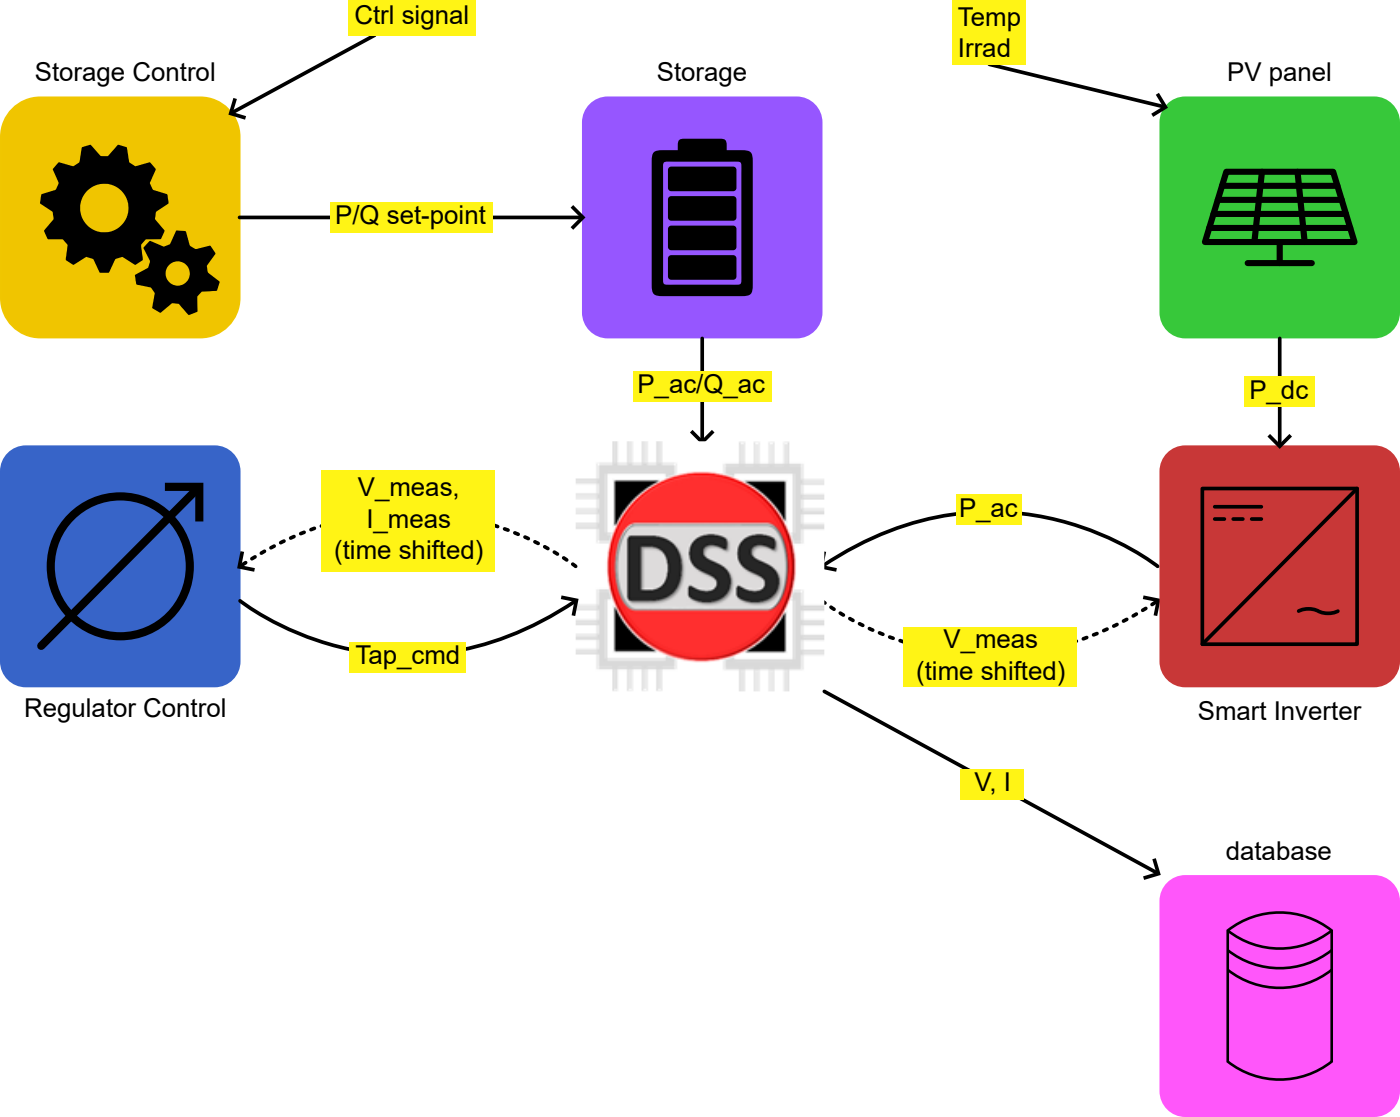
Ctrl signal
Storage Control
Storage
Temp
Irrad
PV panel
P/Q set-point
P_ac/Q_ac
P_dc
V_meas,
I_meas
(time shifted)
DSS
P_ac
V_meas
(time shifted)
Tap_cmd
Regulator Control
Smart Inverter
V, I
database