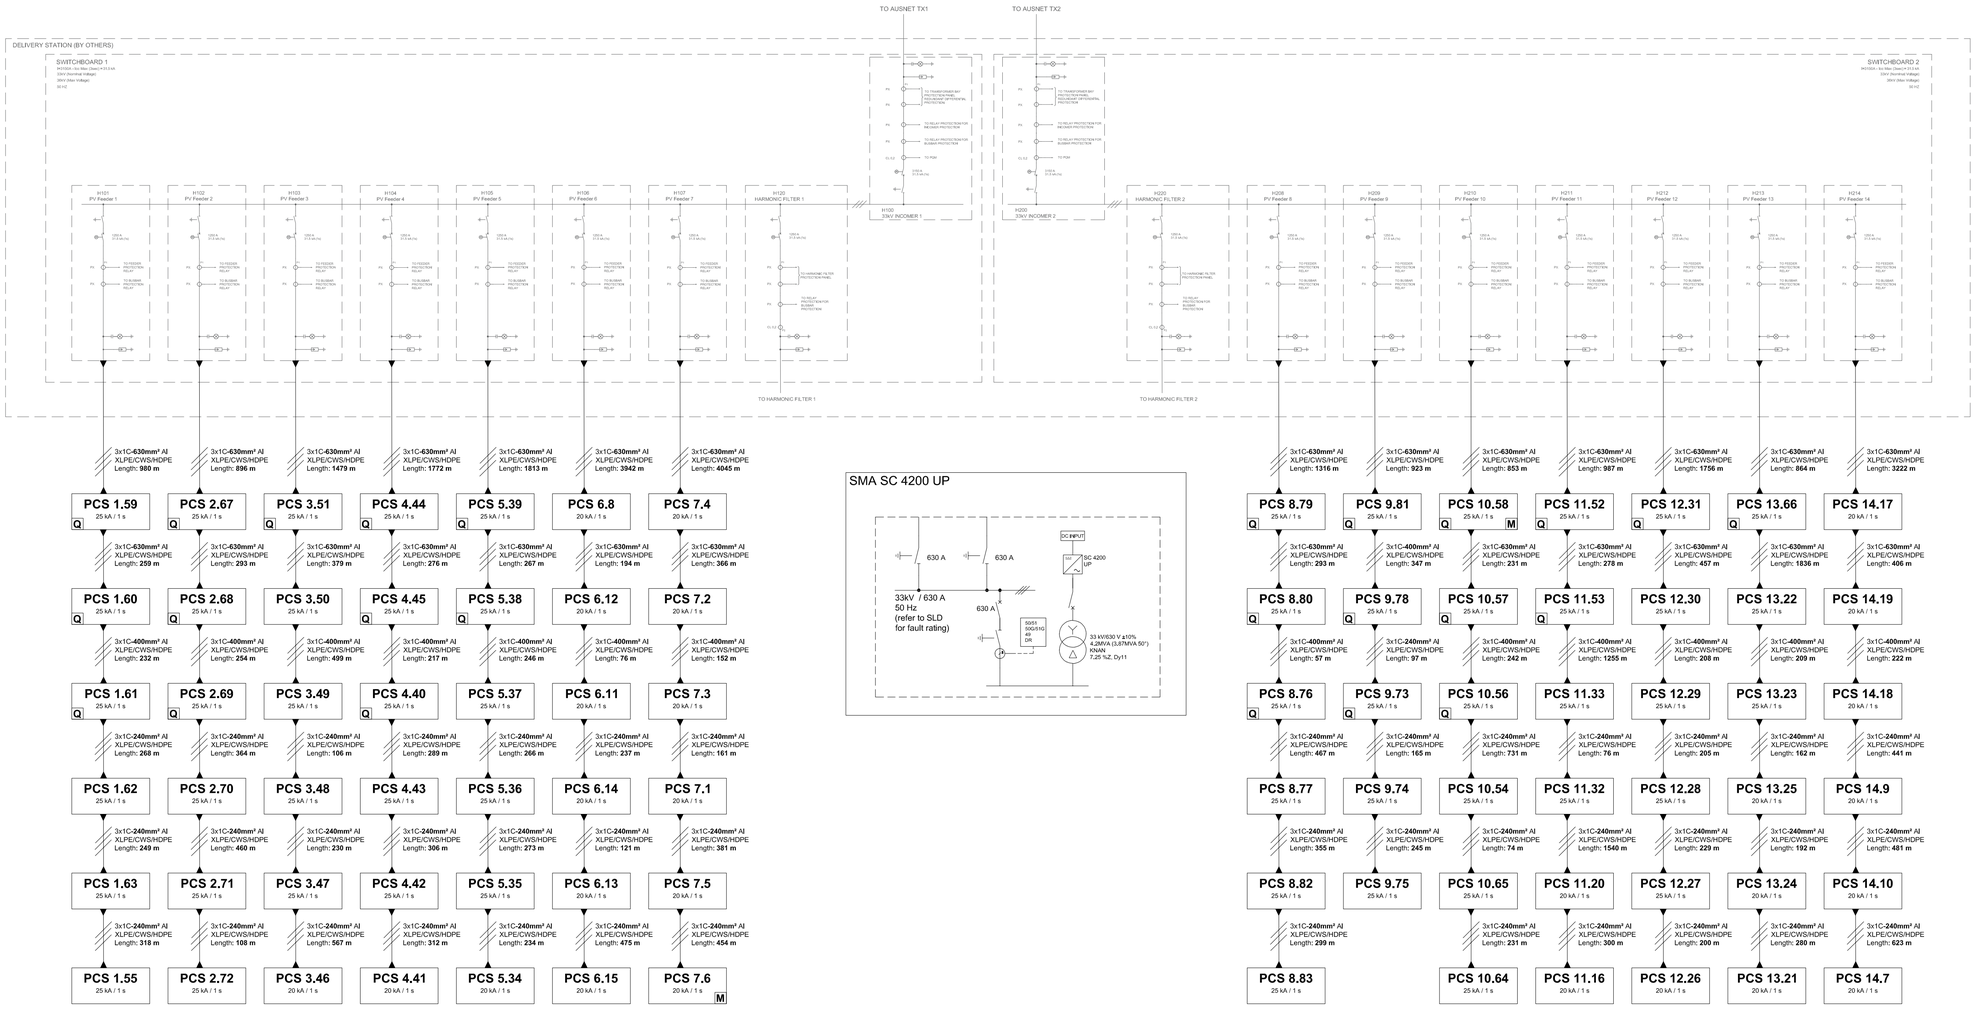

NOTES:

1. THE DESIGN IS FOR INFORMATION ONLY AND NOT FOR CONSTRUCTION.
2. THE AUSNET SUBSTATION AND DELIVERY STATION EQUIPMENT ARE BY OTHERS AND ARE SHOWN INDICATIVELY OR OMITTED.
3. ALL MV CABLE SCREENS TO BE SOLID BONDED AT BOTH ENDS.
4. PCS NAMING CONVENTION: PCS [FEEDER #].[PCS #]

LEGEND:

- CIRCUIT BREAKER
- DISCONNECTOR SWITCH
- MOTORISED CIRCUIT BREAKER
- DISCONNECTOR EARTH SWITCH
- THREE PHASE
- CABLE TERMINATION
- PCS #.## / XX kA / X s — POWER CONVERSION STATION
- PCS #.## / XX kA / 1 s / Q — POWER CONVERSION STATION WITH Q AT NIGHT
- CAPACITIVE VOLTAGE INDICATOR
- SURGE ARRESTOR
- TRANSFORMER
- INVERTER

©Mott MacDonald
This document should not be relied on or used in circumstances other than those for which it was originally prepared and for which Mott MacDonald was commissioned. Mott MacDonald accepts no responsibility for this document to any other party other than the person by whom it was commissioned.

NOT FOR CONSTRUCTION

MOTT MACDONALD

CLIENT: ENGIE

Rev	Date	Description	Ch'k'd	App'd
C	27/09/24	80% issue	RK	KC
B	13/09/24	80% issue	RK	KC
A	05/07/24	Draft 30% issue	RK	KC

SCALE

EPC CONTRACTOR: BOUYGUES CONSTRUCTION AUSTRALIA — EQUANS SOLAR & STORAGE

TITLE
GOORAMBAT EAST SOLAR FARM
MV SINGLE LINE DIAGRAM

DRAWING INFORMATION

Drawn:	P. MCGRANN	Revision:	C
Designed:	P. MCGRANN	Status:	FOR INFORMATION
Checked:	R. KUMERESHAN	Security:	STD
Approved:	K. CHENG		

DRAWING NUMBER
ENG-GESF-EL-DWG-6002

ISO A1 594mm x 841mm

FILE LOCATION: C:\users\mal106098\appdata\local\projectwise\workdir\mott-au-pw-06\dms47290\ENG-GESF-EL-DWG-6002.dwg Sep 27, 2024 - 9:31AM MAL106098