
COX

Research and Technology, Inc.

DUPLEX PUMP
CONTROL PANEL
MILLERVILLAGE
SHOPPING CENTER

Cox Research and Technology, Inc.
14697 S. Harrells Ferry Road
Baton Rouge, LA. 70816
(225) 756-3271 Fax (225) 755-1030

CP-1975

VOLTAGE	120/240V	(480V, 277/480V, 240V, 120/240V, 208V, 120/208V)
PHASE/HZ	3/60	
NO. MOTORS	2	
HP	2	
FLA	9	
TYPE OF PUMP	Submersible	(Self-Priming, Submersible)
MANUFACTURER	Barnes	
CATALOG NUMBER	SGVF2032L	

CONTROL VOLTAGE	120V	(120V, Other)
ENCLOSURE	NEMA 4X	(NEMA 1, NEMA 3R, NEMA 4, NEMA 4X)
ENCLOSURE MATERIAL	Fiberglass	(Painted Steel, Stainless Steel, Fiberglass)
CONTROL SENSOR	Floats	(Floats, Bubbler, Other)
CAPACITORS	No	(Yes, No)
CAPACITOR WIRING FIGURE	N/A	
THERM. & SEAL FAIL WIRING FIGURE		


OPTIONS:


SEAL FAIL LIGHTS	X	(Submersible Only)
SEAL FAIL RELAYS		(Submersible Only)
SEAL FAIL PUMP SHUTDOWN		(Submersible Only)
HT PUMP SHUTDOWN	X	(Self-Primer, Submersible)
ALARM HORN		
ALARM LIGHT	X	
LIGHT PANEL MTD	X	
LIGHT REMOTE MTD		
LIGHT FLASHER		
LIGHTNING ARRESTER	X	
ELAPSED TIME METER		
PHASE MONITOR	X	
NEMA RATED STARTERS		
GROUND FAULT RECPT.		
GREEN RUN LIGHTS VS. RED		
POLE, BOX, SEAL		
INTRINSICALLY SAFE RELAYS		
HIGH TEMP. LOCKOUT, MANUAL RESET		
ECONOMY VERSION		

SOLD TO: Delta Process - New Orleans, LA


TAG : Millervillage Shopping Center

SHIP TO: Delta Process - Denham Springs, LA

	Drawing Title						
	PANEL DESCRIPTION						
DATE 1/12/05		REFERENCE DRAWING S/N	NO. Sales Engineer C.C.	REVISION-LOCATION Application Engineer R.C.	DRAWN BY C. RACHAL	ECN	DATE
	Project Title	<div style="text-align: center;">  COX Research and Technology, Inc. </div>			P.O. Box 77808 Baton Rouge, LA 70809		PURCHASE ORDER NUMBER
	DUPLEX PUMP CONTROL PANEL				Ph. (225)756-3271 Fax (225)755-1030		DRAWING NUMBER CP-1975
							SHEET NUMBER 1

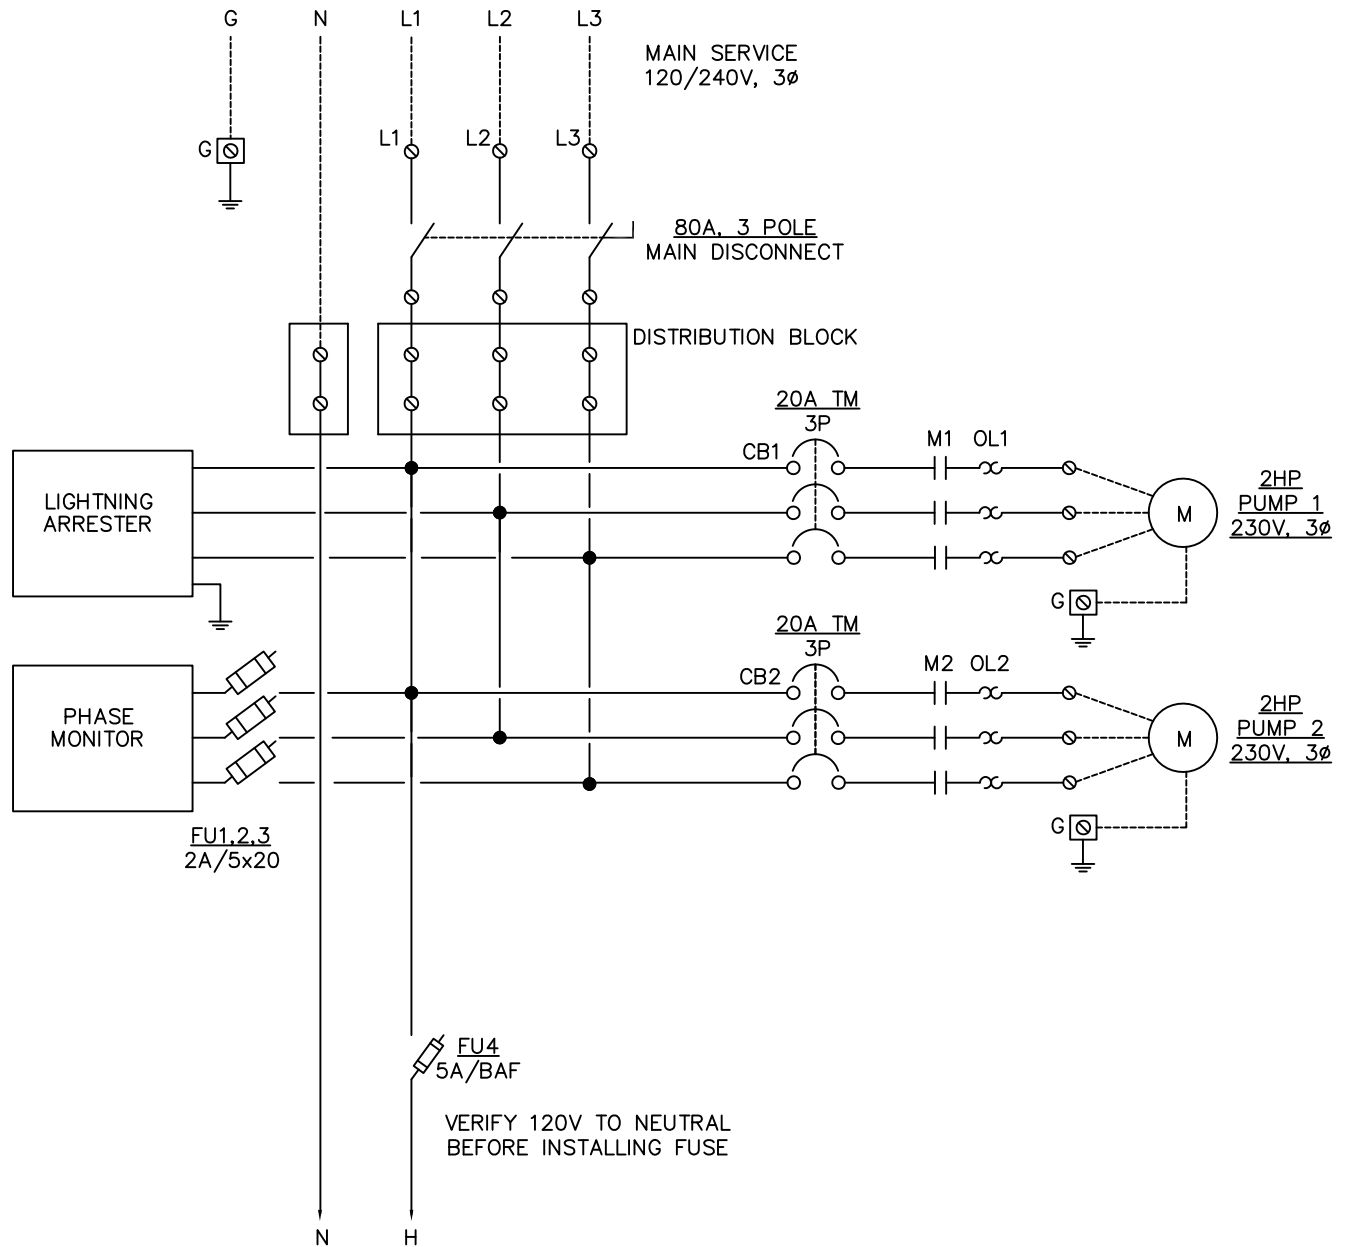

	Drawing Title							
	POWER DIAGRAM							
DATE 1/12/05		REFERENCE DRAWING	NO.	REVISION-LOCATION	ECN	DATE	BY	
		S/N	Sales Engineer C.C.	Application Engineer R.C.	BY C. RACHAL	APPROVED		
	Project Title	COX			P.O. Box 77808 Baton Rouge, LA 70809	PURCHASE ORDER NUMBER		
	DUPLEX PUMP CONTROL PANEL	Research and Technology, Inc.			Ph. (225)756-3271 Fax (225)755-1030	DRAWING NUMBER CP-1975		
						SHEET NUMBER 2		

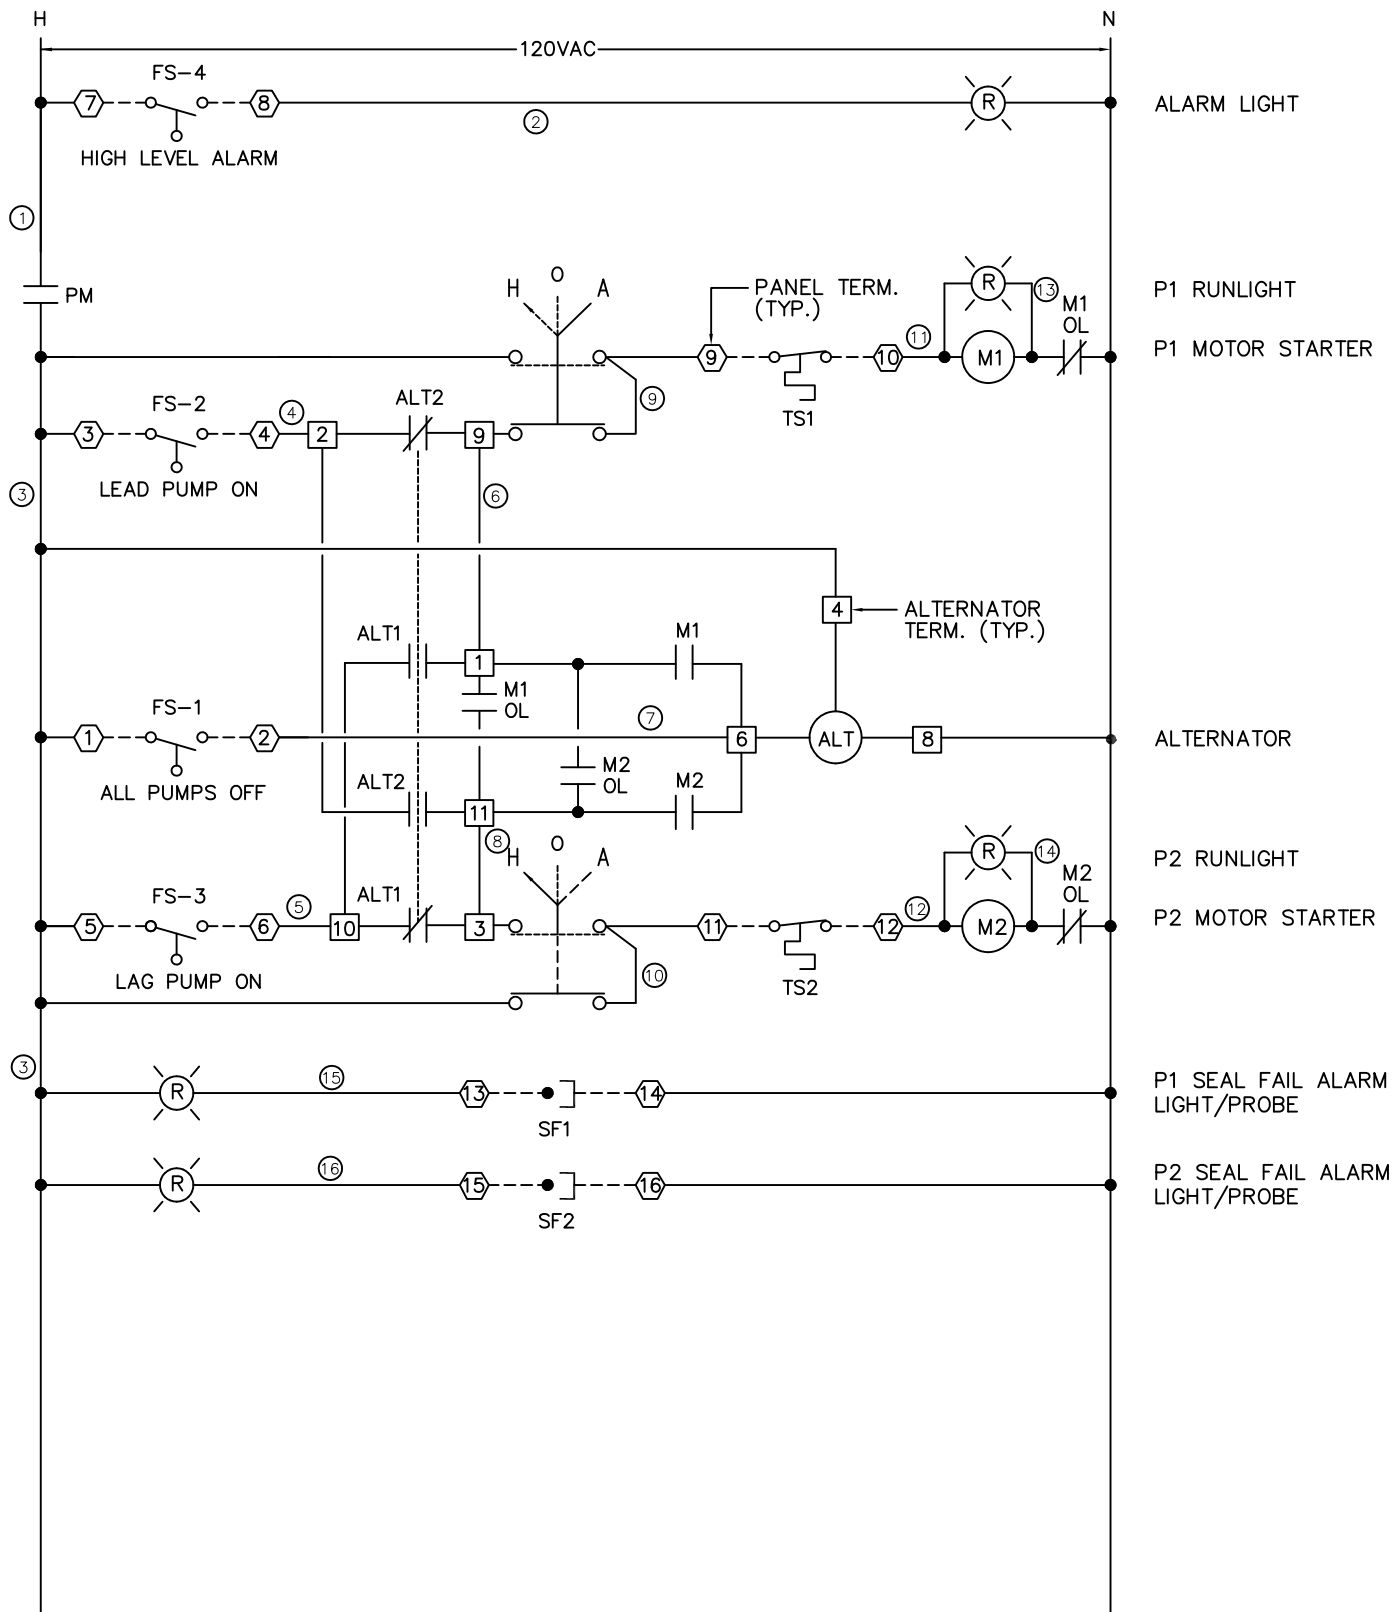


	Drawing Title								
	CONTROL DIAGRAM								
DATE	1/12/05	REFERENCE DRAWING	NO.	REVISION-LOCATION	ECN	DATE	BY		
		S/N	Sales Engineer C.C.	Application Engineer R.C.	BY C. RACHAL	APPROVED			
	Project Title					PURCHASE ORDER NUMBER			
	DUPLEX PUMP CONTROL PANEL					DRAWING NUMBER CP-1975			
						SHEET NUMBER			3

COX

Research and Technology, Inc.

P.O. Box 77808
Baton Rouge, LA
70809

Ph. (225)756-3271
Fax (225)755-1030

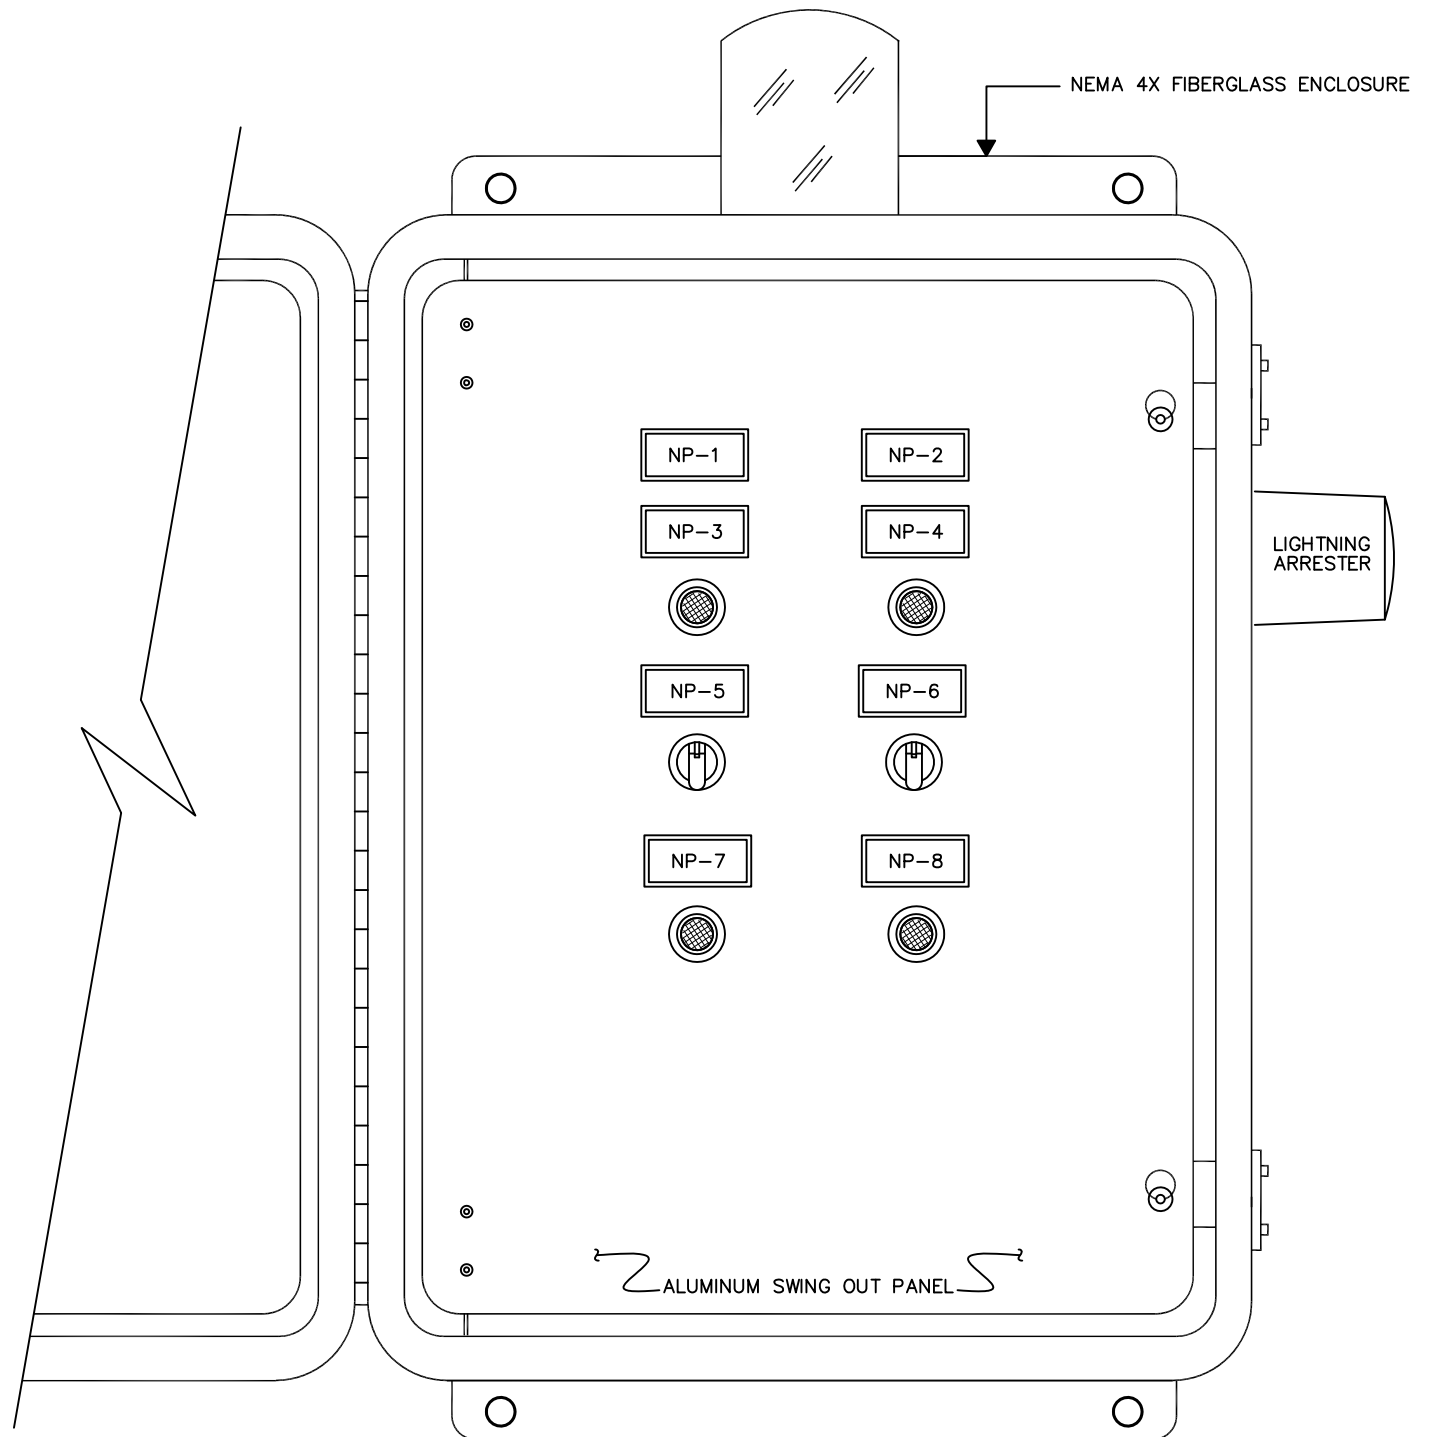

VIEW OF SWING OUT PANEL

NAMEPLATE SCHEDULE

NP-1	PUMP 1
NP-2	PUMP 2
NP-3	RUN
NP-4	RUN
NP-5	HOA
NP-6	HOA
NP-7	SEAL FAIL
NP-8	SEAL FAIL

NOTE:
SEWER GASSES WILL DESTROY COMPONENTS IN PANEL.
PROPER SEALS MUST BE INSTALLED EXTERNAL TO THE
PANEL TO PREVENT ENTRY OF GASSES.

	Drawing Title ENCLOSURE									
DATE 1/12/05			REFERENCE DRAWING		NO.	REVISION-LOCATION		ECN	DATE	BY
			S/N	Sales Engineer	Application Engineer	DRAWN		APPROVED		
				C.C.	R.C.	BY C. RACHAL		BY	DATE	
	Project Title DUPLEX PUMP CONTROL PANEL		<div>COX</div> <div>Research and Technology, Inc.</div>			P.O. Box 77808 Baton Rouge, LA 70809 Ph. (225)756-3271 Fax (225)755-1030		PURCHASE ORDER NUMBER		
DRAWING NUMBER										
CP-1975										
SHEET NUMBER										
								4		

BILL OF MATERIALS

ITEM	QTY	MANUFACTURER	PART NO.	DESCRIPTION
1	1	STAHLIN	RJ1816HPLDF	ENCLOSURE
1a	1	STAHLIN	BP1816AL	BACKPLATE
2	1	ABB	OT63E3	MAIN DISC. SWITCH
3	2	ABB	A16-30-10-84	MOTOR STARTER
4	2	ABB	TA25DU11	O.L. RELAY (7.5-11A)
5	2	SQUARE D	QOU320	CB1, CB2
6	1	TIMEMARK	261DT120	ALTERNATING RELAY
7	4	ACI	JR22FR	RED PILOT LIGHT
8	2	ACI	JR22P3M20B	HOA SWITCH
9	1	AC/DC	BL5-R-120	ALARM LIGHT
10	1	MARATHON	1323580	DISTRIBUTION BLOCK
11	1	MARATHON	1321580	NEUTRAL BLOCK
12	1	SSAC	PLMU11	PHASE MONITOR
13	1	DELTA	LA603	LIGHTNING ARRESTER
14				
15				
16				
17				
18				
19				
20				
21				
22				
23				
24				
25				

	Drawing Title							
	<h2 style="margin: 0;">BILL OF MATERIALS</h2>							
DATE 1/12/05		REFERENCE DRAWING S/N	NO. Sales Engineer C.C.	REVISION-LOCATION Application Engineer R.C.	DRAWN BY C. RACHAL	ECN	DATE	BY
		<div style="border: 1px solid black; padding: 5px; margin: 0 auto; width: 100px;"> <h1 style="margin: 0;">COX</h1> <p style="margin: 0; font-size: small;">Research and Technology, Inc.</p> </div>		<p style="margin: 0; font-size: x-small;">P.O. Box 77808 Baton Rouge, LA 70809</p> <p style="margin: 0; font-size: x-small;">Ph. (225)756-3271 Fax (225)755-1030</p>		<p style="margin: 0; font-size: x-small;">PURCHASE ORDER NUMBER</p> <hr/> <p style="margin: 0; font-size: x-small;">DRAWING NUMBER CP-1975</p> <hr/> <p style="margin: 0; font-size: x-small;">SHEET NUMBER</p>		
	Project Title	<h2 style="margin: 0;">DUPLEX PUMP CONTROL PANEL</h2>			<p style="margin: 0; font-size: x-small;">5</p>			